


# CONSTRUCTION PLANS FOR MARKUM RANCH ROAD WIDENING

TARRANT COUNTY, TEXAS  
MAY 2023

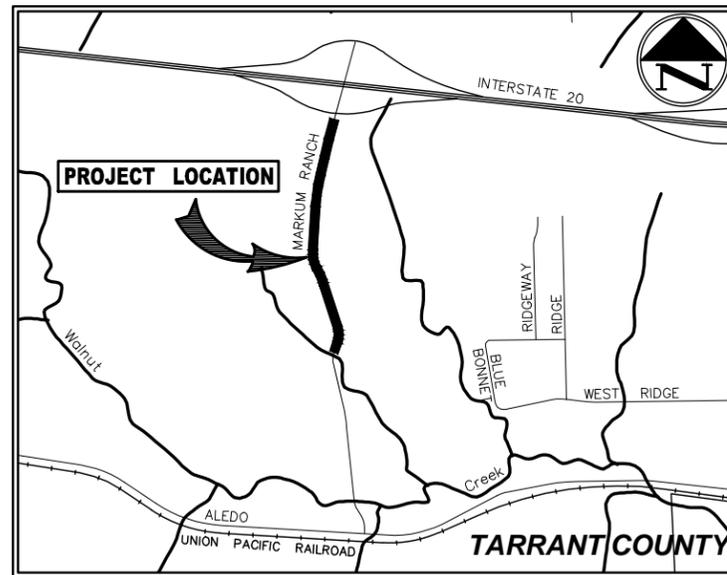

**VICINITY MAP**  
(NOT TO SCALE)

SHEET INDEX	
SHEET	DESCRIPTION
1	COVER SHEET
2	ESTIMATED QUANTITIES
3	GENERAL NOTES
4	TYPICAL SECTIONS
5-11	PAVING PLAN & PROFILE
12-23	PAVING CROSS SECTIONS
24	DRAINAGE AREA MAP
25-28	STORM PLAN & PROFILE
29-31	PAVEMENT STRIPING PLAN
32-34	EROSION CONTROL PLAN
35-41	PAVING DETAILS
42-55	STORM DETAILS
56-57	PAVEMENT STRIPING DETAILS
58-59	EROSION CONTROL DETAILS
60-77	TRAFFIC CONTROL DETAILS

OWNER



PREPARED BY



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

C:\TJ\B\05/02/2023 - 11:29AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\ 2018\5460-22.506\_QTY.DWG

BID ITEM #	BID ITEM	SPEC	UNITS	PAVING							STORM				STRIPING			TOTAL
				5	6	7	8	9	10	11	25	26	27	28	29	30	31	
1	Mobilization	TxDOT 500	LS	1	0	0	0	0	0	0	0	0	0	0	0	0	0	1
2	Barricades, Signs & Traffic Control	TMUTCD	LS	1	0	0	0	0	0	0	0	0	0	0	0	0	0	1
3	Prepare Right of Way	TxDOT 100	STA	3	4	4	4	4	2	2	0	0	0	0	0	0	23	
4	Irrigation Allowance	NCTCOG 502.1	LS	1	0	0	0	0	0	0	0	0	0	0	0	0	1	
5	Temporary Erosion, Sedimentation and Storm Water Pollution Prevention Plan(SV	TxDOT 506	LS	1	0	0	0	0	0	0	0	0	0	0	0	0	1	
6	Project Sign	NCTCOG 107.21	EA	1	0	0	0	1	0	0	0	0	0	0	0	0	2	
7	Unclassified Roadway Excavation	TxDOT 110	CY	2,200	0	0	0	0	0	0	0	0	0	0	0	0	2,200	
8	Embankment	TxDOT 132	CY	1,000	0	0	0	0	0	0	0	0	0	0	0	0	1,000	
9	8" Reinforced Concrete Pavement (4,500 psi)	TxDOT 360	SY	1,009	1,734	2,330	1,734	2,149	0	0	0	0	0	0	0	0	8,956	
10	8" Flexible Base Shoulder (Crushed Stone)	TxDOT 247	SY	186	427	330	237	490	0	0	0	0	0	0	0	0	1,670	
11	Lime Material for Treated Subgrade	TxDOT 260	TON	22.2	38.3	51.2	38.3	47.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	197.2	
12	8" Lime Treated Subgrade (42 LB/SY)	TxDOT 260	SY	1,054	1,822	2,437	1,822	2,246	0	0	0	0	0	0	0	0	9,381	
13	4" Concrete Median	TxDOT 536	SY	0	0	0	0	183	0	0	0	0	0	0	0	0	183	
14	Asphalt Transition - 2" Type "D" on 4" Type "B" (2" Lifts Max)	TxDOT 341	SY	577	0	0	0	0	0	0	0	0	0	0	0	0	577	
15	8" Concrete Driveway Approaches	TxDOT 530	SY	0	141	400	570	203	0	0	0	0	0	0	0	0	1,314	
16	6" Integral Concrete Curb	TxDOT 529	LF	0	0	0	0	380	0	0	0	0	0	0	0	0	380	
17	4" Thick Topsoil	TxDOT 160	SY	547	577	754	495	560	0	0	0	0	0	0	0	0	2,933	
18	Hydromulch Seeding	TxDOT 164	SY	547	577	754	495	560	0	0	0	0	0	0	0	0	2,933	
19	Pavement Header (includes sawcut)	NCTCOG 305.4	LF	0	0	0	0	122	27	36	0	0	0	0	0	0	185	
20	Metal Beam Guard Fence	TxDOT 540	LF	0	0	81	0	0	0	0	0	0	0	0	0	0	81	
21	Remove 24" RCP	TxDOT 496	LF	0	0	0	0	0	0	0	0	34	65	0	0	0	99	
22	Remove Storm Manhole	TxDOT 496	EA	0	0	0	0	0	0	0	0	0	1	0	0	0	1	
23	Remove SET	TxDOT 496	EA	0	0	0	0	0	0	0	1	0	0	0	0	0	1	
24	Remove Concrete Headwall with Wings	TxDOT 496	EA	0	0	0	0	0	0	0	0	0	2	0	0	0	2	
25	Remove Large Rock Riprap	TxDOT 100	SY	0	0	0	0	0	0	0	0	183	0	0	0	0	183	
26	10' Curb Inlet	TxDOT 465	EA	0	0	0	0	0	0	0	1	0	0	0	0	0	1	
27	30" RCP, Class III	TxDOT 464	LF	0	0	0	0	0	0	0	11	0	0	0	0	0	11	
28	24" RCP, Class III	TxDOT 464	LF	0	0	0	0	0	0	0	0	0	73	0	0	0	73	
29	18" RCP, Class III	TxDOT 464	LF	0	0	0	0	0	0	0	0	30	0	0	0	0	30	
30	5'x3' RCBC	TxDOT 462	LF	0	0	0	0	0	0	0	0	0	134	0	0	0	134	
31	30" SET (6:1) Type II (PSET-SC)	TxDOT 467	EA	0	0	0	0	0	0	0	1	0	0	0	0	0	1	
32	24" SET (6:1) Type II (PSET-SP)	TxDOT 467	EA	0	0	0	0	0	0	0	0	1	0	0	0	0	1	
33	5'x3' Type I SET B-CD	TxDOT 467	EA	0	0	0	0	0	0	0	0	2	0	0	0	0	2	
34	Concrete Headwall with Parallel Wings	TxDOT 466	EA	0	0	0	0	0	0	0	1	0	0	0	0	0	1	
35	Concrete Headwall with Flared Wings	TxDOT 466	EA	0	0	0	0	0	0	0	0	1	0	0	0	0	1	
36	Concrete Flume	TxDOT 420	SY	0	0	0	0	0	0	0	0	10	0	0	0	0	10	
37	18" Rock Riprap (36" thick)	TxDOT 432	CY	0	0	0	0	0	0	0	0	171	107	0	0	0	278	
38	Temporary Asphalt Paving Repair	TxDOT 351	LF	0	0	0	0	0	0	0	30	24	60	0	0	0	114	
39	Trench Safety	TxDOT 402	LF	0	0	0	0	0	0	0	0	41	67	73	0	0	181	



THE SEAL APPEARING ON THIS DOCUMENT WAS  
 AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON  
 05/02/2023. ALTERATION OF A SEALED DOCUMENT  
 WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE  
 ENGINEER IS AN OFFENSE UNDER THE TEXAS  
 ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817.412.7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001

**ESTIMATED QUANTITIES**  
**MARKUM RANCH ROAD WIDENING**  
**TARRANT COUNTY, TEXAS**

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	2

MARKUM RANCH ROAD WIDENING

**GENERAL NOTES**

THE CONTRACTOR SHALL FURNISH AND INSTALL ALL MATERIALS REQUIRED AND FURNISH ALL LABOR AND EQUIPMENT NECESSARY FOR A COMPLETE AND FINISHED PROJECT READY FOR USE AND OPERATION BY THE COUNTY.

1. PRIOR TO ANY CONSTRUCTION THE CONTRACTOR SHALL FAMILIARIZE THEMSELVES WITH THE CONTRACT DOCUMENTS AND SPECIFICATIONS, THE PLANS INCLUDING ALL NOTES, AND ANY OTHER APPLICABLE STANDARDS AND SPECIFICATIONS RELEVANT TO THE PROPER COMPLETION OF THE WORK SPECIFIED. FAILURE ON THE PART OF THE CONTRACTOR TO FAMILIARIZE THEMSELVES WITH ALL STANDARDS AND SPECIFICATION PERTAINING TO THE PROJECT IN NO WAY RELIEVES THEM FROM THE RESPONSIBILITY OF PERFORMING THE WORK IN ACCORDANCE WITH ALL SUCH APPLICABLE STANDARDS AND SPECIFICATIONS.
2. CONTRACTOR SHALL HAVE IN THEIR POSSESSION, PRIOR TO CONSTRUCTION, ALL OF THE NECESSARY PERMITS, LICENSES, EASEMENTS, RIGHT-OF-ENTRIES, ETC... CONTRACTOR SHALL HAVE AT LEAST ONE SET OF APPROVED ENGINEERING PLANS AND SPECIFICATIONS ON-SITE AT ALL TIMES.
3. ALL WORK SHALL CONFORM TO TARRANT COUNTY, NCTCOG AND TXDOT DETAILS AND SPECIFICATIONS AS NECESSARY.
4. IN THE EVENT AN ITEM IS NOT COVERED IN THE ABOVE LISTED SPECIFICATIONS, THE CONTRACTOR SHALL NOTIFY THE OWNER AND ENGINEER. THE ENGINEER SHALL HAVE THE FINAL DECISION ON ALL CONSTRUCTION MATERIALS, METHODS AND PROCEDURES.
5. CONSTRUCTION INSPECTIONS WILL BE PERFORMED BY A REPRESENTATIVE OF THE OWNER, ENGINEER, GEOTECHNICAL ENGINEER, AND REVIEWING AUTHORITIES AND AGENCIES. UNRESTRICTED ACCESS SHALL BE PROVIDED TO THEM AT ALL TIMES. CONTRACTOR IS RESPONSIBLE FOR UNDERSTANDING AND SCHEDULING REQUIRED INSPECTIONS.
6. ALL CONTRACTORS MUST CONFINE THEIR ACTIVITIES TO THE WORK AREA. NO ENCROACHMENTS ONTO DEVELOPED OR IN DEVELOPED AREAS WILL BE ALLOWED, UNLESS SPECIFICALLY NOTED ON PLANS. ANY DAMAGE RESULTING THERE FROM SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR.
7. IT WILL BE THE RESPONSIBILITY OF EACH CONTRACTOR TO PROTECT ALL EXISTING PUBLIC AND PRIVATE UTILITIES THROUGHOUT THE CONSTRUCTION AREA. CONTRACTORS SHALL BE RESPONSIBLE FOR FIELD LOCATING EXISTING UTILITIES AND IMPROVEMENTS PRIOR TO CONSTRUCTION. CONTRACTOR SHALL CONTACT THE APPROPRIATE UTILITY COMPANIES FOR LINE LOCATIONS PRIOR TO COMMENCEMENT OF ANY CONSTRUCTION ACTIVITY AND SHALL ASSUME FULL LIABILITY TO THOSE COMPANIES FOR ANY DAMAGES CAUSED TO THEIR FACILITY.
8. ALL IMPROVEMENTS NOT SCHEDULED FOR REPLACEMENT DURING CONSTRUCTION WHICH ARE DAMAGED OR DESTROYED BY THE CONTRACTOR SHALL BE RESTORED TO EQUAL OR BETTER CONDITION BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE COUNTY OR THE AFFECTED PROPERTY OWNER.
9. ALL EXCAVATIONS, TRENCHING AND SHORING OPERATIONS SHALL COMPLY WITH THE REQUIREMENTS OF THE US DEPARTMENT OF LABOR, OSHA, "CONSTRUCTION SAFETY AND HEALTH REGULATIONS," VOL. 29, SUPPORT P, PAGE 128-137, AND ANY AMENDMENT THERETO.
10. THE CONTRACTOR SHALL RESTORE ALL AREAS DISTURBED BY CONSTRUCTION TO ORIGINAL CONDITION OR BETTER. RESTORED AREAS INCLUDE, BUT ARE NOT LIMITED TO TRENCH BACKFILL, SIDE SLOPES, FENCES, CULVERT PIPES, DRAINAGE DITCHES, DRIVEWAYS, PRIVATE YARDS, SPRINKLER SYSTEMS AND ROADWAYS.
11. ALL TESTING SHALL BE PERFORMED BY A CERTIFIED LABORATORY OF THE COUNTY'S CHOICE AND COST, THEREFORE, SHALL BE PAID BY THE COUNTY. RE-TESTING DUE TO FAILURE TO MEET SPECIFICATIONS MUST BE PAID BY THE CONTRACTOR. THE COUNTY SHALL BE RESPONSIBLE FOR NOTIFYING THE LABORATORY AND COORDINATING THE TEST SCHEDULE IN ACCORDANCE WITH THE REQUIREMENTS OUTLINED HEREIN. TEST REPORTS SHALL BE ISSUED TO THE COUNTY.

12. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING GENERAL SAFETY AT AND ADJACENT TO THE PROJECT AREA, INCLUDING THE PERSONAL SAFETY OF THE CONSTRUCTION
13. ALL ITEMS REMOVED DURING THE COURSE OF CONSTRUCTION ARE THE PROPERTY OF THE CONTRACTOR AND SHALL BE DISPOSED OF LEGALLY OFF SITE BY THE CONTRACTOR.
14. CONSTRUCTION STAKING WILL BE CONDUCTED BY THE CONTRACTOR AT NO SEPARATE PAY BUT SHALL BE CONSIDERED SUBSIDIARY TO THE BID ITEMS.
15. IF UNFORESEEN PROBLEMS OR CONFLICTS ARE ENCOUNTERED IN THE CONSTRUCTION, FOR WHICH AN IMMEDIATE SOLUTION IS NOT APPARENT, THE ENGINEER AND OWNER SHALL BE NOTIFIED IMMEDIATELY.
16. TRAFFIC CONTROL MEASURES SHALL BE INSTALLED FOR ANY WORK ACTIVITY THAT TAKES PLACE ON OR ADJACENT TO ANY PUBLIC STREET OR ROADWAY. TRAFFIC CONTROL MEASURES SHALL CONFORM TO THE TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES.
17. PROVIDE AND MAINTAIN INTERIM ACCESS FROM ROADWAYS CURRENTLY IN USE TO ALL DRIVEWAYS AND INTERSECTING ROADS.
18. MAINTAIN NORMAL PROJECT DRAINAGE UNTIL NEW DRAINAGE FACILITIES ARE FUNCTIONAL, INCLUDING WHERE NECESSARY, INTERIM REPLACEMENT OF EXISTING DRAINAGE STRUCTURES REMOVED FOR CONSTRUCTION OF NEW DRAINAGE FACILITIES.
19. MAINTAIN ALL WORK AND MATERIAL STORAGE AREAS IN ORDERLY CONTROL, FREE OF DEBRIS AND WASTE. ON COMPLETION OF THE PROJECT, CLEAN UP THE PROJECT AND ADJACENT AFFECTED AREAS TO ACCEPTABLE CONDITIONS.
20. UNLESS NOTED, ALL FILL PLACED UNDER PAVING SHALL BE COMPACTED TO 98% STANDARD PROCTOR DENSITY IN 6 INCH LIFTS. ALL OTHER FILL AREAS TO BE COMPACTED TO 95% STANDARD PROCTOR.
21. TEMPORARY EROSION CONTROL SHALL BE USED TO MINIMIZE THE SPREAD OF SILT AND MUD FROM THE PROJECT ONTO EXISTING ROADS, DRIVEWAYS, DRAINAGE WAYS AND PRIVATE PROPERTY. THE CONTRACTOR SHALL PREPARE, MAINTAIN AND BECOME THE OPERATOR OF THE STORM WATER POLLUTION PLAN NECESSARY FOR THIS PROJECT. STABILIZATION (SEEDING) OF DISTURBED AREAS MUST OBTAIN AT LEAST 75 PERCENT COVERAGE PRIOR TO ACCEPTANCE BY THE OWNER. ADDITIONAL EROSION CONTROL MEASURES MAY BE NECESSARY AND SHALL BE SUBSIDIARY TO THE PROJECT.
22. ADEQUATE MEASURES SHALL BE TAKEN TO PREVENT EROSION. IN THE EVENT THAT SIGNIFICANT EROSION OCCURS AS A RESULT OF CONSTRUCTION, THE CONTRACTOR SHALL RESTORE THE ERODED AREA TO ORIGINAL CONDITION. SILT FENCE OR ROCK BERM OR OTHER APPROPRIATE BMP'S SHALL BE PLACED AND MAINTAINED THROUGHOUT THE PROJECT BY THE CONTRACTOR.
23. THE LOCATIONS OF UTILITIES SHOWN IN THESE PLANS ARE APPROXIMATE AND HAVE BEEN TAKEN FROM PUBLIC RECORDS. UTILITIES MAY EXIST THAT ARE NOT SHOWN. IT IS THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY ALL UTILITY OWNERS PRIOR TO AND CONSTRUCTION IN THE AREA AND VERIFY THE ACTUAL LOCATION OF ALL BURIED UTILITIES IN THE WORK AREA. THE CONTRACTOR SHALL PRESERVE AND PROTECT ALL UNDERGROUND AND OVERHEAD FACILITIES AND BE RESPONSIBLE FOR ANY DAMAGE HE MAY CAUSE. THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER AT ONCE OF ANY CONFLICTS IN GRADES AND ALIGNMENTS.
24. CONTRACTOR IS CAUTIONED THAT UNDERGROUND UTILITIES SHOWN ON THESE PLANS ARE BASED ON THE BEST INFORMATION AVAILABLE. CONTRACTOR SHALL VERIFY ALL UTILITIES PRIOR TO CONSTRUCTION. CALL 1-800-DIG-TESS 48 HOURS PRIOR TO ANY CONSTRUCTION ACTIVITIES.

25. TRENCH SAFETY: THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ADEQUATE TRENCH SAFETY WHEN INSTALLING UNDERGROUND IMPROVEMENTS. THE TRENCH SAFETY SYSTEM SHALL BE DESIGNED BY THE CONTRACTOR'S TEXAS LICENSED ENGINEER.
26. ALL TREES WITHIN THE ROW AND TEMPORARY EASEMENTS SHALL BE REMOVED ONLY AS NECESSARY FOR CONSTRUCTION. ALL TREES DESIGNATED BY THE CONTRACTOR AS "TO BE REMOVED" SHALL BE FLAGGED IN THE FIELD AND THEIR REMOVAL APPROVED IN ADVANCE BY TARRANT COUNTY.
27. CERTIFIED ELEVATIONS BY A SURVEYOR SHALL BE TAKEN FOR SUBBASE, EACH COURSE OF ROADWAY AND DITCH FLOWLINE AT 100 FT STATION INTERVALS TO VERIFY ELEVATIONS. THESE SHALL BE SUBMITTED TO THE ENGINEER FOR VERIFICATION PRIOR TO BEGINNING CONSTRUCTION ON THE NEXT ROADWAY ITEM. THE SURVEY DATA SHALL BE IN A TABULAR FORM LISTING THE ROADWAY STATION, PROPOSED ELEVATION, MEASURED ELEVATION AND ELEVATION DIFFERENCE. THE MAXIMUM ALLOWABLE TOLERANCE FOR FINAL GRADE OF ALL PLAN ITEMS SHALL BE 0.1 FT FOR PAVEMENT FINISHED GRADE AND 0.2 FT FOR DITCH AND CULVERT FLOWLINES.
28. CONTRACTOR SHALL HAVE A SUPERINTENDENT OR FOREMAN ON THE PROJECT SITE AT ALL TIMES WHILE CONSTRUCTION IS ONGOING. SUPERINTENDENT OR FOREMAN SHALL SPEAK FLUENT ENGLISH.
29. ANY ITEM THAT IS CALLED OUT FOR ON THE PLANS, BUT NOT GIVEN A SPECIFIC BID ITEM TO BE PAID FOR SHALL BE CONSIDERED SUBSIDIARY TO THE PROJECT, AND NO SEPARATE PAY SHALL BE GIVEN.
30. ALL SIGNAGE SHALL BE CAREFULLY REMOVED AND STORED DURING CONSTRUCTION ACTIVITIES AND SHALL BE REINSTALLED AT THE DIRECTION OF THE COUNTY.
31. DURING CONSTRUCTION, THE CONTRACTOR SHALL KEEP THE UPSTREAM WATER LEVEL AT OR ABOVE THE UPSTREAM FLOWLINE OF THE PROPOSED CULVERT.
32. THE CONTRACTOR SHALL BE RESPONSIBLE FOR UTILIZING THE EXISTING, PROPOSED OR TEMPORARY FENCING AROUND THE SITE OF THE WORK AS REQUIRED TO CONTROL THE ADJACENT PROPERTY OWNER'S LIVESTOCK. NO SEPARATE PAYMENT WILL BE PROVIDED FOR TEMPORARY FENCING.
33. ALL TEMPORARY FENCE ALONG PROPOSED EASEMENTS, PROPOSED ROW, OR OTHER WORK SHALL BE CONSTRUCTED AND IN PLACE PRIOR TO REMOVAL OF EXISTING FENCES AND REMOVED AFTER APPROVAL OF PROPOSED FENCES. PAYMENT OF TEMPORARY FENCING IS CONSIDERED SUBSIDIARY TO THE VARIOUS BID ITEMS OF THE PROJECT.
34. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING/RELOCATING EXISTING IRRIGATION LINES, SPRINKLER HEADS, CONTROL BOXES AND OTHER IRRIGATION APPURTENANCES. ALL MATERIAL AND CONSTRUCTION SHALL BE EQUAL TO EXISTING IRRIGATION.
35. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SWPPP MEASURES AND IMPLEMENTING THE SWPPP FOR THE PROJECT IN ACCORDANCE WITH TXDOT SPECIFICATION 506.



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company

4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**GENERAL NOTES**


**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS


DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	3

C:\TURNER\05/02/2023 - 11:29AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\CSO\_2018\5460-22.506\_CV.DWG


MARKUM RANCH ROAD WIDENING

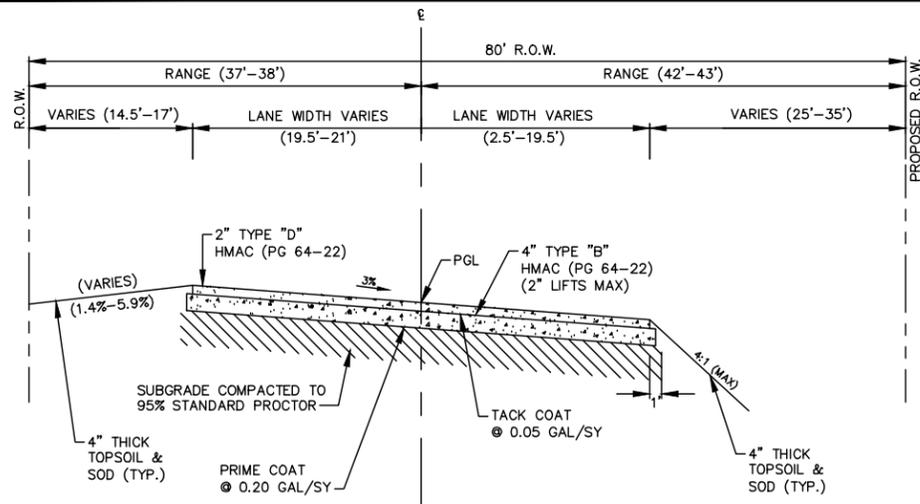


ASPHALT TRANSITION  
NOT TO SCALE  
STA 1+00 - STA 2+66.21

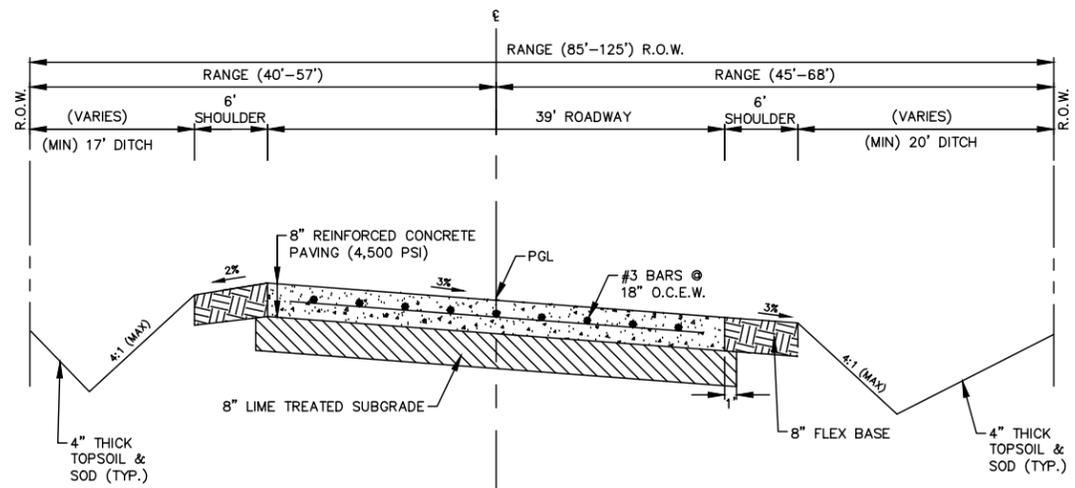


6' & 6' SHOULDER FOR 39' ROADWAY  
NOT TO SCALE  
STA 2+66.21 - STA 15+19.57

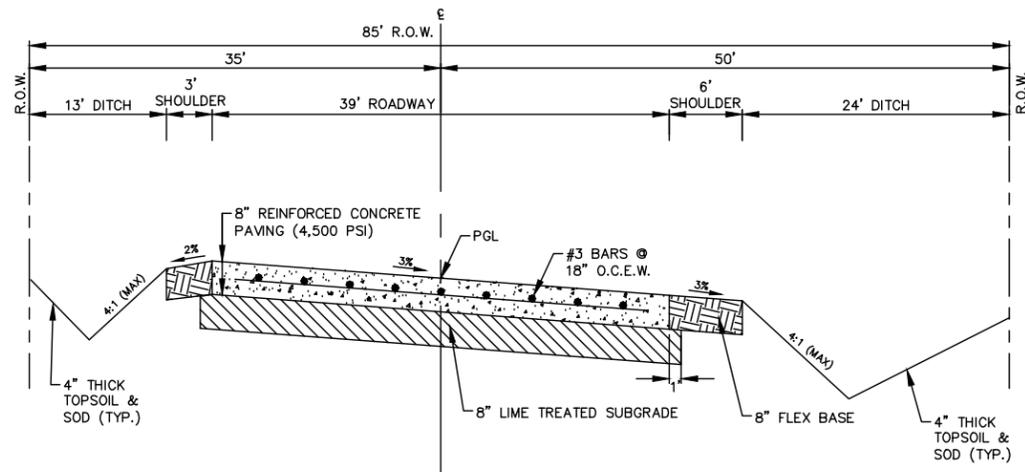

3' & 6' SHOULDER FOR 39' ROADWAY  
NOT TO SCALE  
STA 15+19.57 - STA 17+14.48

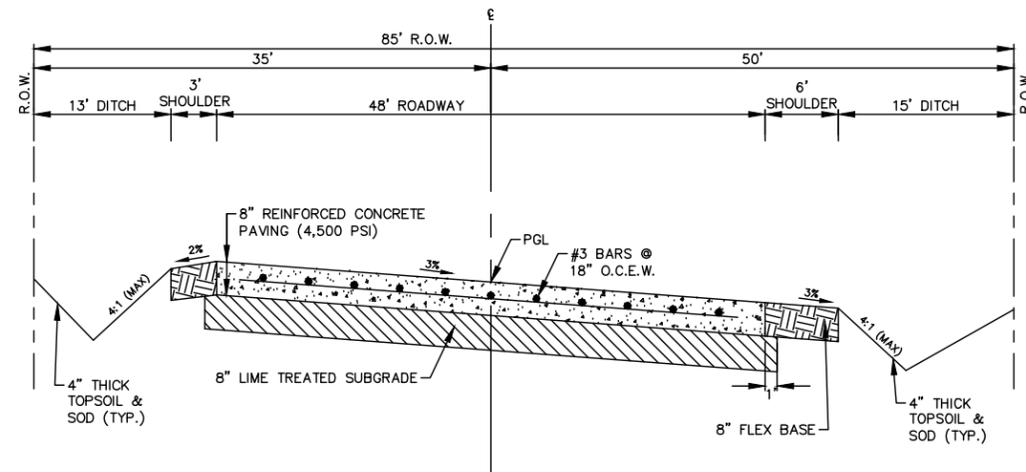

3' & 6' SHOULDER FOR 48' ROADWAY  
NOT TO SCALE  
STA 17+72.44 - STA 18+19.48

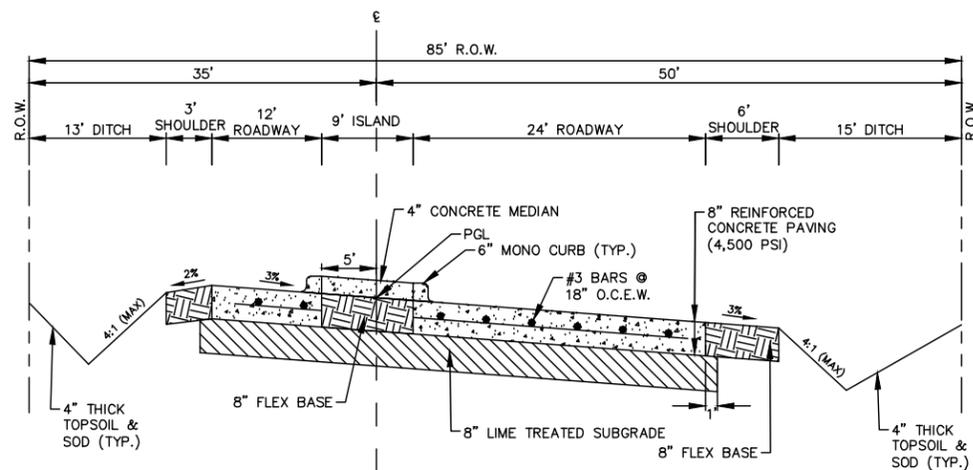

9' ISLAND ON 48' ROADWAY  
NOT TO SCALE  
STA 18+19.48 - STA 20+04.22



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

TYPICAL SECTIONS

MARKUM RANCH ROAD WIDENING



TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	4

CKT:JMR  
 05/02/2023 11:29AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\ 2018\5460-22.506\_TS.DWG


MARKUM RANCH ROAD WIDENING

CKT:TURNER  
 09/08/2023 - 9:26AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_PA.DWG

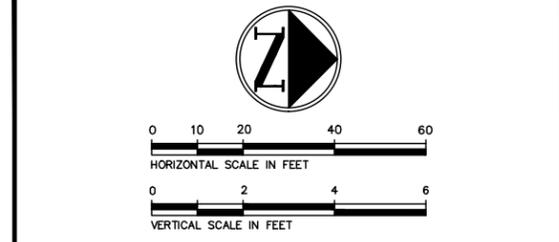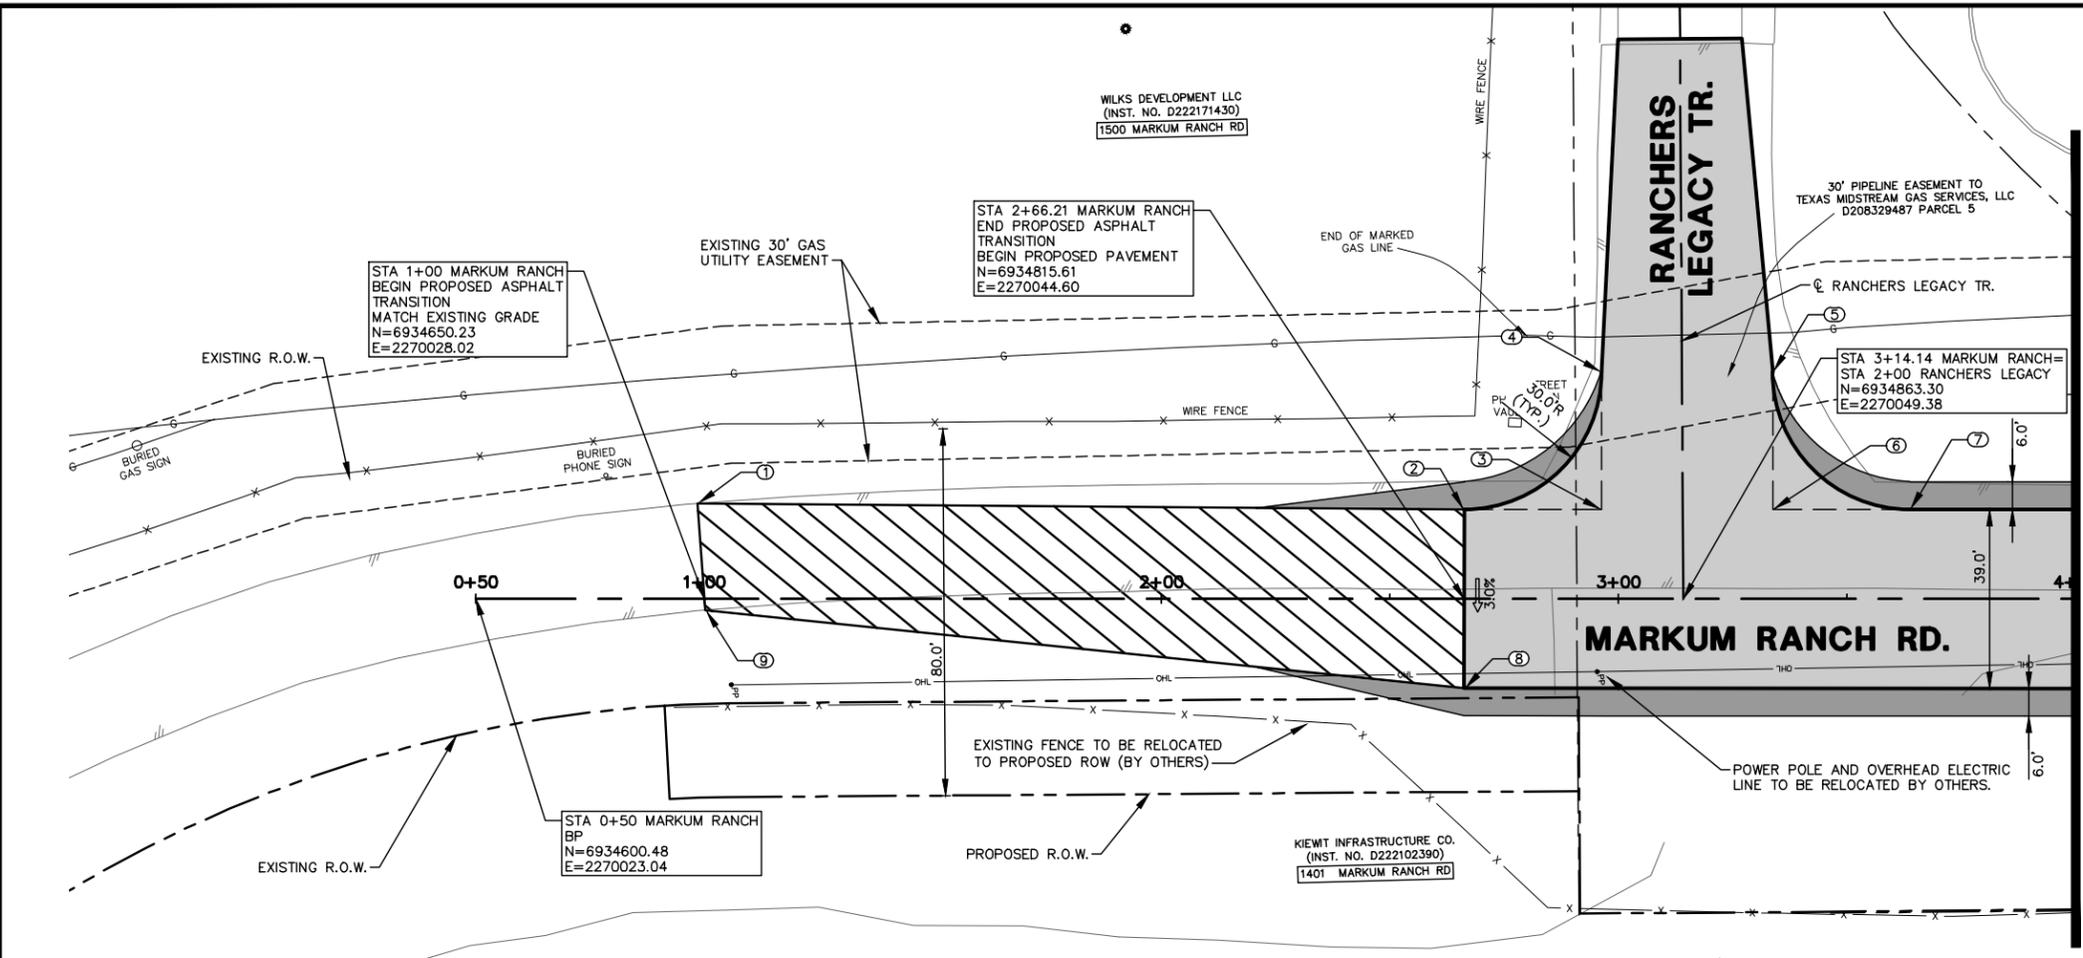


**LEGEND**

<ul style="list-style-type: none"> <li>◆ FIRE HYDRANT</li> <li>● WATER METER</li> <li>⊙ WATER VALVE</li> <li>⊙ WATER MANHOLE</li> <li>⊙ SPRINKLER HEAD</li> <li>⊙ SPRINKLER CONTROL BOX</li> <li>⊙ HOSE BIB</li> <li>⊙ STORM DRAIN MANHOLE</li> <li>⊙ SANITARY SEWER MANHOLE</li> <li>⊙ SANITARY SEWER CLEANOUT</li> <li>⊙ POWER POLE</li> <li>⊙ POWER POLE ANCHOR</li> <li>⊙ LIGHT POLE</li> <li>⊙ GROUND LIGHT</li> <li>⊙ ELECTRIC MANHOLE</li> <li>⊙ UNDERGROUND ELECTRIC MARKER</li> <li>⊙ ELECTRIC RISER</li> </ul>	<ul style="list-style-type: none"> <li>FH</li> <li>WM</li> <li>WV</li> <li>WMH</li> <li>SH</li> <li>ICV</li> <li>HB</li> <li>STMH</li> <li>SSMH</li> <li>SSCO</li> <li>PP</li> <li>GUY</li> <li>LP</li> <li>FL</li> <li>EMH</li> <li>UEM</li> <li>UER</li> </ul>	<ul style="list-style-type: none"> <li>— OVERHEAD ELECTRIC</li> <li>— ELECTRIC TRANSFORMER PAD</li> <li>— TRAFFIC LIGHT POLE</li> <li>— TRAFFIC SIGNAL CONTROL BOX</li> <li>— ELECTRIC SERVICE</li> <li>— ELECTRIC METER</li> <li>— PHONE MANHOLE</li> <li>— BURIED PHONE LINE</li> <li>— PHONE RISER</li> <li>— GAS METER</li> <li>— GAS VALVE</li> <li>— UNDERGROUND GAS MARKER</li> <li>— GAS MANHOLE</li> <li>— FENCE LINE</li> <li>— ASPHALT PAVEMENT</li> <li>— TRAFFIC SIGN</li> <li>— BOLLARD POST</li> <li>— MAIL BOX</li> </ul>	<ul style="list-style-type: none"> <li>OE</li> <li>XFMR</li> <li>TLP</li> <li>TSCB</li> <li>ESRV</li> <li>EM</li> <li>PHMH</li> <li>UPM</li> <li>GM</li> <li>GV</li> <li>UGM</li> <li>DMH</li> <li>FNC</li> <li>ASPH</li> <li>SGN</li> <li>BP</li> <li>MB</li> </ul>
--	--	---	--

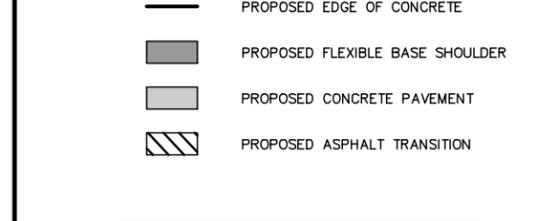

**PAVING DESIGN POINTS**

PT.	DESCR.	STATION	OFFSET	TC ELEV
1	DP	0+98.47	20.8' LT	894.06
2	DP	2+66.21	19.5' LT	894.65
3	DP	2+96.21	19.5' LT	894.64
4	DP	2+96.21	49.5' LT	895.51
5	DP	3+33.76	49.5' LT	895.36
6	DP	3+33.76	19.5' LT	894.56
7	DP	3+63.76	19.5' LT	894.42
8	DP	2+66.21	19.5' RT	893.48
9	DP	1+00.18	2.5' RT	893.50

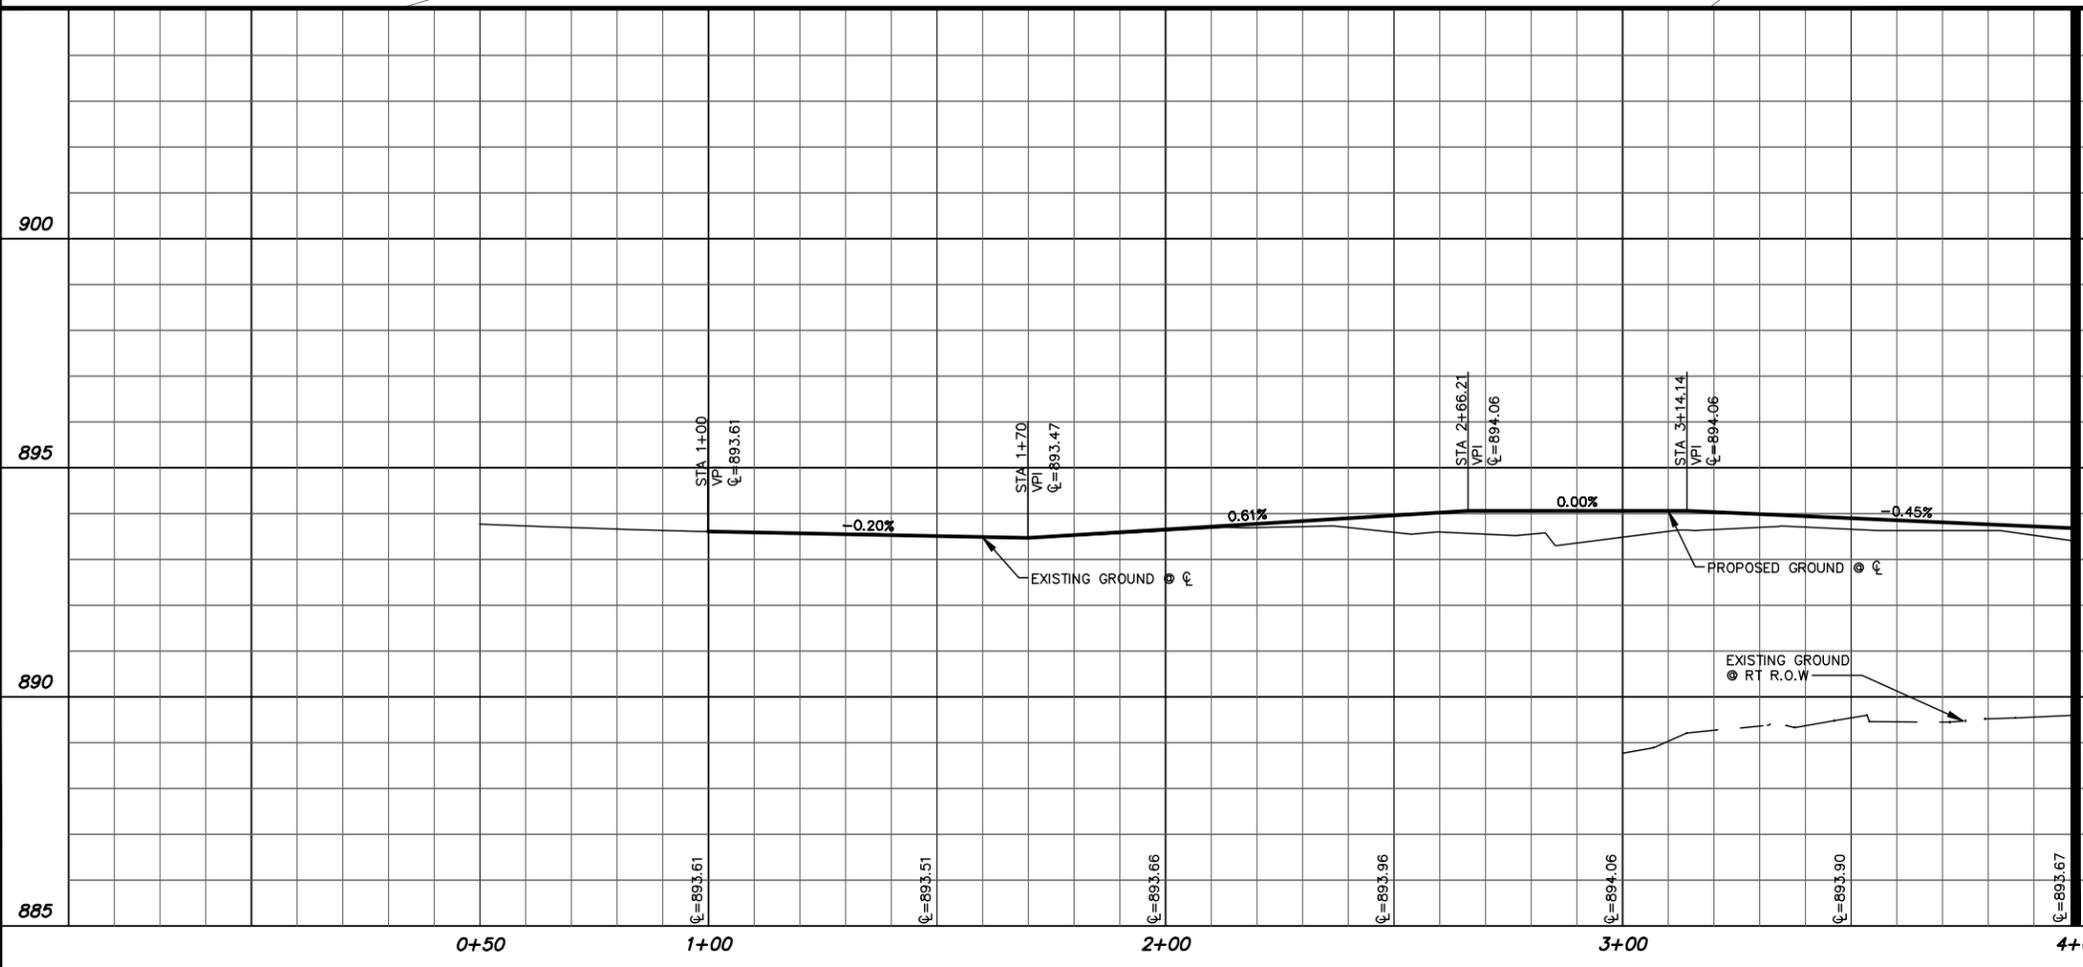

THE SEAL APPEARING ON THIS DOCUMENT WAS  
 AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON  
 08/28/2023. ALTERATION OF A SEALED DOCUMENT  
 WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE  
 ENGINEER IS AN OFFENSE UNDER THE TEXAS  
 ENGINEERING PRACTICE ACT.


NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD**  
**PAVING PLAN & PROFILE**  
**STA 0+50 TO STA 4+00**  
**MARKUM RANCH ROAD WIDENING**  
**TARRANT COUNTY, TEXAS**

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	AUGUST 2023	5460-22.506	5

MARKUM RANCH ROAD WIDENING



### LEGEND

- ◆ FIRE HYDRANT
- WATER METER
- ⊕ WATER VALVE
- ⊕ WATER MANHOLE
- ⊕ SPRINKLER HEAD
- ⊕ SPRINKLER CONTROL BOX
- ⊕ HOSE BIB
- ⊕ STORM DRAIN MANHOLE
- ⊕ SANITARY SEWER MANHOLE
- ⊕ SANITARY SEWER CLEANOUT
- ⊕ POWER POLE
- ⊕ POWER POLE ANCHOR
- ⊕ LIGHT POLE
- ⊕ GROUND LIGHT
- ⊕ ELECTRIC MANHOLE
- ⊕ UNDERGROUND ELECTRIC MARKER
- ⊕ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- ⊕ ELECTRIC SERVICE
- ⊕ ELECTRIC METER
- ⊕ FENCE LINE
- ⊕ PHONE MANHOLE
- ⊕ BURIED PHONE LINE
- ⊕ PHONE RISER
- ⊕ GAS METER
- ⊕ GAS VALVE
- ⊕ UNDERGROUND GAS MARKER
- ⊕ GAS MANHOLE
- ⊕ FENCE LINE
- ⊕ ASPHALT PAVEMENT
- ⊕ TRAFFIC SIGN
- ⊕ BOLLARD POST
- ⊕ MAIL BOX
- OE XFMR
- TLP
- TSGB
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- GV
- UGM
- DMH
- FNC
- ASPH
- SGN
- BP
- MB

- PROPOSED EDGE OF CONCRETE
- ▨ PROPOSED FLEXIBLE BASE SHOULDER
- ▨ PROPOSED CONCRETE PAVEMENT

PAVING DESIGN POINTS				
PT.	DESCR.	STATION	OFFSET	TC ELEV
1	DP	5+13.75	19.5' LT	892.77
2	DP	5+96.83	19.5' LT	890.20
3	DP	7+33.05	19.5' LT	883.44
4	DP	7+33.08	19.5' RT	882.27
5	DP	5+96.83	19.5' RT	889.03
6	DP	5+13.75	19.5' RT	891.60



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 08/28/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.



NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD PAVING PLAN & PROFILE**  
STA 4+00 TO STA 8+00


**MARKUM RANCH ROAD WIDENING**  
TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	AUGUST 2023	5460-22.506	6

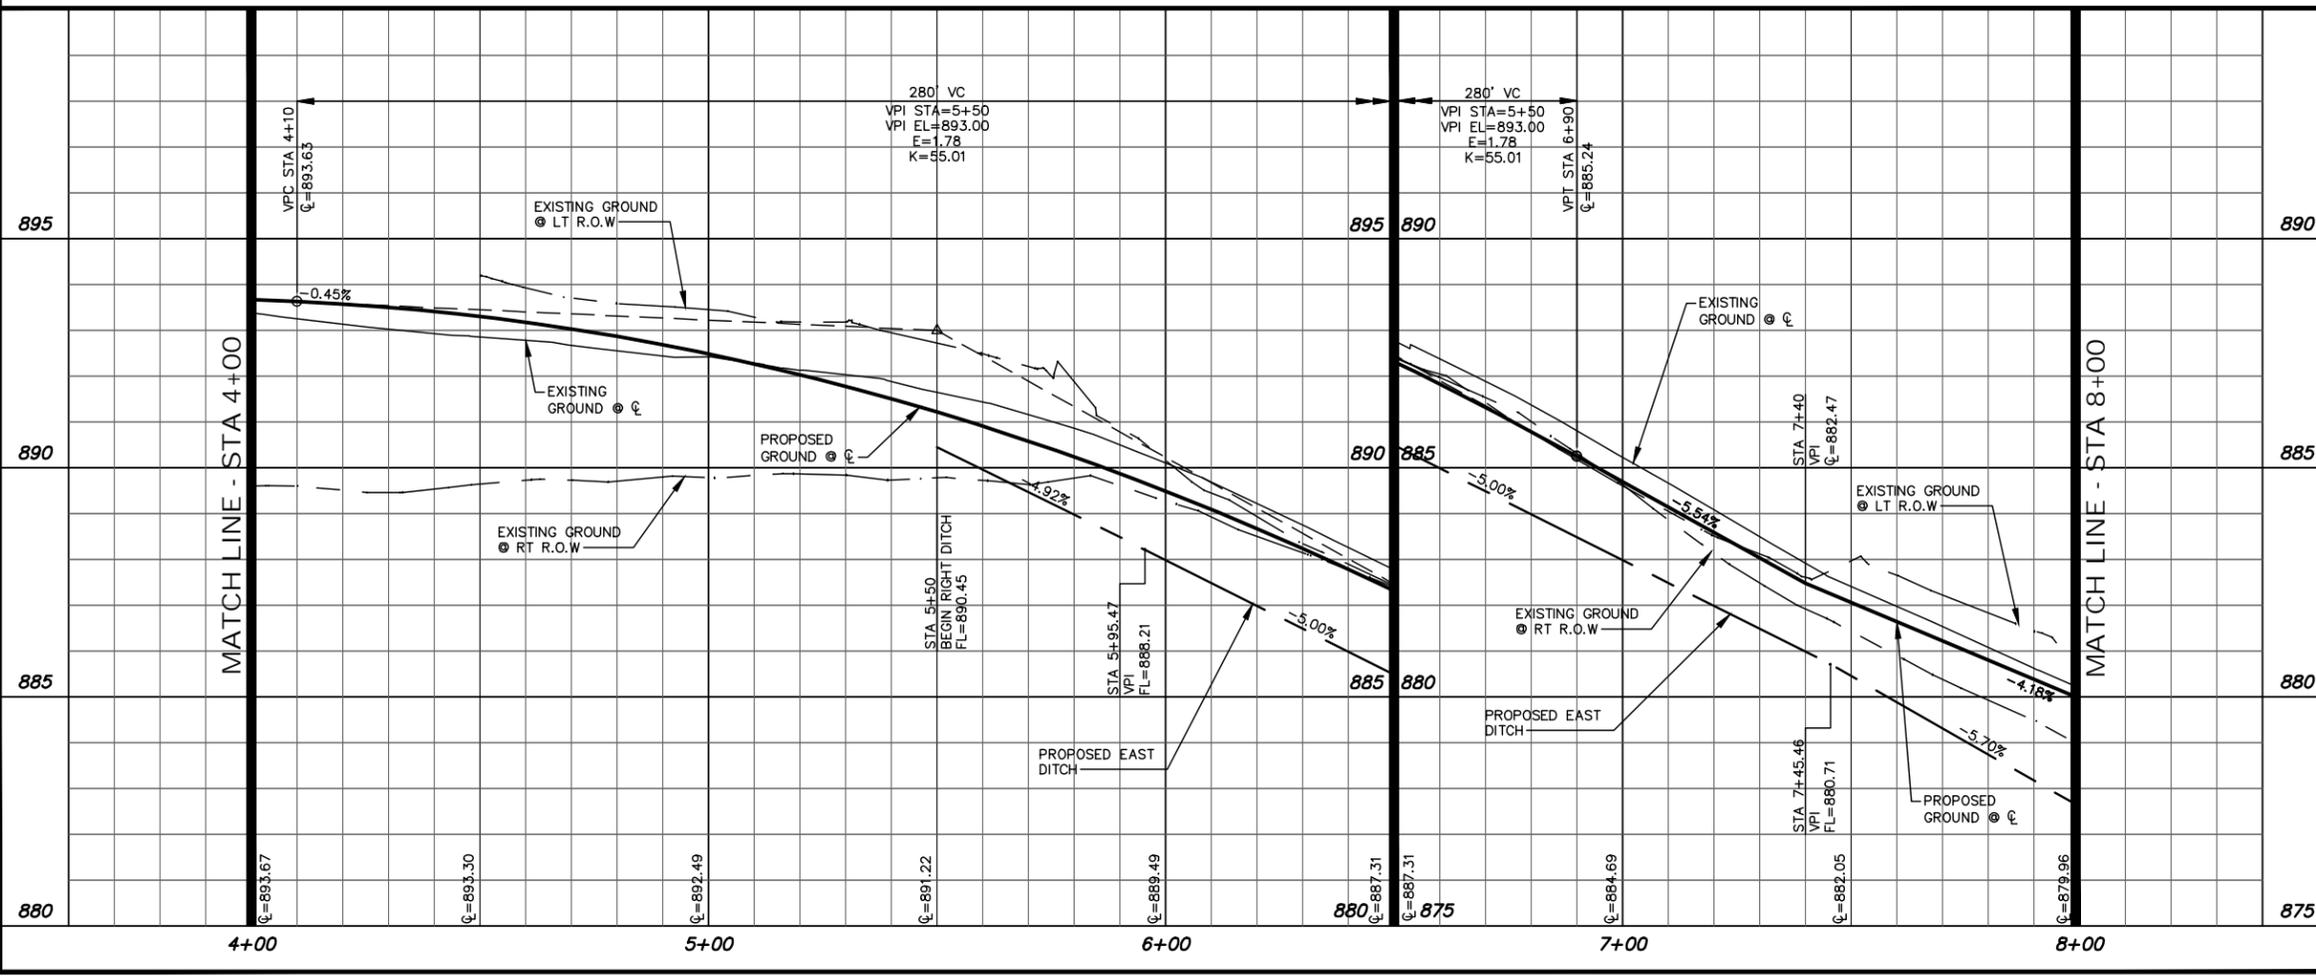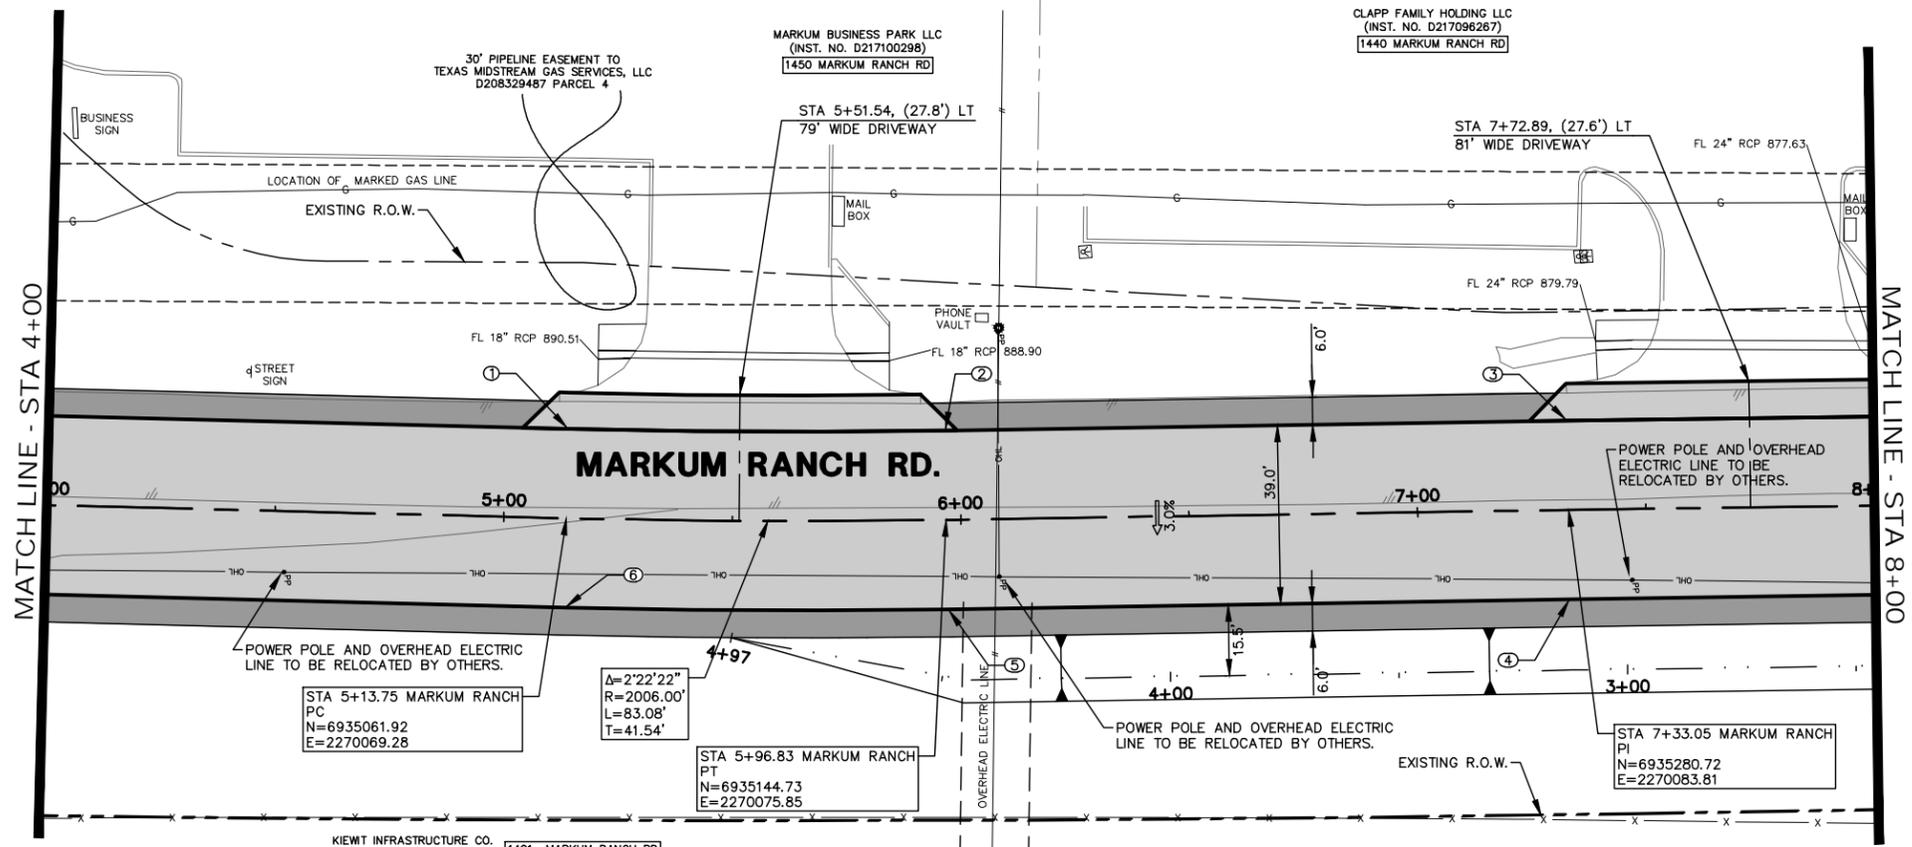

CKT/TURNER  
 08/28/2023 - 4:23PM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_PA.DWG

MARKUM RANCH ROAD WIDENING



### LEGEND

- ◆ FIRE HYDRANT
- WATER METER
- WATER VALVE
- ⊙ WATER MANHOLE
- ⊕ SPRINKLER HEAD
- ⊞ SPRINKLER CONTROL BOX
- ⊞ HOSE BIB
- ⊞ STORM DRAIN MANHOLE
- ⊞ SANITARY SEWER MANHOLE
- ⊞ SANITARY SEWER CLEANOUT
- ⊞ POWER POLE
- ⊞ POWER POLE ANCHOR
- ⊞ LIGHT POLE
- ⊞ GROUND LIGHT
- ⊞ ELECTRIC MANHOLE
- ⊞ UNDERGROUND ELECTRIC MARKER
- ⊞ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ICV ELECTRIC METER
- HB PHONE MANHOLE
- ⊞ BURIED PHONE LINE
- STMH STORM DRAIN MANHOLE
- SSMH SANITARY SEWER MANHOLE
- SSCO GAS METER
- PP GAS VALVE
- GUY UNDERGROUND GAS MARKER
- LP GAS MANHOLE
- ⊞ FENCE LINE
- EMH ASPHALT PAVEMENT
- UEM TRAFFIC SIGN
- UER BOLLARD POST
- OE XFMR
- TLP
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- GV
- UGM
- CMH
- FNC
- ASPH
- SGN
- BP
- MB

- PROPOSED EDGE OF CONCRETE
- ▒ PROPOSED FLEXIBLE BASE SHOULDER
- ▒ PROPOSED CONCRETE DRIVEWAY
- ▒ PROPOSED CONCRETE PAVEMENT

PAVING DESIGN POINTS				
PT.	DESCR.	STATION	OFFSET	TC ELEV
1	DP	8+80.91	19.5' LT	877.20
2	DP	9+90.64	19.5' LT	873.84
3	DP	10+18.96	19.5' LT	873.16
4	DP	10+18.96	48.3' LT	874.02
5	DP	10+61.50	48.3' LT	873.10
6	DP	10+61.50	19.5' LT	872.24
7	DP	10+89.82	19.5' LT	871.85
8	DP	11+03.54	19.5' LT	871.72
9	DP	11+03.54	19.5' RT	870.55
10	DP	8+80.91	19.5' RT	876.03



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 08/28/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.



NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD PAVING PLAN & PROFILE**  
STA 8+00 TO STA 12+00



**MARKUM RANCH ROAD WIDENING**  
TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	AUGUST 2023	5460-22.506	7

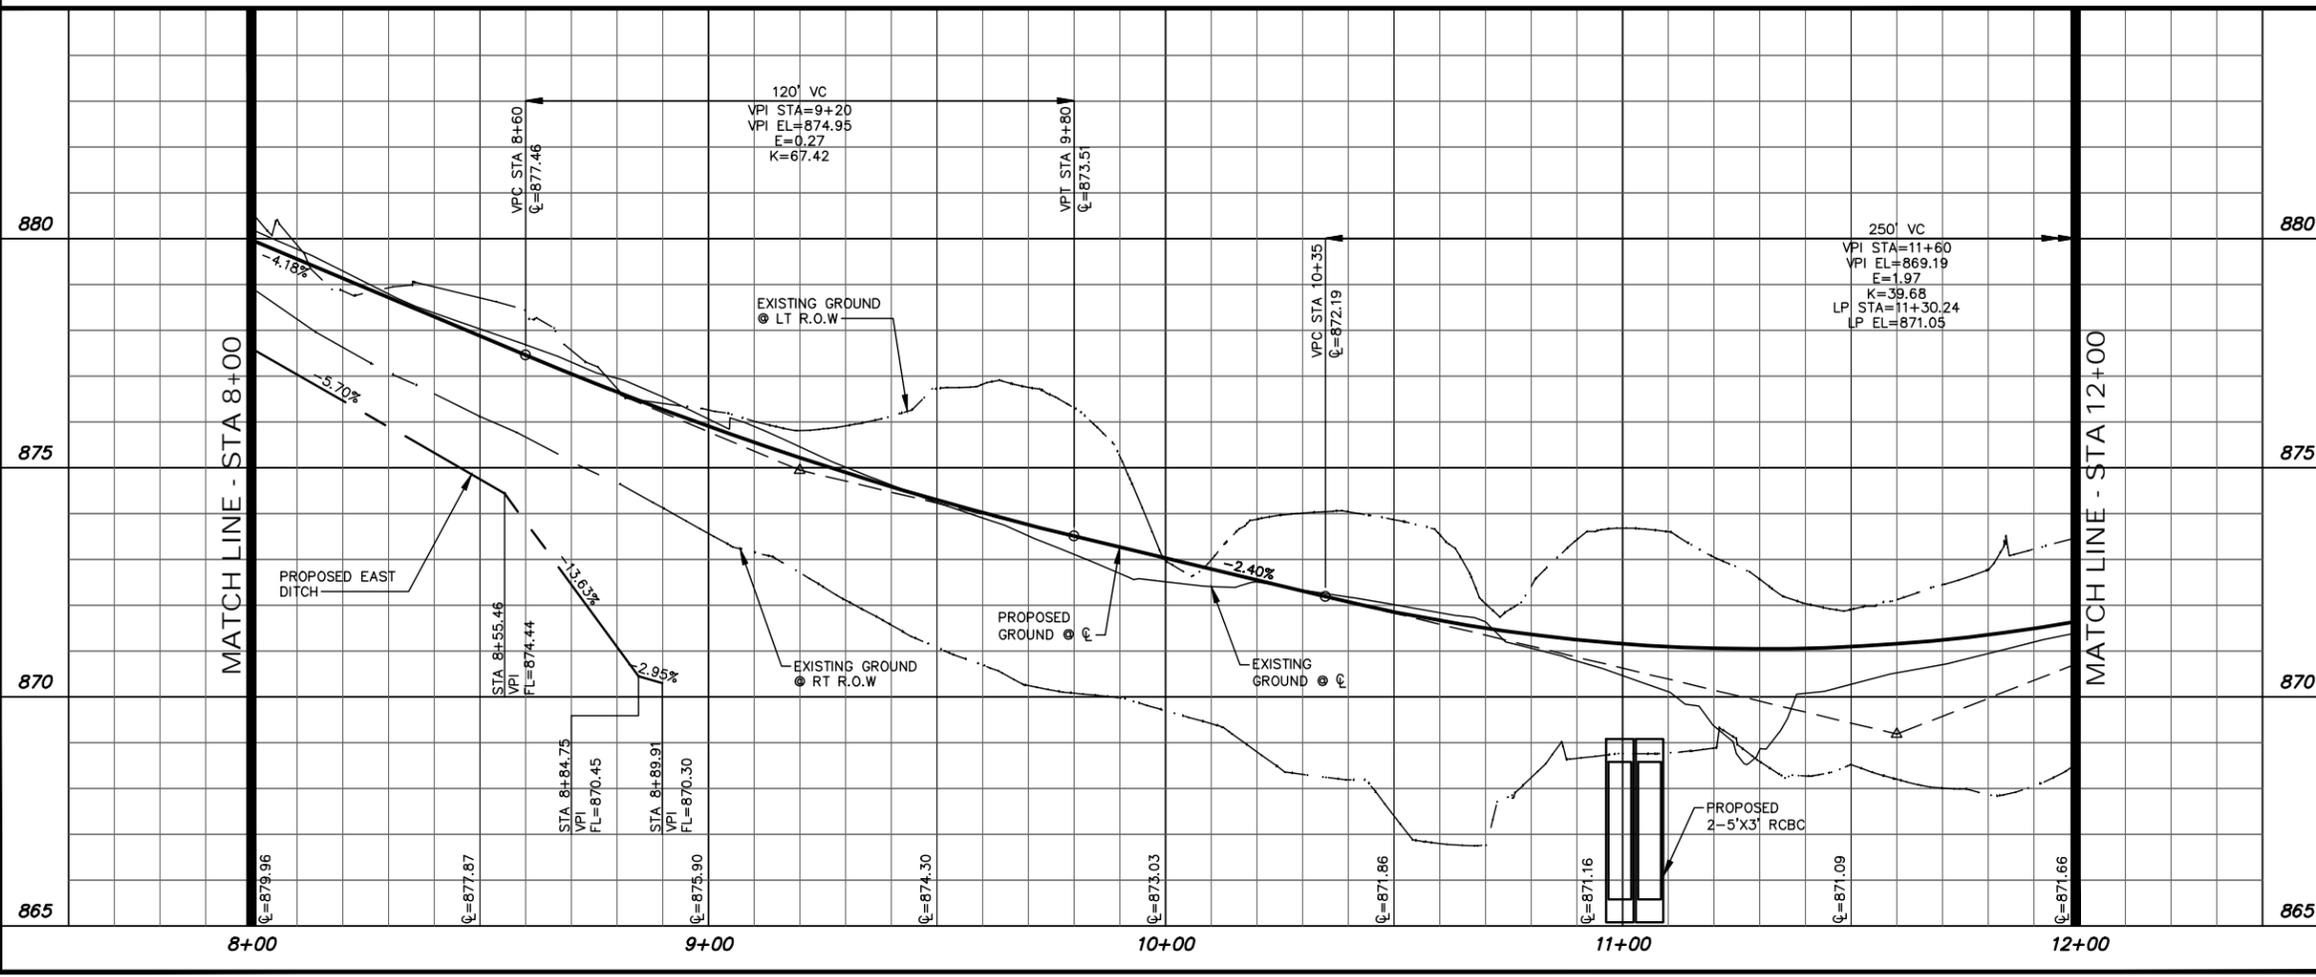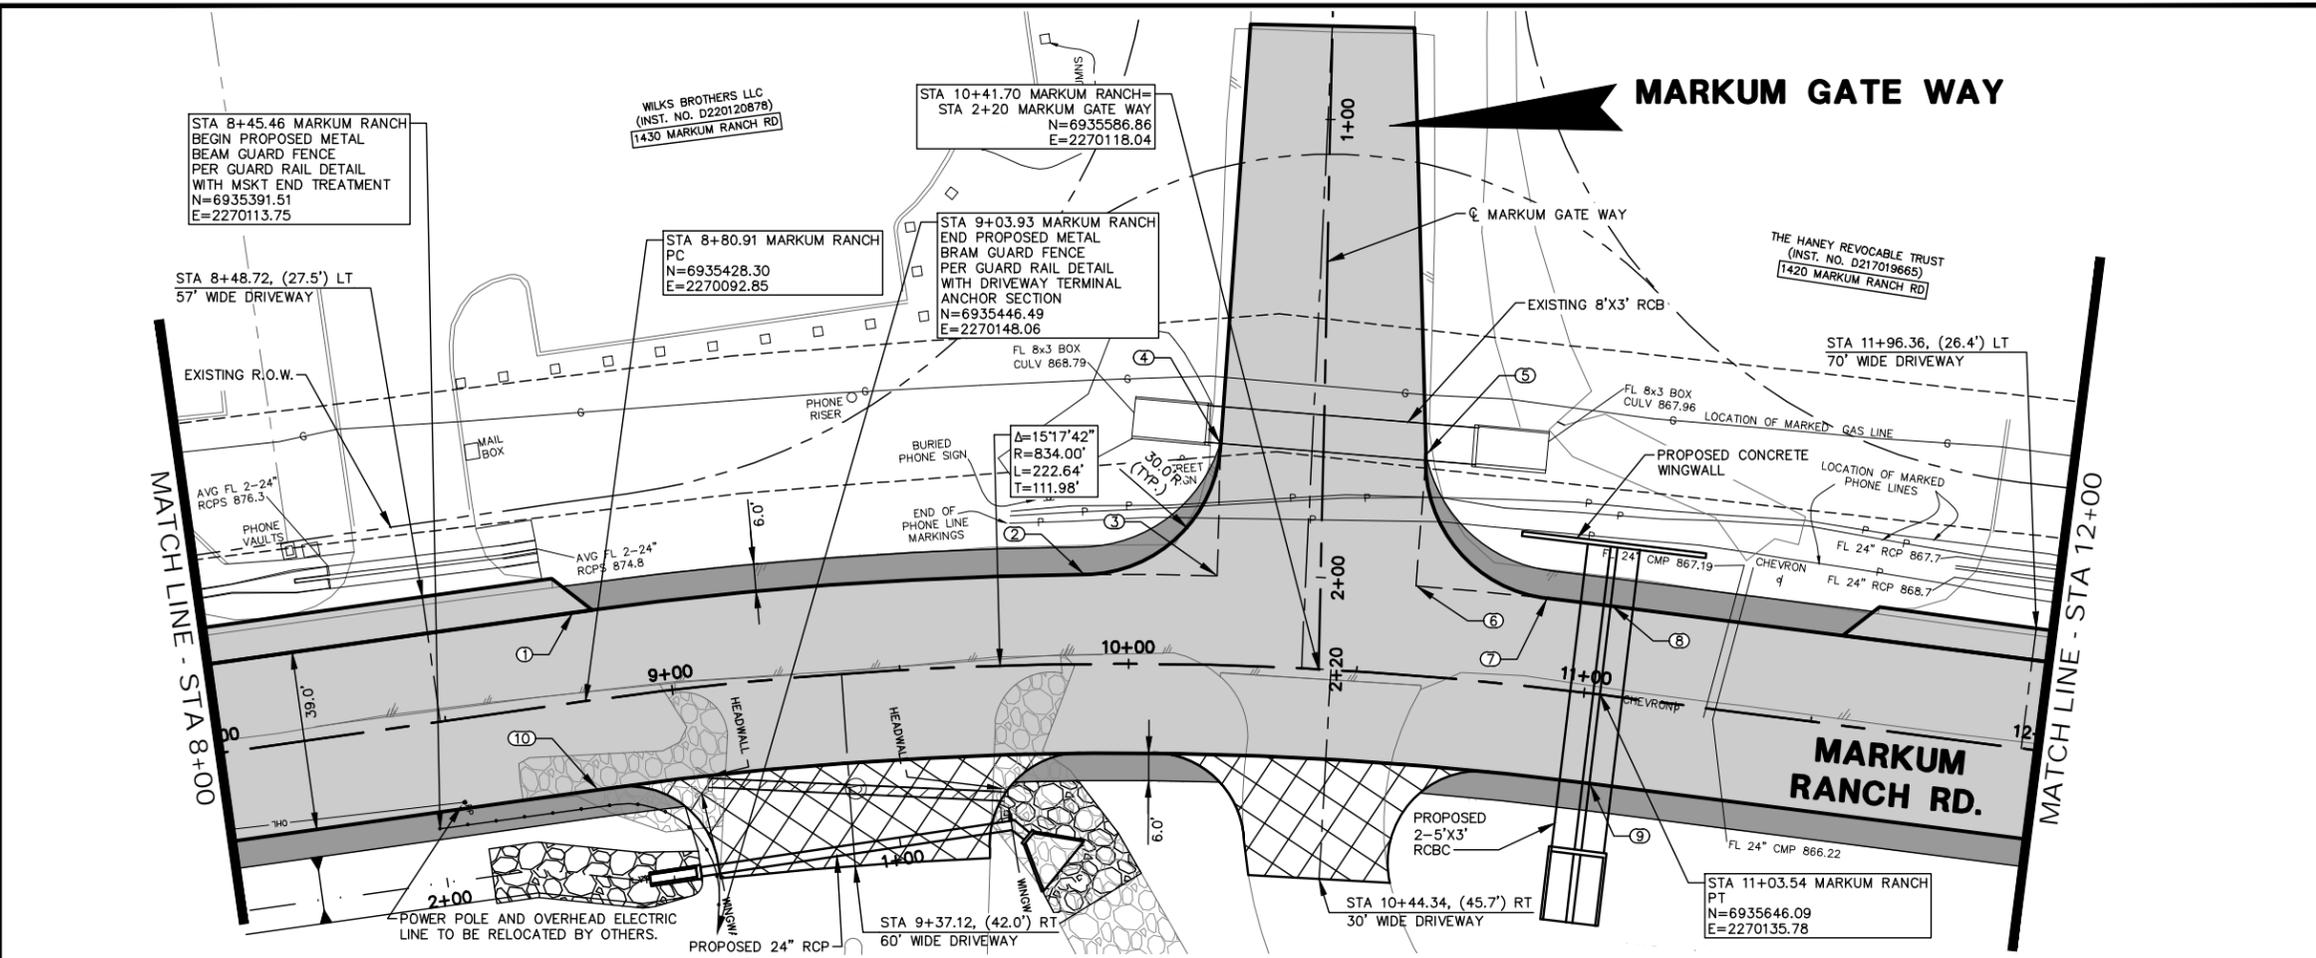

C:\TURNER\08/28/2023 - 4:23PM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_PA.DWG

MARKUM RANCH ROAD WIDENING

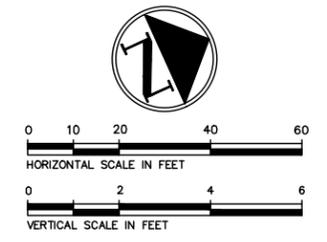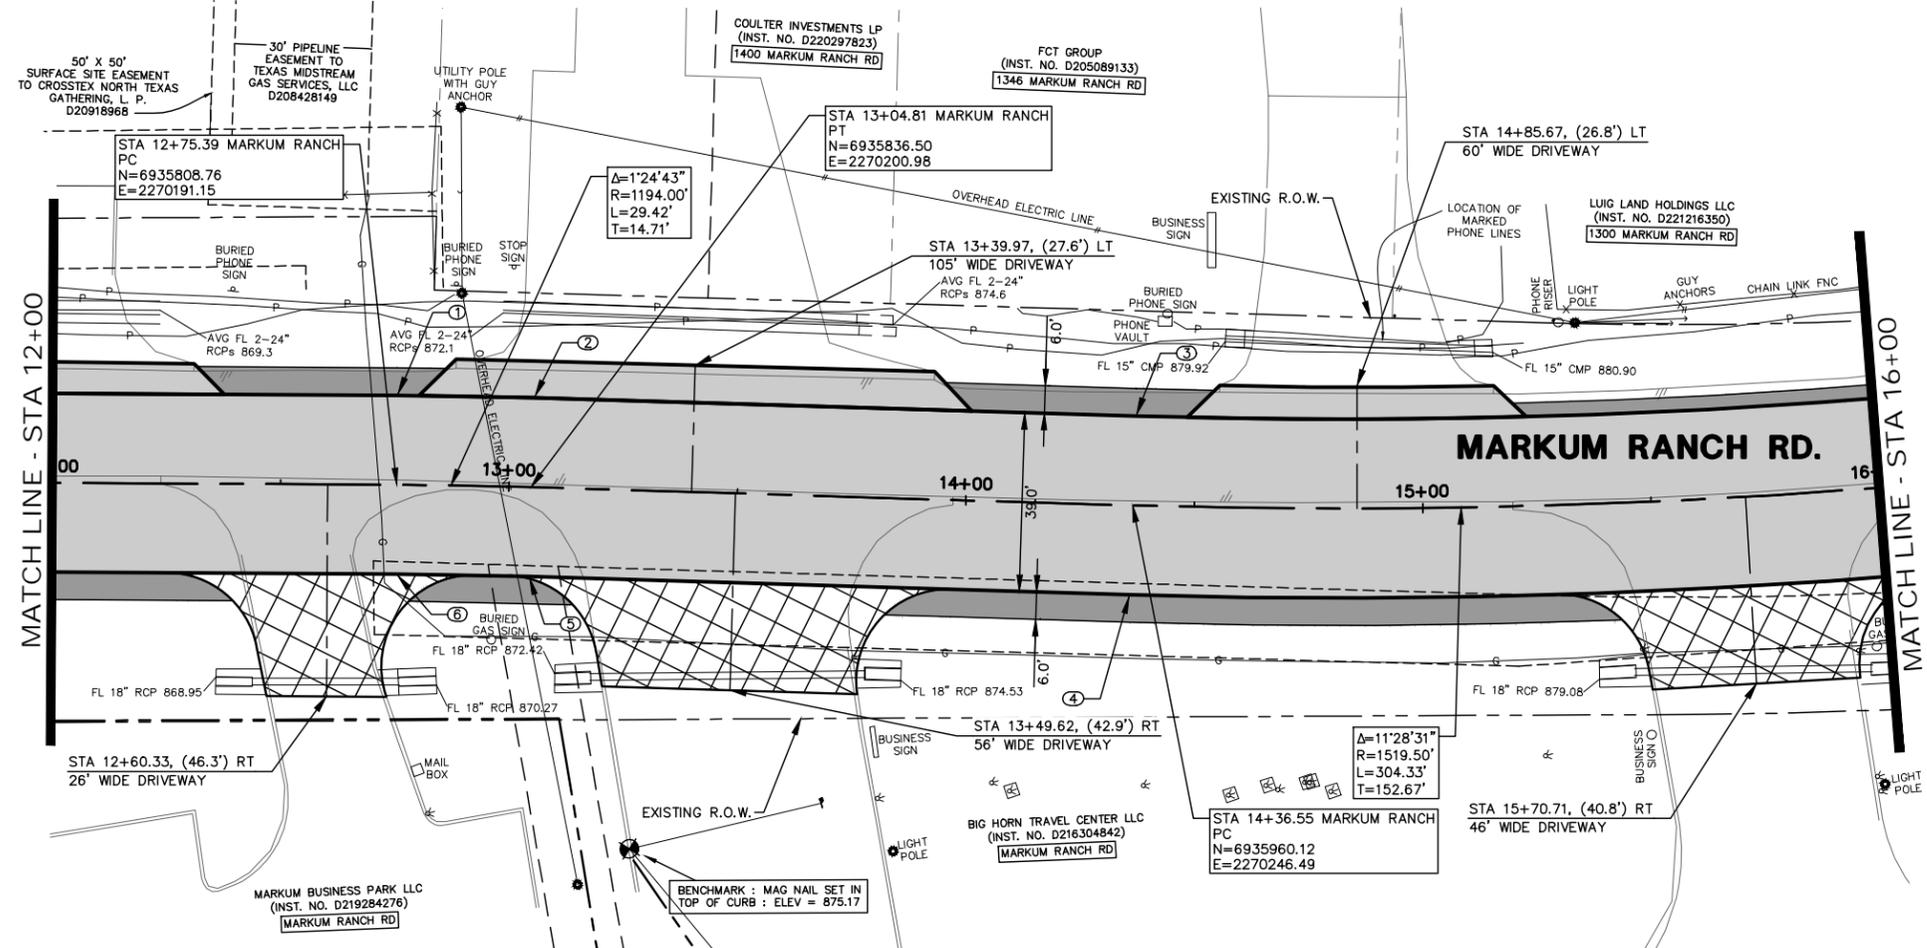

**LEGEND**


- ◆ FIRE HYDRANT
- WATER METER
- WATER VALVE
- ⊙ WATER MANHOLE
- ▽ SPRINKLER HEAD
- ⊠ SPRINKLER CONTROL BOX
- ⊞ HOSE BIB
- ⊞ STORM DRAIN MANHOLE
- ⊞ SANITARY SEWER MANHOLE
- ⊞ SANITARY SEWER CLEANOUT
- ⊞ POWER POLE
- ⊞ POWER POLE ANCHOR
- ⊞ LIGHT POLE
- ⊞ GROUND LIGHT
- ⊞ ELECTRIC MANHOLE
- ⊞ UNDERGROUND ELECTRIC MARKER
- ⊞ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ICV ELECTRIC METER
- HB PHONE MANHOLE
- ⊞ BURIED PHONE LINE
- STMH GAS METER
- SSM PHR
- SSCO GAS METER
- PP GAS VALVE
- GUY UNDERGROUND GAS MARKER
- LP GAS MANHOLE
- ⊞ FENCE LINE
- EMH ASPHALT PAVEMENT
- UEM TRAFFIC SIGN
- UER BOLLARD POST
- OE XFMR
- TLP
- TSCB
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- GV
- UGM
- GMH
- FNC
- ASPH
- SGN
- BP
- MB

- PROPOSED EDGE OF CONCRETE
- ▨ PROPOSED FLEXIBLE BASE SHOULDER
- ▩ PROPOSED CONCRETE DRIVEWAY
- ▩ PROPOSED CONCRETE PAVEMENT

PAVING DESIGN POINTS				
PT.	DESCR.	STATION	OFFSET	TC ELEV
1	DP	12+75.39	19.5' LT	874.29
2	DP	13+04.81	19.5' LT	875.42
3	DP	14+36.55	19.5' LT	880.41
4	DP	14+36.55	19.5' RT	879.24
5	DP	13+04.81	19.5' RT	874.25
6	DP	12+75.39	19.5' RT	873.12



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 08/28/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

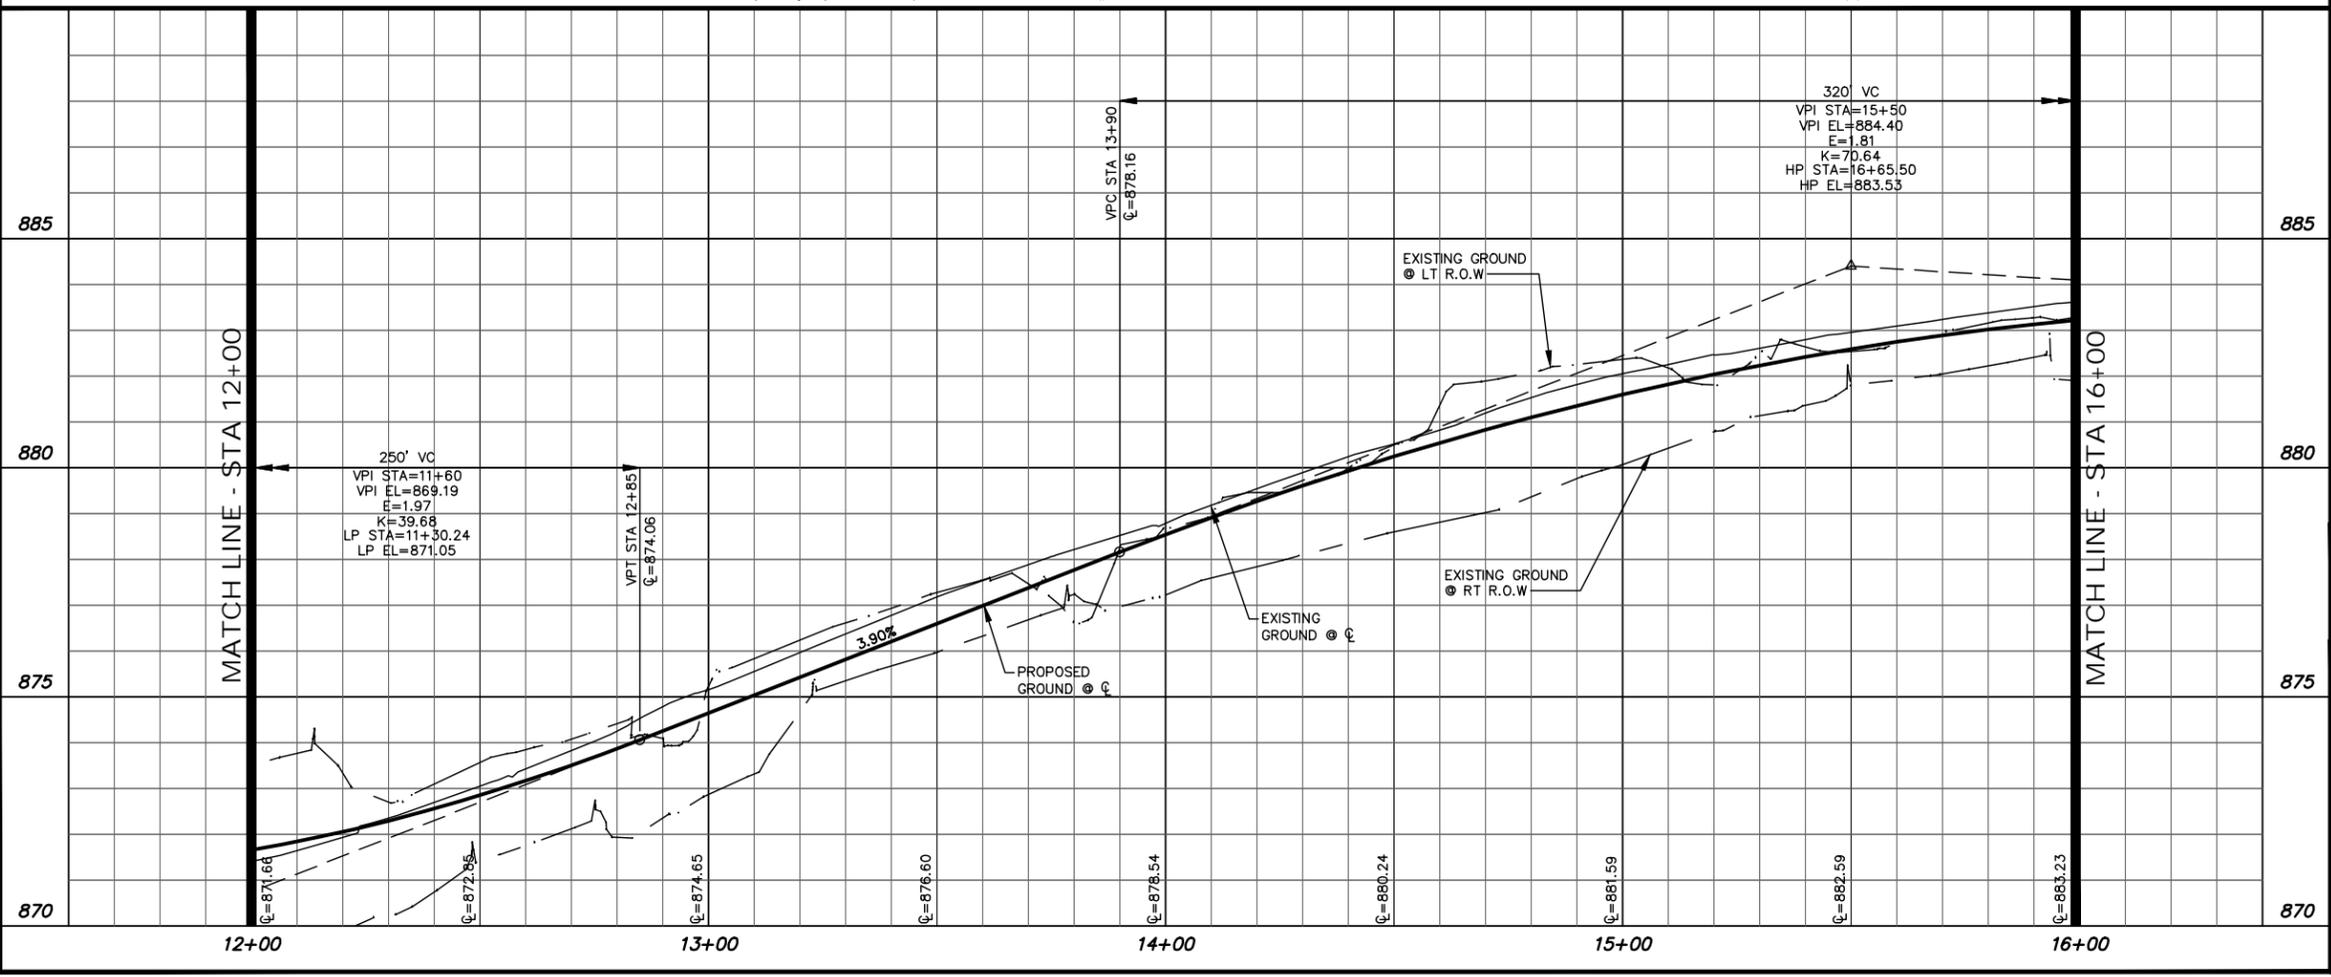

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD**  
PAVING PLAN & PROFILE  
STA 12+00 TO STA 16+00



**MARKUM RANCH ROAD WIDENING**  
TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	AUGUST 2023	5460-22.506	8

C:\TANNER\08/28/2023 - 4:23PM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_PA.DWG

MARKUM RANCH ROAD WIDENING

# INTERSTATE HWY. 20 E. BOUND ACCESS ROAD

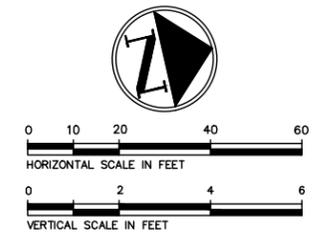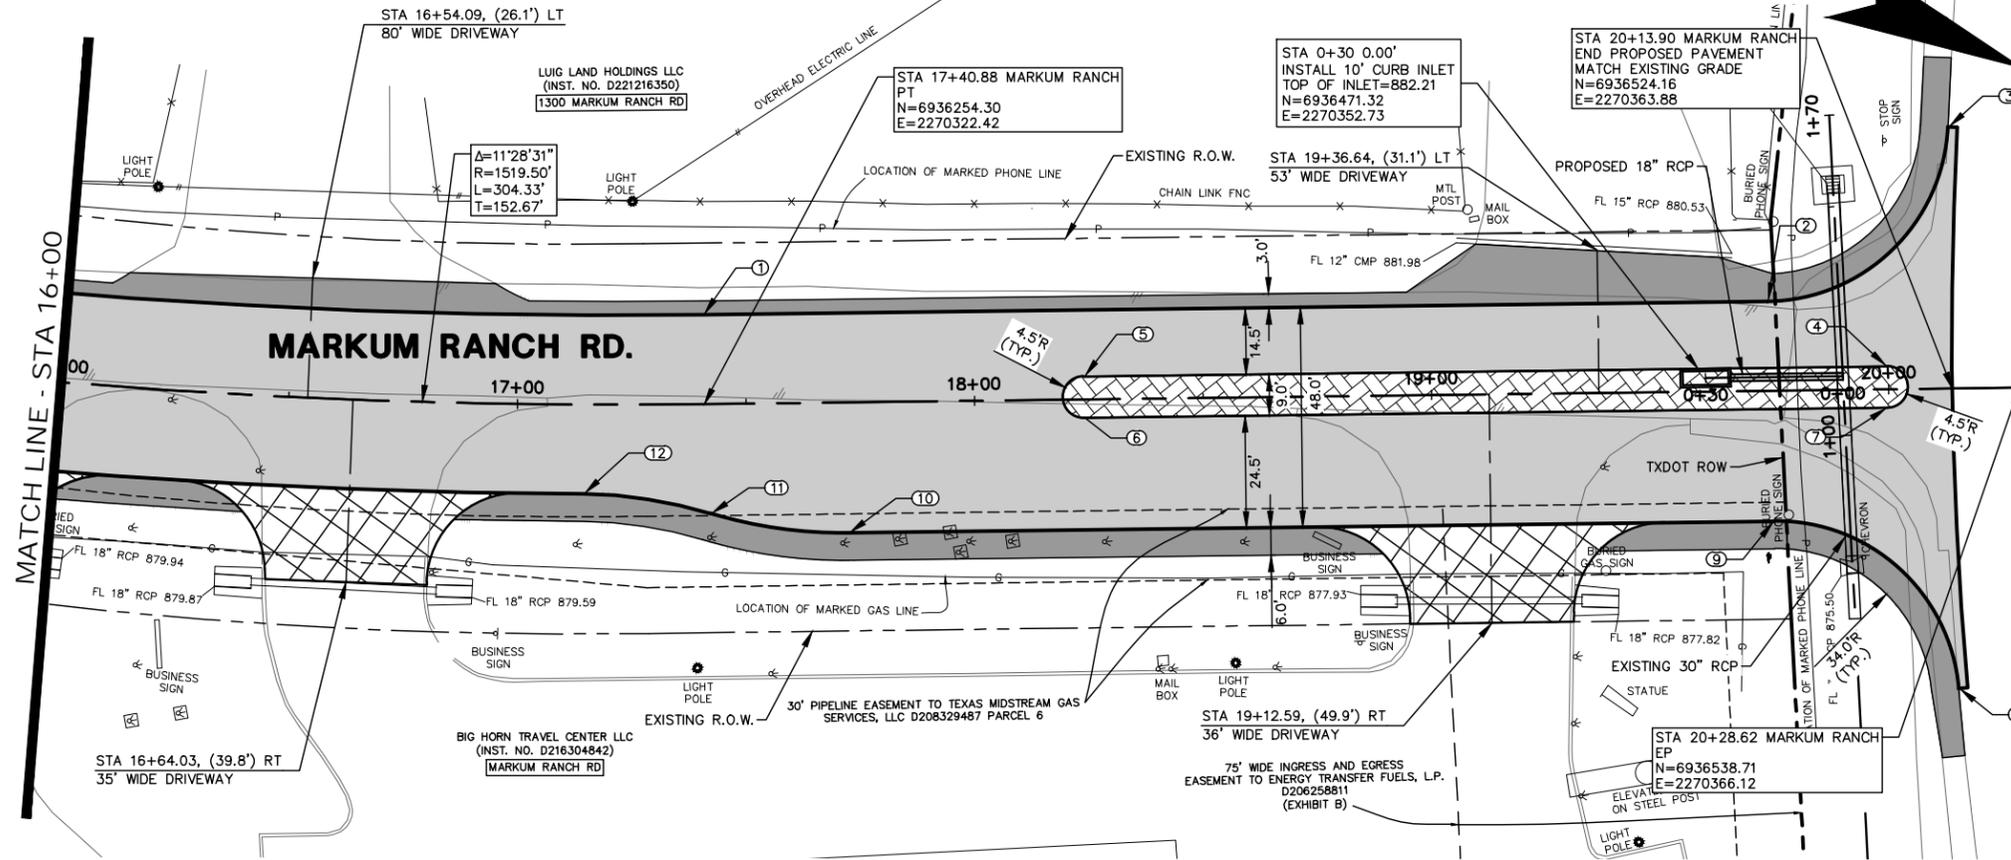


## LEGEND

- ⊕ FIRE HYDRANT
- ⊕ WATER METER
- ⊕ WATER VALVE
- ⊕ WATER MANHOLE
- ⊕ SPRINKLER HEAD
- ⊕ SPRINKLER CONTROL BOX
- ⊕ HOSE BIB
- ⊕ STORM DRAIN MANHOLE
- ⊕ SANITARY SEWER MANHOLE
- ⊕ SANITARY SEWER CLEANOUT
- ⊕ POWER POLE
- ⊕ POWER POLE ANCHOR
- ⊕ LIGHT POLE
- ⊕ GROUND LIGHT
- ⊕ ELECTRIC MANHOLE
- ⊕ UNDERGROUND ELECTRIC MARKER
- ⊕ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- EV ELECTRIC METER
- ⊕ PHONE MANHOLE
- ⊕ BURIED PHONE LINE
- ⊕ PHONE RISER
- ⊕ GAS METER
- ⊕ GAS VALVE
- ⊕ UNDERGROUND GAS MARKER
- ⊕ GAS MANHOLE
- ⊕ FENCE LINE
- EMH ASPHALT PAVEMENT
- UEM ASPH TRAFFIC SIGN
- UER BOLLARD POST
- ⊕ MAIL BOX
- OE XFMR
- TLP
- TSCB
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- UGM
- CMH
- FNC
- ASPH
- SGN
- BP
- MB


- PROPOSED EDGE OF CONCRETE
- ▨ PROPOSED FLEXIBLE BASE SHOULDER
- ▩ PROPOSED CONCRETE MEDIAN
- ▩ PROPOSED CONCRETE DRIVEWAY
- ▩ PROPOSED CONCRETE PAVEMENT

## PAVING DESIGN POINTS

PT.	DESCR.	STATION	OFFSET	TC ELEV
1	DP	17+40.88	19.5' LT	883.78
2	DP	19+73.77	19.5' LT	882.21
3	DP	20+13.70	57.1' LT	883.45
4	DP	19+99.75	5.0' LT	882.54
5	DP	18+23.95	5.0' LT	883.32
6	DP	18+23.95	4.0' RT	883.05
7	DP	19+99.75	4.0' RT	882.27
8	DP	20+14.52	65.4' RT	880.04
9	DP	19+74.64	28.5' RT	880.81
10	DP	17+72.08	28.5' RT	882.14
11	DP	17+41.96	23.9' RT	882.47
12	DP	17+14.58	19.5' RT	882.78



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

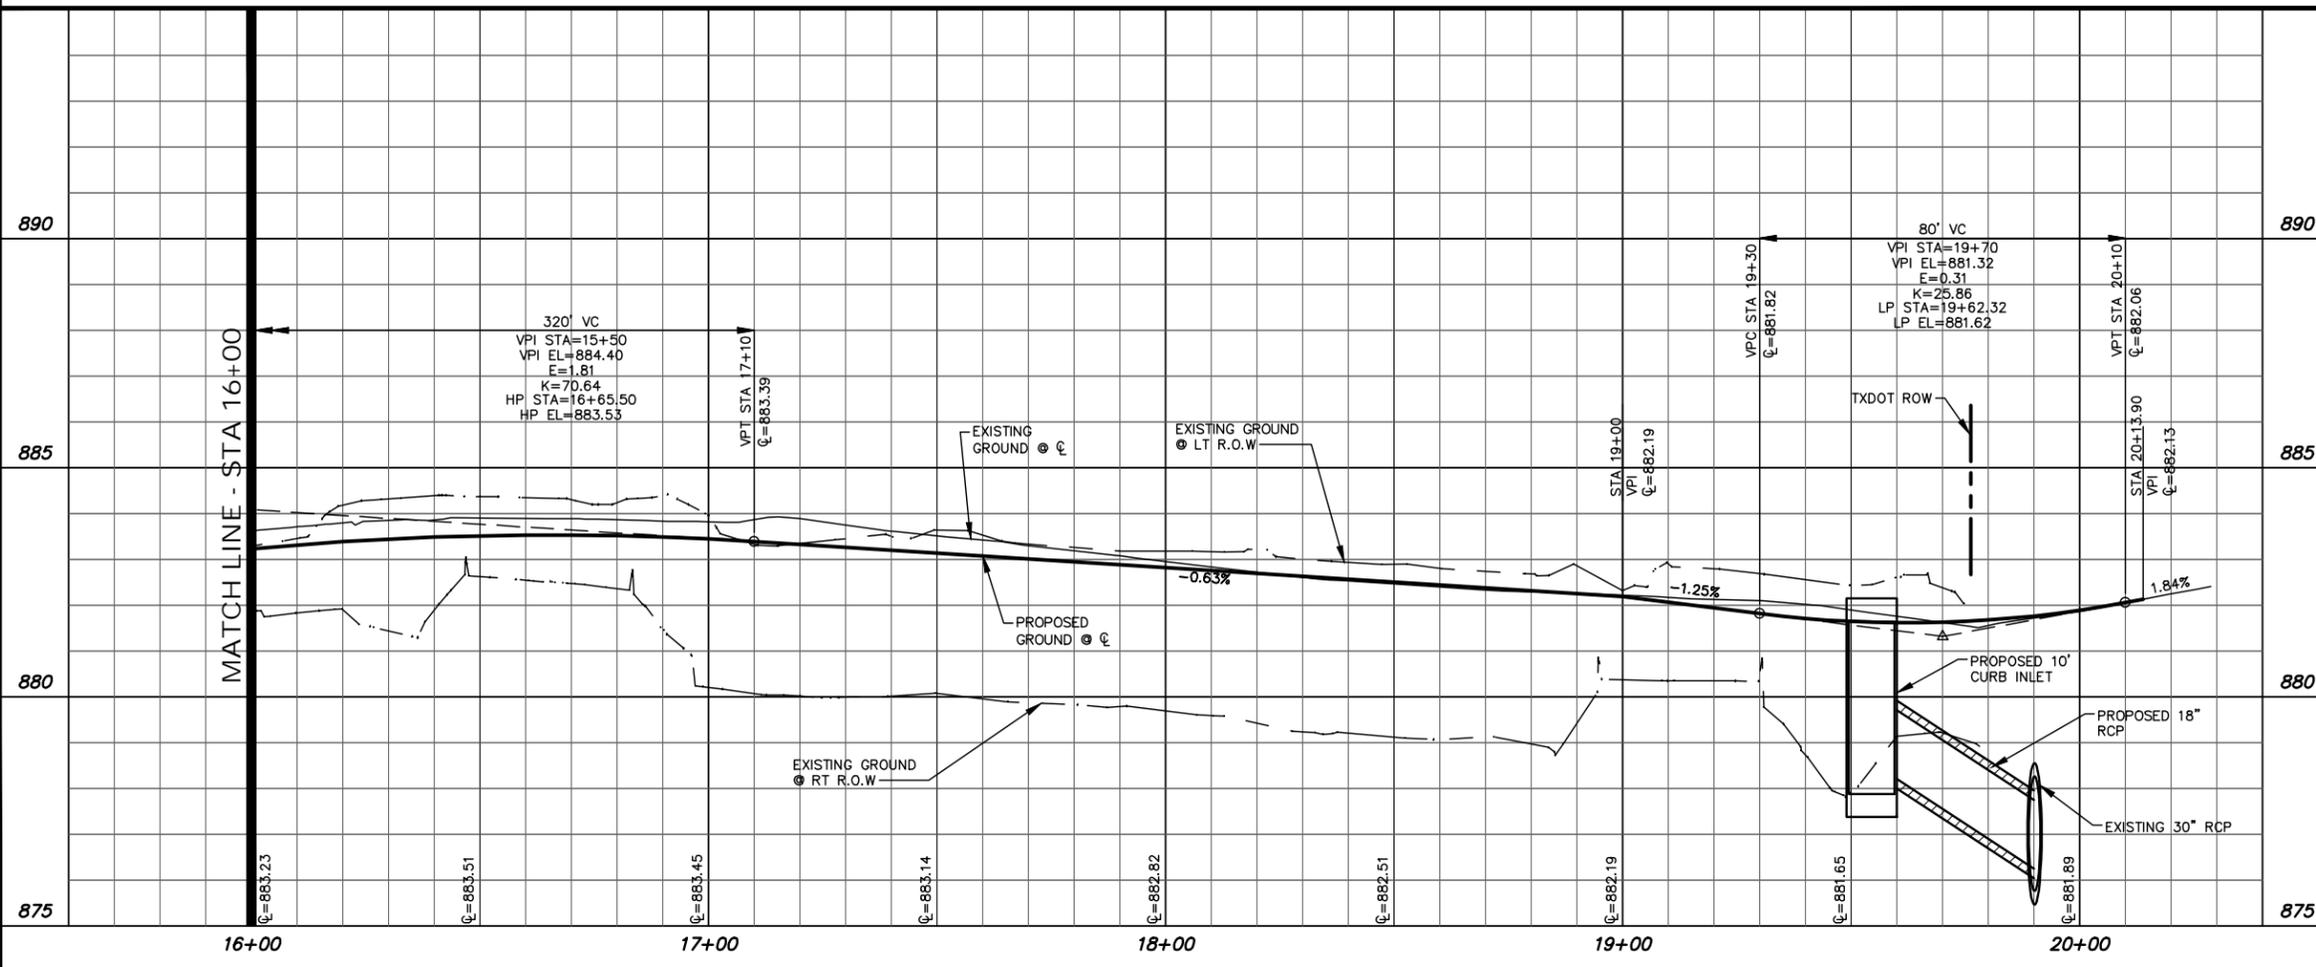

NO.	DATE	REVISION


**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD  
PAVING PLAN & PROFILE  
STA 16+00 TO STA 20+13.90**

MARKUM RANCH ROAD WIDENING				
TARRANT COUNTY, TEXAS				
DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	9

CKT:JMR  
 05/02/2023 - 11:32AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_PA.DWG

MARKUM RANCH ROAD WIDENING



LEGEND

- ◆ FIRE HYDRANT
- WATER METER
- ⊙ WATER VALVE
- ⊙ WATER MANHOLE
- ⊙ SPRINKLER HEAD
- ⊙ SPRINKLER CONTROL BOX
- ⊙ HOSE BIB
- ⊙ STORM DRAIN MANHOLE
- ⊙ SANITARY SEWER MANHOLE
- ⊙ SANITARY SEWER CLEANOUT
- ⊙ POWER POLE
- ⊙ POWER POLE ANCHOR
- ⊙ LIGHT POLE
- ⊙ GROUND LIGHT
- ⊙ ELECTRIC MANHOLE
- ⊙ UNDERGROUND ELECTRIC MARKER
- ⊙ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ⊙ ELECTRIC METER
- ⊙ PHONE MANHOLE
- ⊙ BURIED PHONE LINE
- ⊙ PHONE RISER
- ⊙ GAS METER
- ⊙ GAS VALVE
- ⊙ UNDERGROUND GAS MARKER
- ⊙ GAS MANHOLE
- ⊙ FENCE LINE
- ⊙ ASPHALT PAVEMENT
- ⊙ TRAFFIC SIGN
- ⊙ BOLLARD POST
- ⊙ MAIL BOX
- OE XFMR
- TLP
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- UGM
- DMH
- FNC
- ASPH
- SGN
- BP
- MB

- PROPOSED EDGE OF CONCRETE
- ▒ PROPOSED FLEXIBLE BASE SHOULDER
- ▒ PROPOSED CONCRETE PAVEMENT
- ▒ PROPOSED ASPHALT TRANSITION

PAVING DESIGN POINTS				
PT.	DESCR.	STATION	OFFSET	TC ELEV
1	DP	0+77.80	13.5' LT	897.33
2	DP	1+50.62	19.9' LT	895.36
3	DP	1+80.62	19.7' LT	894.56
4	DP	1+80.39	17.8' RT	894.64
5	DP	0+77.84	13.5' RT	897.59
6	DP	1+50.39	17.6' RT	895.51



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION
890		4060 BRYANT IRVIN ROAD FORT WORTH, TX 76109 817-412-7155 TX REG. ENGINEERING FIRM F-469 TX REG. SURVEYING FIRM LS-10008001



**Pacheco Koch**  
a Westwood company

**RANCHERS LEGACY TRAIL  
PAVING PLAN & PROFILE  
STA 0+50 TO STA 2+00**

**MARKUM RANCH ROAD WIDENING**



TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	10

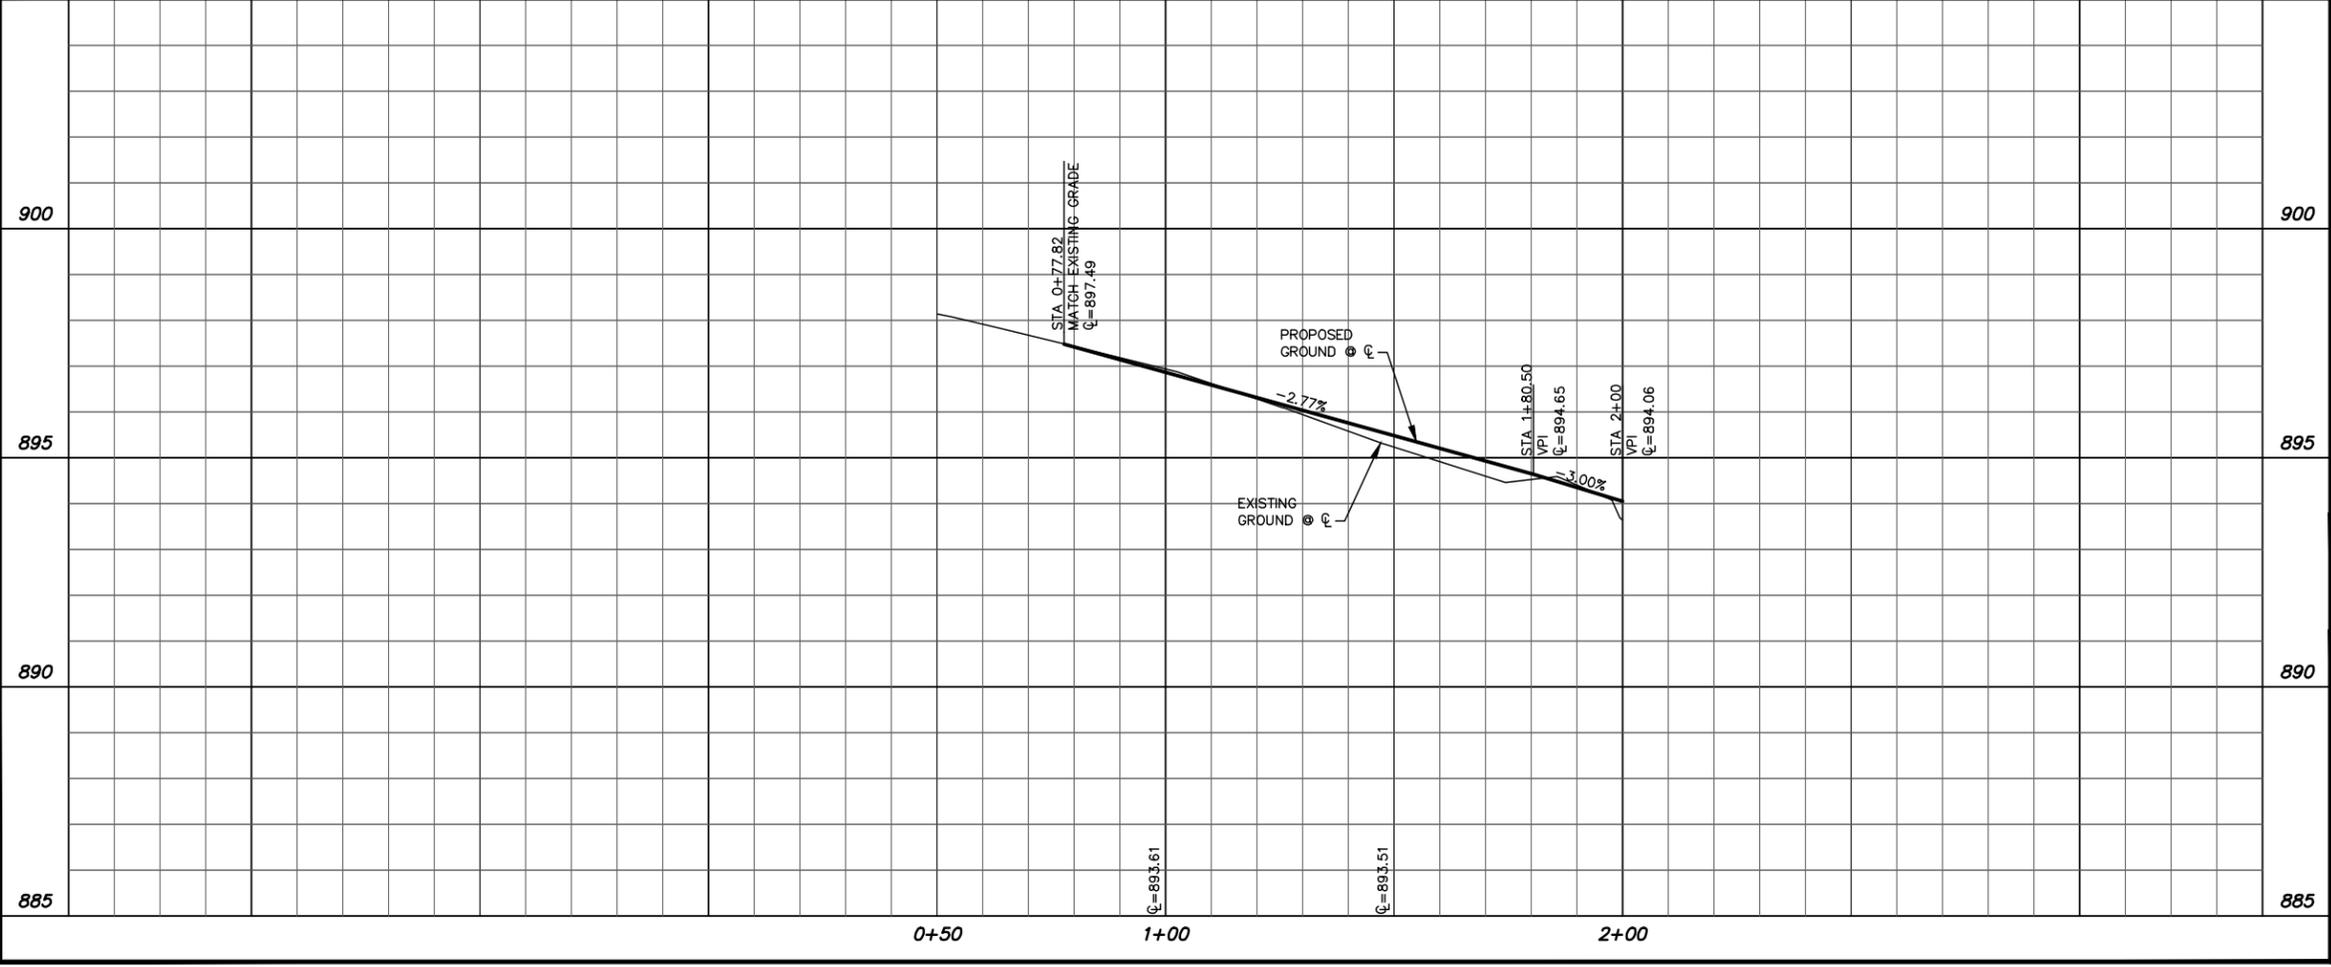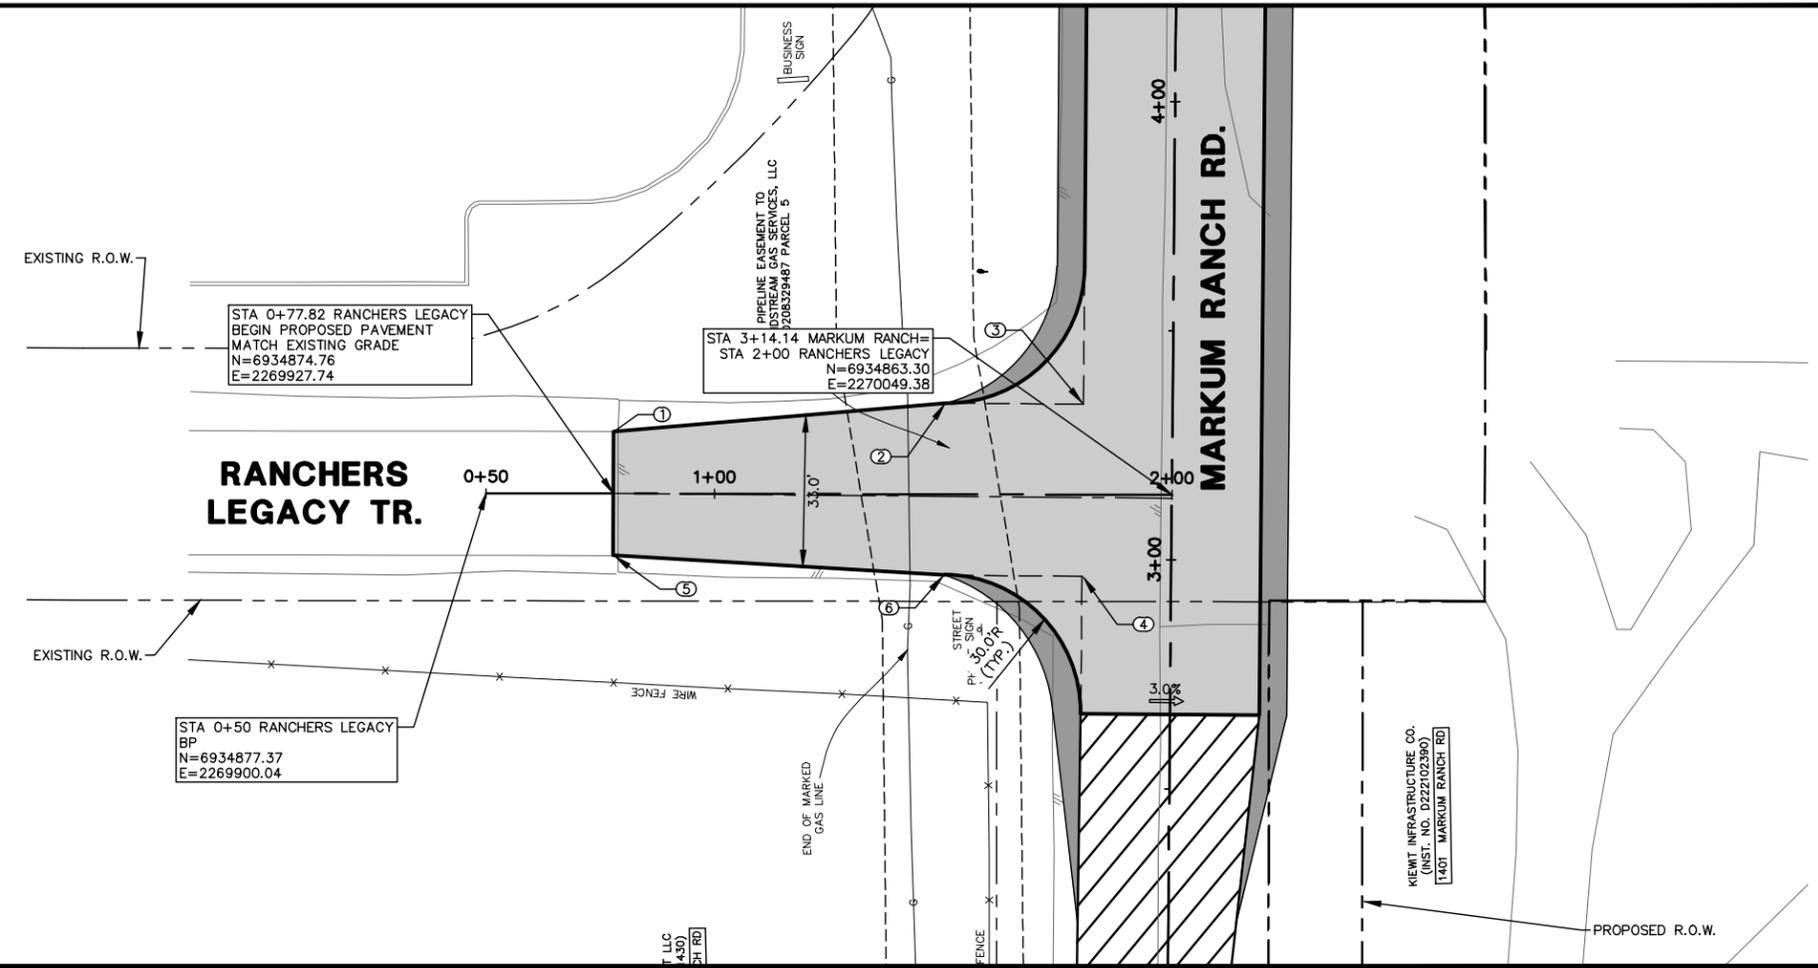

CKT:CKT 05/02/2023 11:32AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_PA.DWG

MARKUM RANCH ROAD WIDENING

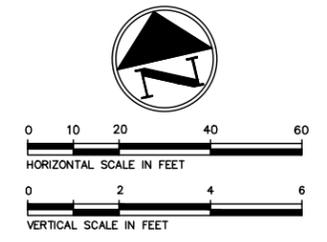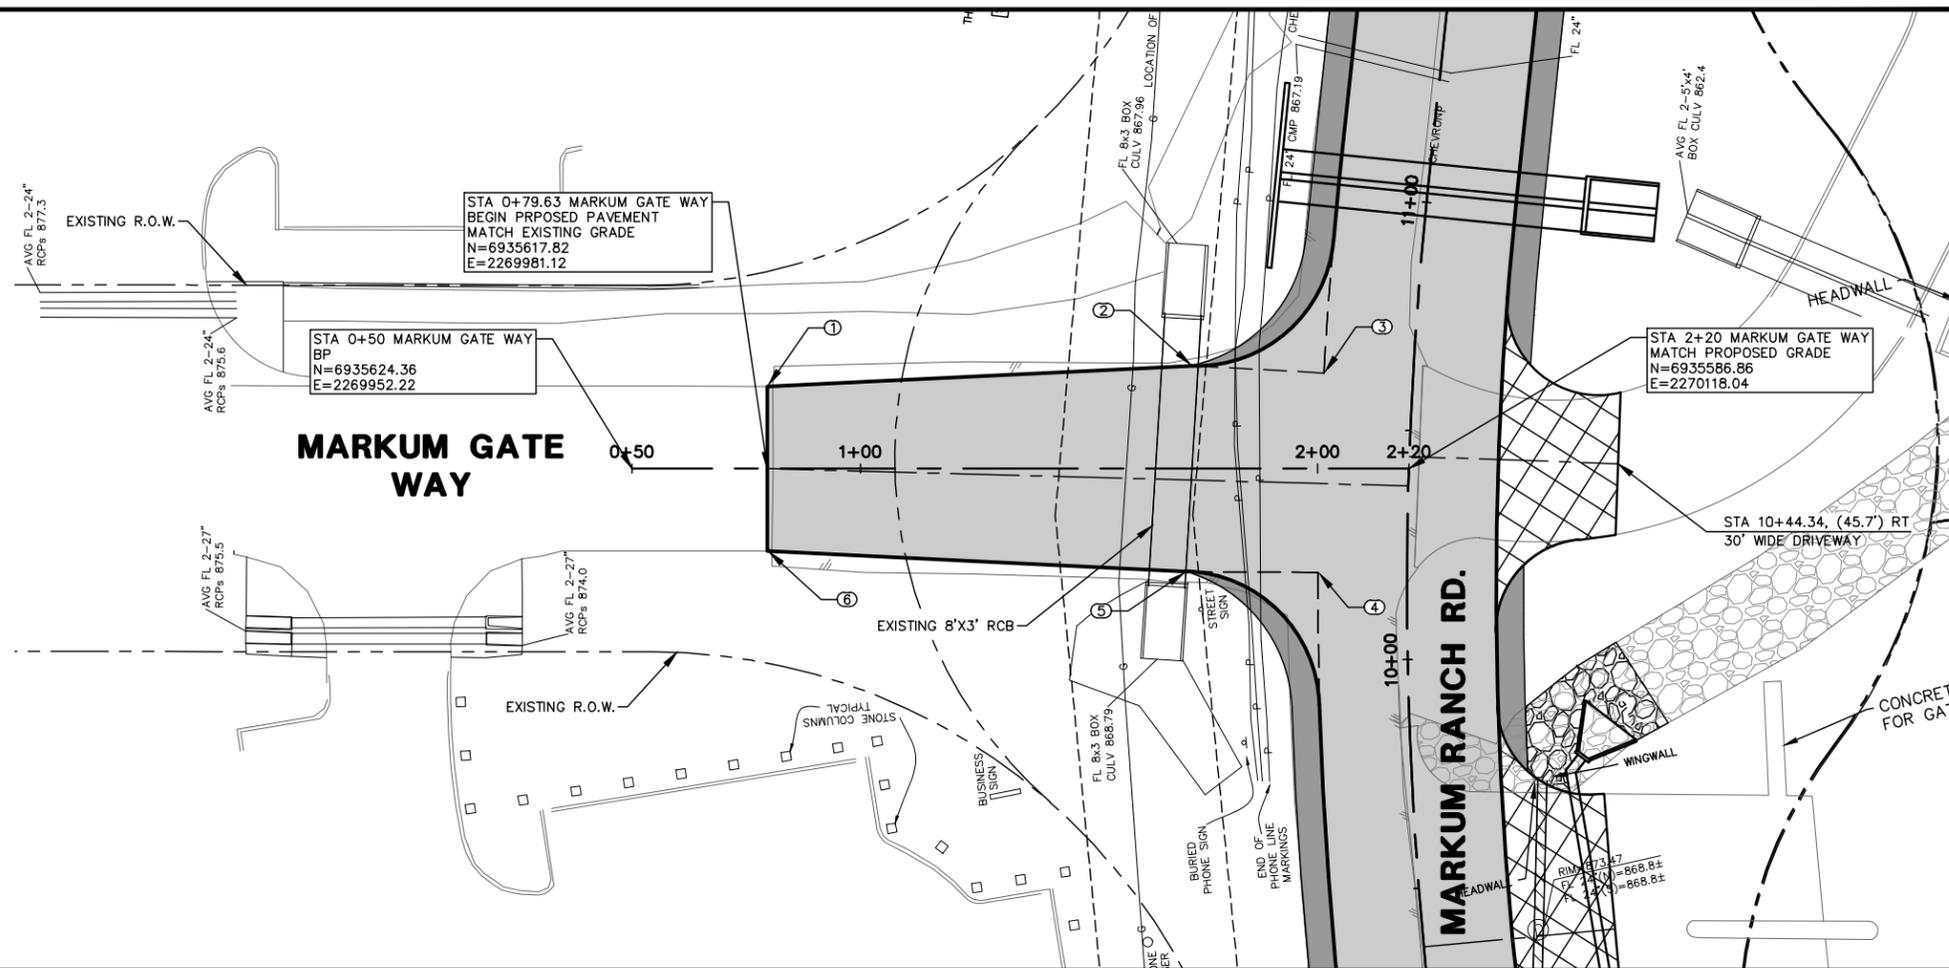


**LEGEND**

- ◆ FIRE HYDRANT
- WATER METER
- ⊕ WATER VALVE
- ⊙ WATER MANHOLE
- ⊙ SPRINKLER HEAD
- ⊙ SPRINKLER CONTROL BOX
- ⊙ HOSE BIB
- ⊙ STORM DRAIN MANHOLE
- ⊙ SANITARY SEWER MANHOLE
- ⊙ SANITARY SEWER CLEANOUT
- ⊙ POWER POLE
- ⊙ POWER POLE ANCHOR
- ⊙ LIGHT POLE
- ⊙ GROUND LIGHT
- ⊙ ELECTRIC MANHOLE
- ⊙ UNDERGROUND ELECTRIC MARKER
- ⊙ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ⊙ ELECTRIC METER
- ⊙ PHONE MANHOLE
- ⊙ BURIED PHONE LINE
- ⊙ PHONE RISER
- ⊙ GAS METER
- ⊙ GAS VALVE
- ⊙ UNDERGROUND GAS MARKER
- ⊙ GAS MANHOLE
- ⊙ ASPHALT PAVEMENT
- ⊙ TRAFFIC SIGN
- ⊙ BOLLARD POST
- ⊙ MAIL BOX
- OE XFMR
- TLP
- TSCB
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- UGM
- GMH
- FNC
- ASPH
- SGN
- BP
- MB

- PROPOSED EDGE OF CONCRETE
- ▒ PROPOSED FLEXIBLE BASE SHOULDER
- ▒ PROPOSED CONCRETE PAVEMENT
- ▒ PROPOSED ASPHALT TRANSITION

PAVING DESIGN POINTS				
PT.	DESCR.	STATION	OFFSET	TC ELEV
1	DP	0+79.61	17.9' LT	874.44
2	DP	1+72.64	22.5' LT	873.10
3	DP	2+01.39	20.9' LT	872.24
4	DP	2+00.09	22.7' RT	873.16
5	DP	1+71.30	22.5' RT	874.02
6	DP	0+79.64	17.9' RT	874.81

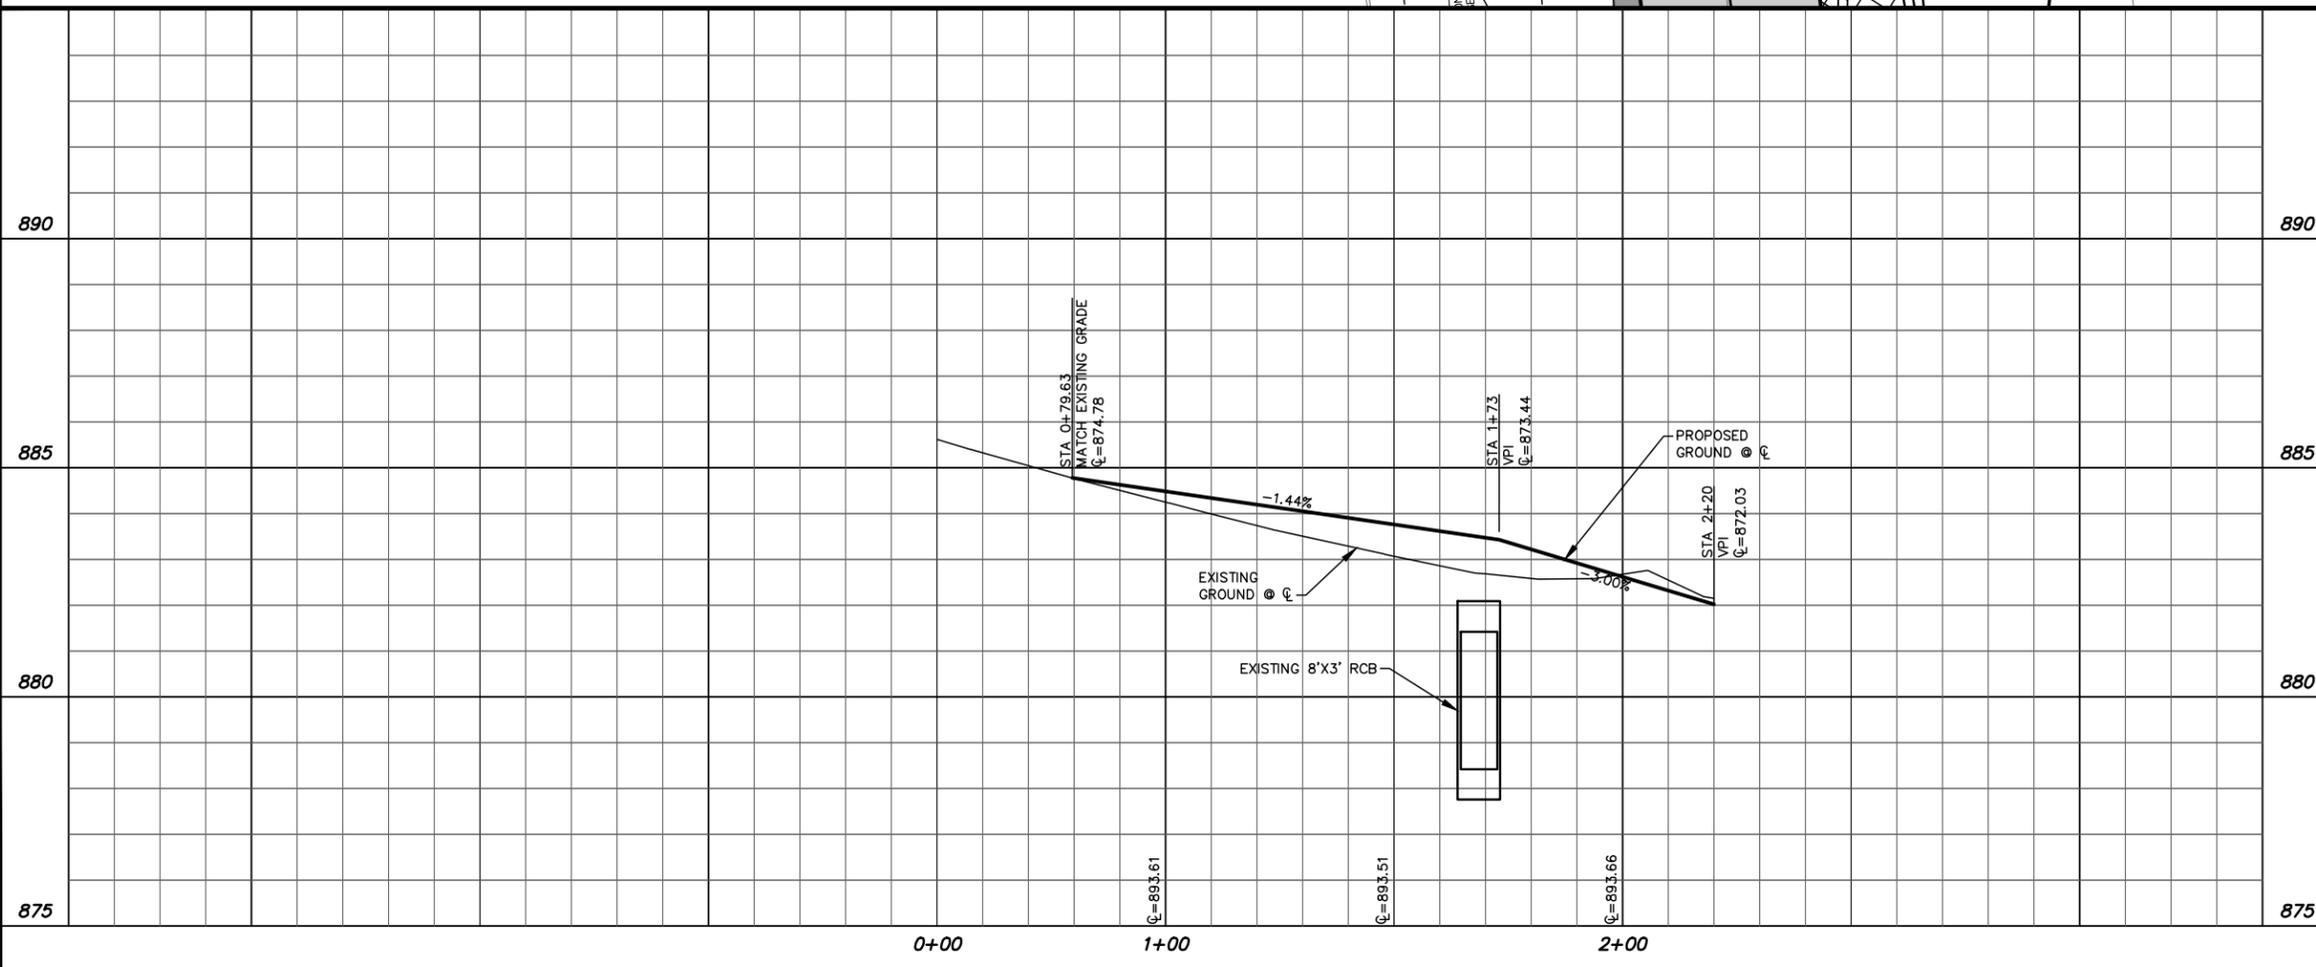

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**MARKUM GATE WAY  
PAVING PLAN & PROFILE  
STA 0+50 TO STA 2+20**





**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	11

CKT:JRM  
 05/02/2023 - 11:32AM  
 M:\DWG-5A\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_PA.DWG

MARKUM RANCH ROAD WIDENING

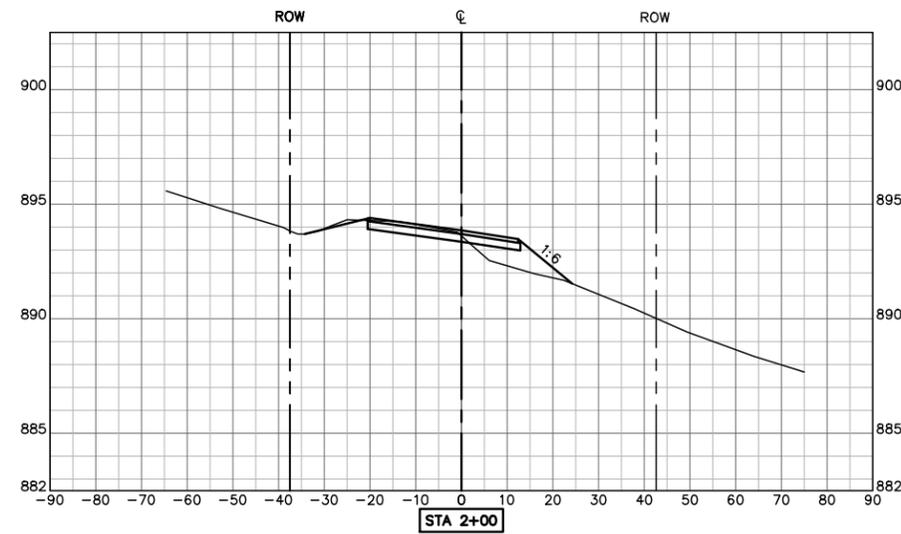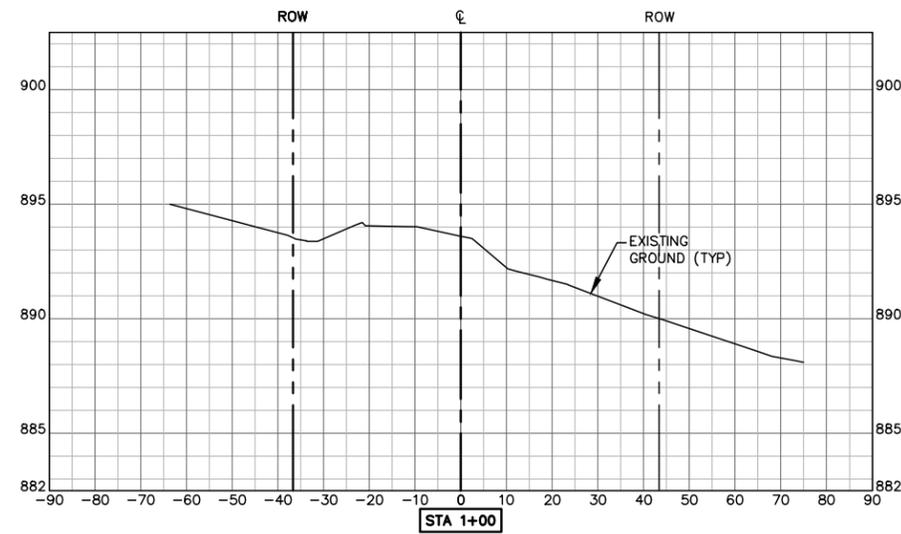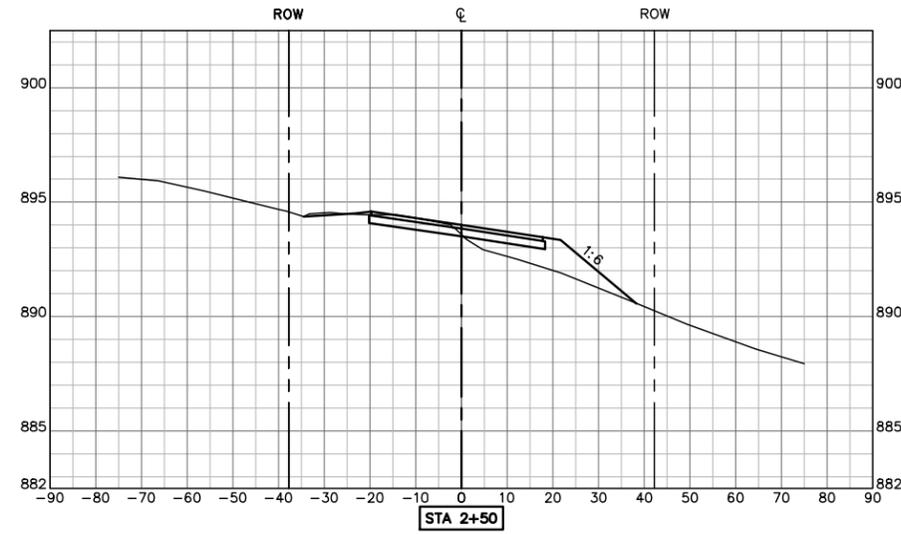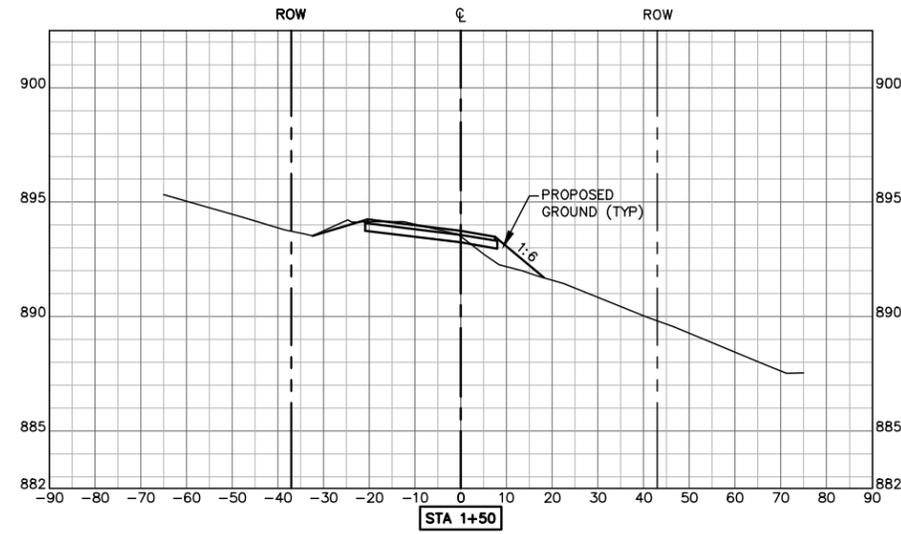

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
STA 1+00 TO STA 2+50



**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	12

CKT:JNER  
 05/02/2023 11:34AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

MARKUM RANCH ROAD WIDENING

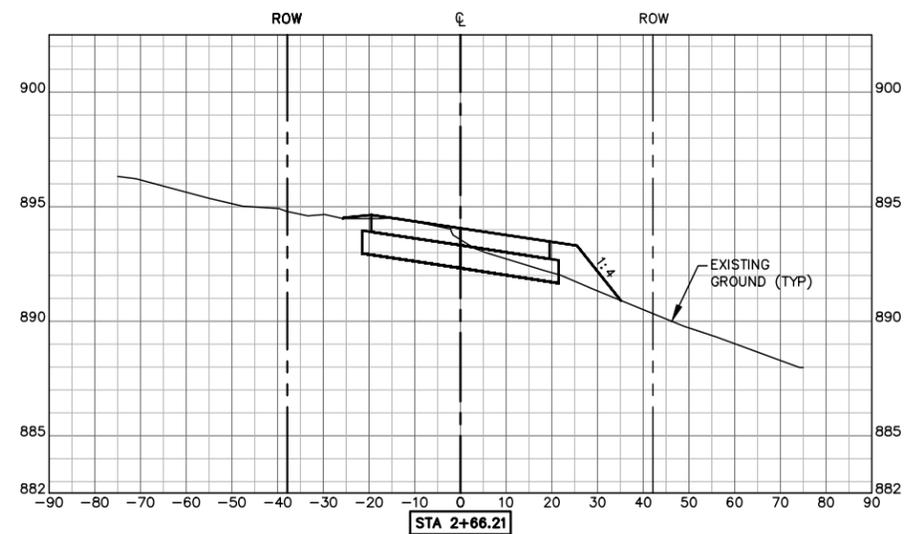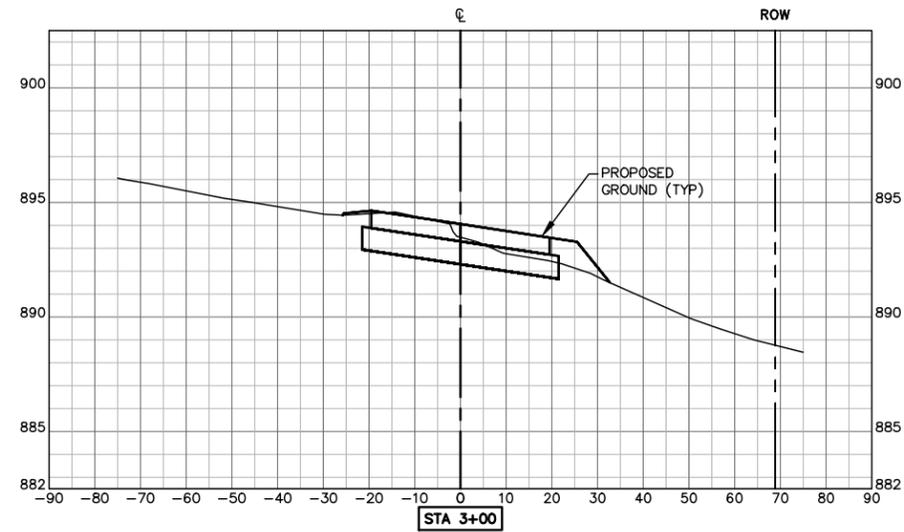

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
 STA 2+70.42 TO STA 3+00




**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	13

CKT:JNER  
 05/02/2023 11:34AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

MARKUM RANCH ROAD WIDENING

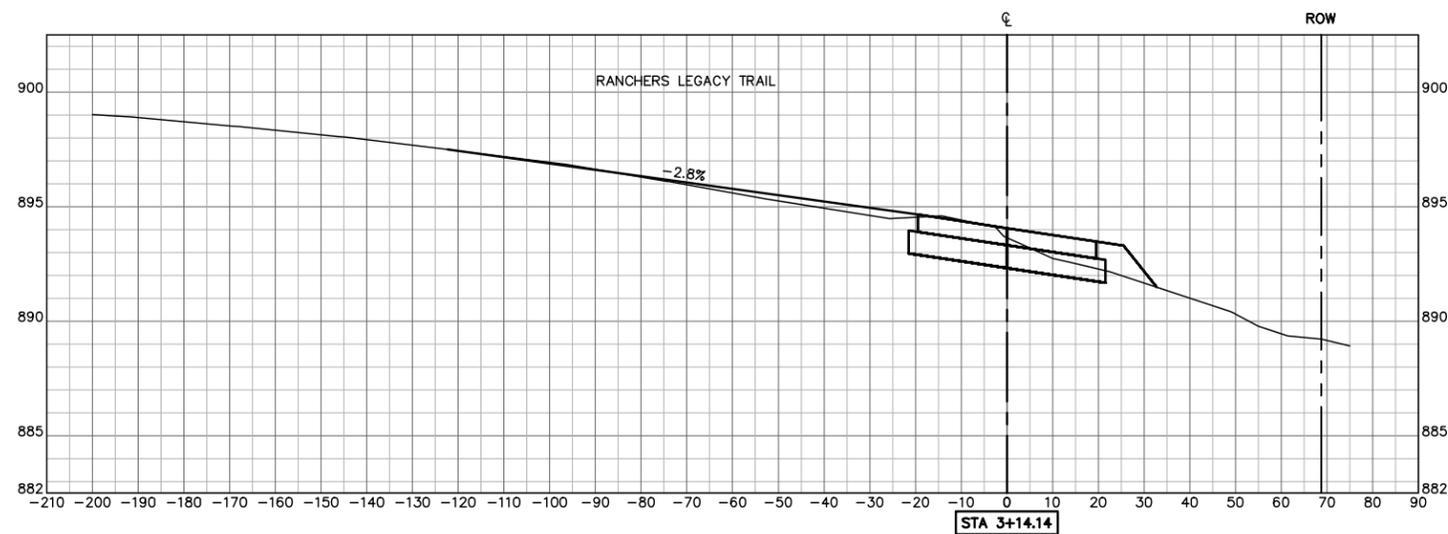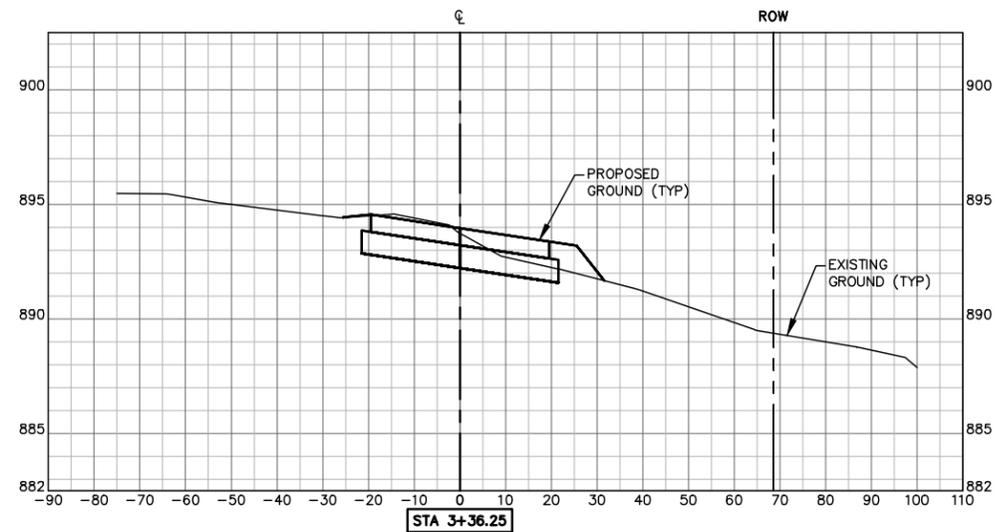

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
 STA 3+14.14 TO STA 3+36.25






**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	14

CKT:JNER  
 05/02/2023 11:34AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\ 2018\5460-22.506\_XSEC.DWG

MARKUM RANCH ROAD WIDENING

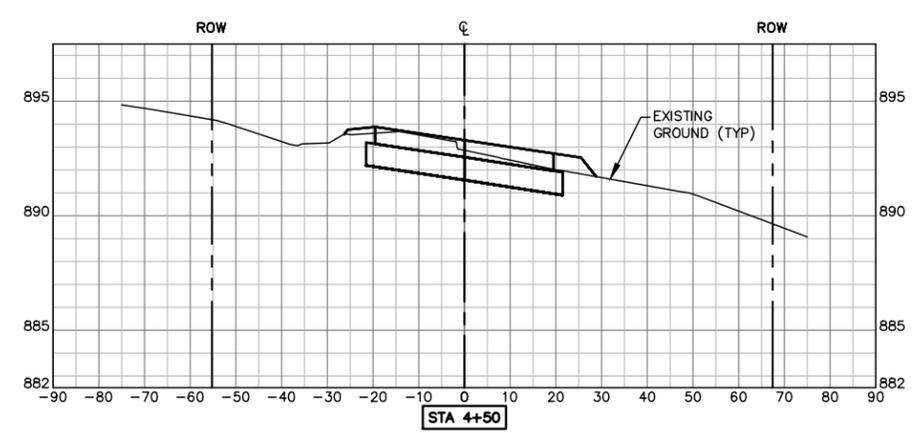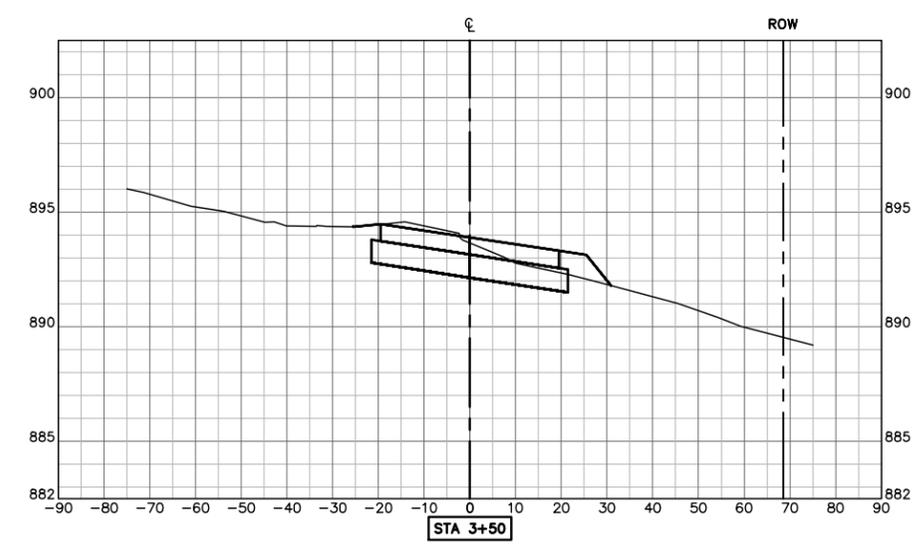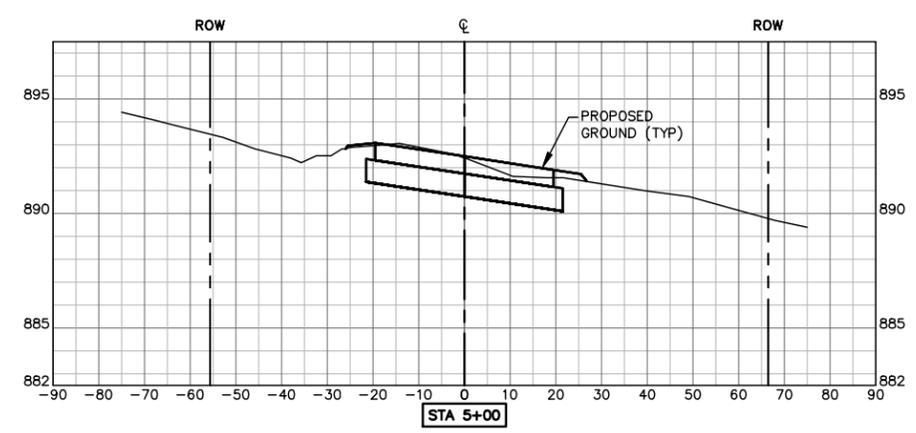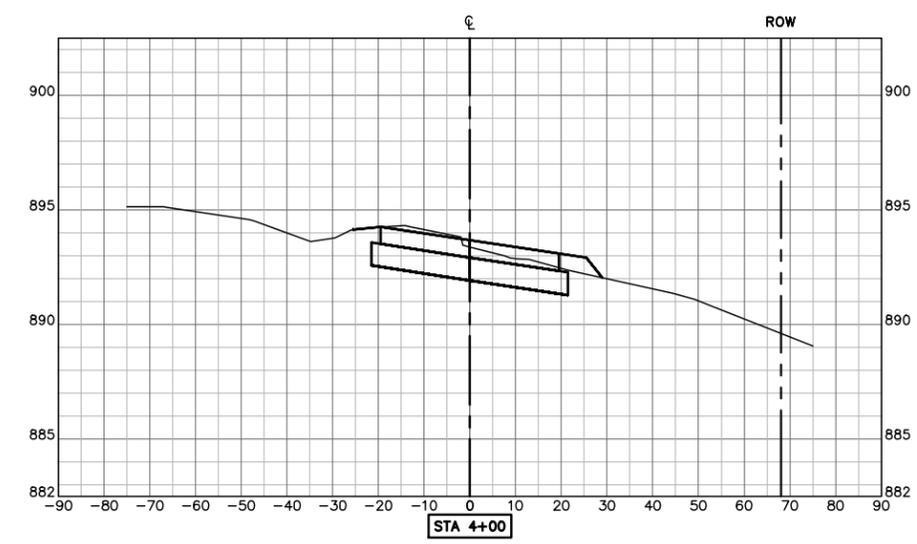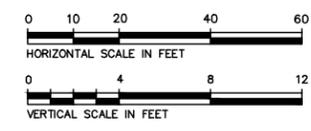

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company

4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
STA 3+50 TO STA 5+00








**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	15

CKT:JNER  
 05/02/2023 11:34AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

MARKUM RANCH ROAD WIDENING

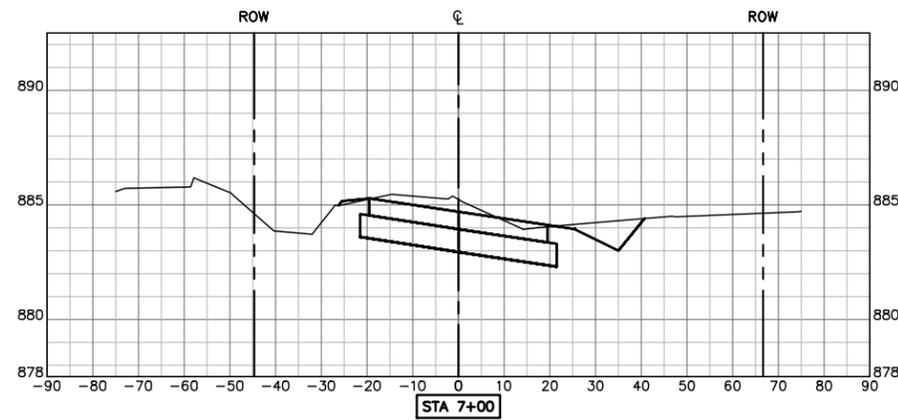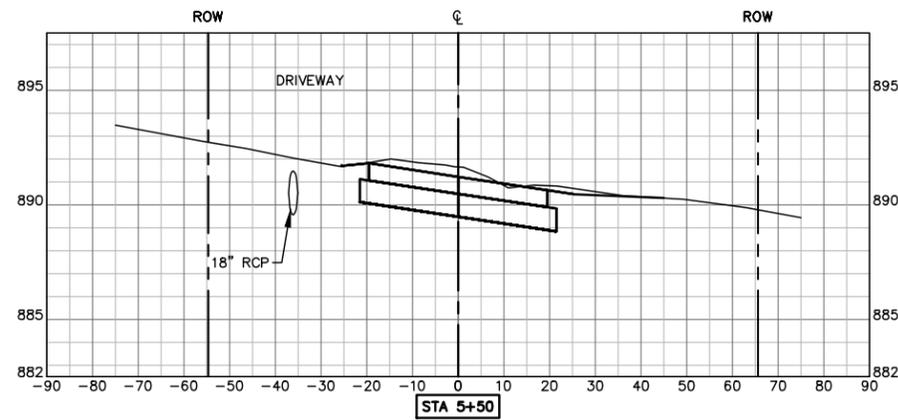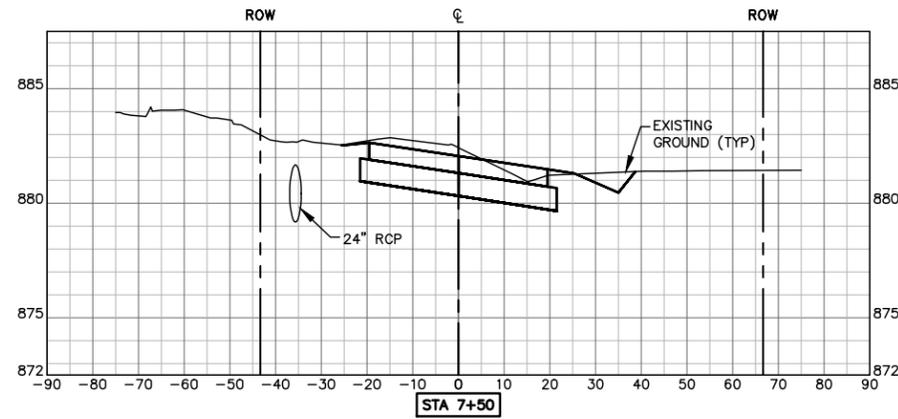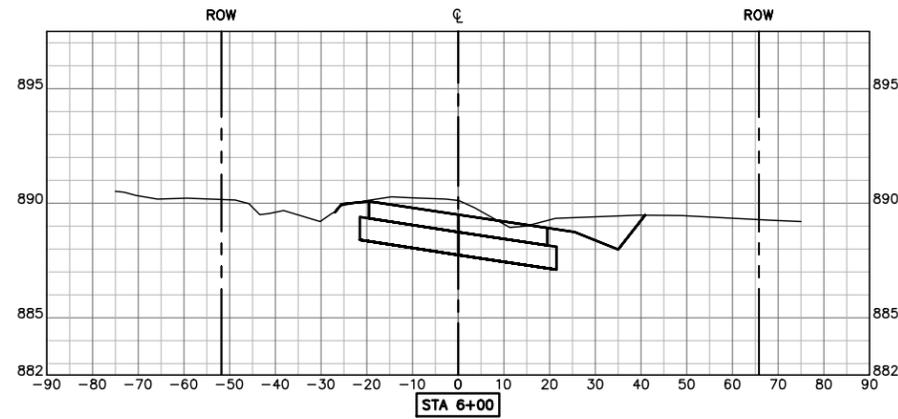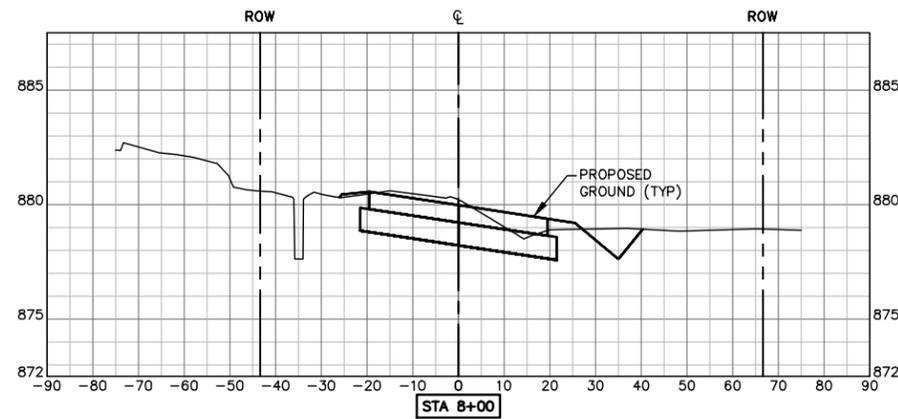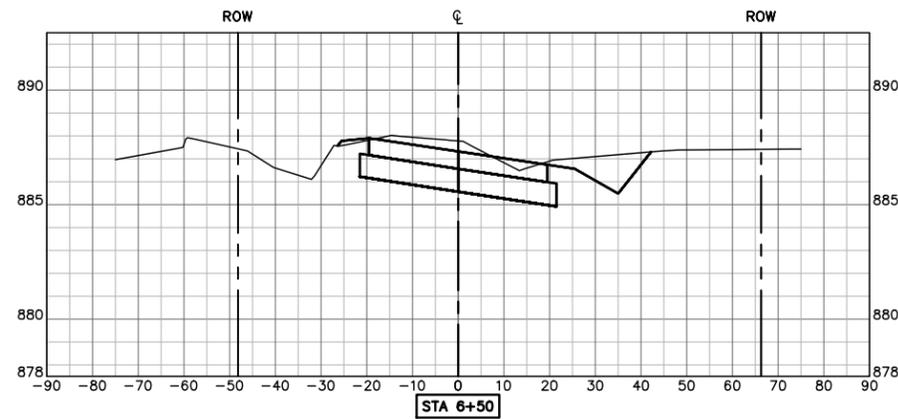

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
 STA 5+50 TO STA 8+00






**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	16

CKT:JNER  
 05/02/2023 - 11:34AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\CS0\_2018\5460-22.506\_XSEC.DWG

MARKUM RANCH ROAD WIDENING

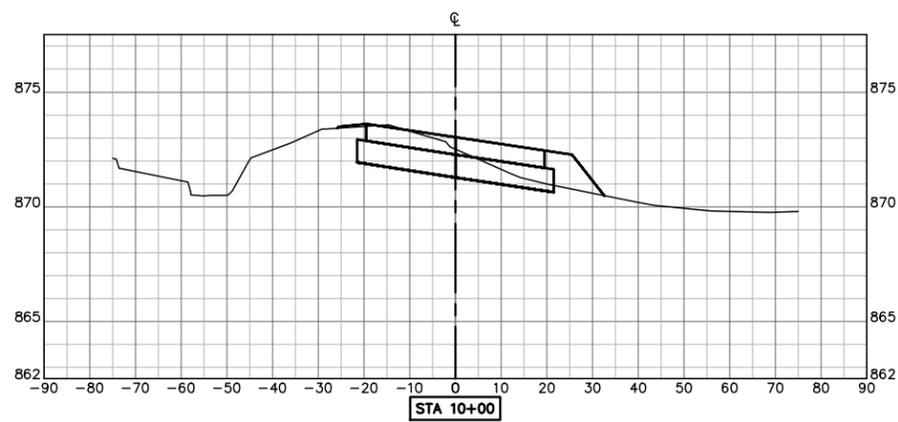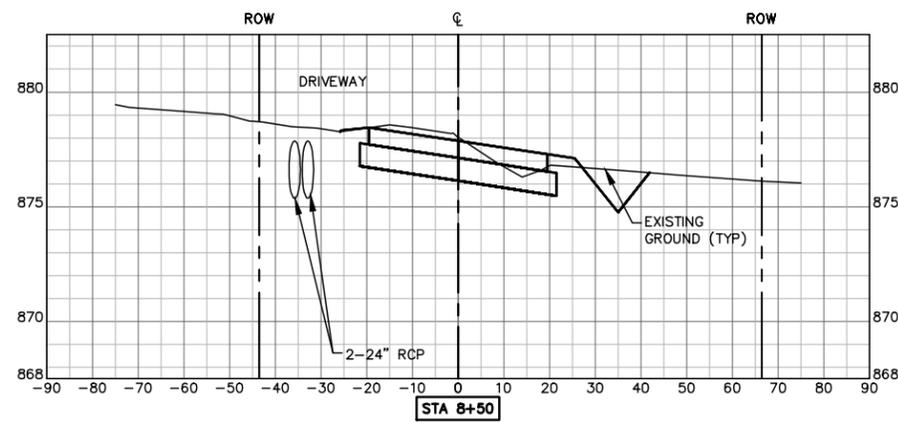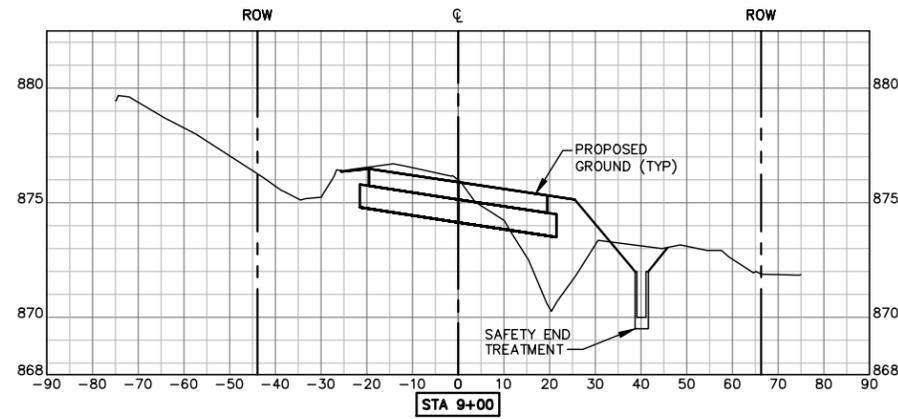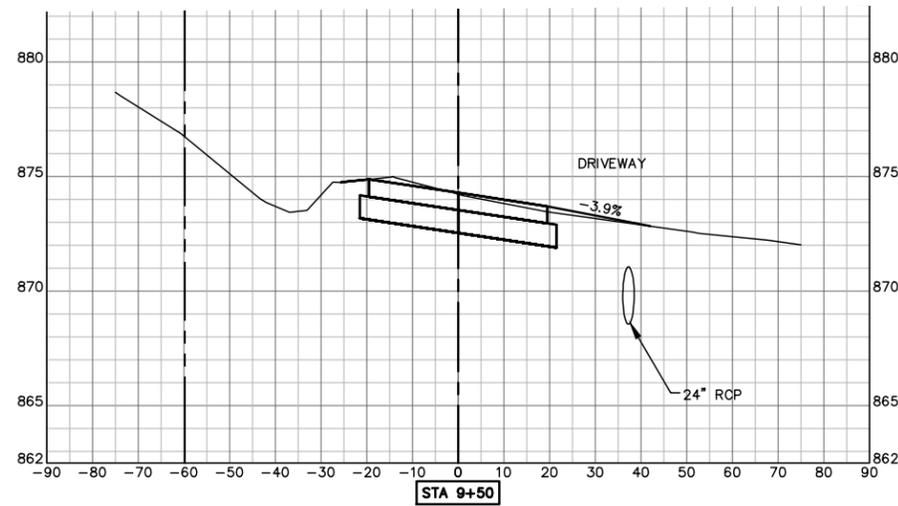

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
STA 8+50 TO STA 10+00

**MARKUM RANCH ROAD WIDENING**




TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	17

CKT:JNER  
 05/02/2023 - 11:34AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

MARKUM RANCH ROAD WIDENING

CKT:JMR  
 05/02/2023 - 11:34AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

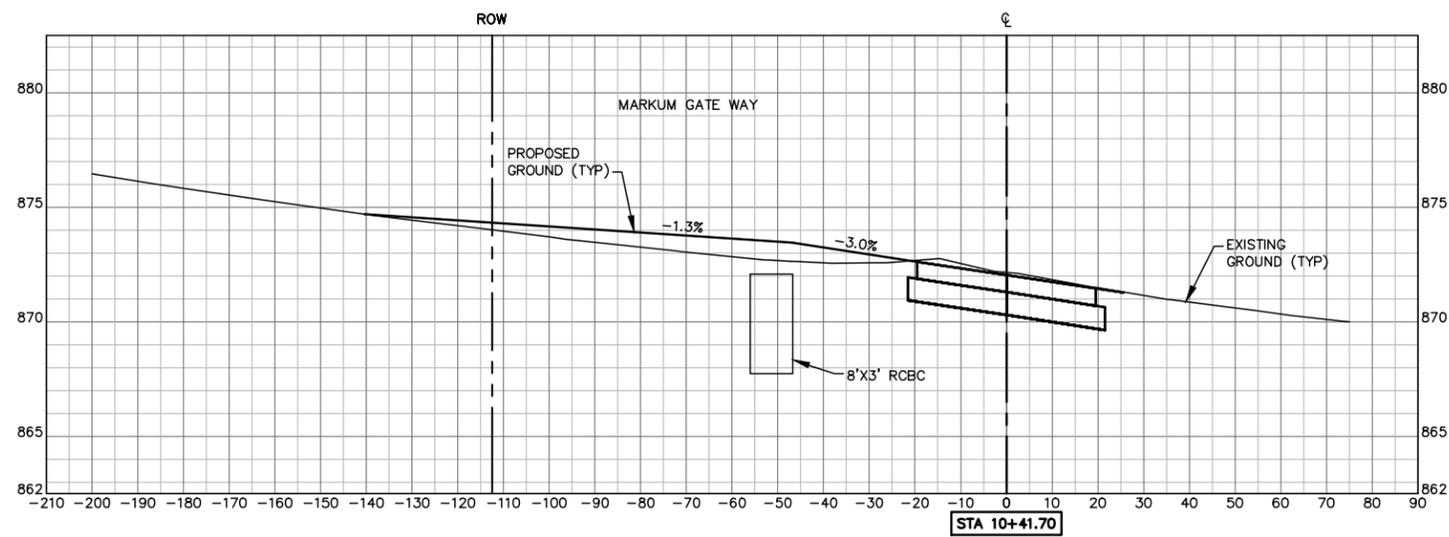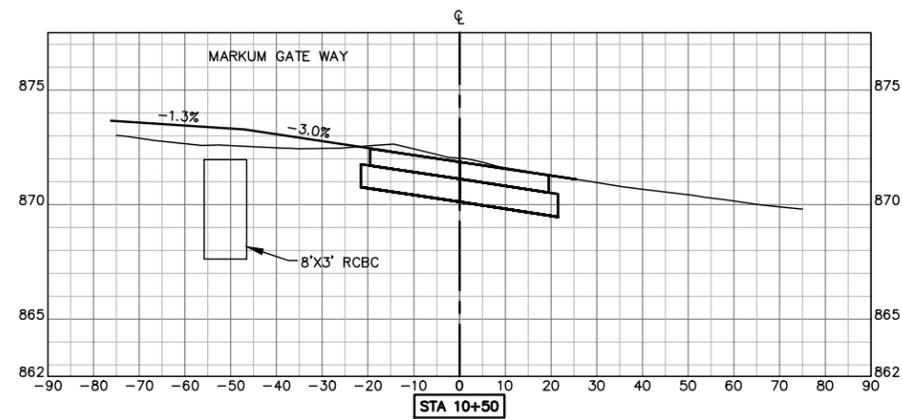

THE SEAL APPEARING ON THIS DOCUMENT WAS  
 AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON  
 05/02/2023. ALTERATION OF A SEALED DOCUMENT  
 WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE  
 ENGINEER IS AN OFFENSE UNDER THE TEXAS  
 ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
 STA 10+41.70 TO STA 10+50






**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	18

MARKUM RANCH ROAD WIDENING

CKT:JNER  
 05/02/2023 - 11:34AM  
 N: \\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

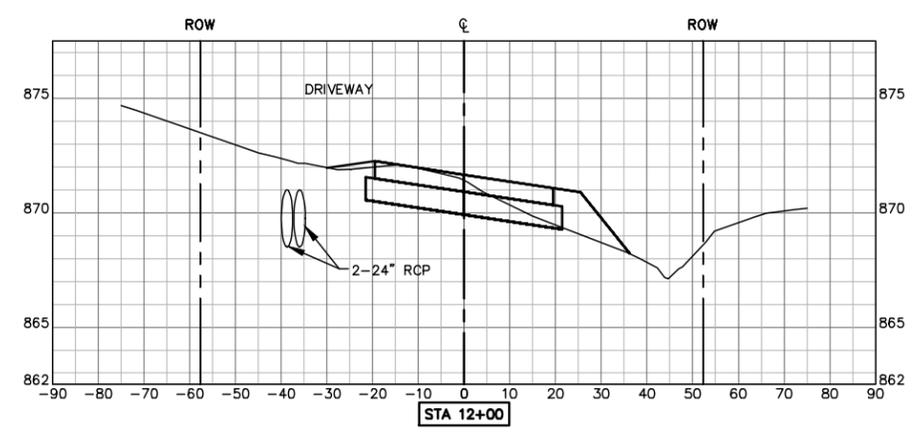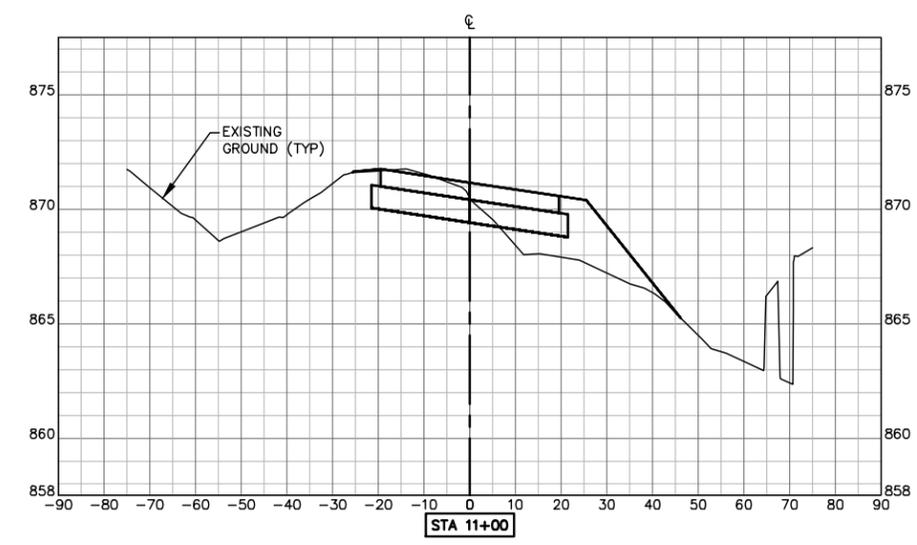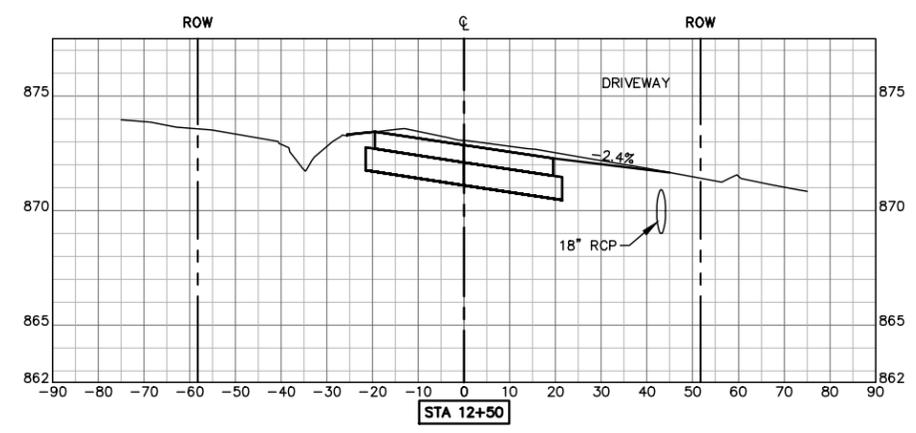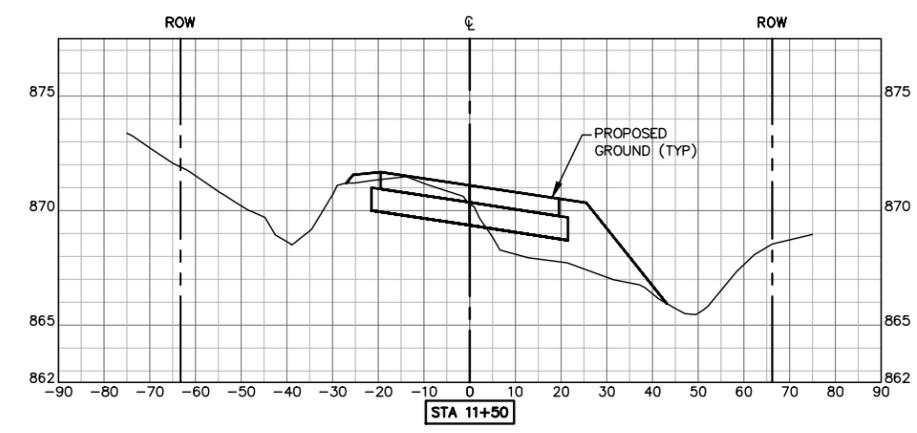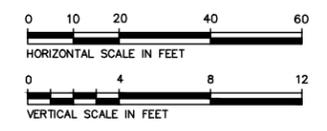

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001








PAVING CROSS SECTIONS  
 STA 11+00 TO STA 12+50

**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	19

MARKUM RANCH ROAD WIDENING

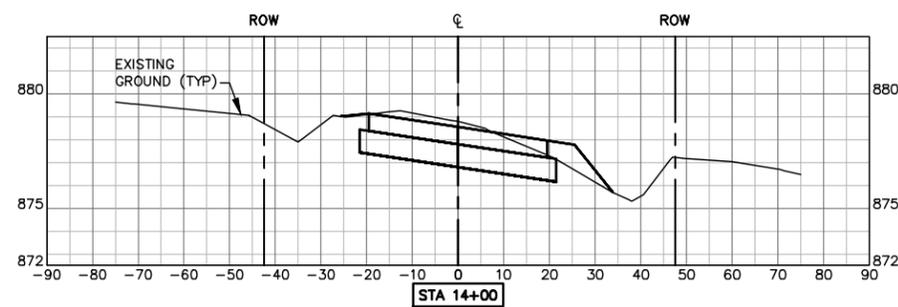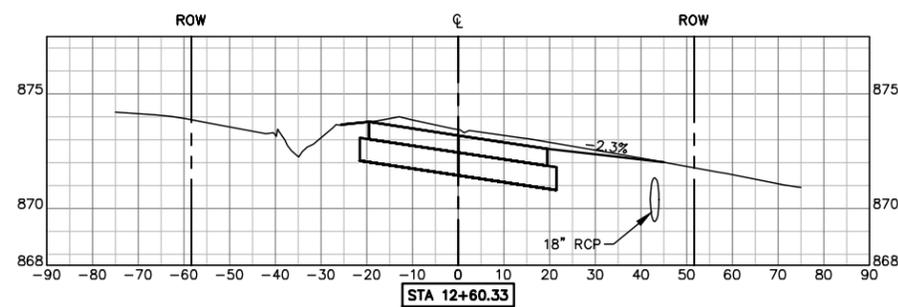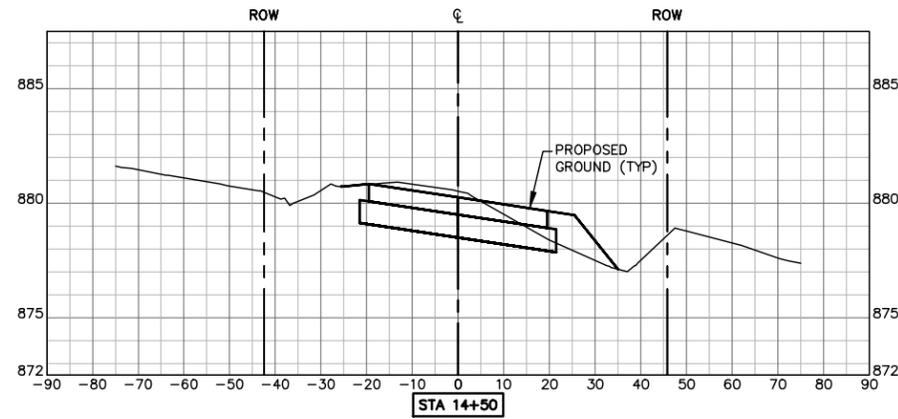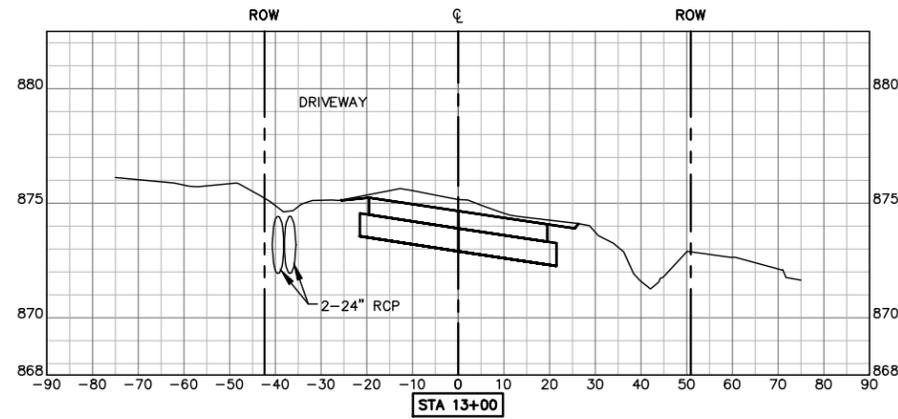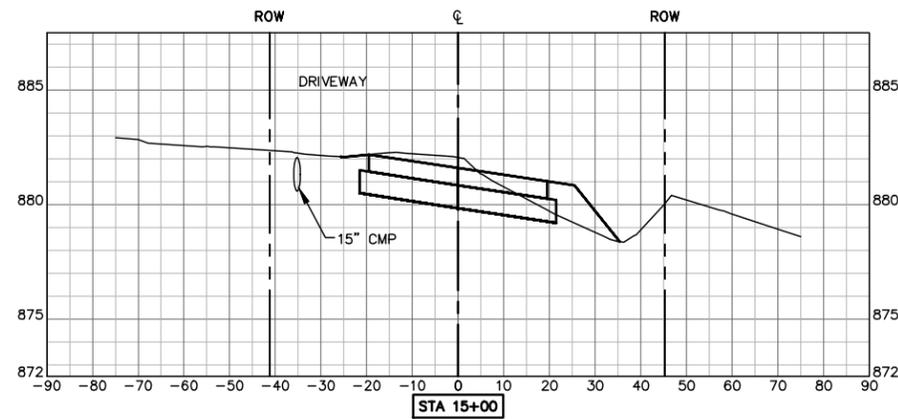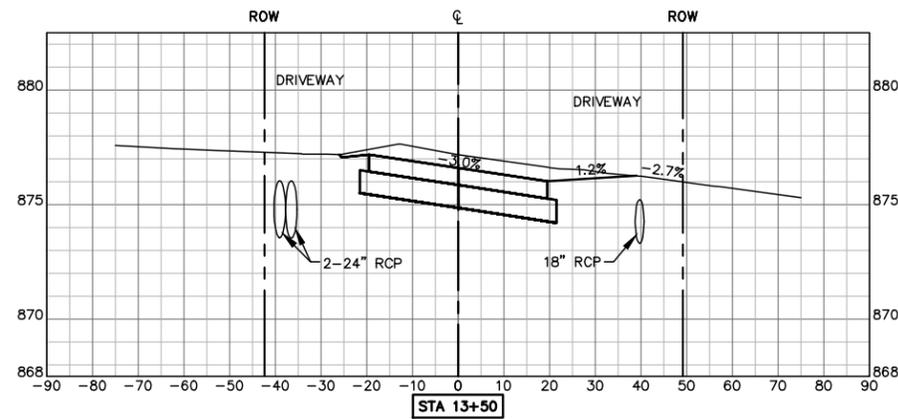

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
STA 12+60.33 TO STA 15+00

**MARKUM RANCH ROAD WIDENING**






TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	20

CKT:JNER  
 05/02/2023 - 11:34AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

MARKUM RANCH ROAD WIDENING

CKT:JNER  
 05/02/2023 11:34AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

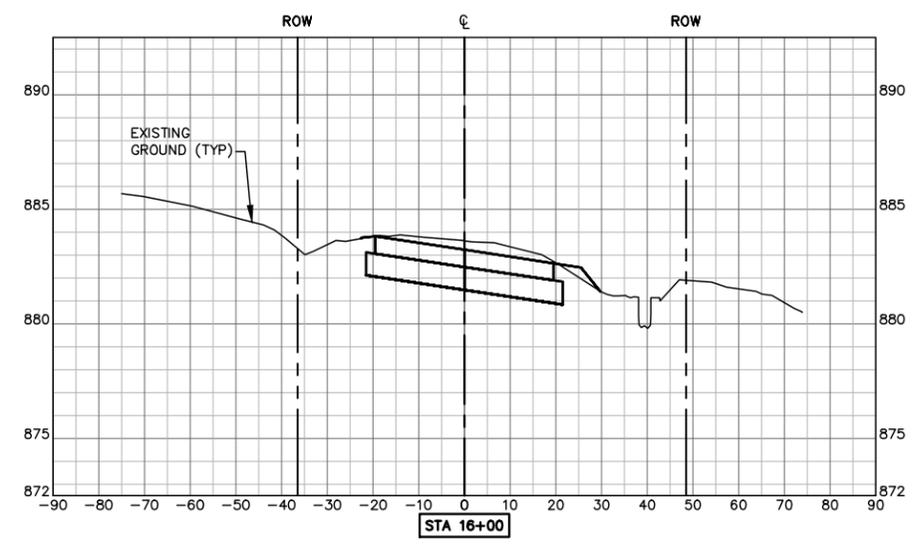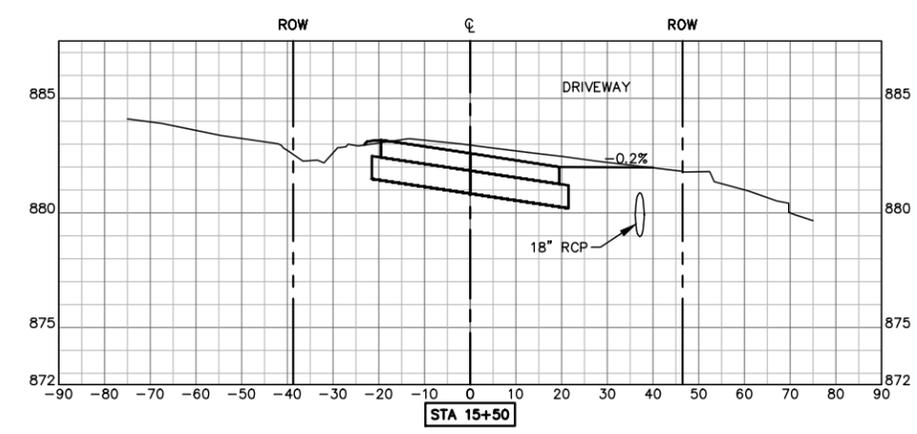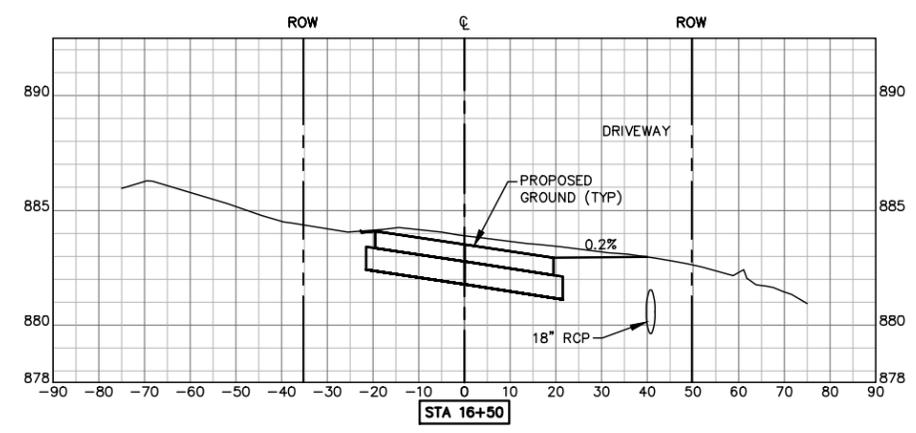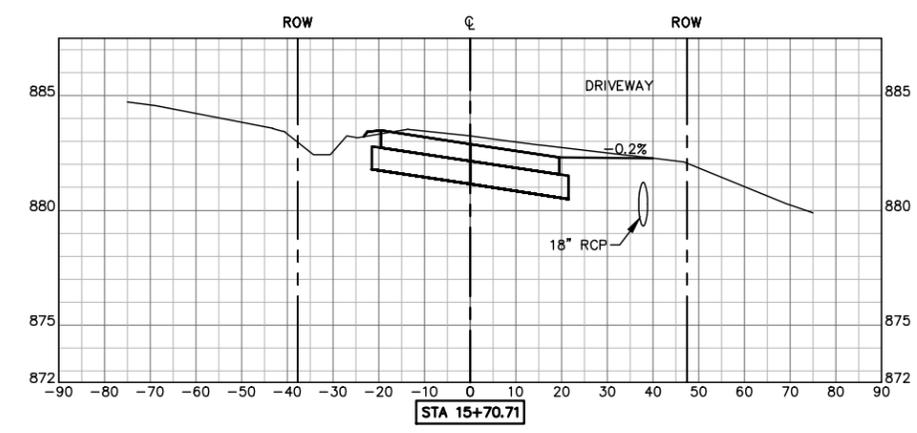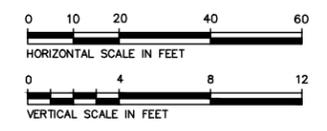

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
 STA 15+50 TO STA 16+50






**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	21

MARKUM RANCH ROAD WIDENING

CKT/NER  
 05/02/2023 - 11:34AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_XSEC.DWG

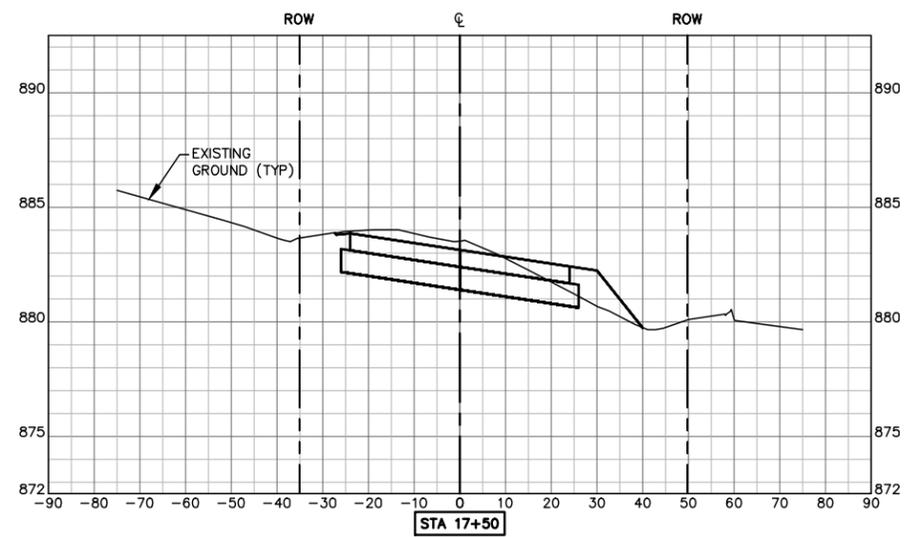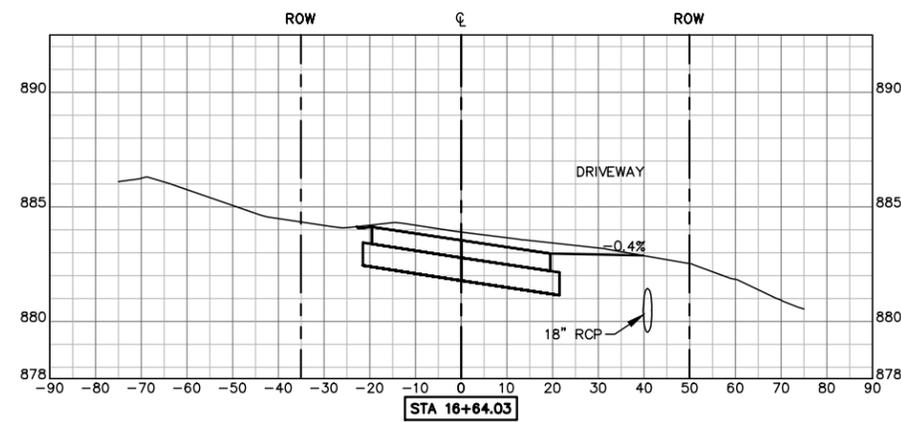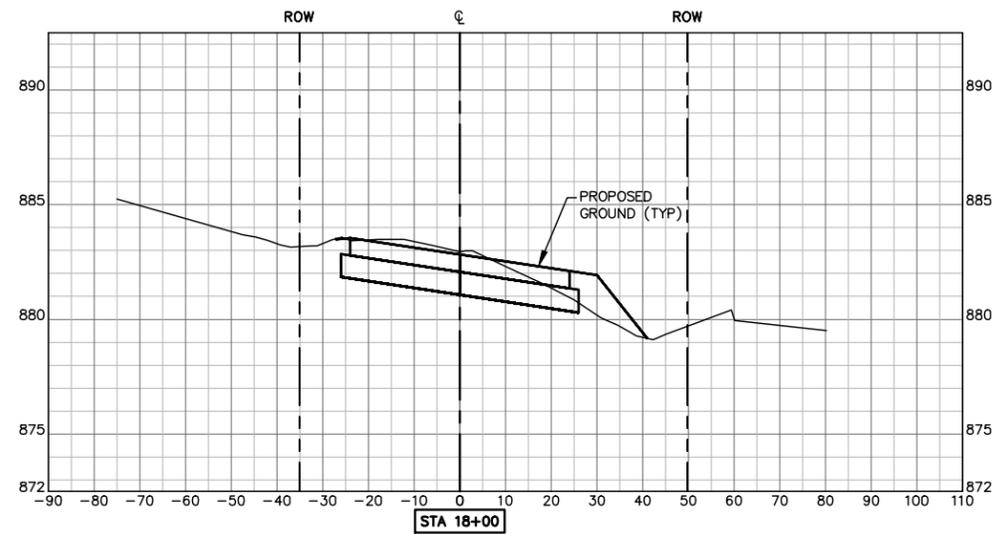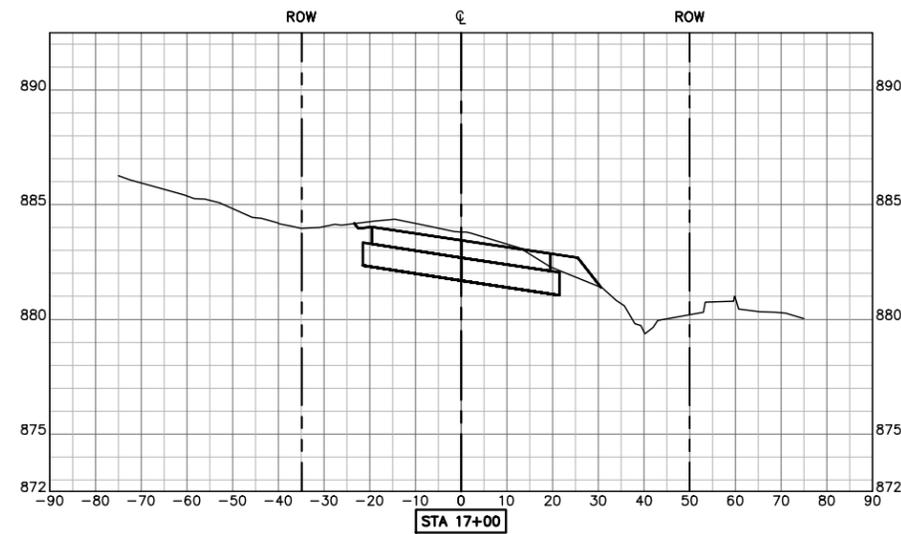

THE SEAL APPEARING ON THIS DOCUMENT WAS  
 AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON  
 05/02/2023. ALTERATION OF A SEALED DOCUMENT  
 WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE  
 ENGINEER IS AN OFFENSE UNDER THE TEXAS  
 ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001







PAVING CROSS SECTIONS  
 STA 16+64.03 TO STA 18+00

**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	22

MARKUM RANCH ROAD WIDENING

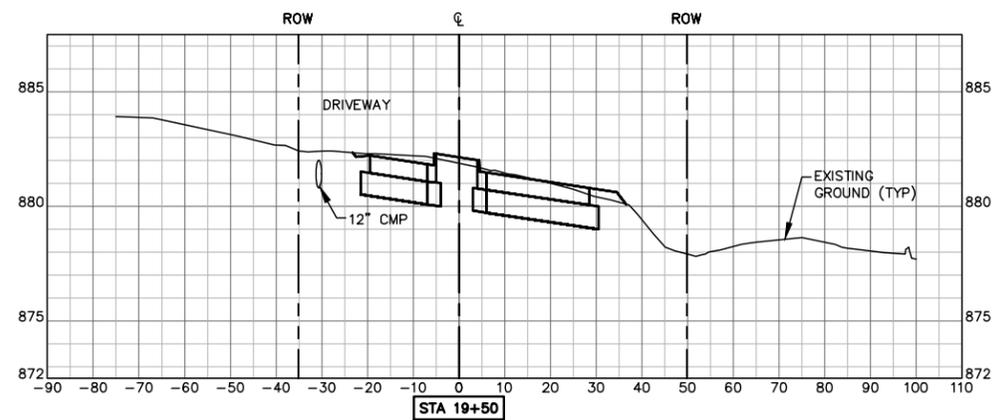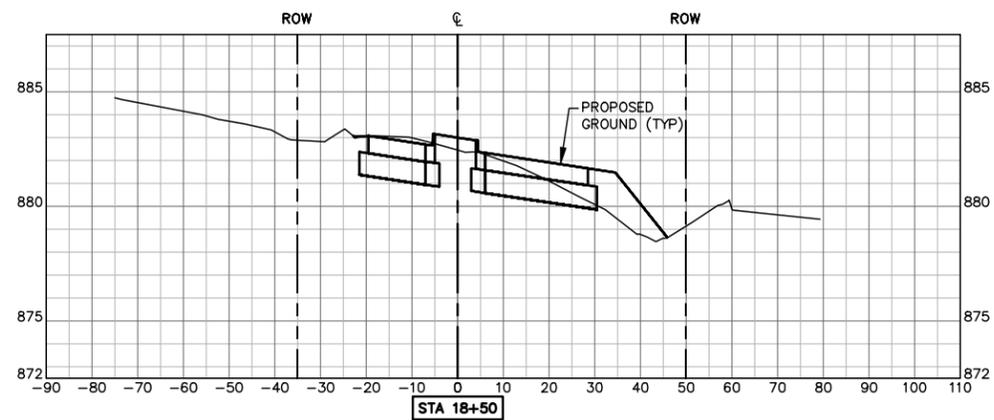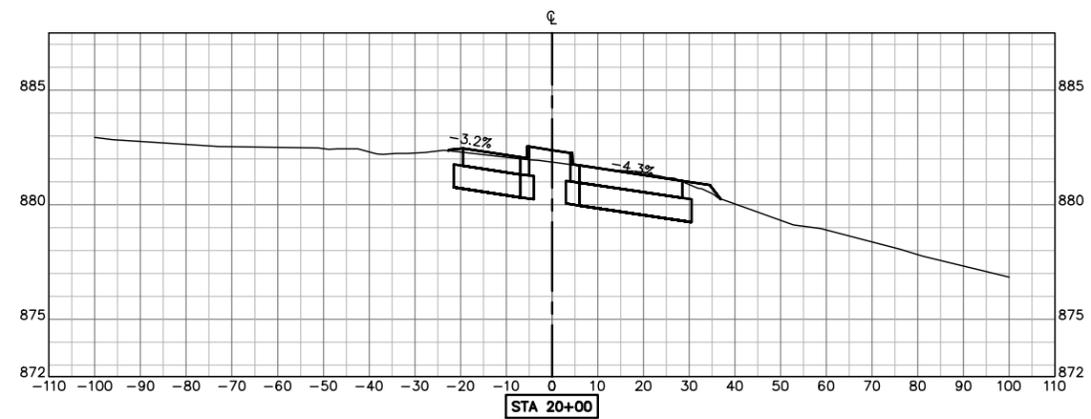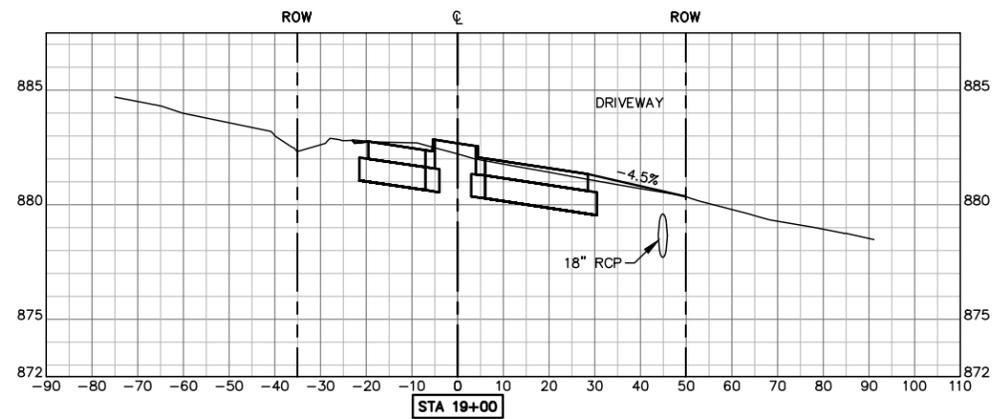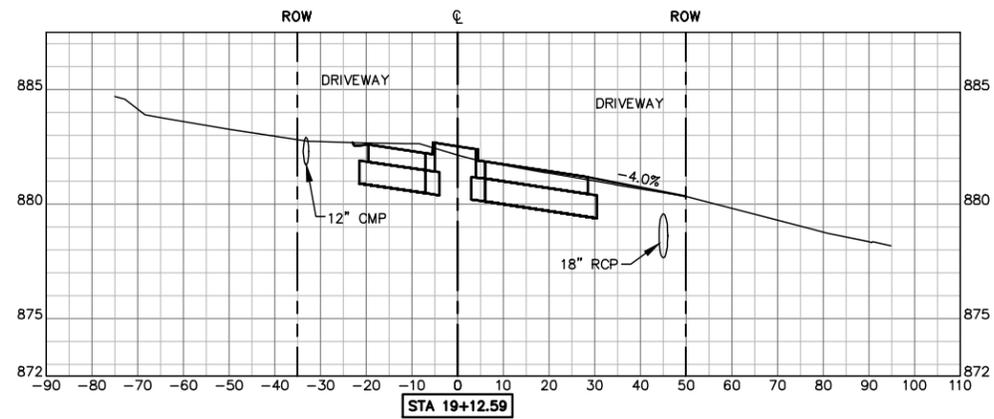

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company

4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

PAVING CROSS SECTIONS  
STA 18+50 TO STA 20+00

**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	23


CKT:JNER  
 05/02/2023 11:35AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D 2018\5460-22.506\_XSEC.DWG

MARKUM RANCH ROAD WIDENING



**LEGEND**

- PROPOSED DRAINAGE DIVIDE
- DRAINAGE FLOW DIRECTION
- DRAINAGE AREA ID  
AREA IN ACRES  
Q<sub>100</sub> IN FT<sup>3</sup>/SECOND
- 571 CONTOUR

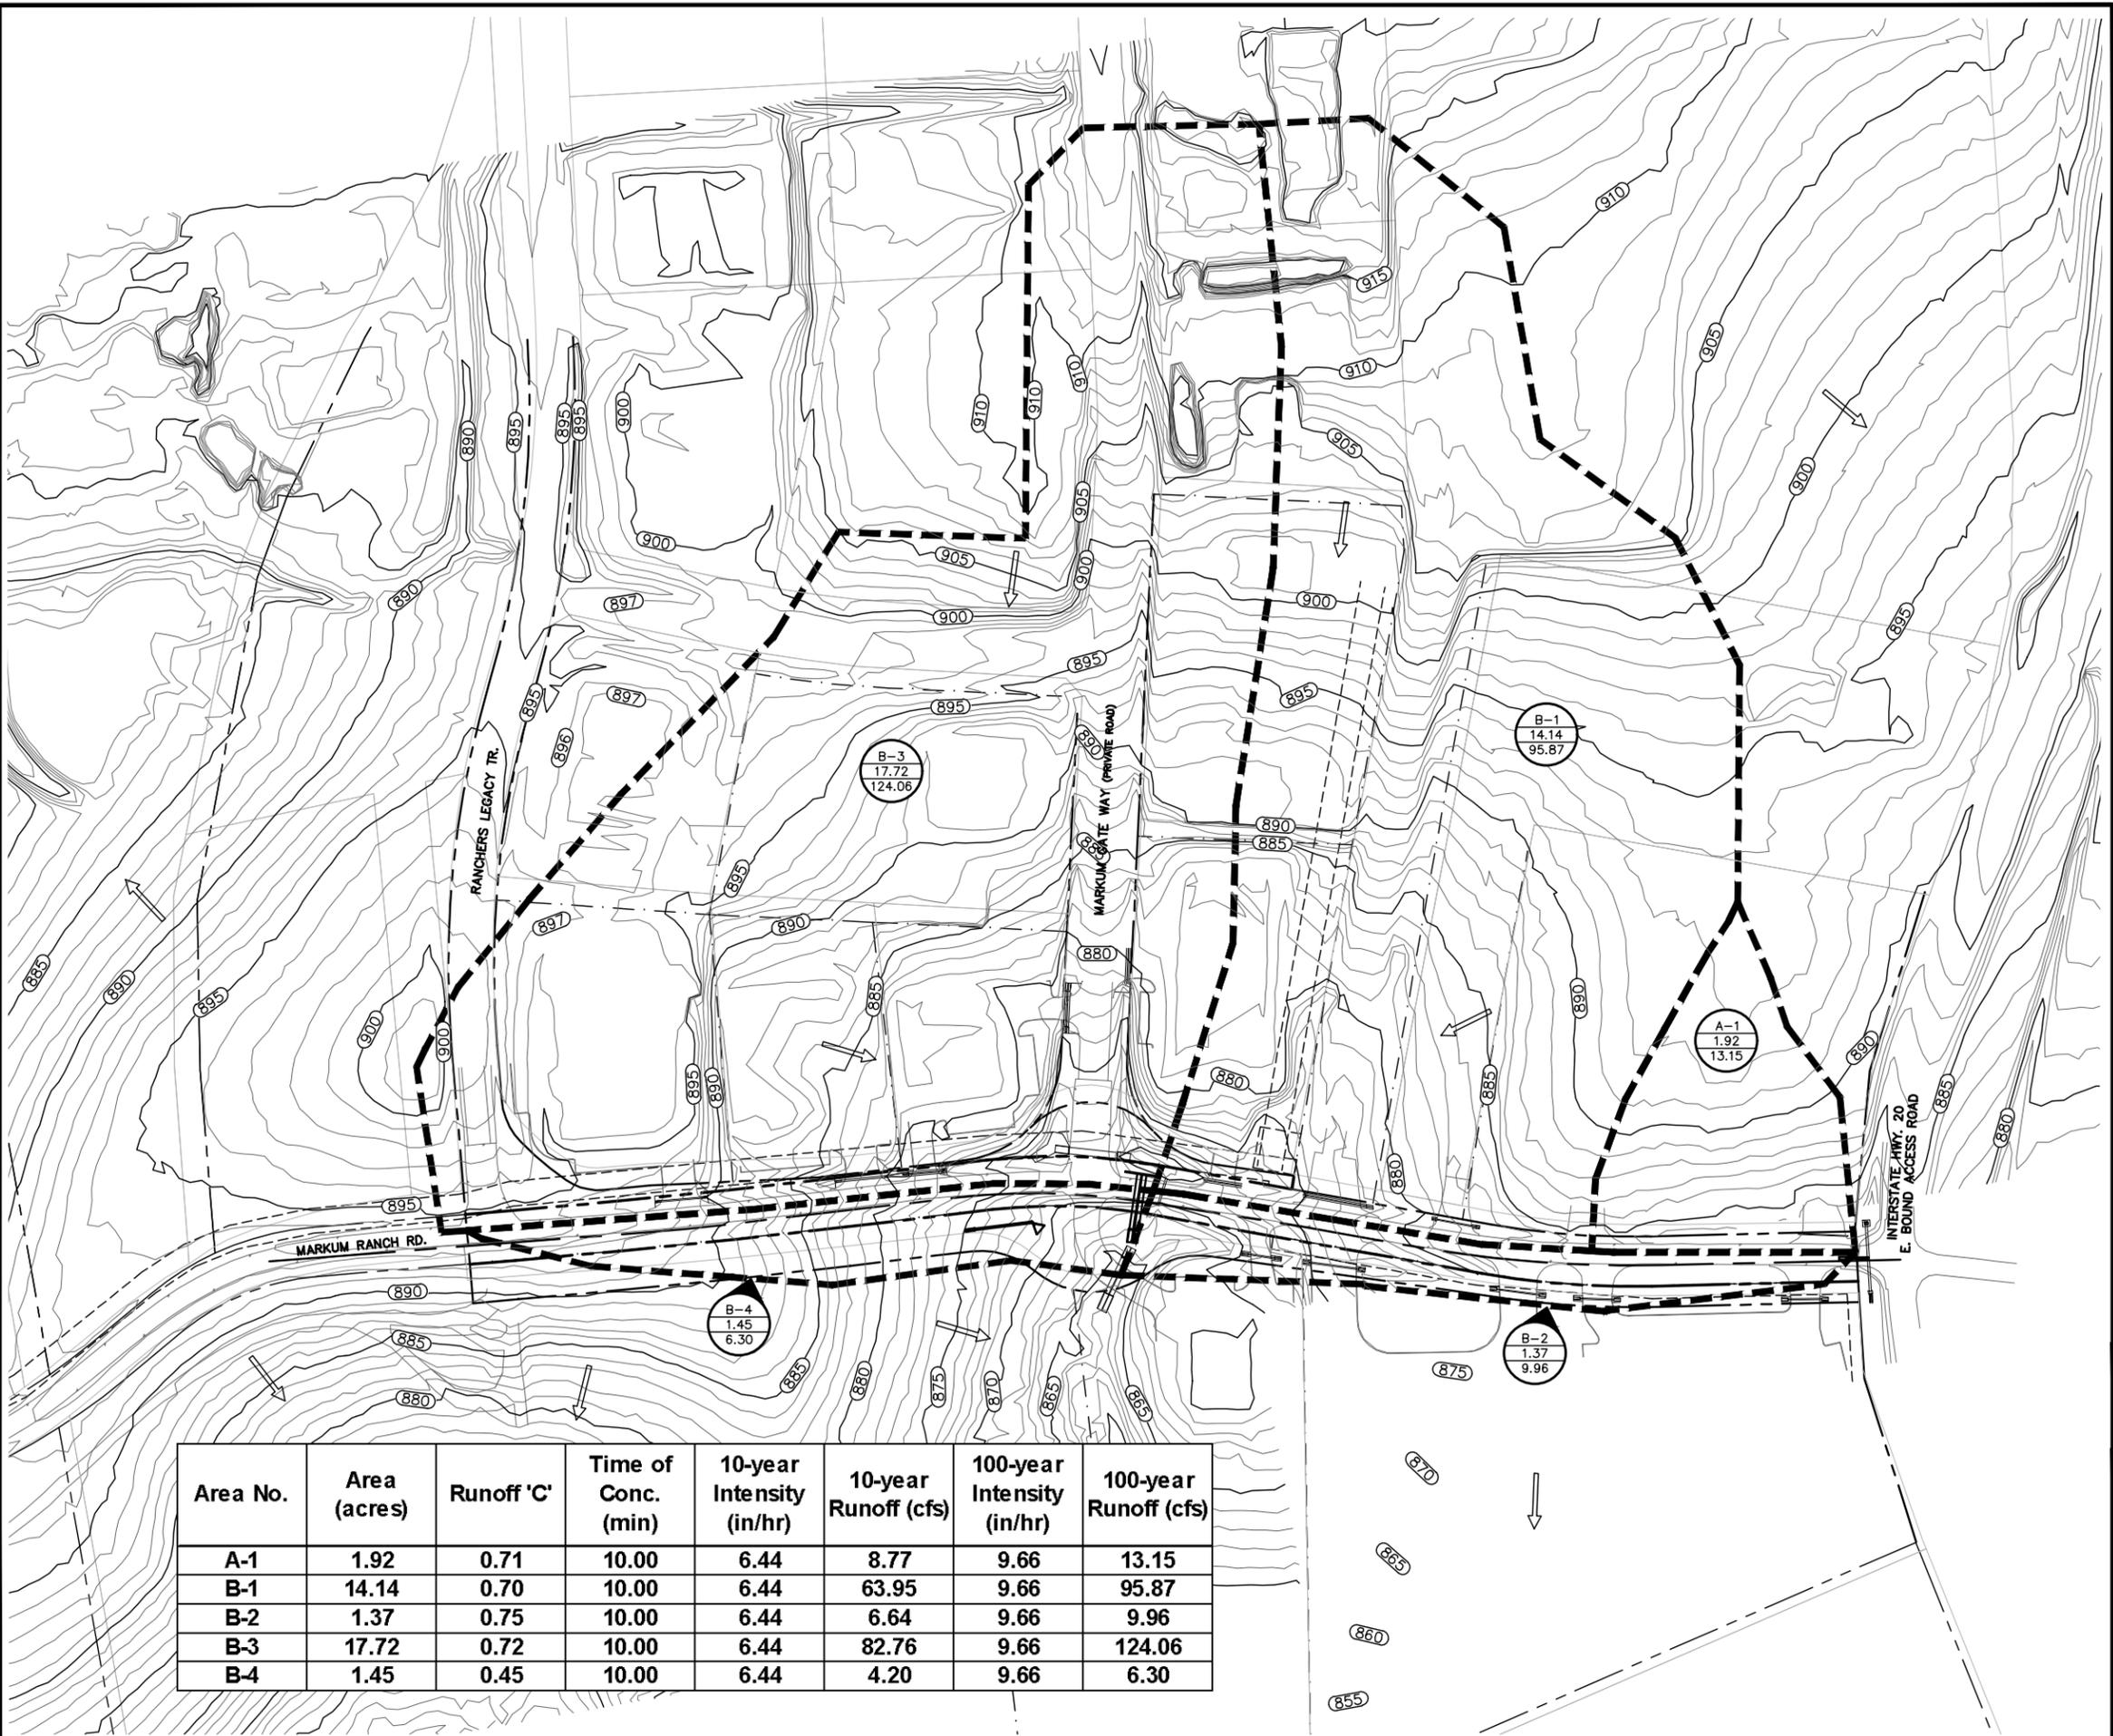

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

Area No.	Area (acres)	Runoff 'C'	Time of Conc. (min)	10-year Intensity (in/hr)	10-year Runoff (cfs)	100-year Intensity (in/hr)	100-year Runoff (cfs)
A-1	1.92	0.71	10.00	6.44	8.77	9.66	13.15
B-1	14.14	0.70	10.00	6.44	63.95	9.66	95.87
B-2	1.37	0.75	10.00	6.44	6.64	9.66	9.96
B-3	17.72	0.72	10.00	6.44	82.76	9.66	124.06
B-4	1.45	0.45	10.00	6.44	4.20	9.66	6.30

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company

4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-1000801

DRAINAGE AREA MAP


**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	24



CKT:JMR  
 05/02/2023 - 11:36AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\330\_2018\MARKUM\_RANCH\_DAM.DWG

MARKUM RANCH ROAD WIDENING



LEGEND

- ◇ FIRE HYDRANT
- WATER METER
- ⊙ WATER VALVE
- ⊙ WATER MANHOLE
- ▽ SPRINKLER HEAD
- ⊠ SPRINKLER CONTROL BOX
- ⊠ HOSE BIB
- ⊙ STORM DRAIN MANHOLE
- ⊙ SANITARY SEWER MANHOLE
- ⊙ SANITARY SEWER CLEANOUT
- ⊙ POWER POLE
- ⊙ POWER POLE ANCHOR
- ⊙ LIGHT POLE
- ⊙ GROUND LIGHT
- ⊙ ELECTRIC MANHOLE
- ⊙ UNDERGROUND ELECTRIC MARKER
- ⊙ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ⊙ ELECTRIC METER
- ⊙ PHONE MANHOLE
- ⊙ BURIED PHONE LINE
- ⊙ PHONE RISER
- ⊙ GAS METER
- ⊙ GAS VALVE
- ⊙ UNDERGROUND GAS MARKER
- ⊙ GAS MANHOLE
- ⊙ FENCE LINE
- ⊙ ASPHALT PAVEMENT
- ⊙ TRAFFIC SIGN
- ⊙ BOLLARD POST
- ⊙ MAIL BOX
- OE XFMR
- TLP TSCB
- ESRV EM
- PHMH UPM
- PHR GM
- GV UGM
- ⊙ CMH
- FNC ASPH
- SGN BP
- MB

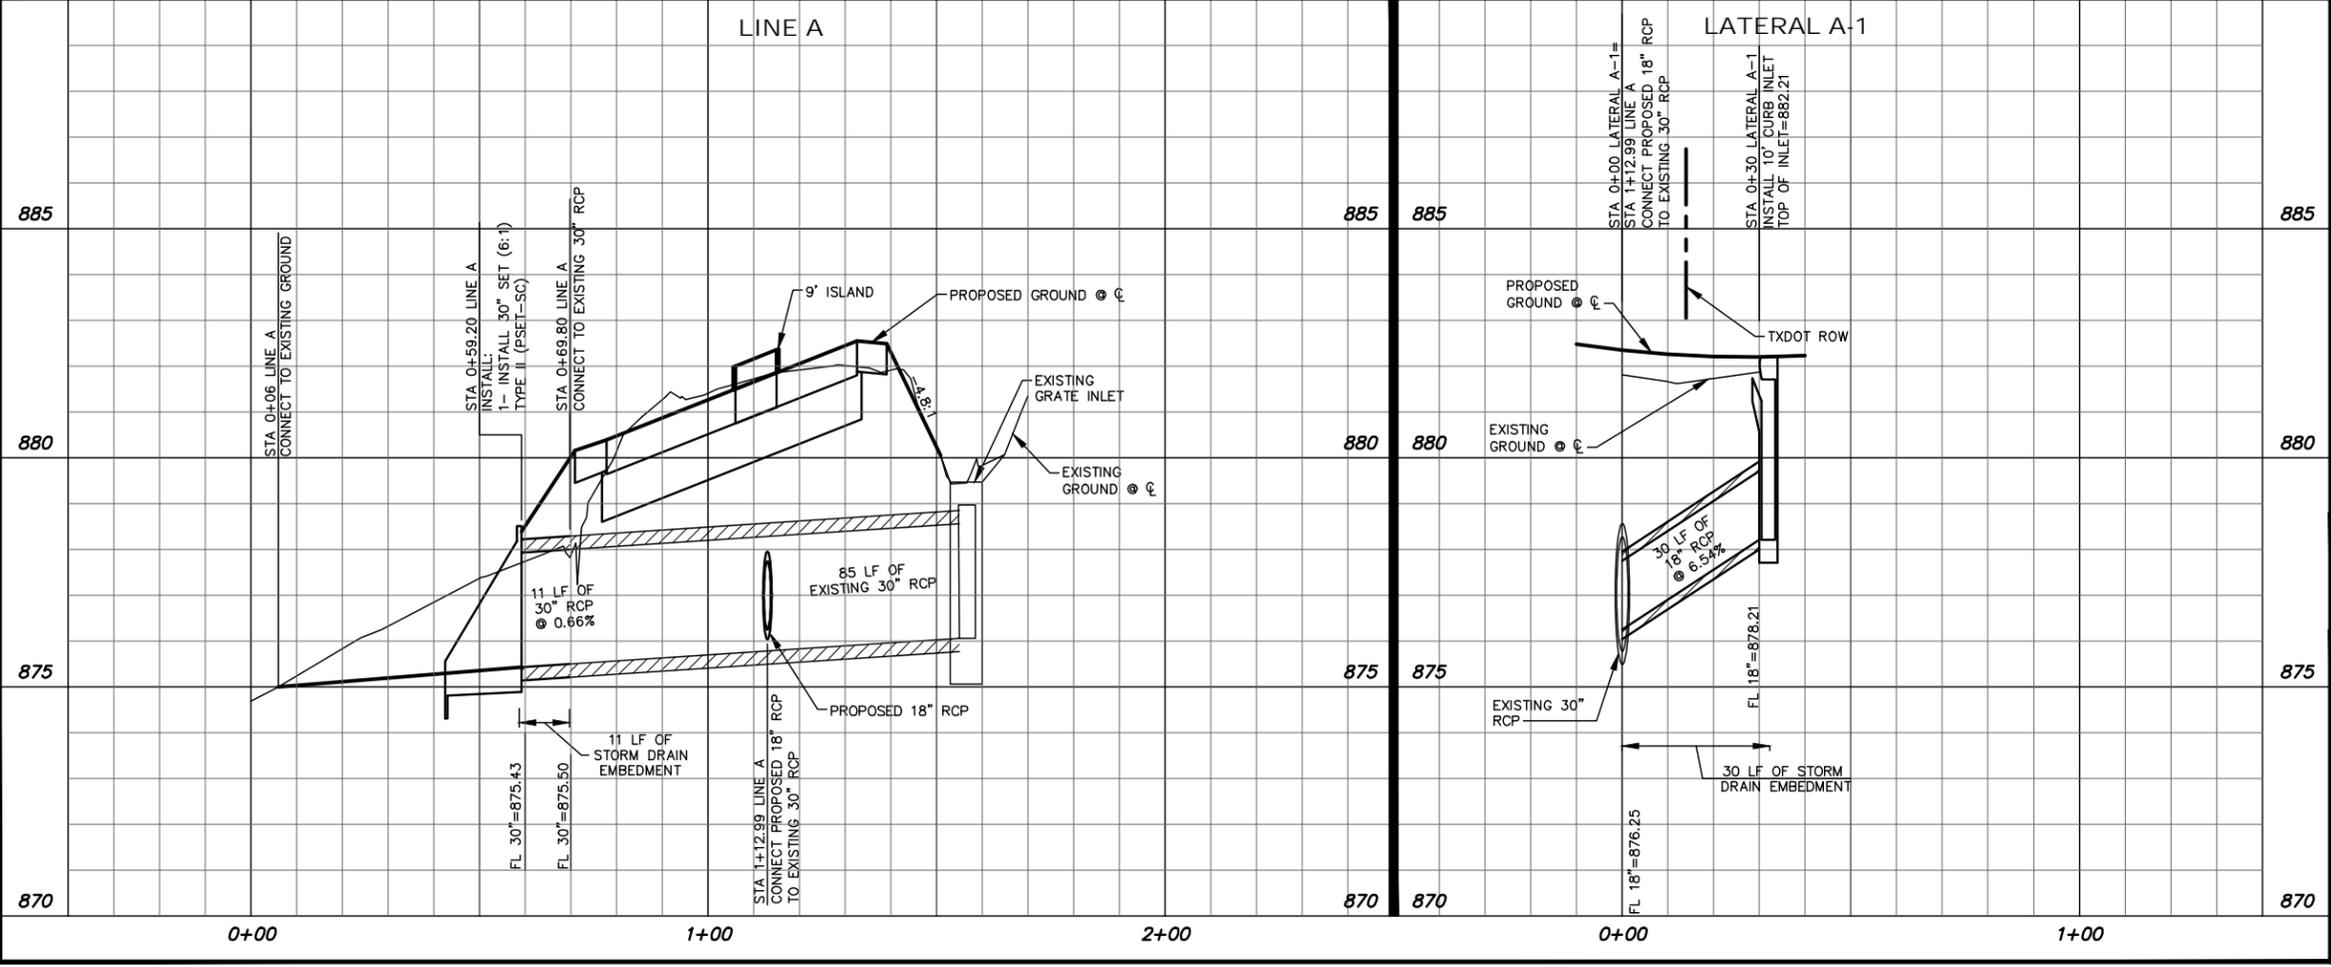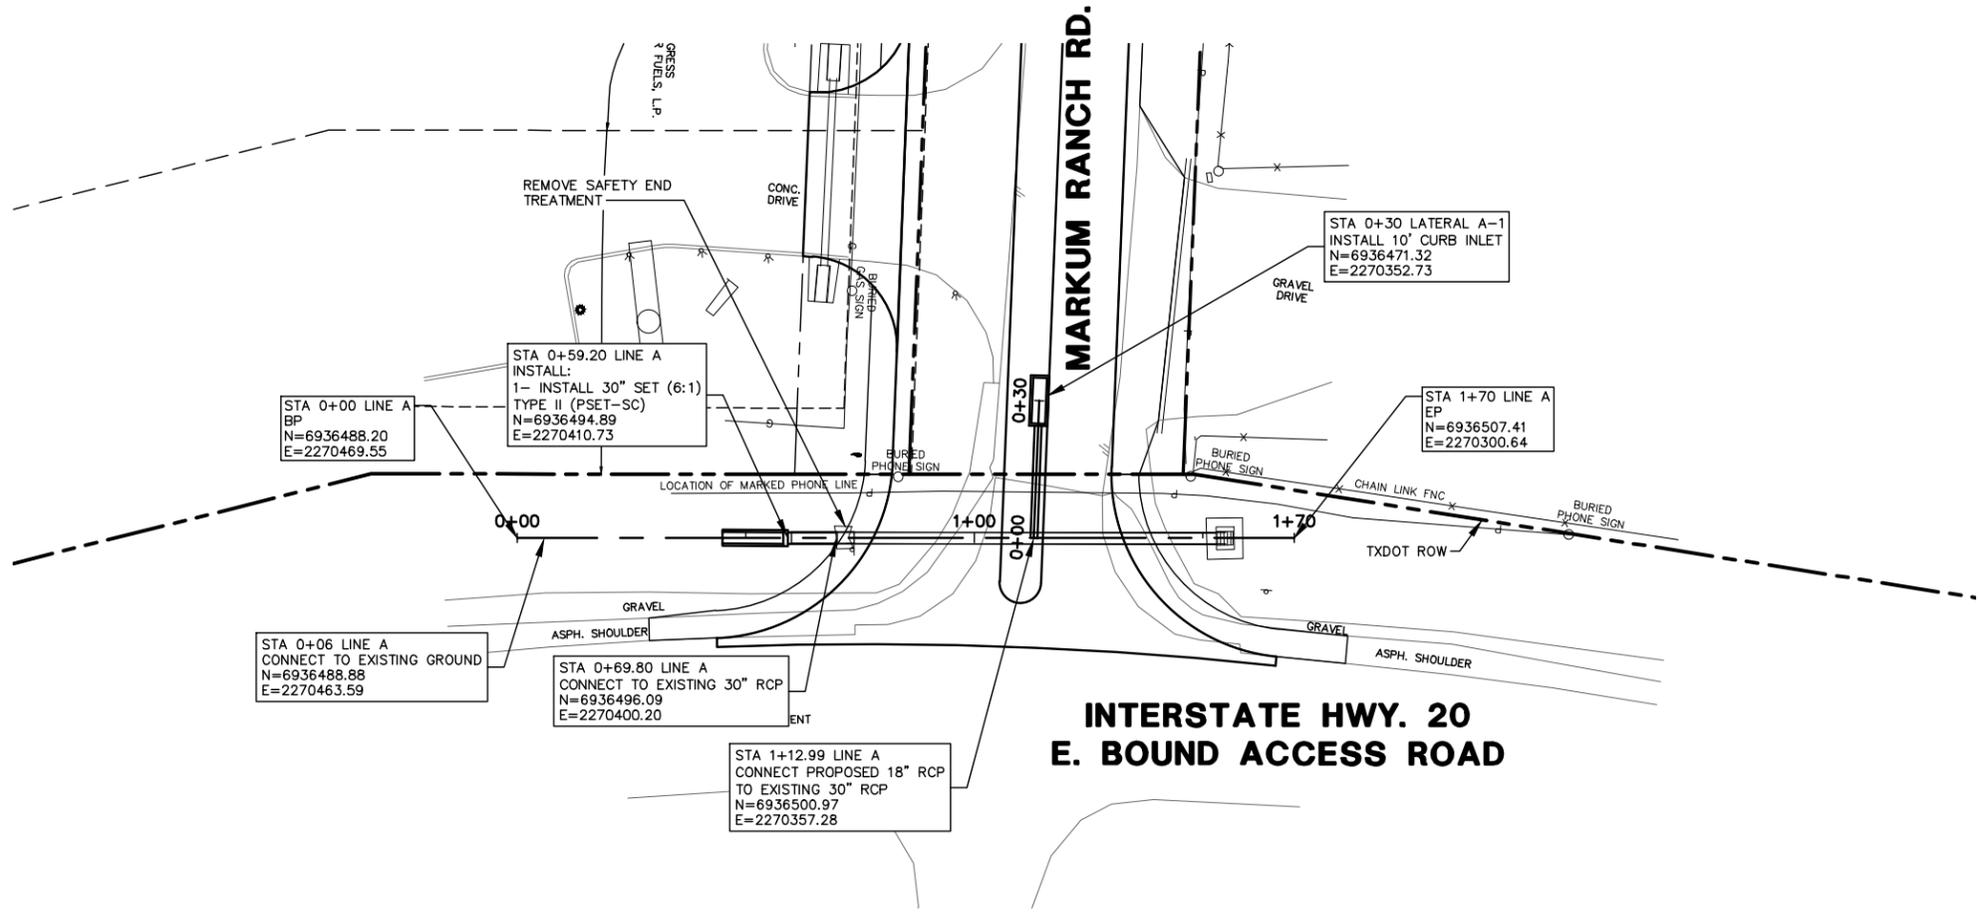



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION
 <small>4060 BRYANT IRVIN ROAD FORT WORTH, TX 76109 817-412-7155 TX REG. ENGINEERING FIRM F-469 TX REG. SURVEYING FIRM LS-10008001</small>		

<b>STORM PLAN &amp; PROFILE</b>				
<b>LINE A &amp; LATERAL A-1</b>				
<b>MARKUM RANCH ROAD WIDENING</b>				
<b>TARRANT COUNTY, TEXAS</b>				
DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	25

CKT:JMR  
 05/02/2023 11:36AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D 2018\5460-22.506\_ST.DWG


MARKUM RANCH ROAD WIDENING

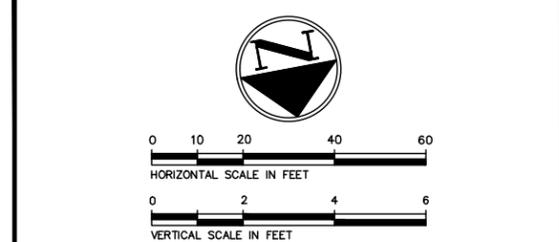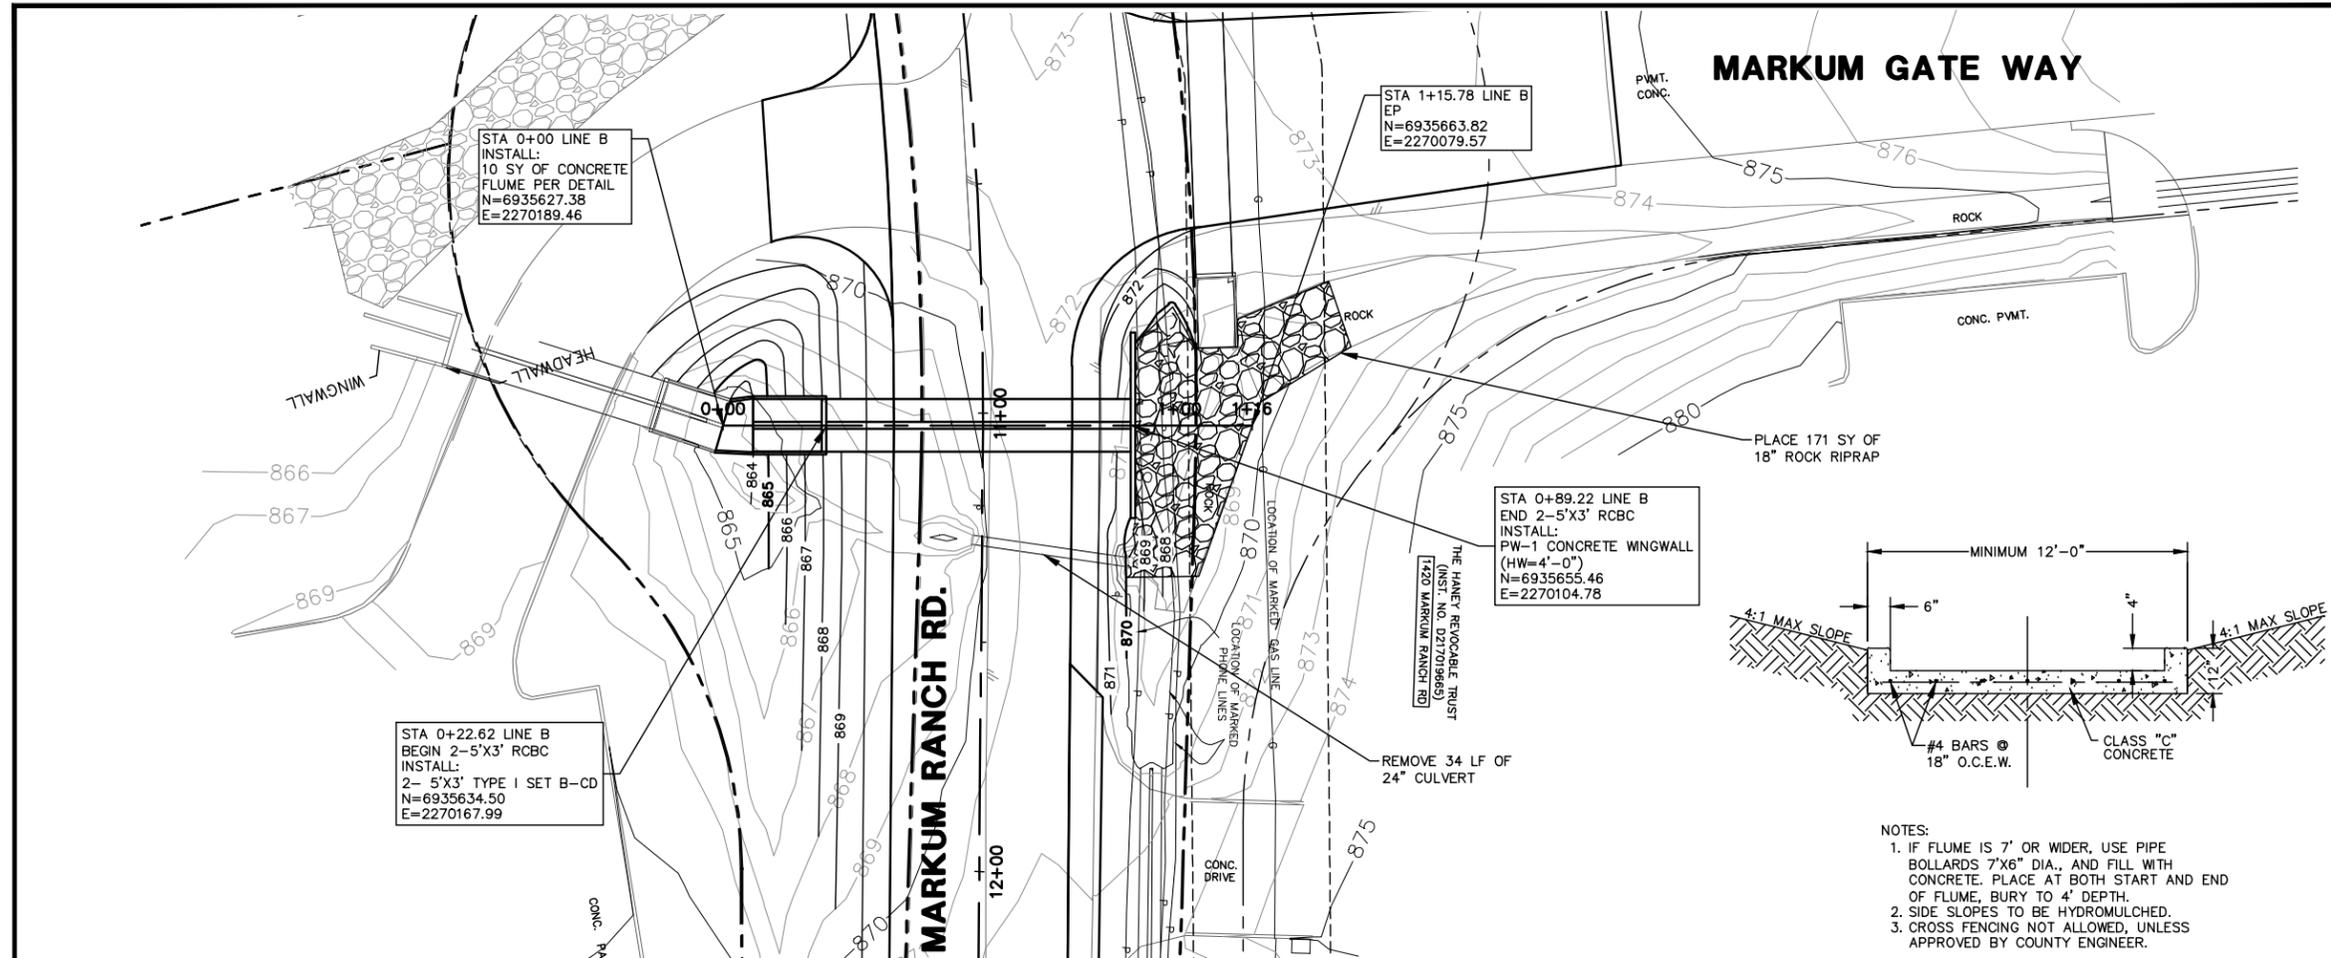

**LEGEND**

◆ FIRE HYDRANT	FH	— OVERHEAD ELECTRIC	OE
● WATER METER	WM	— ELECTRIC TRANSFORMER PAD	XFMR
⊙ WATER VALVE	WV	— TRAFFIC LIGHT POLE	TLP
⊙ WATER MANHOLE	WMH	— TRAFFIC SIGNAL CONTROL BOX	TSCB
⊙ SPRINKLER HEAD	SH	— ELECTRIC SERVICE	ESRV
⊙ SPRINKLER CONTROL BOX	SCB	— ELECTRIC METER	EM
⊙ HOSE BIB	HB	— PHONE MANHOLE	PHMH
⊙ STORM DRAIN MANHOLE	STMH	— BURIED PHONE LINE	UPM
⊙ SANITARY SEWER MANHOLE	SSMH	— PHONE RISER	PHR
⊙ SANITARY SEWER CLEANOUT	SSCO	— GAS METER	GM
⊙ POWER POLE	PP	— GAS VALVE	GV
⊙ POWER POLE ANCHOR	GUY	— UNDERGROUND GAS MARKER	UGM
⊙ LIGHT POLE	LP	— GAS MANHOLE	GMH
⊙ GROUND LIGHT	GL	— FENCE LINE	FNC
⊙ ELECTRIC MANHOLE	EMH	— ASPHALT PAVEMENT	ASPH
⊙ UNDERGROUND ELECTRIC MARKER	UEM	— TRAFFIC SIGN	SGN
⊙ ELECTRIC RISER	UER	— BOLLARD POST	BP
		— MAIL BOX	MB

- NOTES:**
- IF FLUME IS 7' OR WIDER, USE PIPE BOLLARDS 7"x6" DIA., AND FILL WITH CONCRETE. PLACE AT BOTH START AND END OF FLUME, BURY TO 4" DEPTH.
  - SIDE SLOPES TO BE HYDROMULCHED.
  - CROSS FENCING NOT ALLOWED, UNLESS APPROVED BY COUNTY ENGINEER.

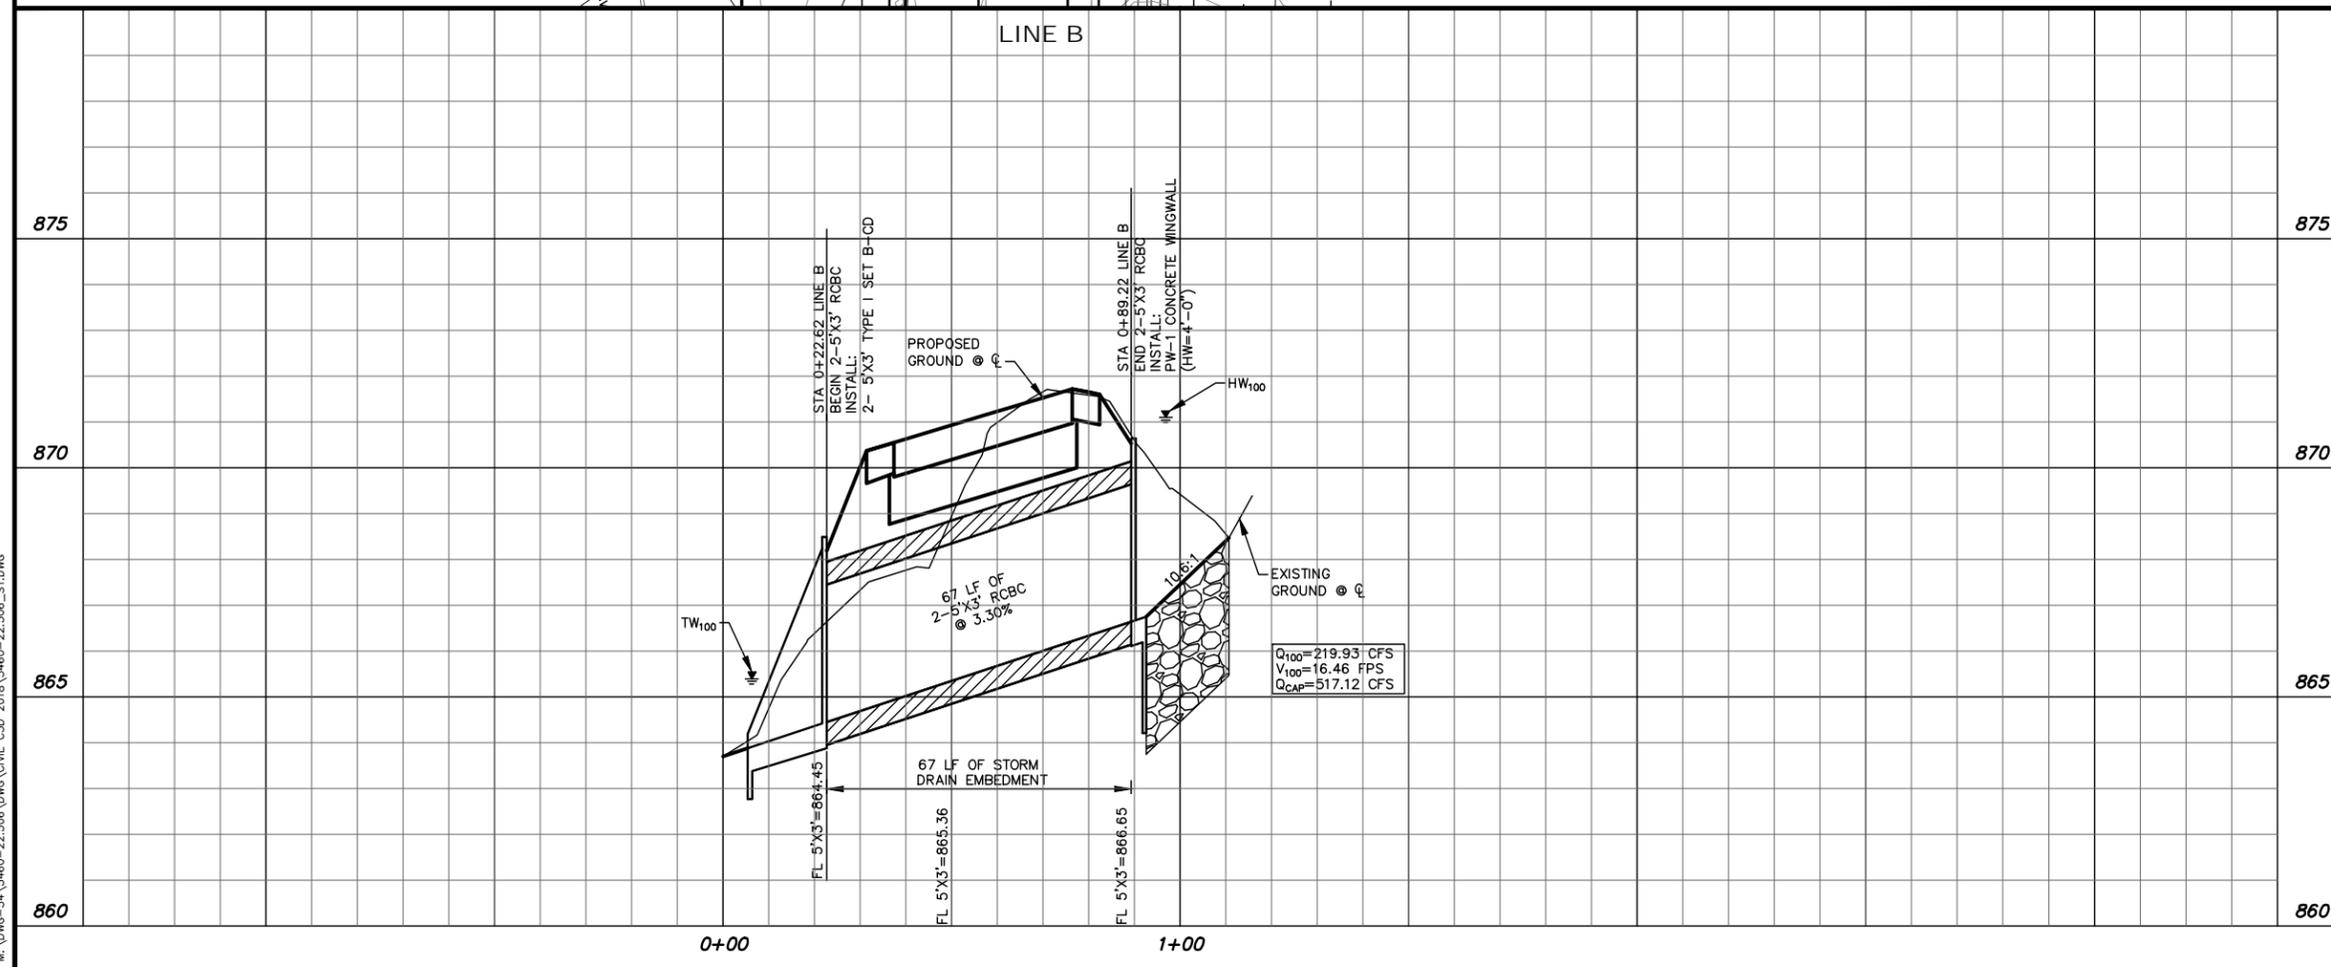

STATE OF TEXAS  
 CHRISTOPHER J. CHA  
 112732  
 LICENSED PROFESSIONAL ENGINEER



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION		
865		4060 BRYANT IRVIN ROAD FORT WORTH, TX 76109 817.412.7155 TX REG. ENGINEERING FIRM F-469 TX REG. SURVEYING FIRM LS-1008001		
<b>STORM PLAN &amp; PROFILE LINE B</b>				
<b>MARKUM RANCH ROAD WIDENING</b>				
<b>TARRANT COUNTY, TEXAS</b>				
DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	26

CKT:JRM  
 05/02/2023 11:37AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_ST.DWG


MARKUM RANCH ROAD WIDENING

KIEWIT INFRASTRUCTURE CO.  
(INST. NO. D22102390)  
1401 MARKUM RANCH RD

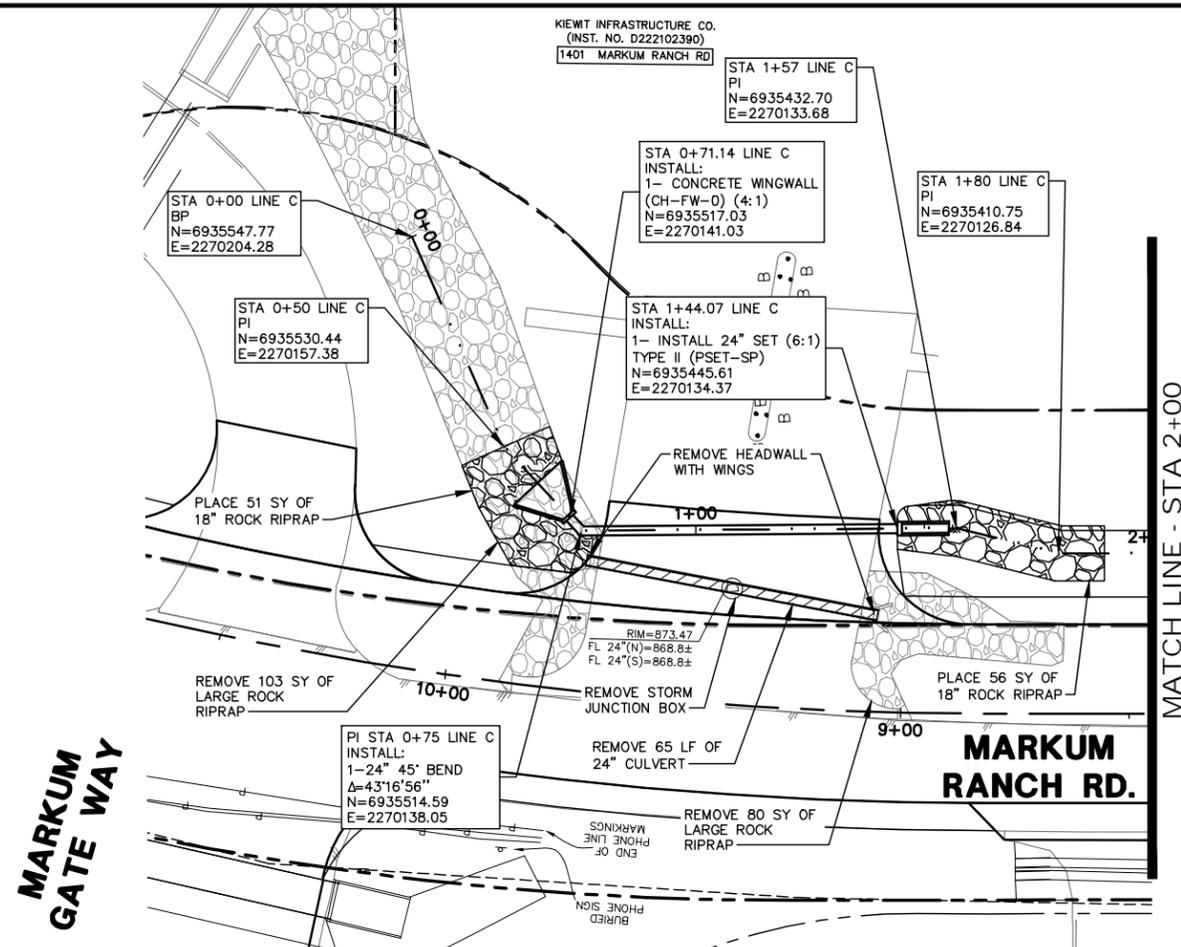

LEGEND

- |                               |      |                              |      |
|-------------------------------|------|------------------------------|------|
| ◇ FIRE HYDRANT                | FH   | —#— OVERHEAD ELECTRIC        | OE   |
| ⊙ WATER METER                 | WM   | ⊠ ELECTRIC TRANSFORMER PAD   | XFMR |
| ⊙ WATER VALVE                 | WV   | ⊠ TRAFFIC LIGHT POLE         | TLP  |
| ⊙ WATER MANHOLE               | WMH  | ⊠ TRAFFIC SIGNAL CONTROL BOX | TSGB |
| ⊙ SPRINKLER HEAD              | SH   | ⊠ ELECTRIC SERVICE           | ESRV |
| ⊠ SPRINKLER CONTROL BOX       | SCB  | ⊠ ELECTRIC METER             | EM   |
| ⊠ HOSE BIB                    | HB   | ⊠ PHONE MANHOLE              | PHMH |
| ⊠ STORM DRAIN MANHOLE         | STMH | —#— BURIED PHONE LINE        | UPM  |
| ⊠ SANITARY SEWER MANHOLE      | SSMH | ⊠ PHONE RISER                | PHR  |
| ⊠ SANITARY SEWER CLEANOUT     | SSCO | ⊠ GAS METER                  | GM   |
| ⊠ POWER POLE                  | PP   | ⊠ GAS VALVE                  | GV   |
| ⊠ POWER POLE ANCHOR           | GUY  | —#— UNDERGROUND GAS MARKER   | UGM  |
| ⊠ LIGHT POLE                  | LP   | ⊠ GAS MANHOLE                | GMH  |
| ⊠ GROUND LIGHT                | GL   | —#— FENCE LINE               | FNC  |
| ⊠ ELECTRIC MANHOLE            | EMH  | /// ASPHALT PAVEMENT         | ASPH |
| ⊠ UNDERGROUND ELECTRIC MARKER | UEM  | ⊠ TRAFFIC SIGN               | SGN  |
| ⊠ ELECTRIC RISER              | UER  | ⊠ BOLLARD POST               | BP   |
|                               |      | ⊠ MAIL BOX                   | MB   |

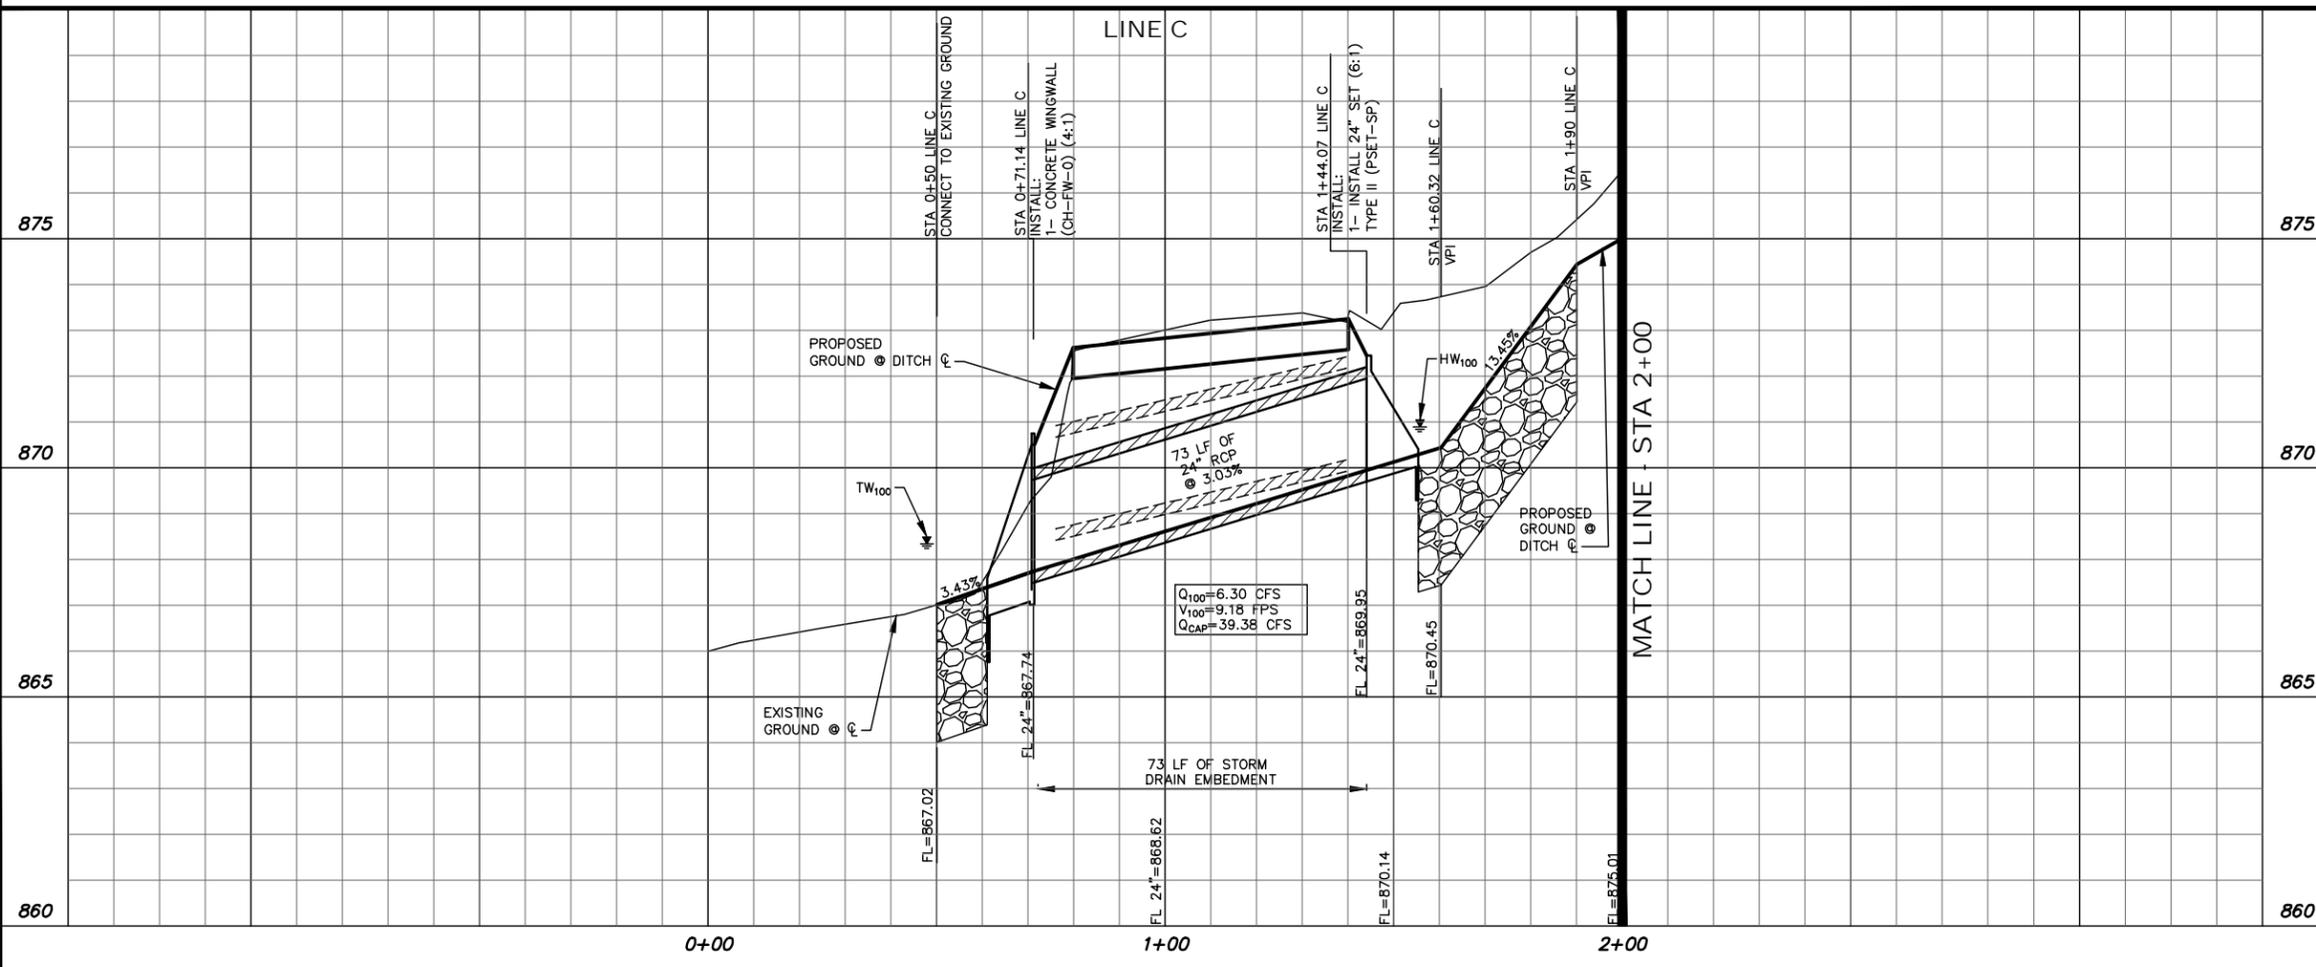

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION
865		

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001


STORM PLAN & PROFILE  
LINE C  
STA 0+00 TO STA 2+00

**MARKUM RANCH ROAD WIDENING**  
TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	27



C:\TANNER\05/02/2023 - 11:37AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_ST.DWG

MARKUM RANCH ROAD WIDENING



LEGEND

- ◇ FIRE HYDRANT
- ⊙ WATER METER
- ⊙ WATER VALVE
- ⊙ WATER MANHOLE
- ⊙ SPRINKLER HEAD
- ⊙ SPRINKLER CONTROL BOX
- ⊙ HOSE BIB
- ⊙ STORM DRAIN MANHOLE
- ⊙ SANITARY SEWER MANHOLE
- ⊙ SANITARY SEWER CLEANOUT
- ◇ POWER POLE
- ◇ POWER POLE ANCHOR
- ◇ LIGHT POLE
- ◇ GROUND LIGHT
- ⊙ ELECTRIC MANHOLE
- ⊙ UNDERGROUND ELECTRIC MARKER
- ⊙ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ⊙ ELECTRIC METER
- ⊙ PHONE MANHOLE
- ⊙ BURIED PHONE LINE
- ⊙ PHONE RISER
- ⊙ GAS METER
- ⊙ GAS VALVE
- ⊙ UNDERGROUND GAS MARKER
- ⊙ GAS MANHOLE
- ⊙ FENCE LINE
- ⊙ ASPHALT PAVEMENT
- ⊙ TRAFFIC SIGN
- ⊙ BOLLARD POST
- ⊙ MAIL BOX
- OE XFMR
- TLP
- TSCB
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- GV
- UGM
- GMH
- FNC
- ASPH
- SGN
- BP
- MB

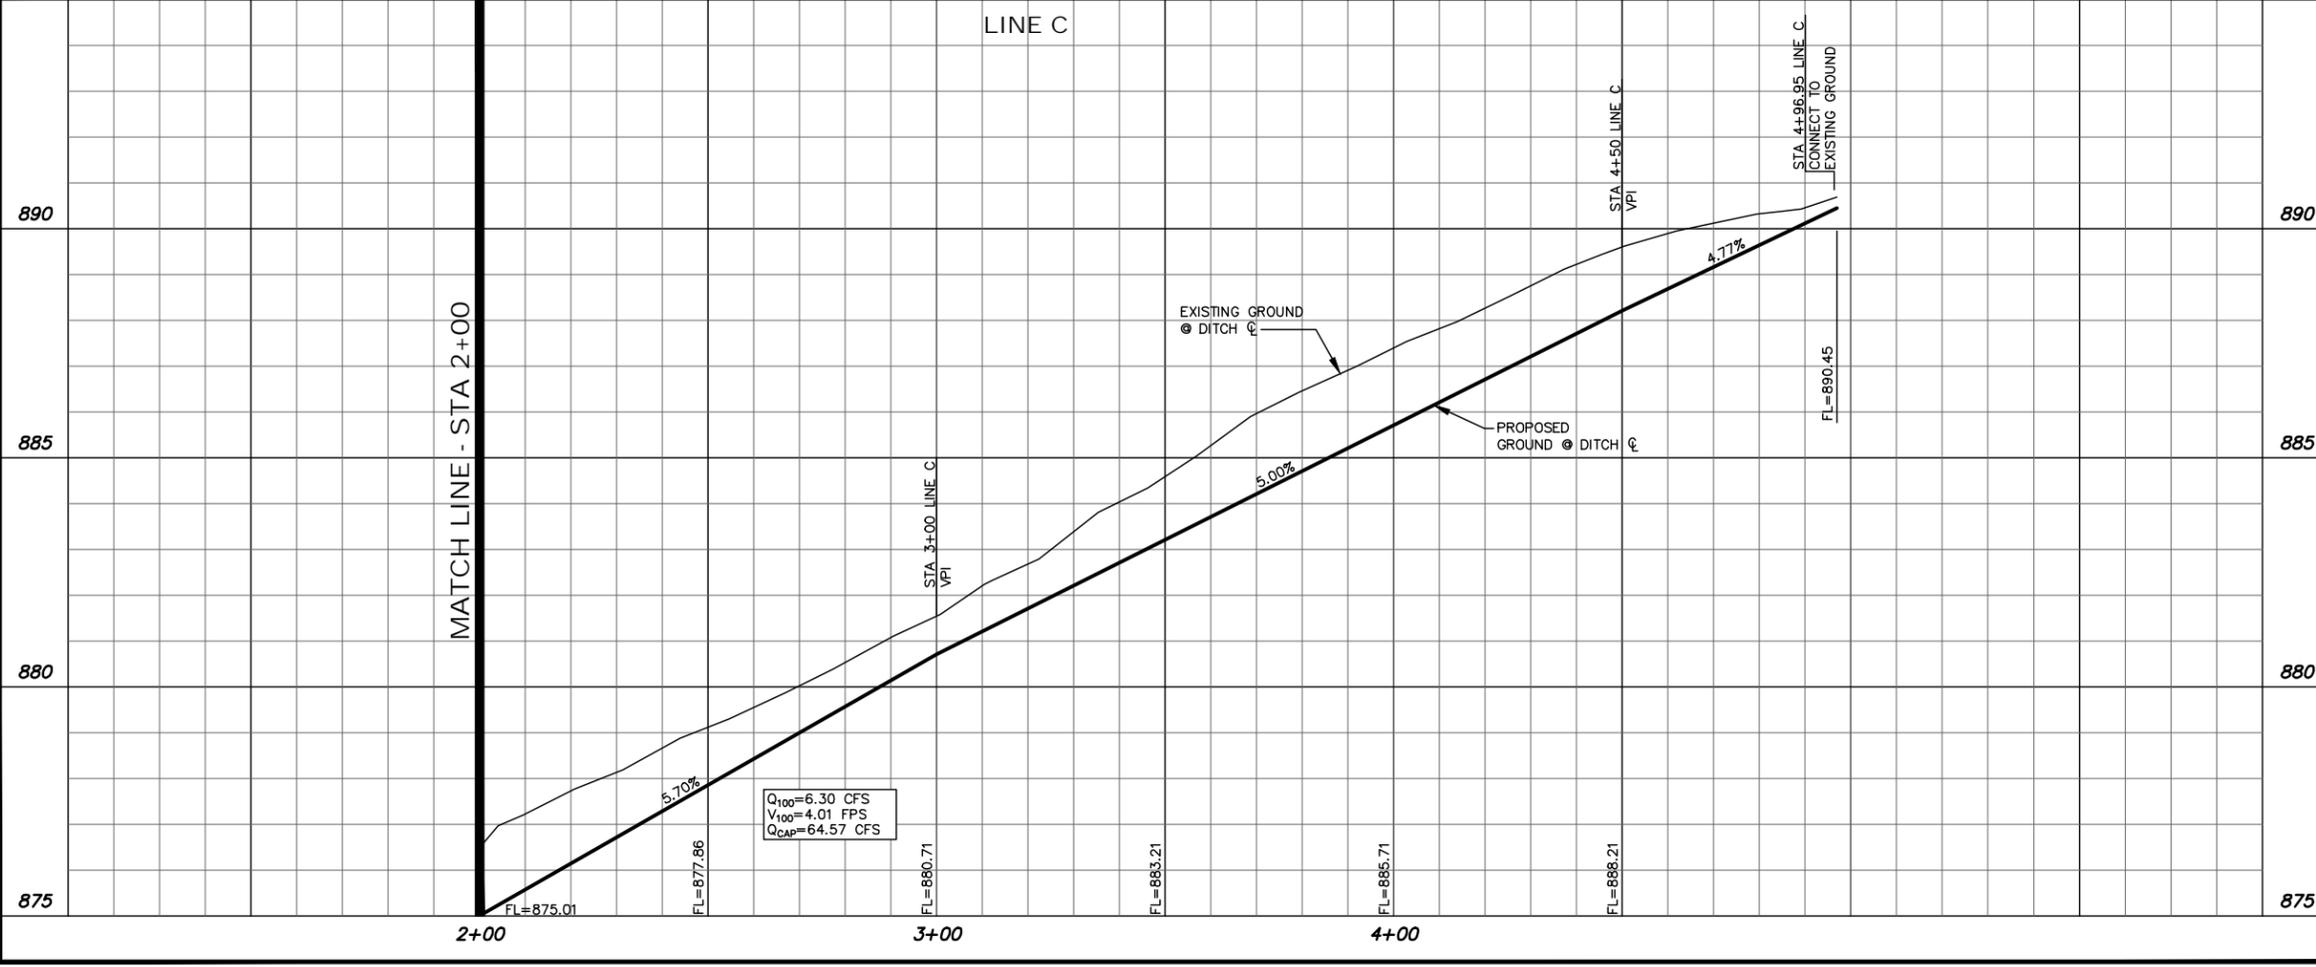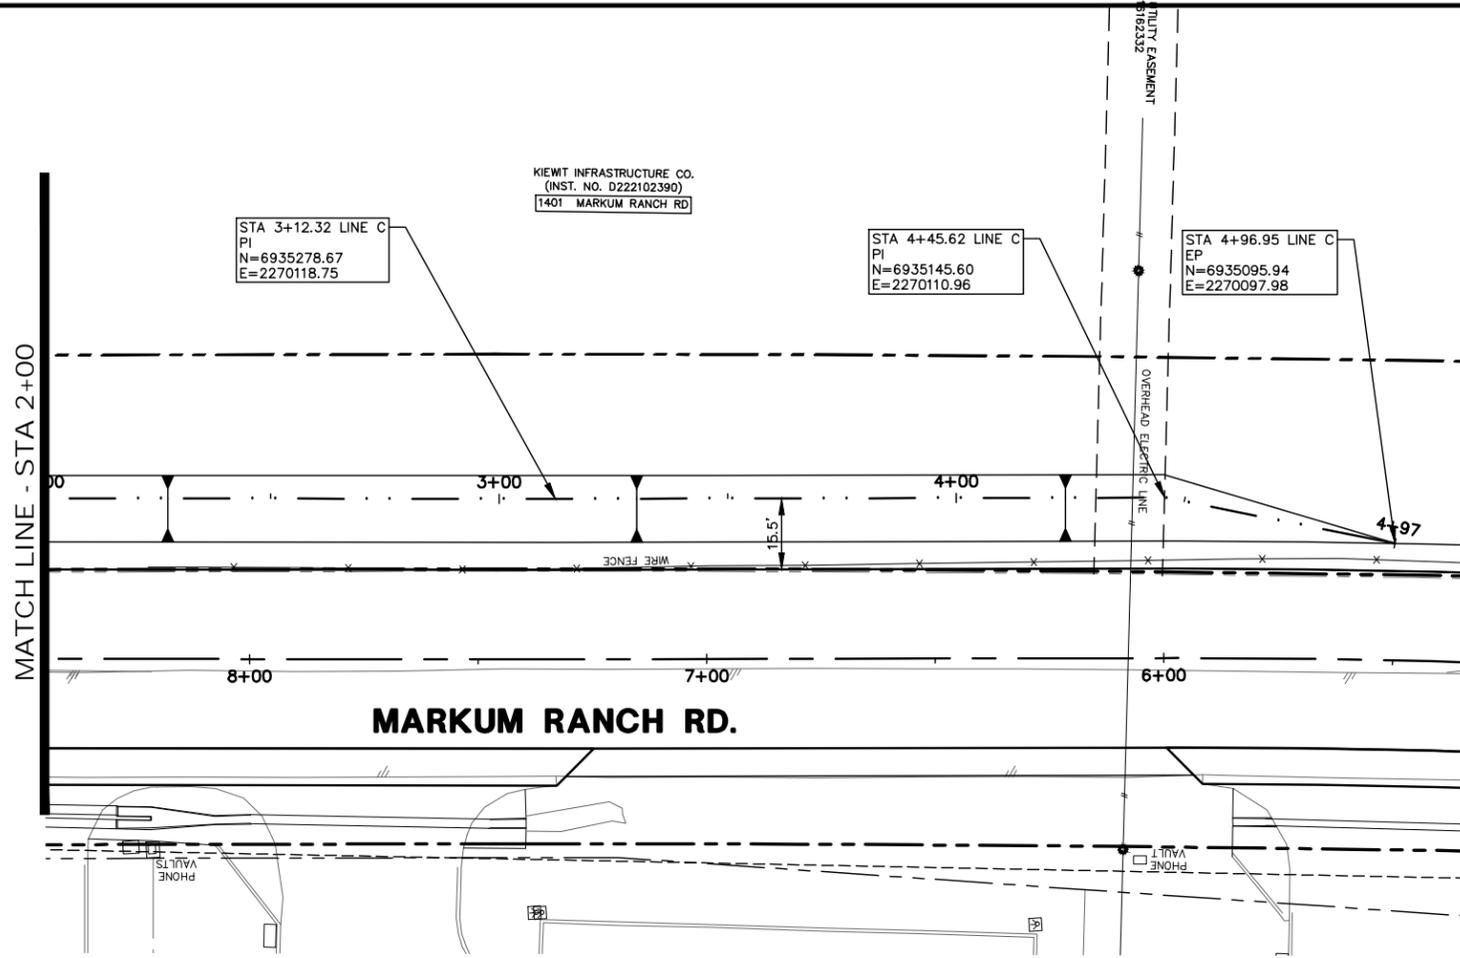

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION
880		

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

STORM PLAN & PROFILE  
LINE C  
STA 2+00 TO STA 4+96.44

**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	28

CKT:JRM  
 05/02/2023 11:37AM  
 M:\DWG-54\5460-22.506\DWG\CIVIL\3D\2018\5460-22.506\_ST.DWG

MARKUM RANCH ROAD WIDENING





LEGEND

- ◆ FIRE HYDRANT
- WATER METER
- ⊕ WATER VALVE
- ⊕ WATER MANHOLE
- ⊕ SPRINKLER HEAD
- ⊕ SPRINKLER CONTROL BOX
- ⊕ HOSE BIB
- ⊕ STORM DRAIN MANHOLE
- ⊕ SANITARY SEWER MANHOLE
- ⊕ SANITARY SEWER CLEANOUT
- ⊕ POWER POLE
- ⊕ POWER POLE ANCHOR
- ⊕ LIGHT POLE
- ⊕ GROUND LIGHT
- ⊕ ELECTRIC MANHOLE
- ⊕ UNDERGROUND ELECTRIC MARKER
- ⊕ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ICV ELECTRIC METER
- HB PHONE MANHOLE
- STMH BURIED PHONE LINE
- SSMH PHONE RISER
- SSCO GAS METER
- PP GAS VALVE
- GUY UNDERGROUND GAS MARKER
- LP GAS MANHOLE
- GL FENCE LINE
- EMH ASPHALT PAVEMENT
- UEM ASPHALT PAVEMENT
- UER TRAFFIC SIGN
- OE MAIL BOX
- XFMR
- TLP
- TSCB
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- GV
- UGM
- CMH
- FNC
- ASPH
- SGN
- BP
- MB

- PROPOSED FLEXIBLE BASE SHOULDER
- PROPOSED CONCRETE PAVEMENT
- PROPOSED ASPHALT TRANSITION



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

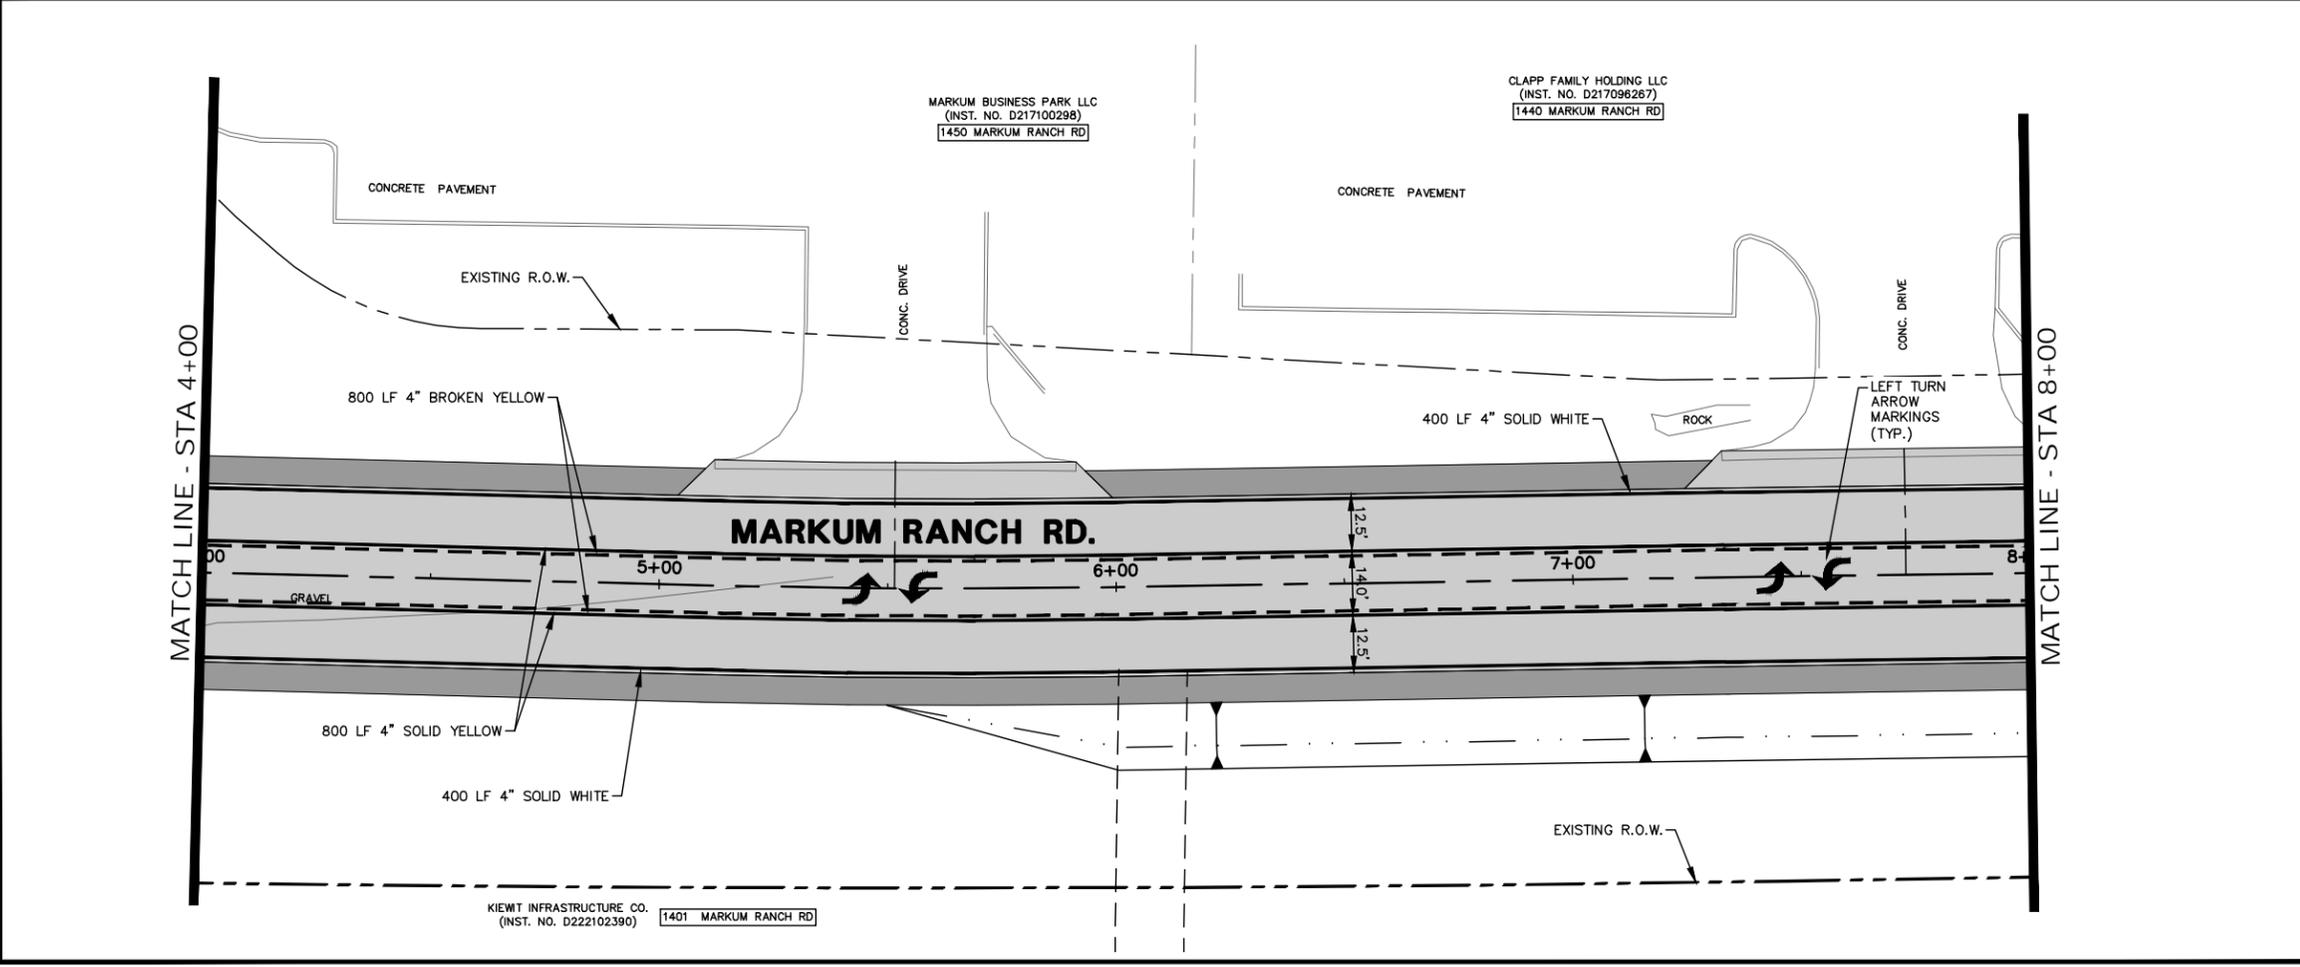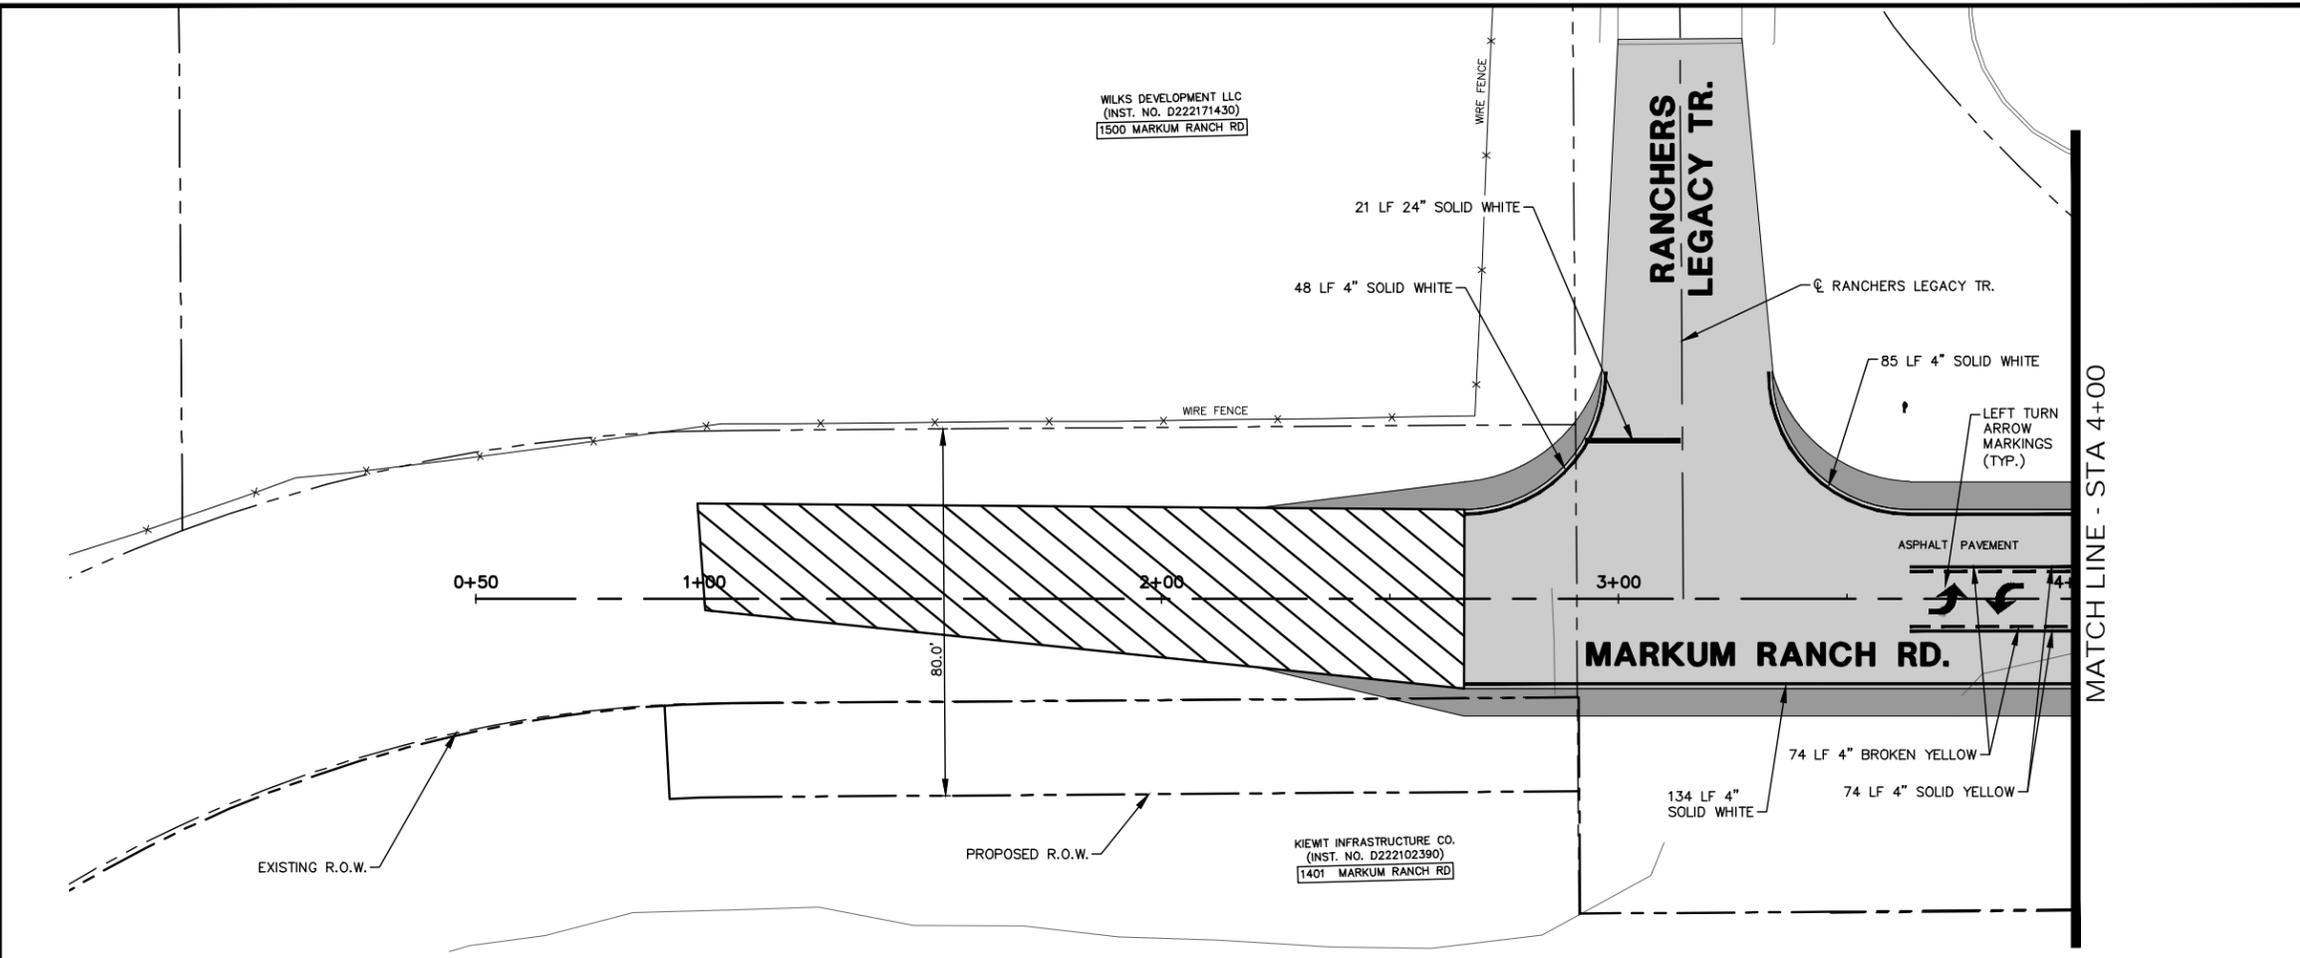

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD  
PAVEMENT STRIPING PLAN  
STA 0+50 TO STA 8+00**

**MARKUM RANCH ROAD WIDENING**  
TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	29

CKT:TURNER  
 05/02/2023 11:39AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\ 2018\5460-22.506\_STRIPING.DWG

MARKUM RANCH ROAD WIDENING



### LEGEND

- ◊ FIRE HYDRANT
- ⊙ WATER METER
- ⊙ WATER VALVE
- ⊙ WATER MANHOLE
- ⊙ SPRINKLER HEAD
- ⊙ SPRINKLER CONTROL BOX
- ⊙ HOSE BIB
- ⊙ STORM DRAIN MANHOLE
- ⊙ SANITARY SEWER MANHOLE
- ⊙ SANITARY SEWER CLEANOUT
- ⊙ POWER POLE
- ⊙ POWER POLE ANCHOR
- ⊙ LIGHT POLE
- ⊙ GROUND LIGHT
- ⊙ ELECTRIC MANHOLE
- ⊙ UNDERGROUND ELECTRIC MARKER
- ⊙ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ICV ELECTRIC METER
- HB PHONE MANHOLE
- STMH BURIED PHONE LINE
- SSMH PHONE RISER
- SSCO GAS METER
- PP GAS VALVE
- GUY UNDERGROUND GAS MARKER
- LP GAS MANHOLE
- FL FENCE LINE
- EMH ASPHALT PAVEMENT
- UEM ASPHALT PAVEMENT
- UER ASPHALT PAVEMENT
- OE
- TLP
- TSCB
- EM
- PHMH
- UPM
- PHR
- GM
- GV
- UGM
- CMH
- FNC
- ASPH
- SGN
- BP
- MB

- PROPOSED FLEXIBLE BASE SHOULDER
- PROPOSED CONCRETE DRIVEWAY
- PROPOSED CONCRETE PAVEMENT





THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION
<b>Pacheco Koch</b> a Westwood company		
4060 BRYANT IRVIN ROAD FORT WORTH, TX 76109 817-412-7155 TX REG. ENGINEERING FIRM F-469 TX REG. SURVEYING FIRM LS-10008001		

## MARKUM RANCH ROAD PAVEMENT STRIPING PLAN STA 8+00 TO STA 16+00

### MARKUM RANCH ROAD WIDENING TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	30

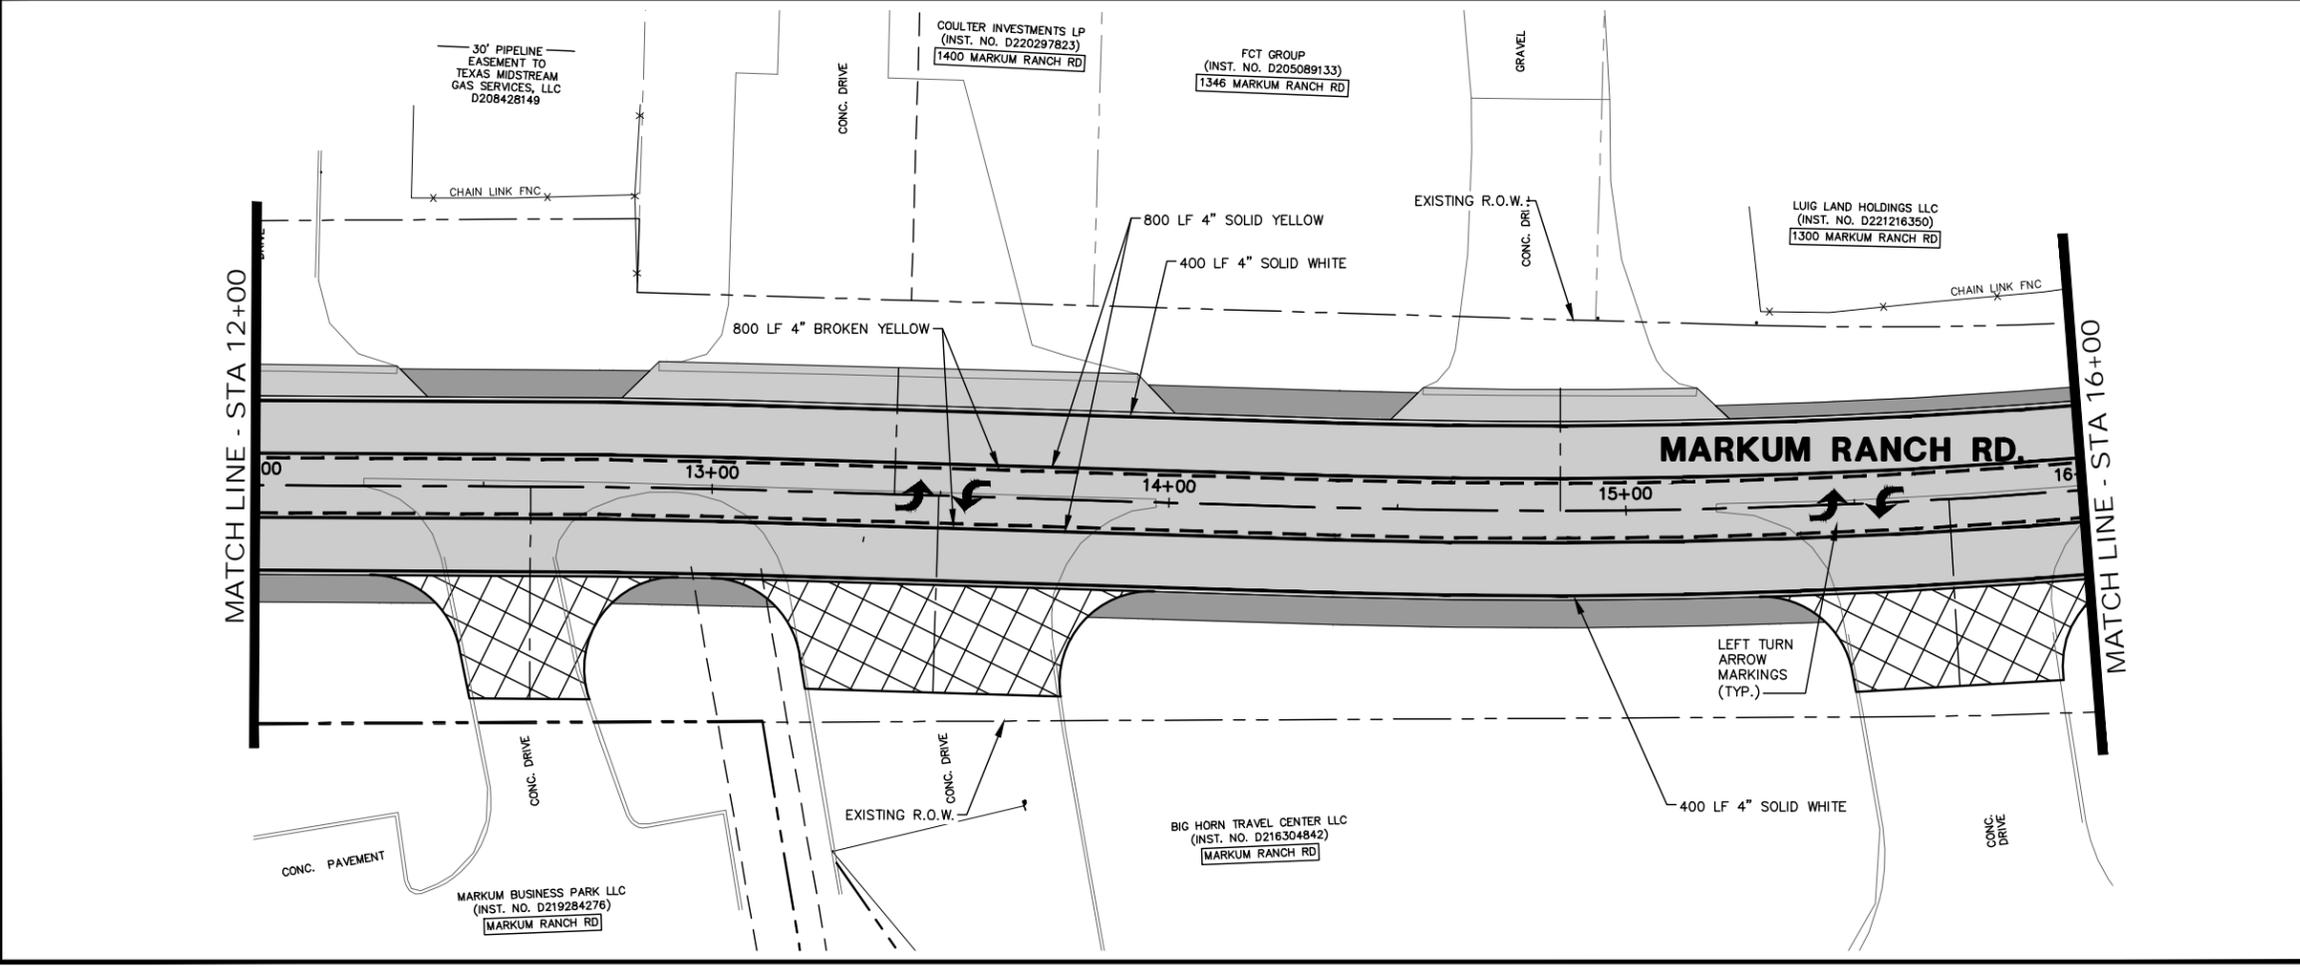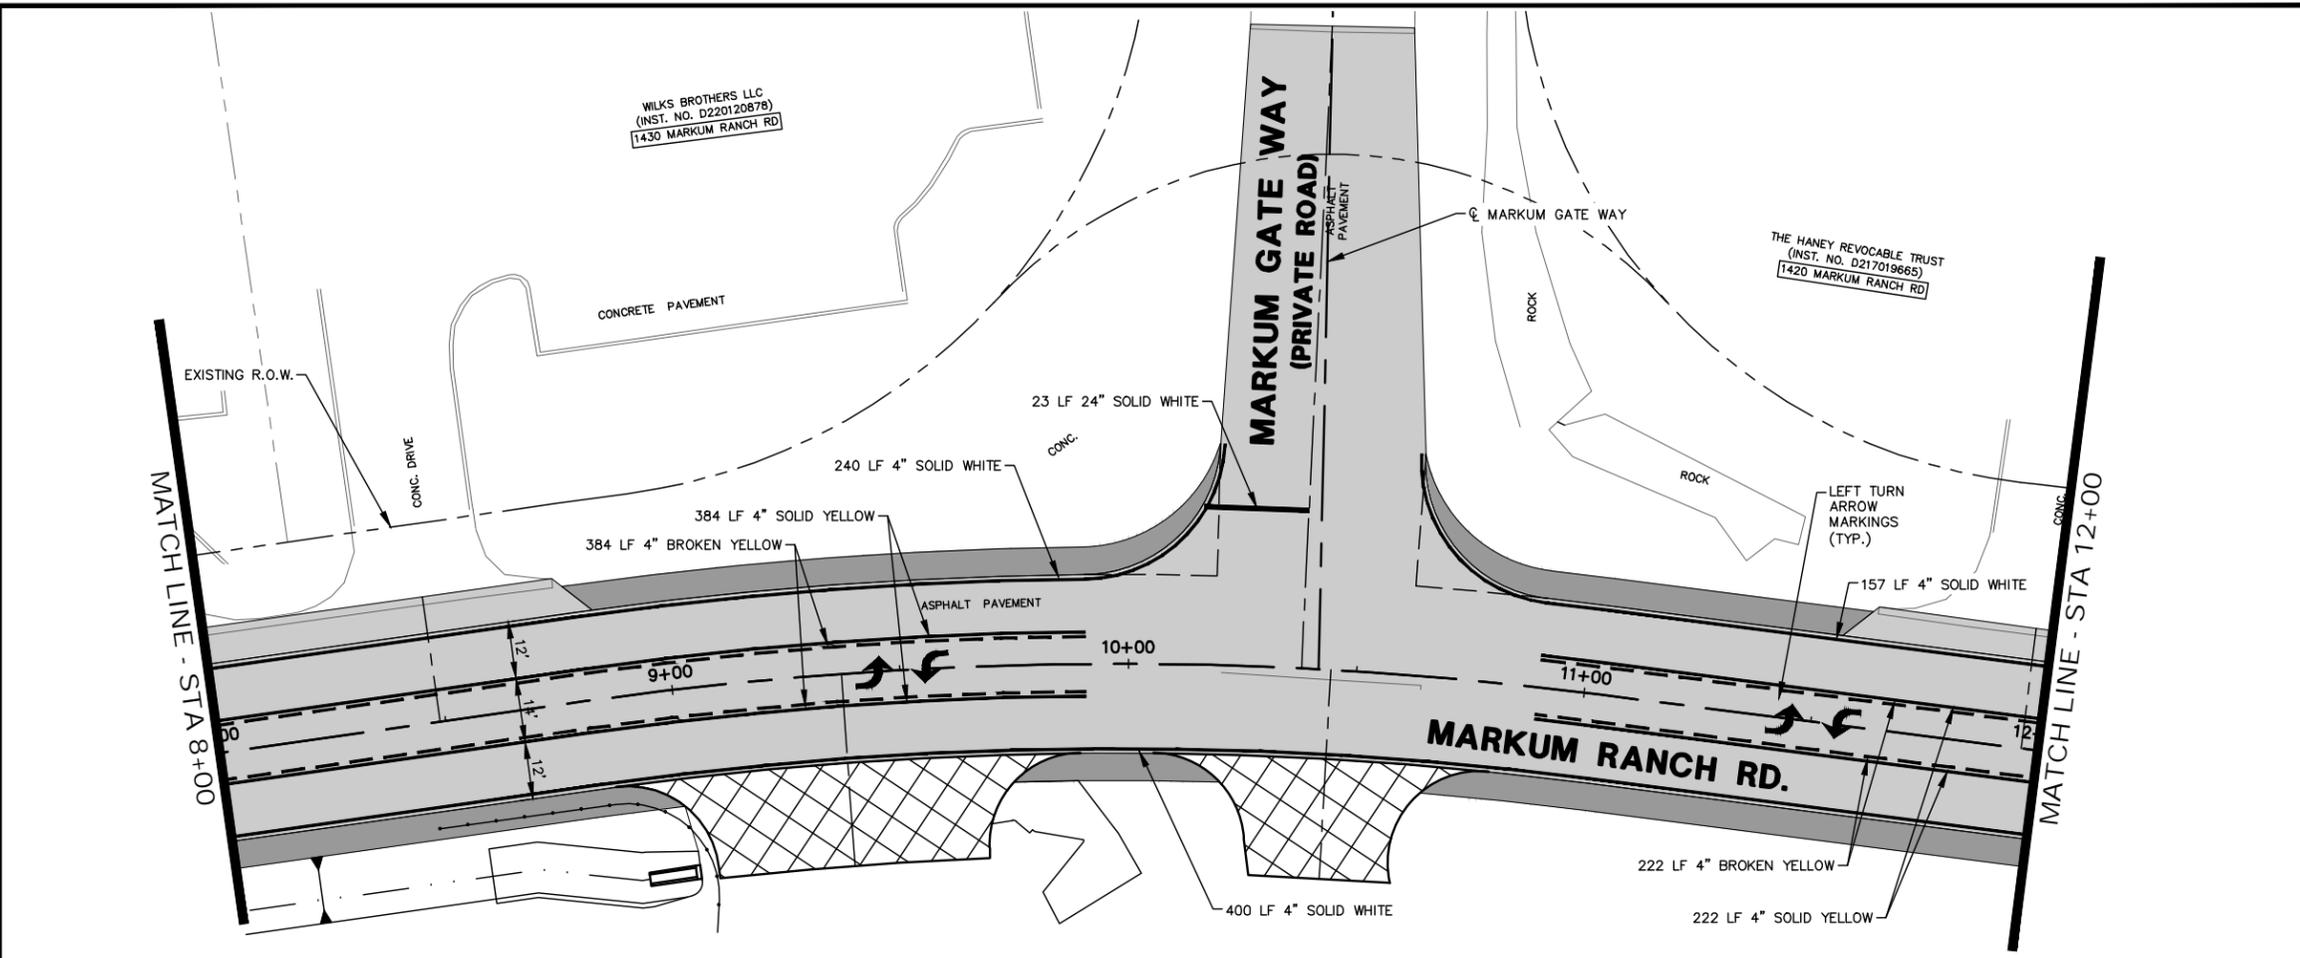

CKT:JMR  
 05/02/2023 11:39AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\ 2018\5460-22.506\_STRIPING.DWG

MARKUM RANCH ROAD WIDENING



### LEGEND

- ◊ FIRE HYDRANT
- ⊙ WATER METER
- ⊙ WATER VALVE
- ⊙ WATER MANHOLE
- ⊙ SPRINKLER HEAD
- ⊙ SPRINKLER CONTROL BOX
- ⊙ HOSE BIB
- ⊙ STORM DRAIN MANHOLE
- ⊙ SANITARY SEWER MANHOLE
- ⊙ SANITARY SEWER CLEANOUT
- ⊙ POWER POLE
- ⊙ POWER POLE ANCHOR
- ⊙ LIGHT POLE
- ⊙ GROUND LIGHT
- ⊙ ELECTRIC MANHOLE
- ⊙ UNDERGROUND ELECTRIC MARKER
- ⊙ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ICV ELECTRIC METER
- HB ELECTRIC METER
- STMH PHONE MANHOLE
- SSMH BURIED PHONE LINE
- SSCO PHONE RISER
- PP GAS METER
- GUY UNDERGROUND GAS MARKER
- LP GAS VALVE
- ⊙ GAS MANHOLE
- ⊙ FENCE LINE
- EMH ASPHALT PAVEMENT
- UEM TRAFFIC SIGN
- UER BOLLARD POST
- MB MAIL BOX
- OE
- XFMR
- TLP
- TSGB
- ESRV
- EM
- PHMH
- UPM
- PHR
- GM
- GV
- UGM
- CMH
- FNC
- ASPH
- SGN
- BP
- MB

- PROPOSED FLEXIBLE BASE SHOULDER
- PROPOSED CONCRETE MEDIAN
- PROPOSED CONCRETE DRIVEWAY
- PROPOSED CONCRETE PAVEMENT



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.


NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD  
PAVEMENT STRIPING PLAN  
STA 16+00 TO STA 20+13.90**

**MARKUM RANCH ROAD WIDENING**  
TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	31



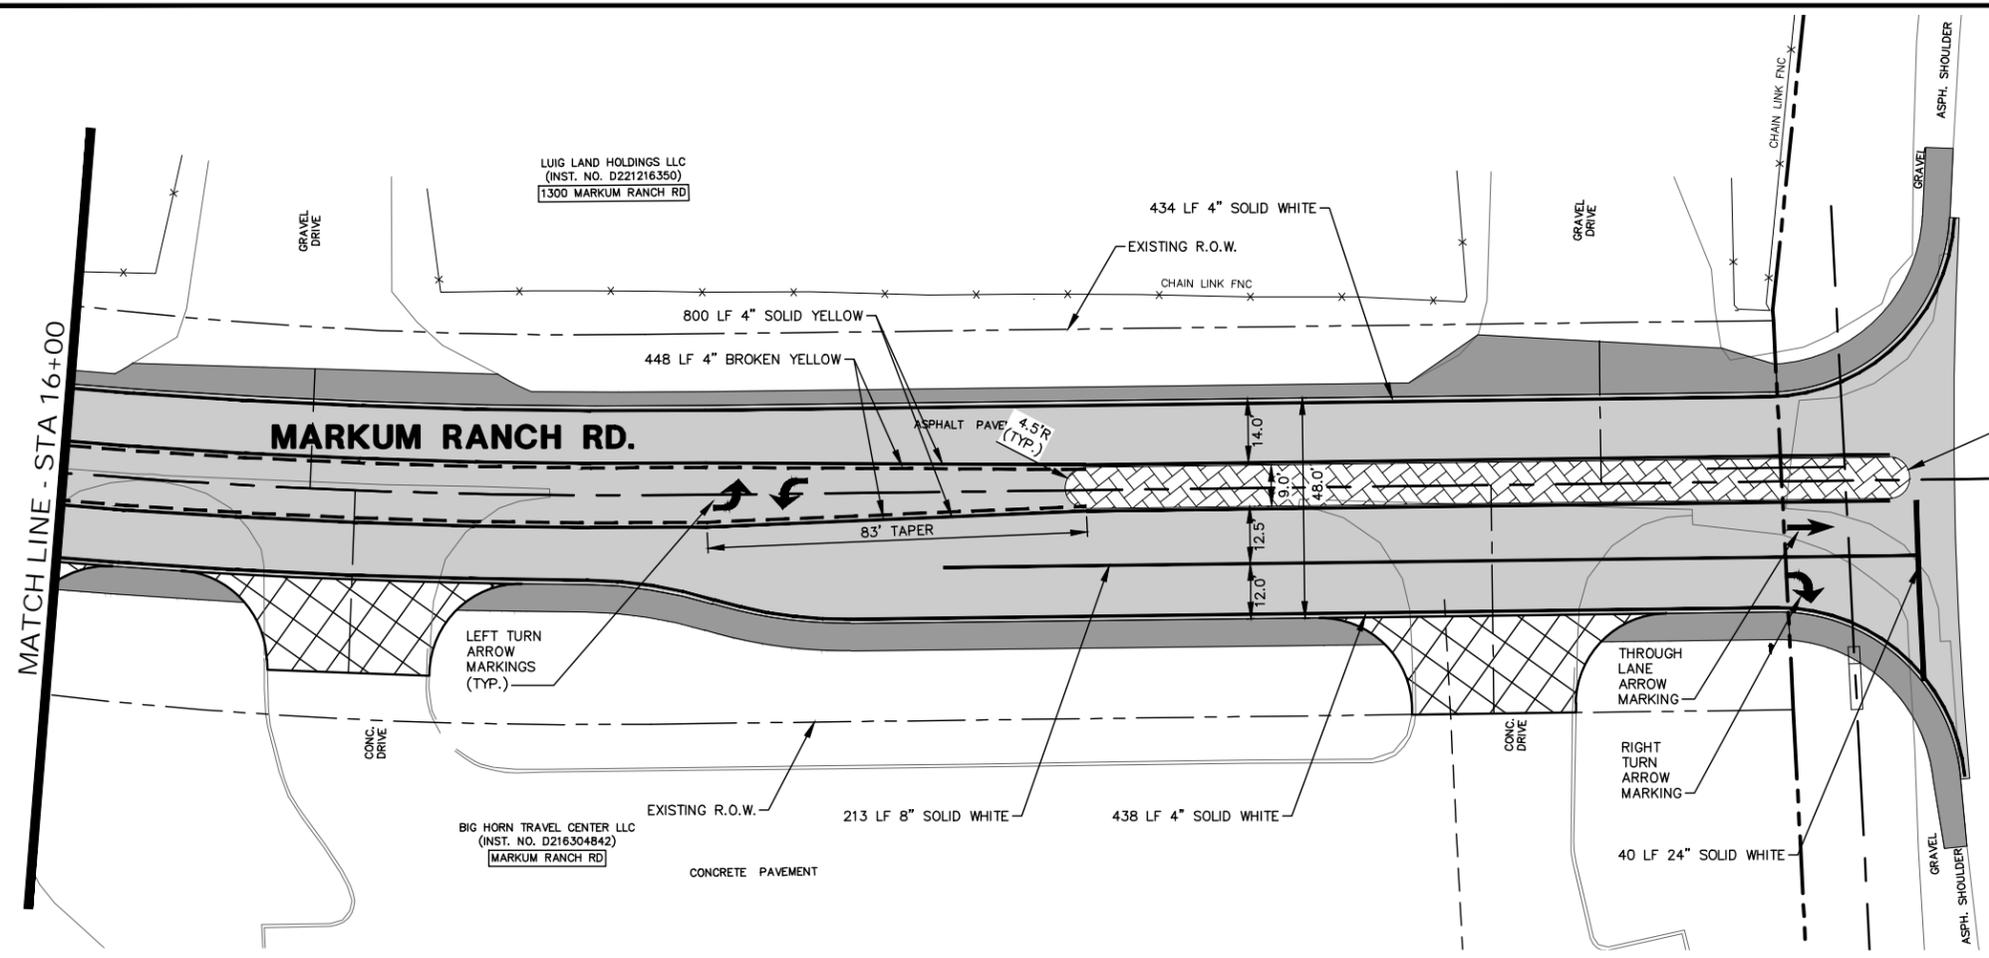


**INTERSTATE HWY. 20  
E. BOUND ACCESS ROAD**

CKT:JMR  
 05/02/2023 - 11:39AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\ 2018\5460-22.506\_STRIPING.DWG

MARKUM RANCH ROAD WIDENING

CKT:JMR  
 05/02/2023 - 11:41AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\ 2018\5460-22.506\_EC.DWG

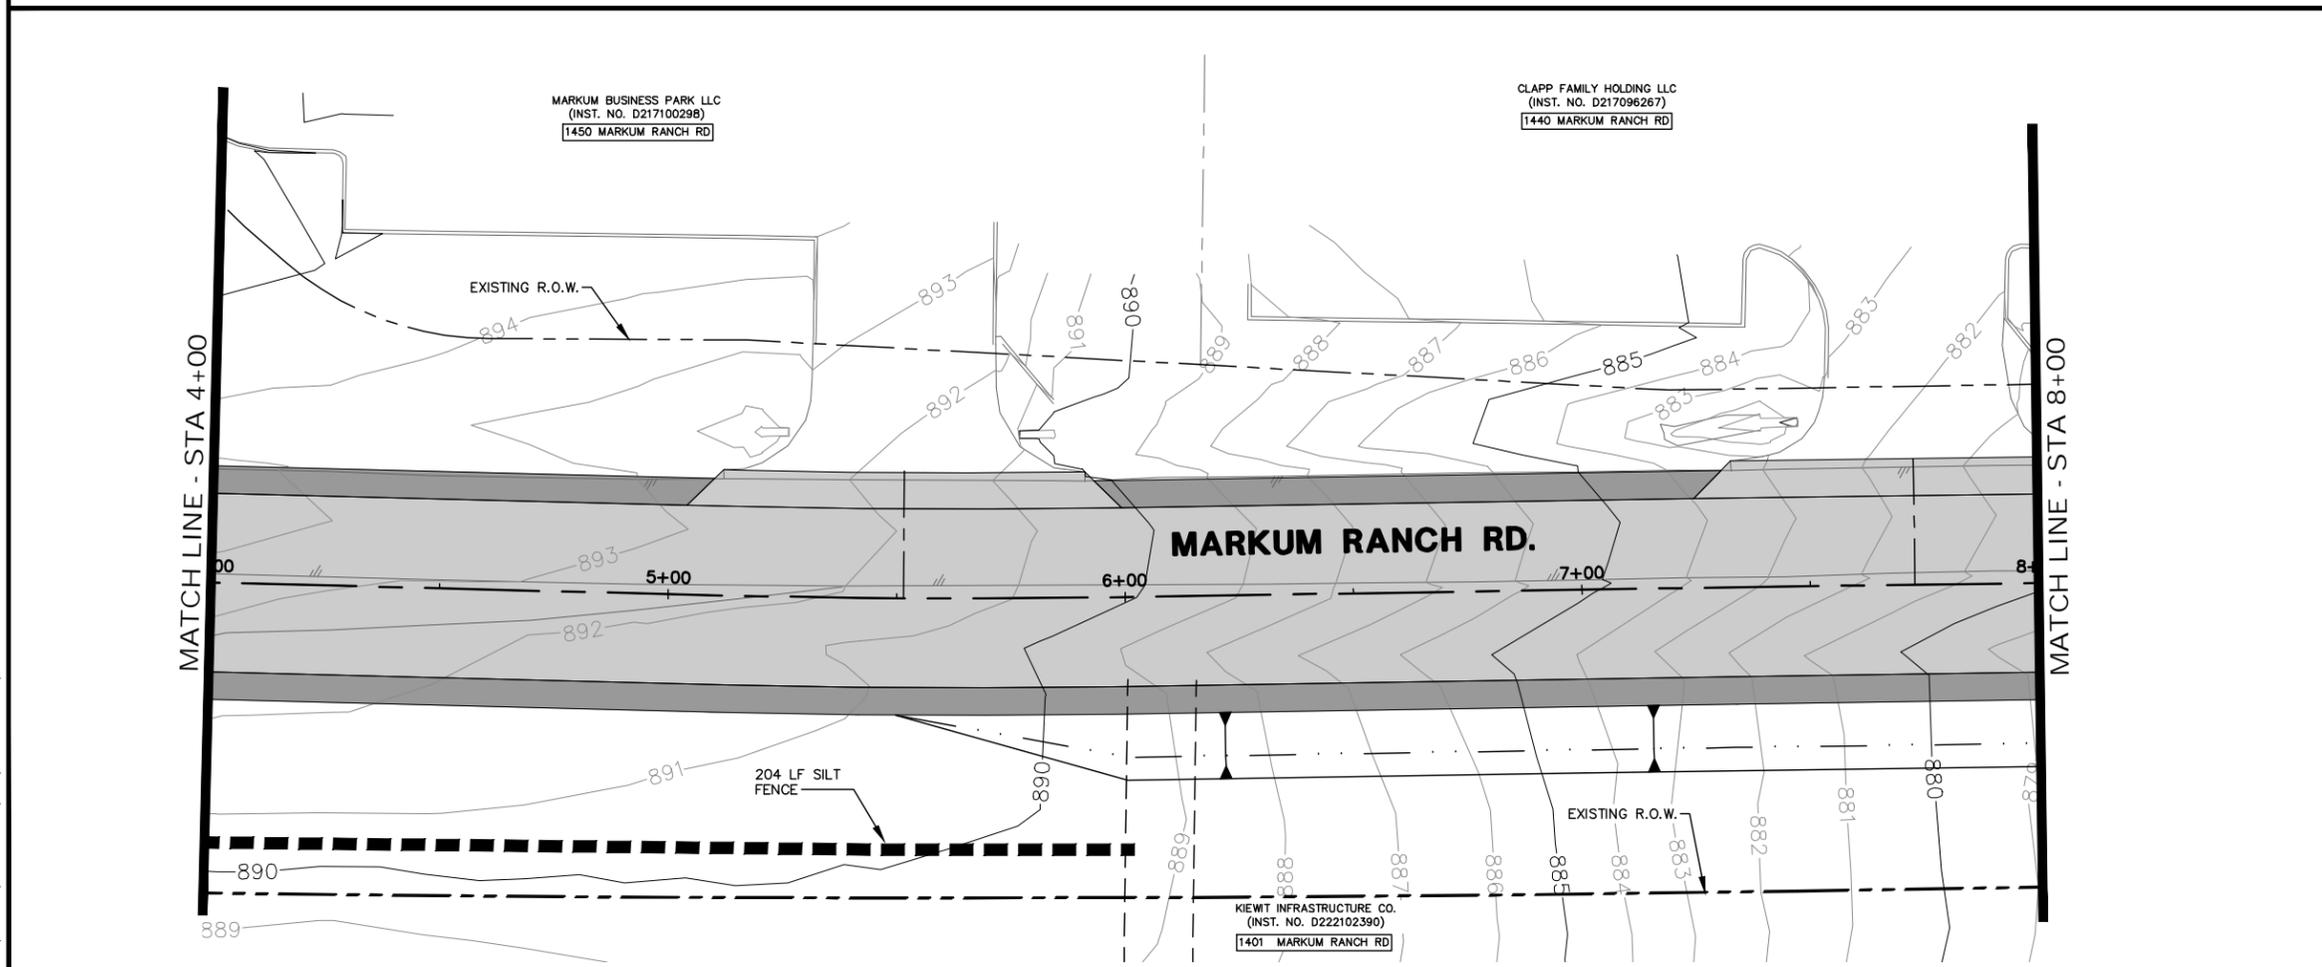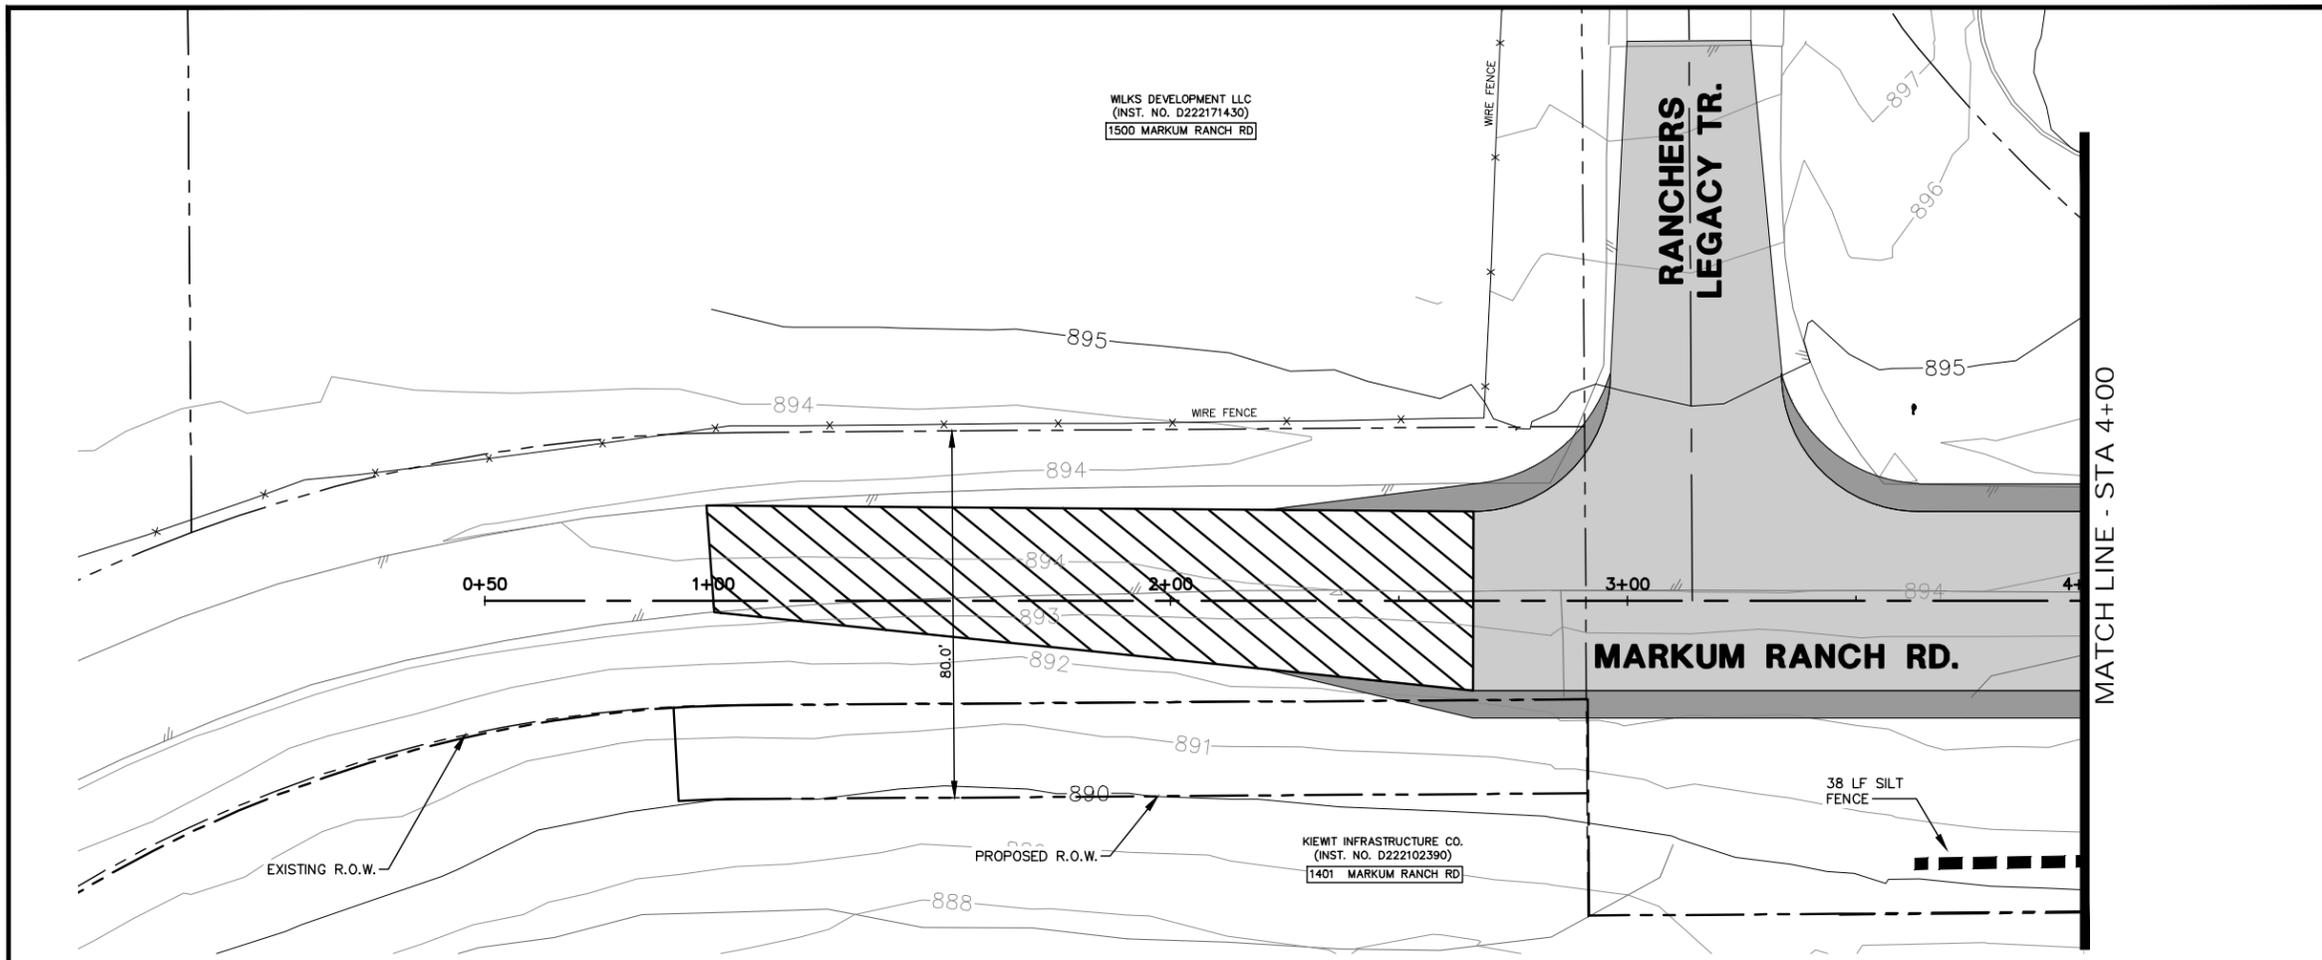

**LEGEND**

- |                               |      |                              |      |
|-------------------------------|------|------------------------------|------|
| ◆ FIRE HYDRANT                | FH   | — OVERHEAD ELECTRIC          | OE   |
| ● WATER METER                 | WM   | — ELECTRIC TRANSFORMER PAD   | XFMR |
| ⊙ WATER VALVE                 | WV   | — TRAFFIC LIGHT POLE         | TLP  |
| ⊙ WATER MANHOLE               | WMH  | — TRAFFIC SIGNAL CONTROL BOX | TSCB |
| ▽ SPRINKLER HEAD              | SH   | — ELECTRIC SERVICE           | ESRV |
| ⊠ SPRINKLER CONTROL BOX       | SCB  | — ELECTRIC METER             | EM   |
| ⊠ HOSE BIB                    | HB   | — PHONE MANHOLE              | PHMH |
| ⊙ STORM DRAIN MANHOLE         | STMH | — BURIED PHONE LINE          | UPM  |
| ⊙ SANITARY SEWER MANHOLE      | SSMH | — PHONE RISER                | PHR  |
| ⊙ SANITARY SEWER CLEANOUT     | SSCO | — GAS METER                  | GM   |
| ⊙ POWER POLE                  | PP   | — GAS VALVE                  | GV   |
| ⊙ POWER POLE ANCHOR           | GUY  | — UNDERGROUND GAS MARKER     | UGM  |
| ⊙ LIGHT POLE                  | LP   | — GAS MANHOLE                | GMH  |
| ⊙ GROUND LIGHT                | GL   | — FENCE LINE                 | FNC  |
| ⊙ ELECTRIC MANHOLE            | EMH  | — ASPHALT PAVEMENT           | ASPH |
| ⊙ UNDERGROUND ELECTRIC MARKER | UEM  | — TRAFFIC SIGN               | SGN  |
| ⊙ ELECTRIC RISER              | UER  | — BOLLARD POST               | BP   |
|                               |      | — MAIL BOX                   | MB   |

- PROPOSED FLEXIBLE BASE SHOULDER
- PROPOSED CONCRETE PAVEMENT
- PROPOSED ASPHALT TRANSITION
- PROPOSED SILT FENCE
- PROPOSED ROCK FILTER DAM



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
 a Westwood company  
 4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD**  
**EROSION CONTROL PLAN**  
 STA 0+50 TO STA 8+00

**MARKUM RANCH ROAD WIDENING**

TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	32

MARKUM RANCH ROAD WIDENING



### LEGEND

- ◆ FIRE HYDRANT
- WATER METER
- ⊕ WATER VALVE
- ⊙ WATER MANHOLE
- ▽ SPRINKLER HEAD
- ⊠ SPRINKLER CONTROL BOX
- ⊠ HOSE BIB
- ⊙ STORM DRAIN MANHOLE
- ⊙ SANITARY SEWER MANHOLE
- ⊙ SANITARY SEWER CLEANOUT
- ⊙ POWER POLE
- ⊙ POWER POLE ANCHOR
- ⊙ LIGHT POLE
- ⊙ GROUND LIGHT
- ⊙ ELECTRIC MANHOLE
- ⊙ UNDERGROUND ELECTRIC MARKER
- ⊙ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ICV ELECTRIC METER
- HB PHONE MANHOLE
- STMH BURIED PHONE LINE
- SSMH PHONE RISER
- SSCO GAS METER
- PP GAS VALVE
- GUY UNDERGROUND GAS MARKER
- LP GAS MANHOLE
- FL FENCE LINE
- EMH ASPHALT PAVEMENT
- UEM TRAFFIC SIGN
- UER BOLLARD POST
- OE XFMR
- TLP TSCB
- ESRV EM
- PHM PHRM
- UPM PPH
- GM GY
- UGM UGM
- CMH CMH
- FNC FNC
- ASPH ASPH
- SGN SGN
- BP BP
- MB MB

- PROPOSED FLEXIBLE BASE SHOULDER
- PROPOSED CONCRETE PAVEMENT
- PROPOSED SILT FENCE
- PROPOSED ROCK FILTER DAM





THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

**MARKUM RANCH ROAD**  
EROSION CONTROL PLAN  
STA 8+00 TO STA 16+00

MARKUM RANCH ROAD WIDENING				
TARRANT COUNTY, TEXAS				
DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	33

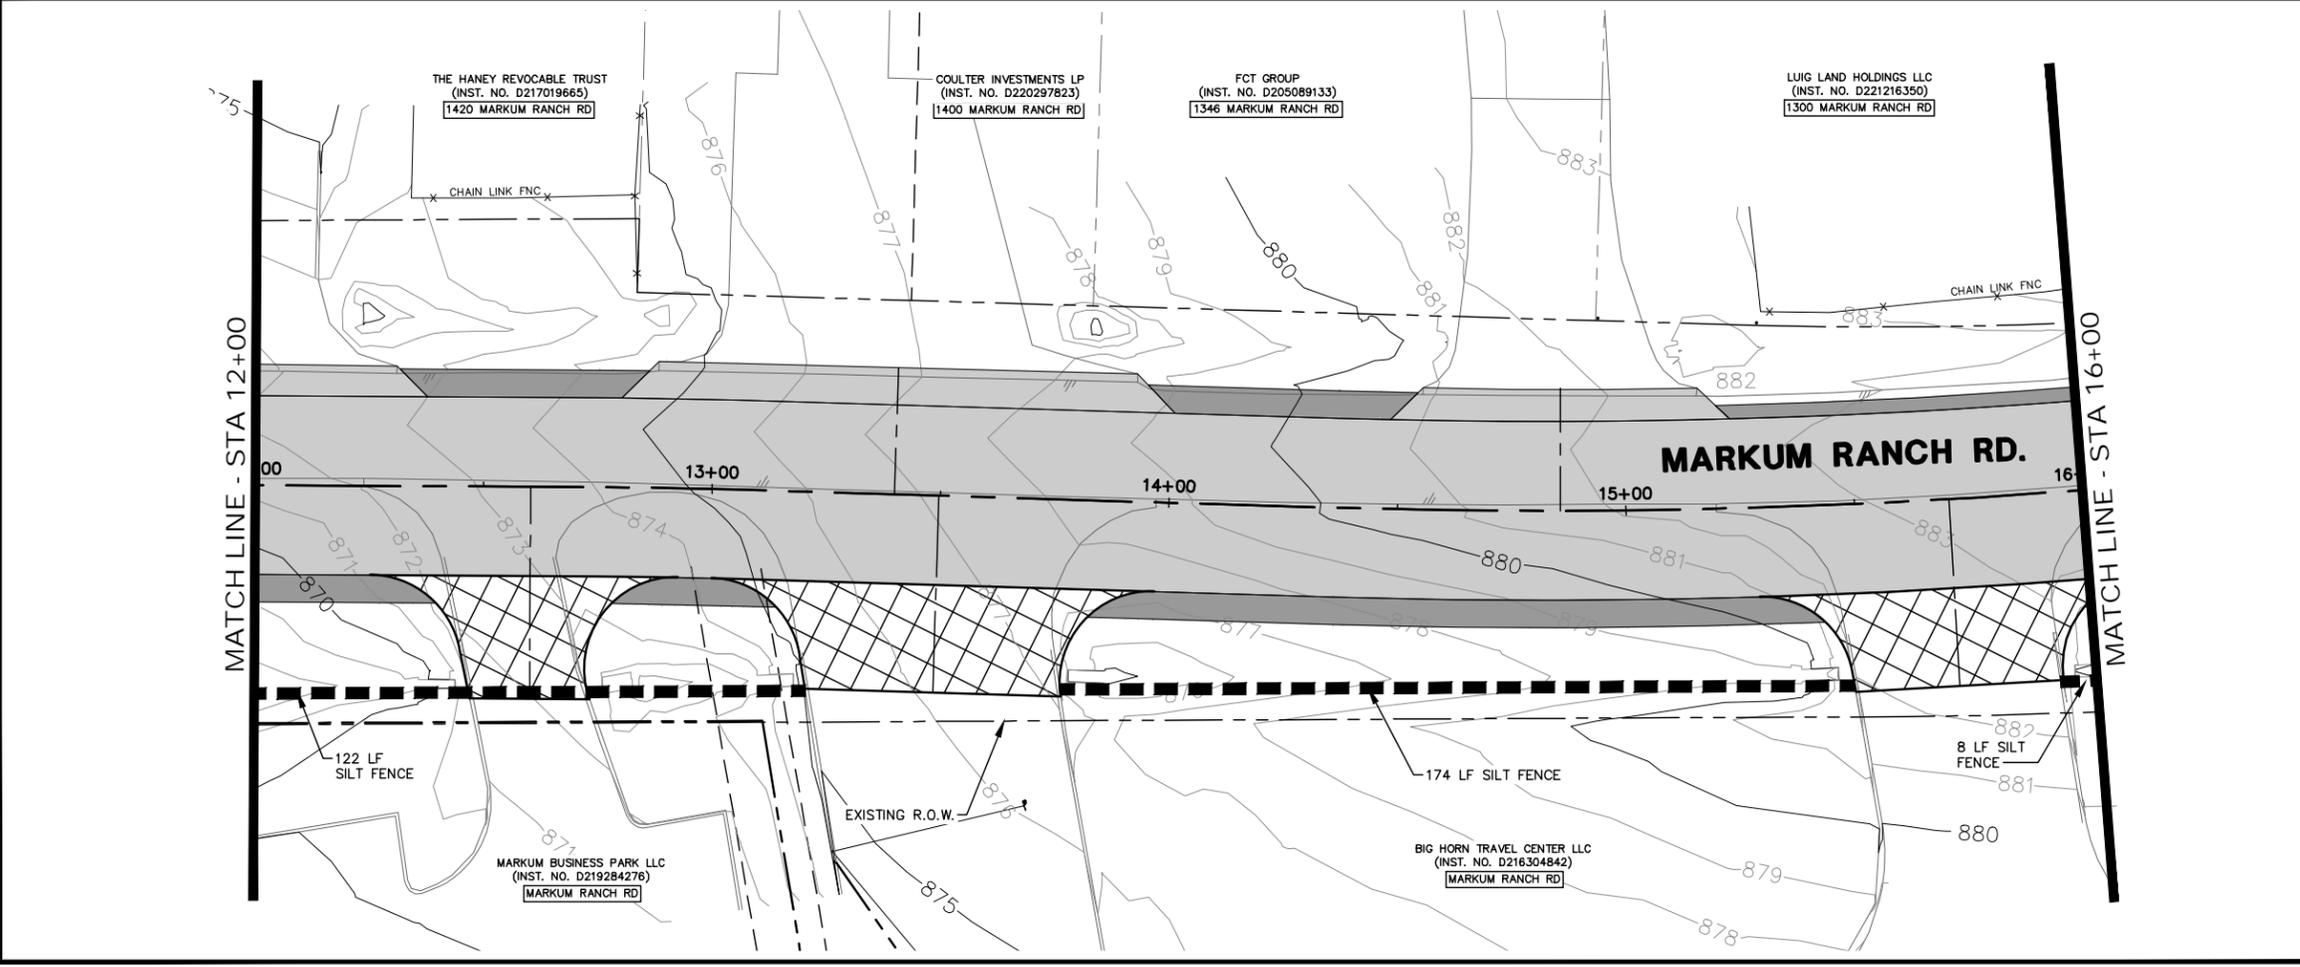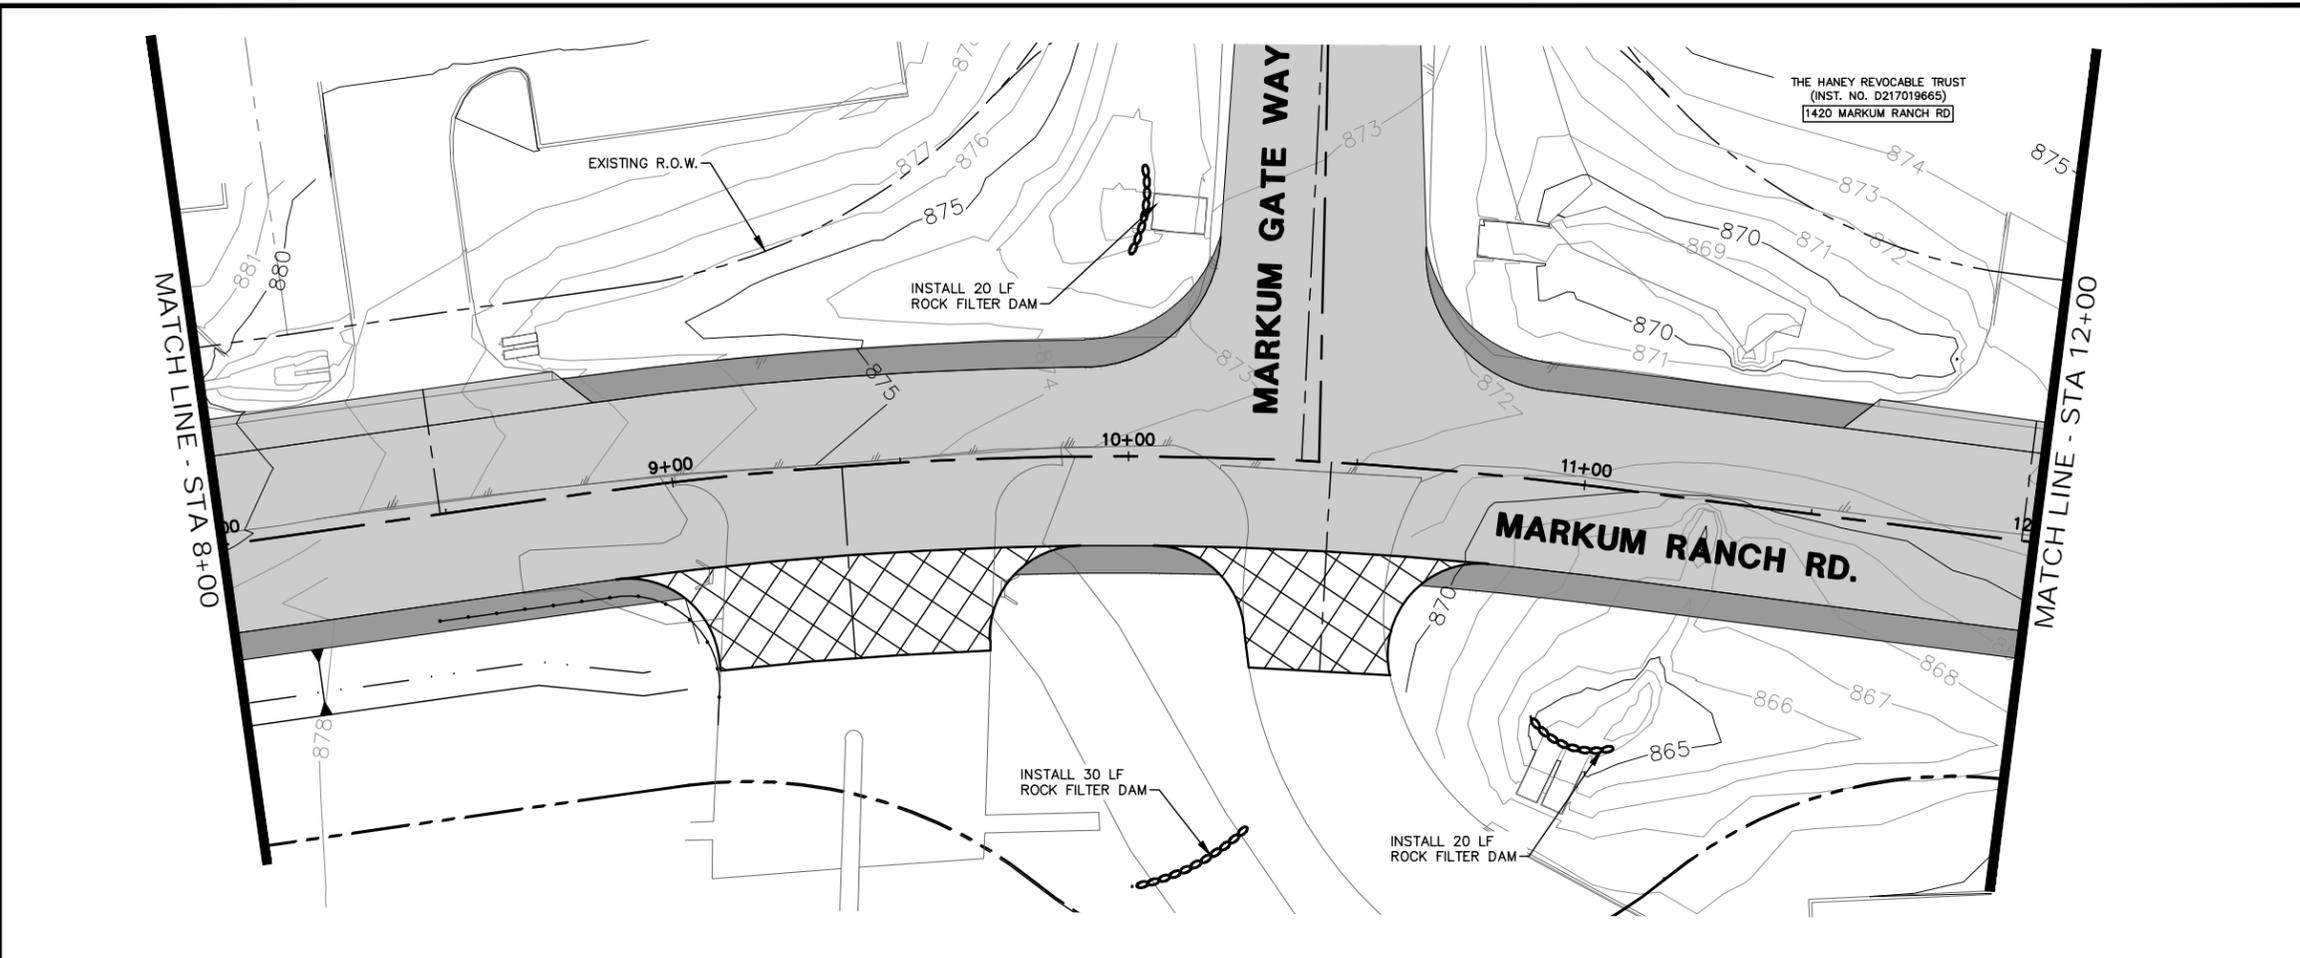

CKT:JRM  
 05/02/2023 11:41AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\33D\_2018\5460-22.506\_EC.DWG

MARKUM RANCH ROAD WIDENING



LEGEND

- ◇ FIRE HYDRANT
- ⊙ WATER METER
- ⊙ WATER VALVE
- ⊙ WATER MANHOLE
- ▽ SPRINKLER HEAD
- ⊠ SPRINKLER CONTROL BOX
- ⊠ HOSE BIB
- ⊙ STORM DRAIN MANHOLE
- ⊙ SANITARY SEWER MANHOLE
- ⊙ SANITARY SEWER CLEANOUT
- ⊙ POWER POLE
- ⊙ POWER POLE ANCHOR
- ⊙ LIGHT POLE
- ⊙ GROUND LIGHT
- ⊙ ELECTRIC MANHOLE
- ⊙ UNDERGROUND ELECTRIC MARKER
- ⊙ ELECTRIC RISER
- FH OVERHEAD ELECTRIC
- WM ELECTRIC TRANSFORMER PAD
- WV TRAFFIC LIGHT POLE
- WMH TRAFFIC SIGNAL CONTROL BOX
- SH ELECTRIC SERVICE
- ⊙ ELECTRIC METER
- ⊙ PHONE MANHOLE
- ⊙ BURIED PHONE LINE
- ⊙ PHONE RISER
- ⊙ GAS METER
- ⊙ GAS VALVE
- ⊙ UNDERGROUND GAS MARKER
- ⊙ GAS MANHOLE
- ⊙ FENCE LINE
- ⊙ ASPHALT PAVEMENT
- ⊙ TRAFFIC SIGN
- ⊙ BOLLARD POST
- ⊙ MAIL BOX
- OE XFMR
- TLP TSCB
- ESRV EM
- PHMH UPM
- PHR PHR
- GM GY
- UGM UGM
- CMH CMH
- FNC FNC
- ASPH ASPH
- SGN SGN
- BP BP
- MB MB

- PROPOSED FLEXIBLE BASE SHOULDER
- PROPOSED CONCRETE PAVEMENT
- PROPOSED SILT FENCE
- PROPOSED ROCK FILTER DAM



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.


NO.	DATE	REVISION

**Pacheco Koch**  
a Westwood company  
4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001

MARKUM RANCH ROAD  
EROSION CONTROL PLAN  
STA 16+00 TO STA 20+13.90

MARKUM RANCH ROAD WIDENING  
TARRANT COUNTY, TEXAS

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	34

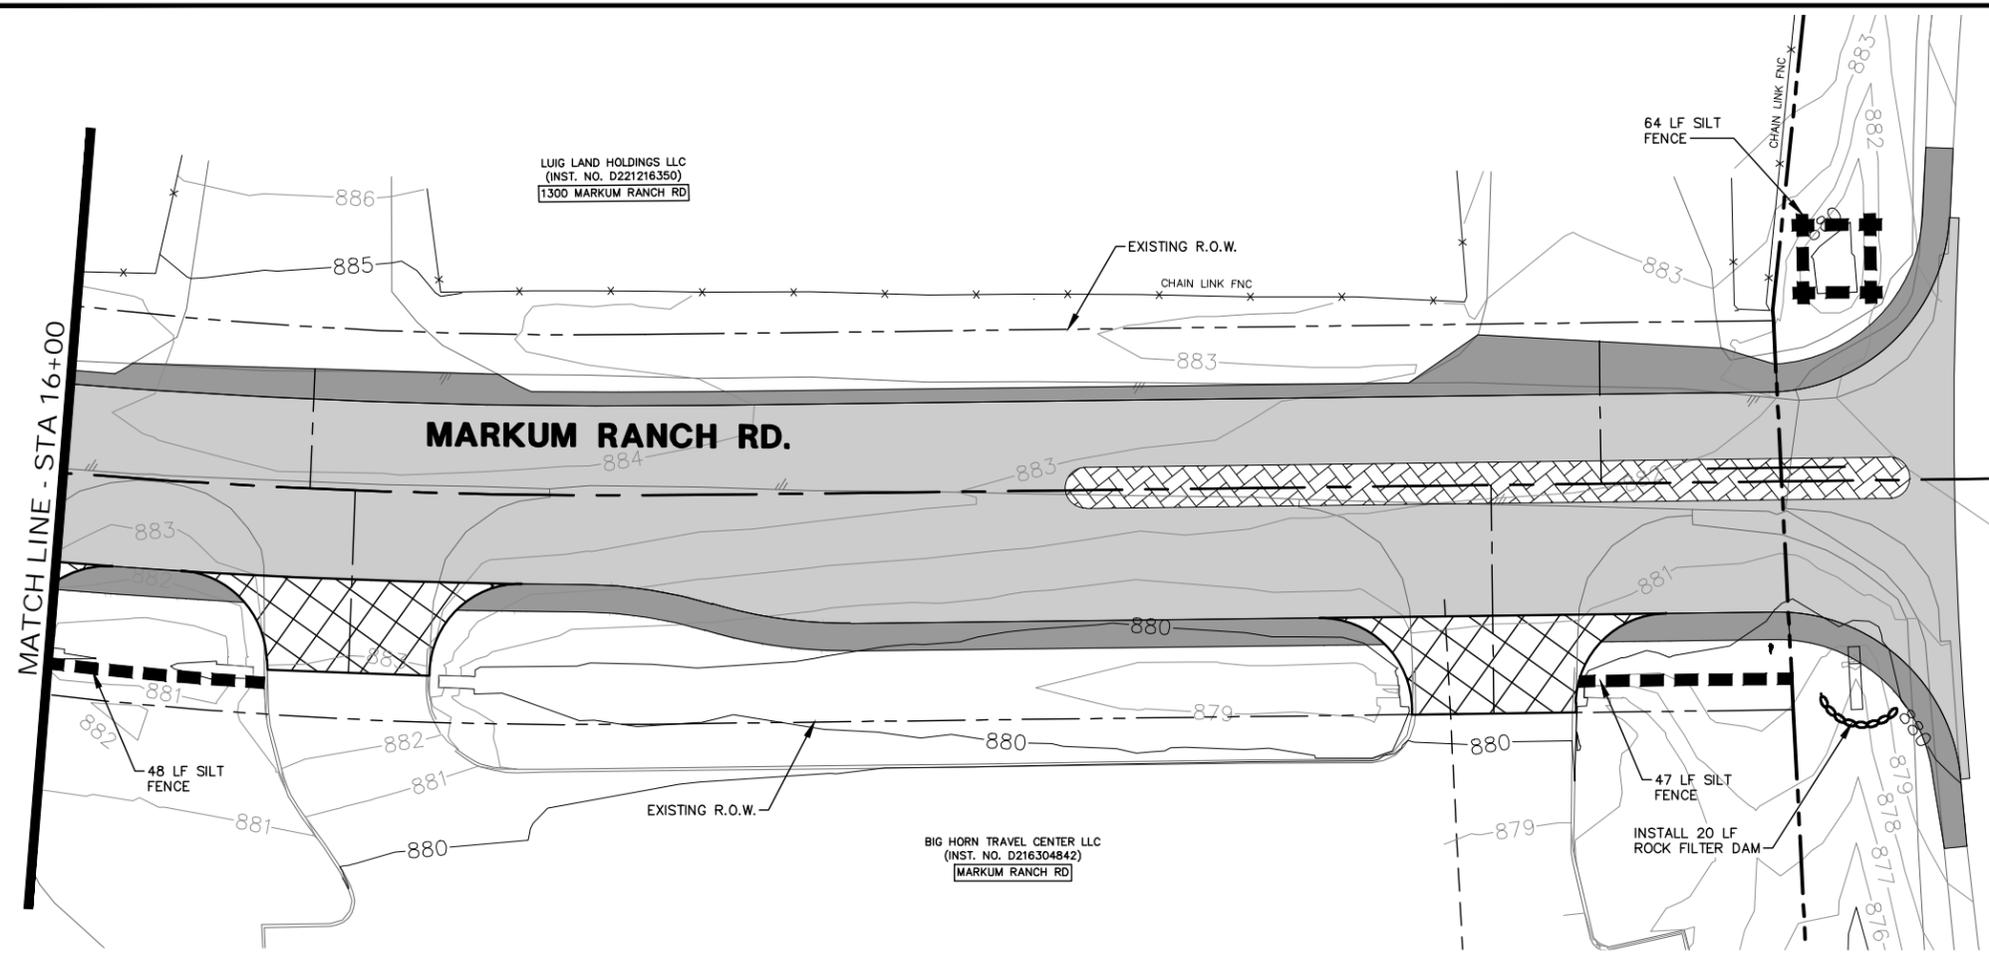

INTERSTATE HWY. 20  
E. BOUND ACCESS ROAD

MATCHLINE - STA 16+00


LUIG LAND HOLDINGS LLC  
(INST. NO. D221216350)  
1300 MARKUM RANCH RD

BIG HORN TRAVEL CENTER LLC  
(INST. NO. D216304842)  
MARKUM RANCH RD


CKT:JMR  
 05/02/2023 - 11:41AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\3D\ 2018\5460-22.506\_EC.DWG

MARKUM RANCH ROAD WIDENING


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

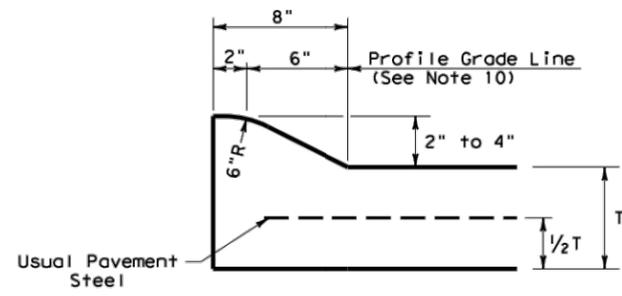


**TYPE I CURB (MONOLITHIC)**  
2" - 4" HEIGHT

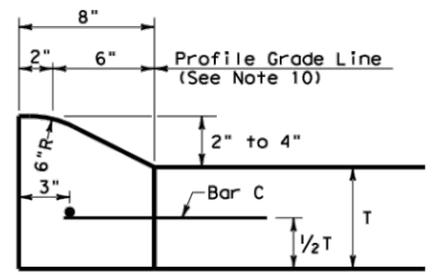


**TYPE I CURB**  
2" - 4" HEIGHT

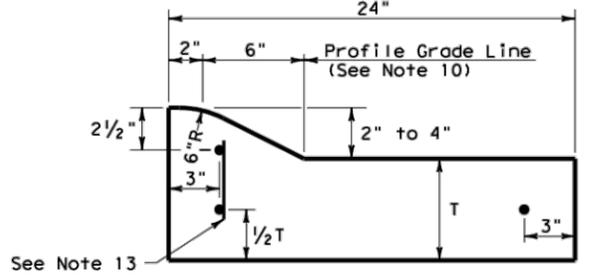


**TYPE I CURB AND GUTTER**  
2" - 4" HEIGHT

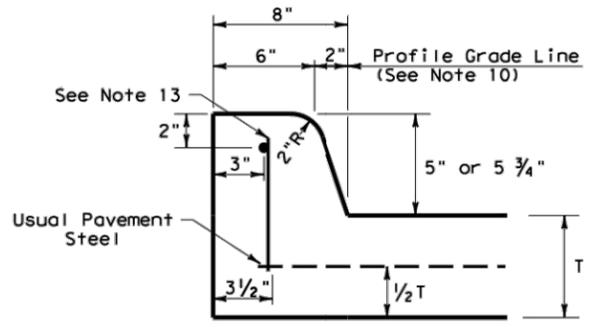


**TYPE II CURB (MONOLITHIC)**  
5" - 5 3/4" HEIGHT

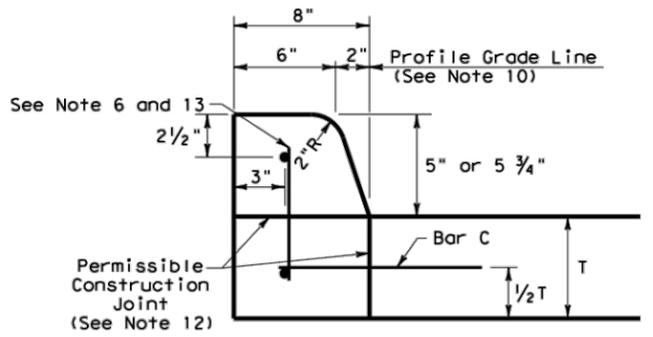


**TYPE II CURB**  
5" - 5 3/4" HEIGHT

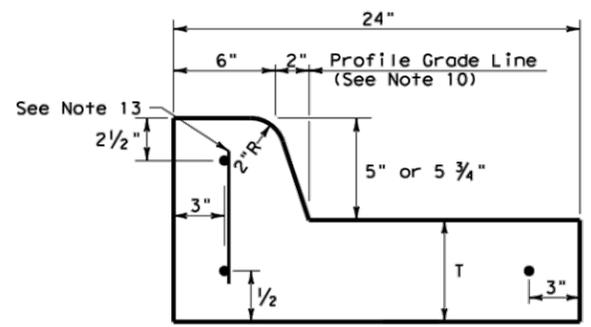


**TYPE II CURB AND GUTTER**  
5" - 5 3/4" HEIGHT

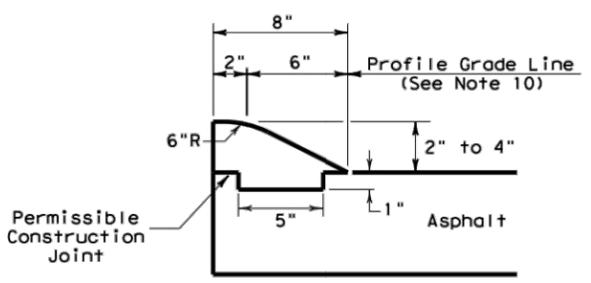


**TYPE III CURB (KEYED)**  
2" - 4" HEIGHT

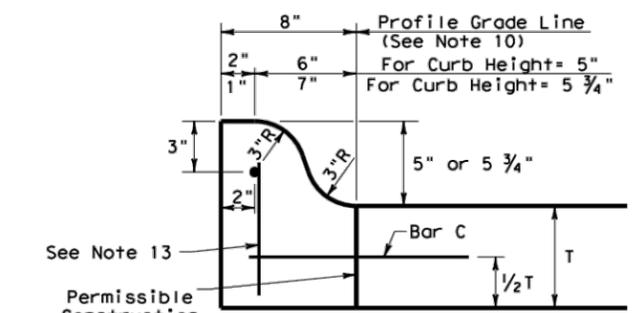


**TYPE IIa CURB**  
5" - 5 3/4" HEIGHT

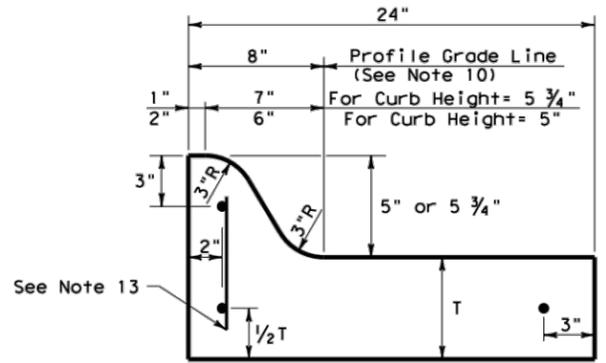


**TYPE IIa CURB AND GUTTER**  
5" - 5 3/4" HEIGHT

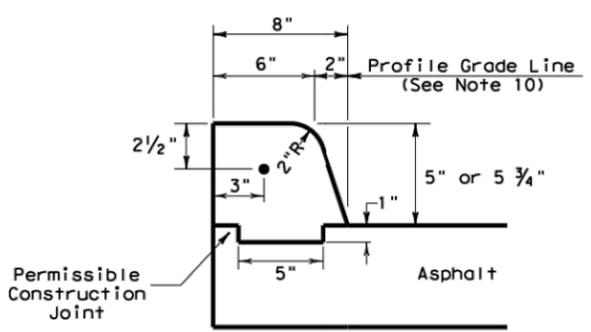

**TYPE IV CURB (KEYED)**  
5" - 5 3/4" HEIGHT

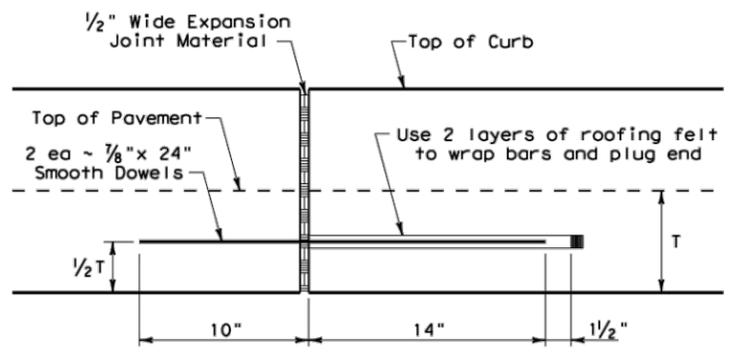


**EXPANSION JOINT DETAIL**

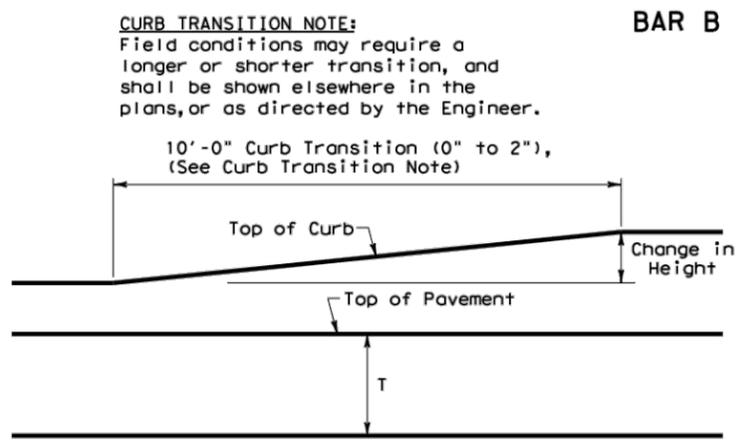

**CURB TRANSITION**  
Note: To be paid for as Highest Curb

**GENERAL NOTES**

- All materials and construction shall be in accordance with Item 529, "Concrete Curb, Gutter, and Combined Curb and Gutter."
- Concrete shall be Class A.
- When reinforcing bars are used, they shall be No.4 unless otherwise shown. The use of fiber reinforced concrete in lieu of reinforcing steel is acceptable. Use fibers meeting the requirements of DMS 4550, "Fibers for Concrete," and dose fibers in accordance with Material Producers List (MPL) "Fibers for Class A and B Concrete Applications."
- Round exposed sharp edges with a rounding tool, to a minimum radius of 1/4 inch.
- All existing curbs and driveways to be removed shall be sawed or removed at existing joints.
- Where concrete curb is to be placed on existing concrete pavement, Bar B may be drilled and grouted in place, or may be inserted into fresh concrete.
- Expansion and contraction joints shall be constructed to match pavement joints in all curbs and curb and gutter adjacent to jointed concrete pavement. Where placement of curb or curb and gutter is not adjacent to concrete pavement, expansion joints shall be provided at structures, curb returns at streets, and at locations directed by The Engineer.
- Vertical and horizontal dowel bars and transverse reinforcing bars shall be placed at four feet C-C.
- Dimension 'T' shown is the thickness of concrete pavement. When curb is installed adjacent to flexible pavement dimension 'T' is 8" maximum.
- Usual profile grade line. Refer to typical sections and plan-profile sheets for exact locations.
- One-half inch expansion joint material shall be provided where curb or curb and gutter is adjacent to sidewalk or riprap.
- When horizontal permissible construction joints are used, the longitudinal pavement steel shall be placed in accordance with pavement details shown elsewhere in the plans. Reinforcing steel for curb section shall then conform to that required for concrete curb.
- Bar B placement as needed (typically at four ft. C-C) to support curb reinforcing steel during concrete placement.

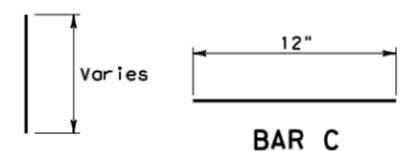

**BAR B**

**BAR C**


**CURB TRANSITION NOTE:**  
Field conditions may require a longer or shorter transition, and shall be shown elsewhere in the plans, or as directed by the Engineer.

		<b>Design Division Standard</b>	
<h2>CONCRETE CURB AND GUTTER</h2>			
<h3>CCCG-22</h3>			
FILE: cccg21.dgn	DN: TxDOT	CK: AN	DW: CS
© TxDOT: JUNE 2022	CONT: SECT	JOB:	HIGHWAY:
REVISIONS		DIST:	COUNTY:
		SHEET NO. 35	


DATE: FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


METHOD B: JOINT SEALING COMPOUND

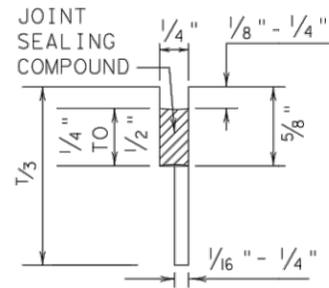


LONGITUDINAL SAWED CONTRACTION JOINT

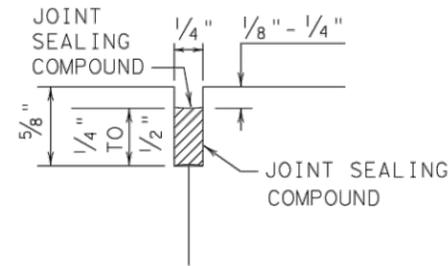


LONGITUDINAL OR TRANSVERSE CONSTRUCTION JOINT

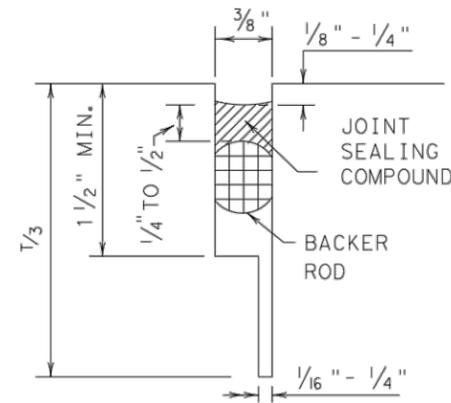

TRANSVERSE SAWED CONTRACTION JOINT

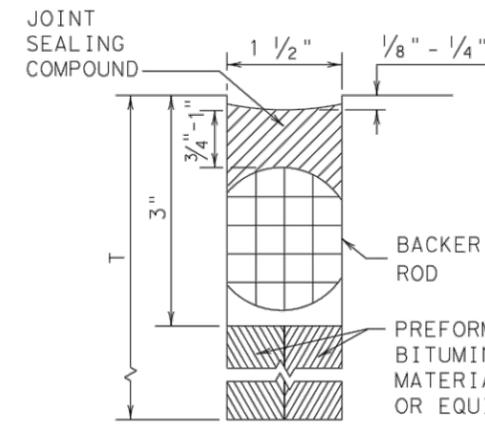


TRANSVERSE FORMED EXPANSION JOINT

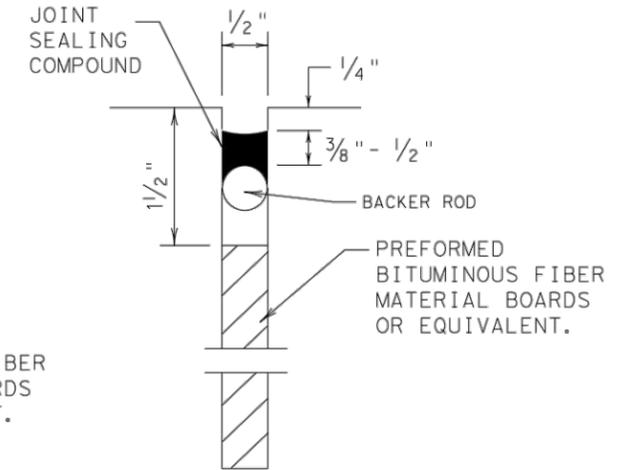


FORMED ISOLATION JOINT


METHOD A: PREFORMED COMPRESSION SEALS (PCS) (DMS-6310 CLASS 6)

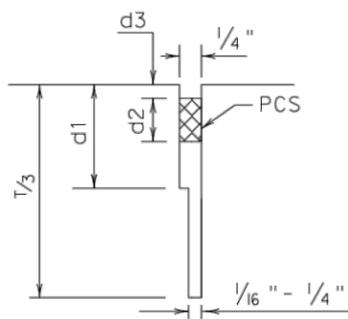


LONGITUDINAL SAWED CONTRACTION JOINT

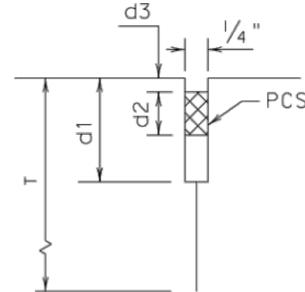

LONGITUDINAL CONSTRUCTION JOINT

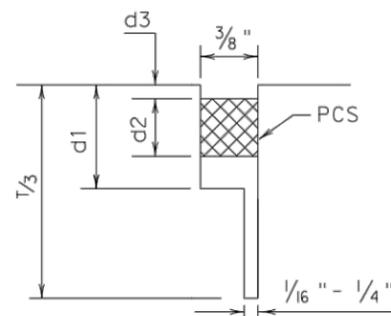

TRANSVERSE SAWED CONTRACTION JOINT

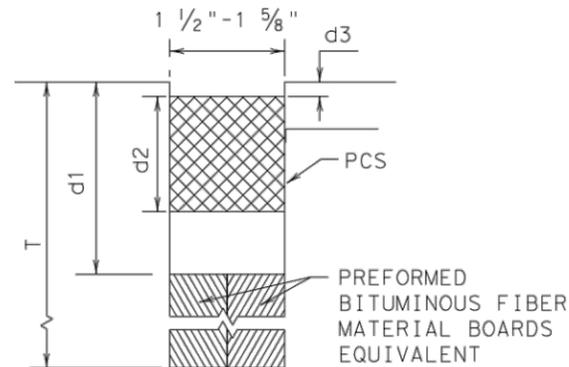

TRANSVERSE FORMED EXPANSION JOINT

GENERAL NOTES

- UNLESS OTHERWISE SHOWN IN THE PLANS, EITHER METHOD "A" OR METHOD "B" MAY BE USED.
- THE LOCATION OF JOINTS SHALL BE AS SHOWN ELSEWHERE IN THE PLANS.
- THE JOINT RESERVOIR FOR SEALANT OR PCS SHALL BE SAWED UNLESS OTHERWISE SHOWN ON THE PLANS FOR THE LONGITUDINAL AND TRANSVERSE CONSTRUCTION JOINTS AND THE SAWED JOINTS.
- DIMENSIONS d1, d2, AND d3 SHOWN IN METHOD A SHALL BE IN ACCORDANCE WITH THE PREFORMED COMPRESSION SEAL MANUFACTURER'S RECOMMENDATION.
- REFER TO DMS-6310 "JOINT SEALANTS AND FILLERS" FOR THE CLASSIFICATIONS.
- FOR SAWED LONGITUDINAL JOINT, LONGITUDINAL OR TRANSVERSE CONSTRUCTION JOINT, USE JOINT SEALANT CLASS 5 OR 8 UNLESS OTHERWISE SHOWN ON THE PLAN OR APPROVED.
- FOR TRANSVERSE SAWED CONTRACTION, TRANSVERSE FORMED EXPANSION JOINT, AND ISOLATION JOINT USE JOINT SEALANT CLASS 5 OR 8 AT NEW JOINTS. USE JOINT SEALANT CLASS 4, 5, 7, OR 8 FOR MAINTAINING EXISTING JOINTS.
- THE JOINTS SHALL BE CLEANED IN ACCORDANCE WITH THE ITEM 438 "CLEANING AND SEALING JOINTS" OR ITEM 713 "CLEANING AND SEALING JOINTS AND CRACKS (CONCRETE PAVEMENT)".
- ISOLATION JOINTS ACCOMMODATE HORIZONTAL AND VERTICAL MOVEMENTS THAT OCCUR BETWEEN A PAVEMENT AND A STRUCTURE. ISOLATION JOINTS MAY BE USED FOR BRIDGE ABUTMENTS, INTERSECTIONS, CURB AND GUTTER, OLD AND NEW PAVEMENTS, OR AROUND DRAINAGE INLETS, MANHOLES, FOOTINGS AND LIGHTING STRUCTURES.

		Design Division Standard	
<b>CONCRETE PAVING DETAILS</b> <b>JOINT SEALS</b> <b>JS-14</b>			
FILE: js14.dgn	DN: TxDOT	DN: HC	CK: AN
© TxDOT: DECEMBER 2014	CONT	SECT	HIGHWAY
REVISIONS			
DIST	COUNTY	SHEET NO.	
		36	


DATE: FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: FILE:

SLAB THICKNESS AND BAR SIZE		REGULAR STEEL BARS	FIRST SPACING AT EDGE OR JOINT	ADDITIONAL STEEL BARS AT TRANSVERSE CONSTRUCTION JOINT (SECTION X-X)	
T (IN.)	BAR SIZE	SPACING C (IN.)	SPACING a (IN.)	SPACING 2 X C (IN.)	LENGTH L (IN.)
7.0	#5	6.5	3 TO 4	13	50
7.5	#5	6.0	3 TO 4	12	50
8.0	#6	9.0	3 TO 4	18	50
8.5	#6	8.5	3 TO 4	17	50
9.0	#6	8.0	3 TO 4	16	50
9.5	#6	7.5	3 TO 4	15	50
10.0	#6	7.0	3 TO 4	14	50
10.5	#6	6.75	3 TO 4	13.5	50
11.0	#6	6.5	3 TO 4	13	50
11.5	#6	6.25	3 TO 4	12.5	50
12.0	#6	6.0	3 TO 4	12	50
12.5	#6	5.75	3 TO 4	11.5	50
13.0	#6	5.5	3 TO 4	11	50


SLAB THICKNESS (IN.)	TRANSVERSE STEEL		TIE BARS AT LONGITUDINAL CONSTRUCTION JOINT (SECTION Z-Z)		TIE BARS AT LONGITUDINAL CONSTRUCTION JOINT (SECTION Y-Y)	
	BAR SIZE	SPACING (IN.)	BAR SIZE	SPACING (IN.)	BAR SIZE	SPACING (IN.)
7.0 - 7.5	#5	48	#5	48	#5	24
8.0 - 13.0	#5	48	#6	48	#6	24

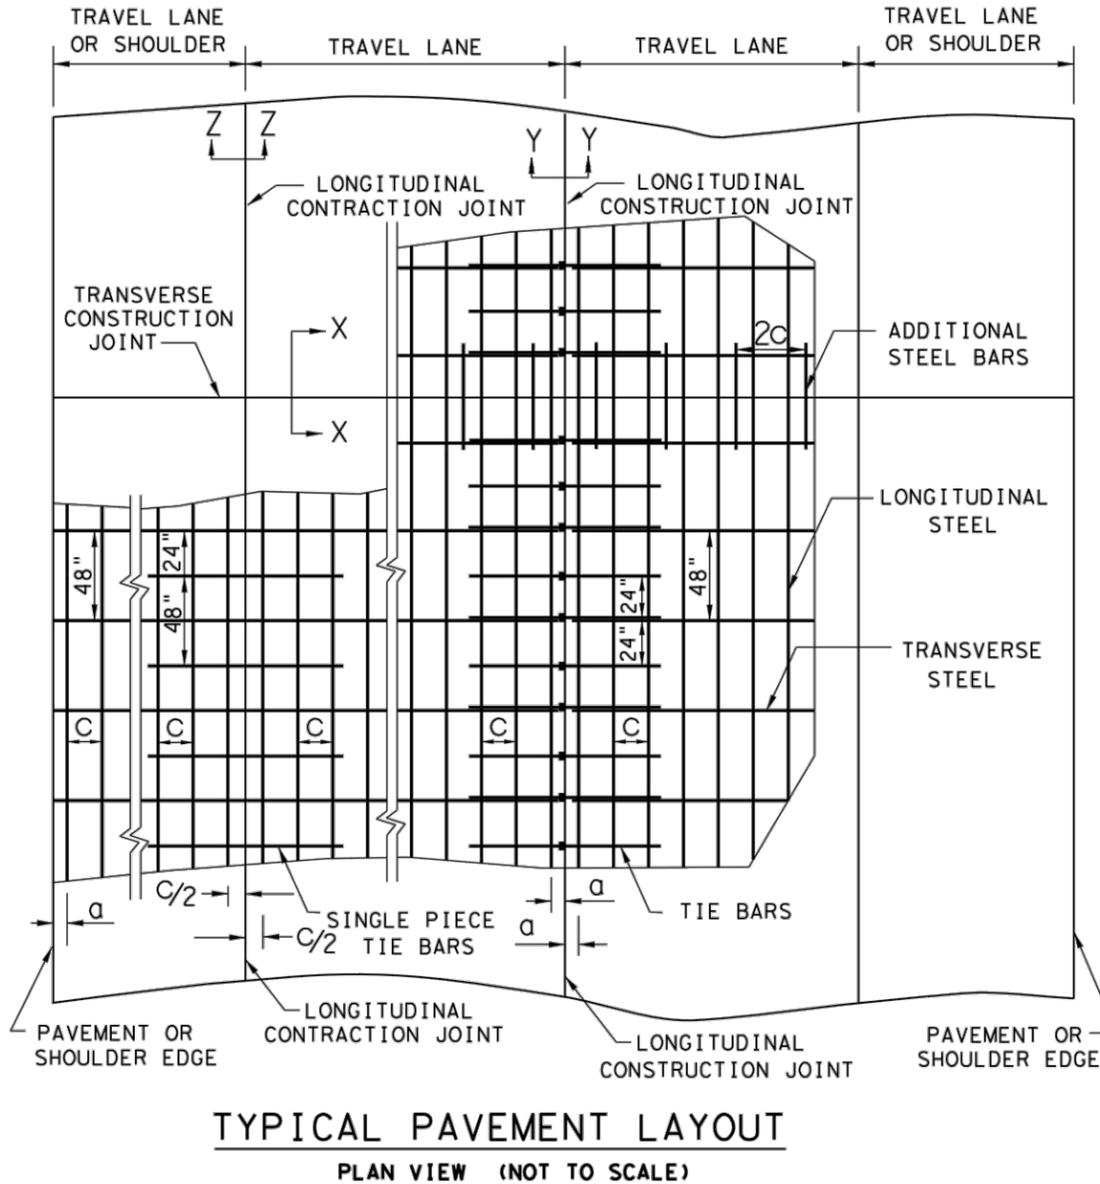


- GENERAL NOTES**
1. DETAILS FOR PAVEMENT WIDTH, PAVEMENT THICKNESS AND THE CROWN CROSS-SLOPE SHALL BE SHOWN ELSEWHERE IN THE PLANS. PAVEMENTS WIDER THAN 100 FT. WITHOUT A FREE LONGITUDINAL JOINT ARE NOT COVERED BY THIS STANDARD.
  2. USE COARSE AGGREGATES WITH A RATED COEFFICIENT OF THERMAL EXPANSION (COTE) OF NOT MORE THAN  $5.5 \times 10^{-6}$  IN/IN/°F AS LISTED IN THE CONCRETE RATED SOURCE QUALITY CATALOG (CRSQC).
  3. ALL THE REINFORCING STEEL AND TIE BARS SHALL BE DEFORMED STEEL BARS CONFORMING TO ASTM A 615 (GRADE 60) OR ASTM A 996 (GRADE 60) OR ABOVE. STEEL BAR SIZES AND SPACINGS SHALL CONFORM TO TABLE NO.1 AND TABLE NO.2.
  4. STEEL BAR PLACEMENT TOLERANCE SHALL BE +/- 1 IN. HORIZONTALLY AND +/- 0.5 IN. VERTICALLY. CALCULATED AVERAGE BAR SPACING (CONCRETE PLACEMENT WIDTH / NUMBER OF LONGITUDINAL BARS) SHALL CONFORM TO TABLE NO.1
  5. PAVEMENT WIDTHS OF MORE THAN 15 FT. SHALL HAVE A LONGITUDINAL JOINT (SECTION Z-Z OR SECTION Y-Y). THESE JOINTS SHALL BE LOCATED WITHIN 6 IN. OF THE LANE LINE UNLESS THE JOINT LOCATION IS SHOWN ELSEWHERE ON THE PLANS.
  6. THE SAW CUT DEPTH FOR THE LONGITUDINAL CONTRACTION JOINT (SECTION Z-Z) SHALL BE ONE THIRD OF THE SLAB THICKNESS (T/3).
  7. WHEN TYING CONCRETE GUTTER AT A LONGITUDINAL JOINT, THE TIE BAR LENGTH OR POSITION MAY BE ADJUSTED. PROVIDE 3 IN. OF CONCRETE COVER FROM THE BACK OF GUTTER TO THE END OF TIE BAR.
  8. REPLACE MISSING OR DAMAGED TIE BARS WITHOUT ADDITIONAL COMPENSATION BY DRILLING MIN. 10 IN. DEEP AND GROUTING TIE BARS WITH TYPE III, CLASS C EPOXY. MEET THE PULL-OUT TEST REQUIREMENTS IN ITEM 361.
  9. OMIT TIE BARS LOCATED WITHIN 18-IN. OF THE TRANSVERSE CONSTRUCTION JOINTS (SECTION X-X). USE HAND-OPERATED IMMERSION VIBRATORS TO CONSOLIDATE THE CONCRETE ADJACENT TO ALL FORMED JOINTS.
  10. LONGITUDINAL REINFORCING STEEL SPLICES SHALL BE A MINIMUM OF 25 IN. STAGGER THE LAP LOCATIONS SO THAT NO MORE THAN 1/3 OF THE LONGITUDINAL STEEL IS SPLICED IN ANY GIVEN 12-FT. WIDTH AND 2-FT. LENGTH OF THE PAVEMENT.
  11. THE DETAIL FOR THE JOINT SEALANT AND RESERVOIR IS SHOWN ON STANDARD SHEET "CONCRETE PAVING DETAILS, JOINT SEALS."

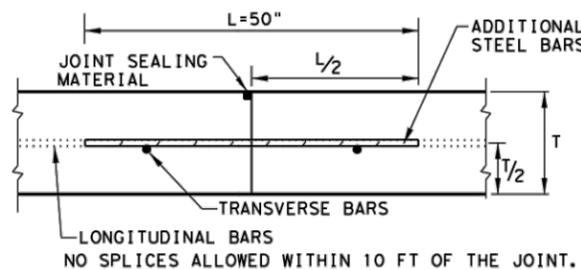

TRANSVERSE CONSTRUCTION JOINT  
SECTION X - X

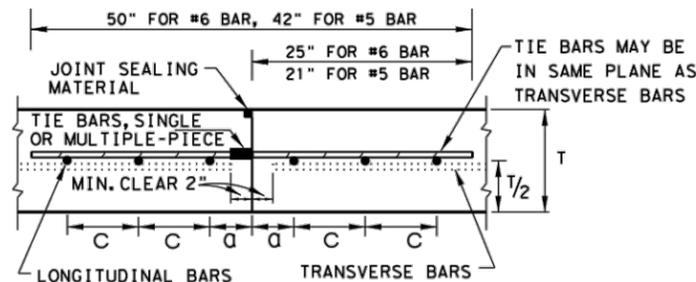

LONGITUDINAL CONSTRUCTION JOINT  
SECTION Y - Y

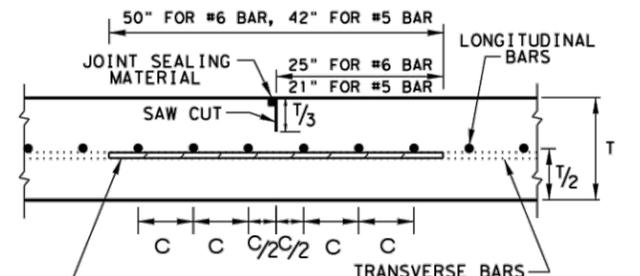


LONGITUDINAL CONTRACTION JOINT  
SECTION Z - Z


SHEET 1 OF 2

		Design Division Standard	
<b>CONTINUOUSLY REINFORCED CONCRETE PAVEMENT</b> <b>ONE LAYER STEEL BAR PLACEMENT</b> <b>T - 7 TO 13 INCHES</b> <b>CRCP (1) - 20</b>			
FILE: crcp120.dgn	DW: TxDOT	CK: KM	DW: AN
© TxDOT: APRIL 2020	CONT	SECT	JOB
10/10/2011 ADD GN #12	DIST	COUNTY	SHEET NO.
04/09/2013 REMOVE 6" AND 6.5" ADD CTE REQUIREMENTS			
05/05/2017 COTE AS RATED 4.3			37


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

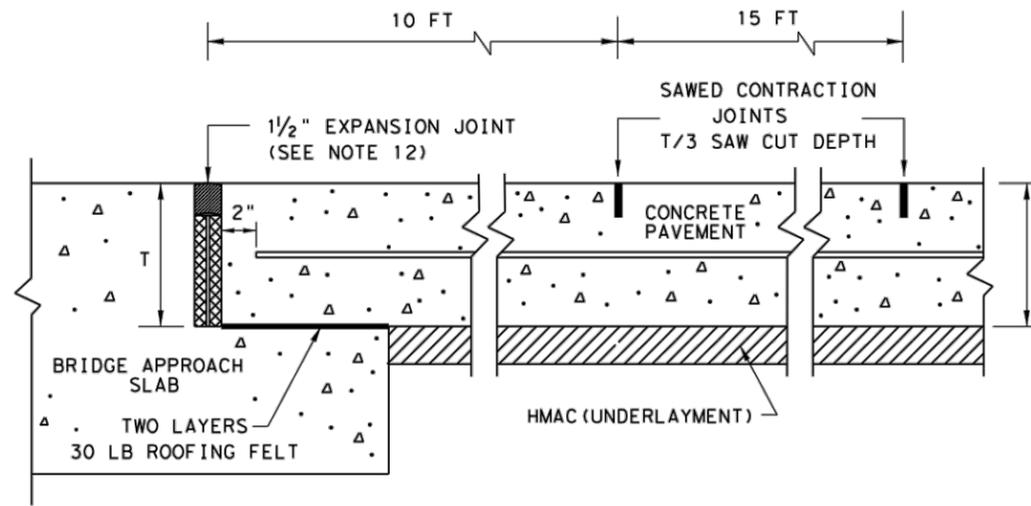


**TRANSVERSE EXPANSION JOINT DETAIL  
AT BRIDGE APPROACH**

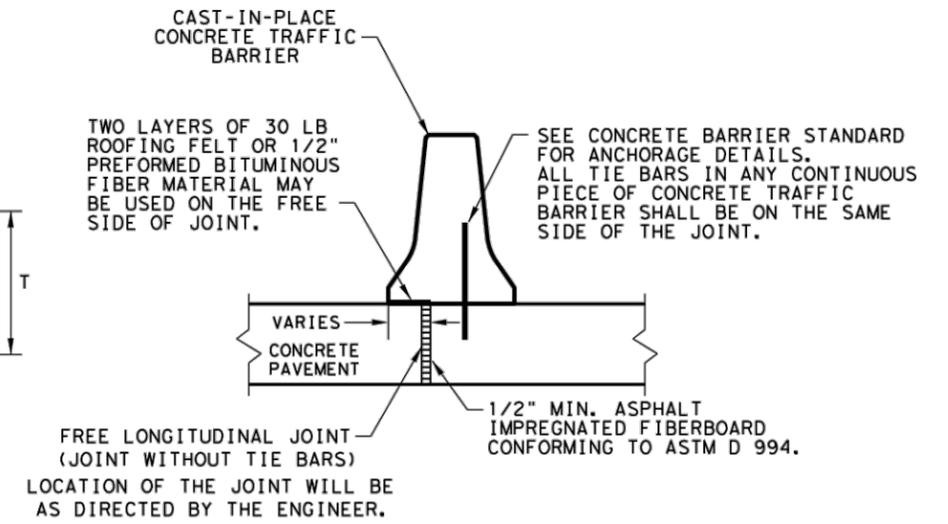

**FREE LONGITUDINAL JOINT DETAIL**

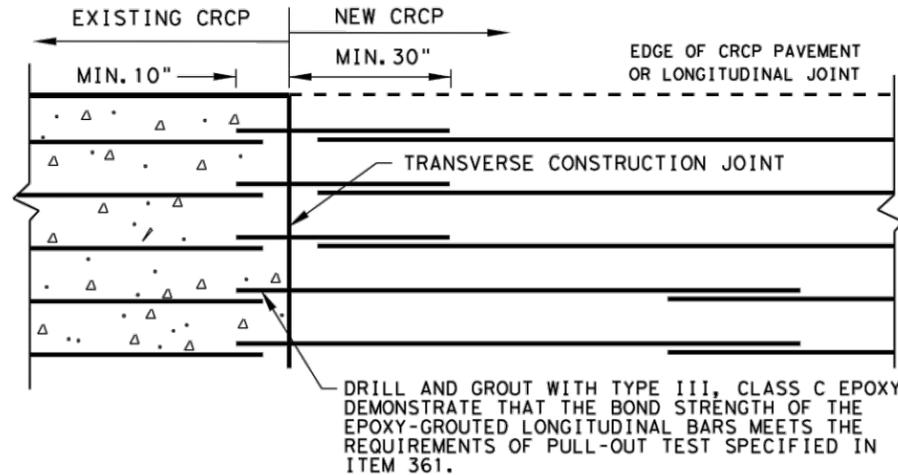


**OPTION A: DRILL AND EPOXY  
PLAN VIEW ( NOT TO SCALE)**

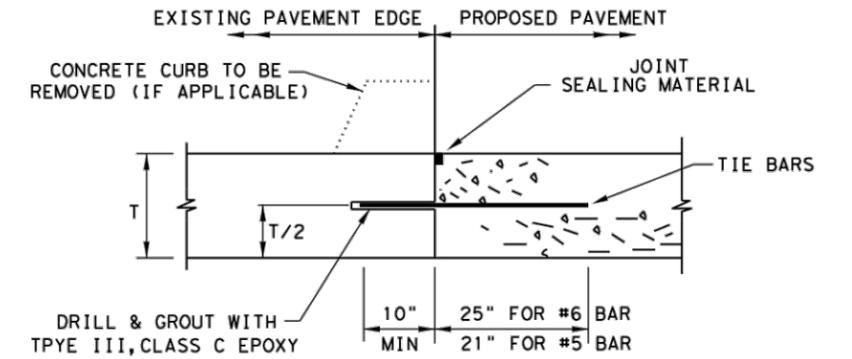


1. BEFORE WIDENING WORK, DEMONSTRATE THAT THE BOND STRENGTH OF THE EPOXY-GROUTED TIE BARS MEETS THE REQUIREMENTS OF PULL-OUT TEST SPECIFIED IN ITEM 361.
2. SPACE TIE BARS AT 24" SPACING. USE #6 TIE BARS FOR 8" AND THICKER SLABS, USE #5 TIE BARS FOR LESS THAN 8" THICK SLABS.

**LONGITUDINAL WIDENING JOINT DETAIL**

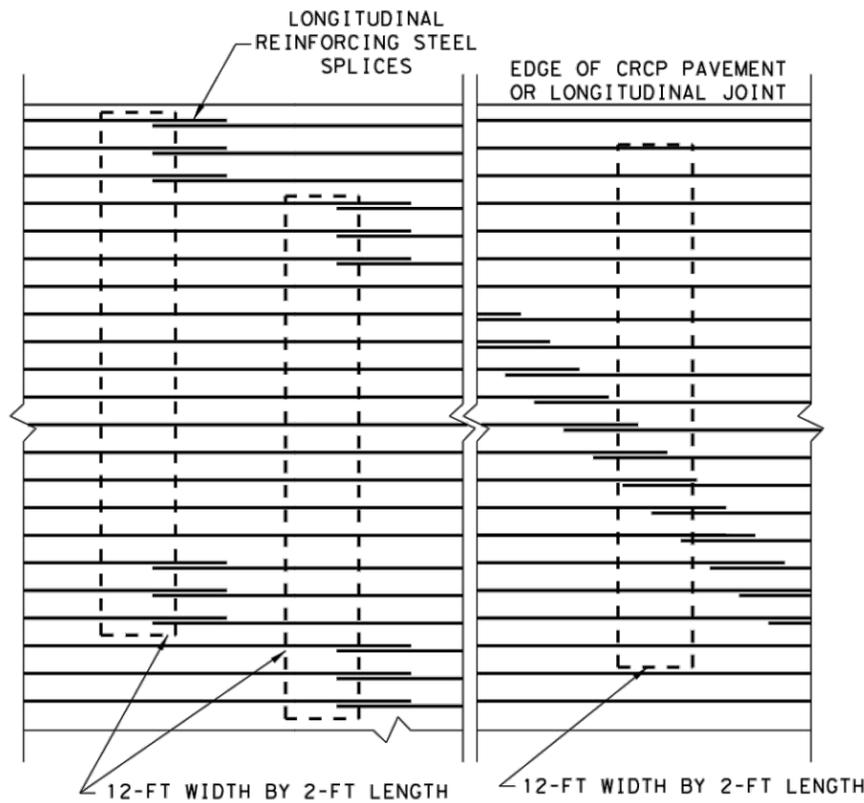

STAGGER THE LAP LOCATIONS SO THAT NO MORE THAN 1/3 OF THE LONGITUDINAL STEEL IS SPLICED IN ANY GIVEN 12-FT. WIDTH AND 2-FT. LENGTH OF THE PAVEMENT. ANY OTHER LAP CONFIGURATION MEETING THIS REQUIREMENT WILL BE ALLOWED.

**EXAMPLES OF LAP CONFIGURATION  
PLAN VIEW ( NOT TO SCALE)**

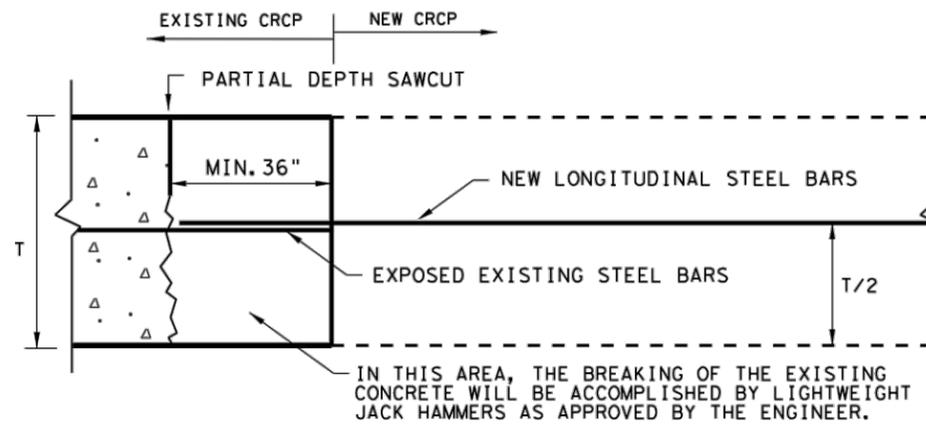

**OPTION B: BREAKBACK AND LAP**

**TRANSVERSE TIE JOINT DETAIL  
EXISTING CRCP TO NEW CRCP**

SHEET 2 OF 2




**CONTINUOUSLY REINFORCED  
CONCRETE PAVEMENT  
ONE LAYER STEEL BAR PLACEMENT  
T - 7 to 13 INCHES  
CRCP (1) - 20**


FILE: crcp120.dgn	DN: TxDOT	CK: KM	DW: AN	CK: VP
© TxDOT: APRIL 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS				
03/16/2020 REMOVED TABLE 1A	DIST	COUNTY	SHEET NO.	
			38	

DATE: FILE:


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

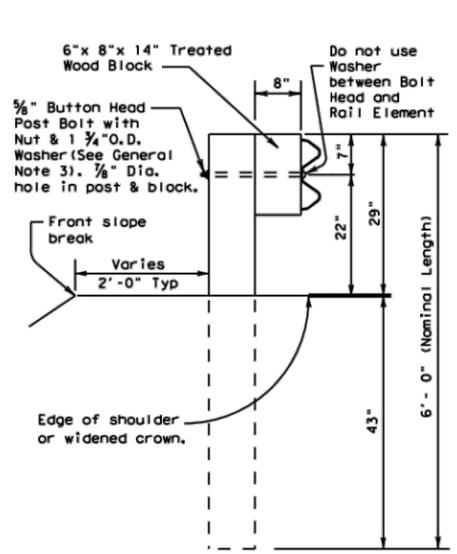


**TYPICAL POST**

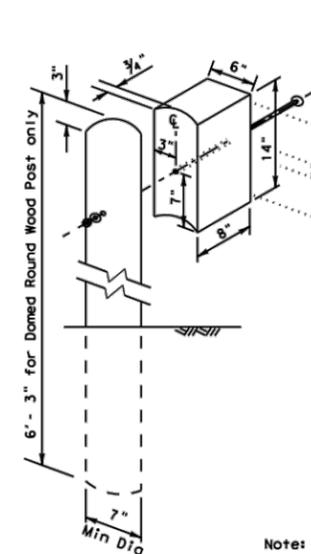


**WOOD BLOCK TO ROUND WOOD POST**

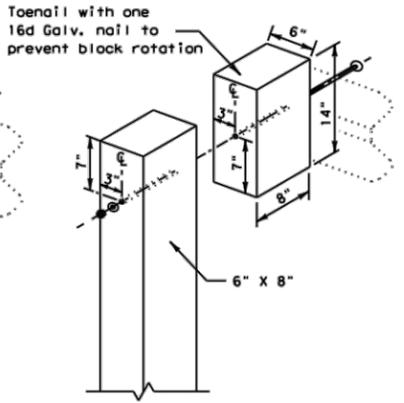


**WOOD BLOCK TO RECTANGULAR WOOD POST**

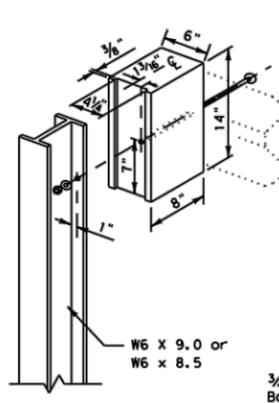


**WOOD BLOCK TO STEEL POST**

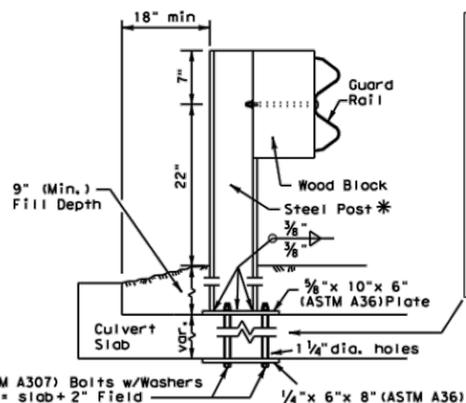


**\* LOW FILL CULVERT POST**

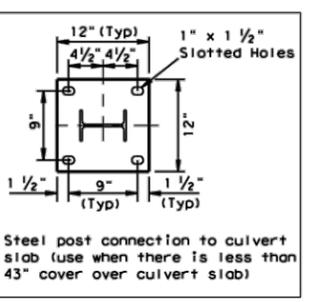

Steel post connection to culvert slab (use when there is less than 43" cover over culvert slab)

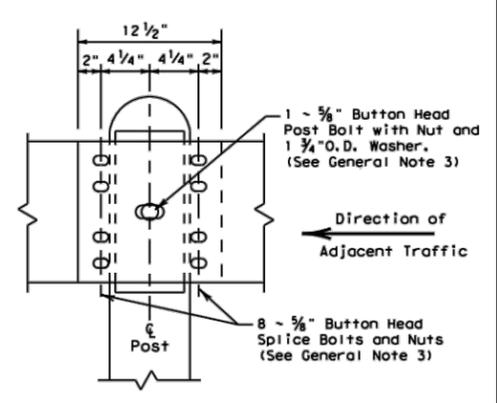

**RAIL SPLICE DETAIL**

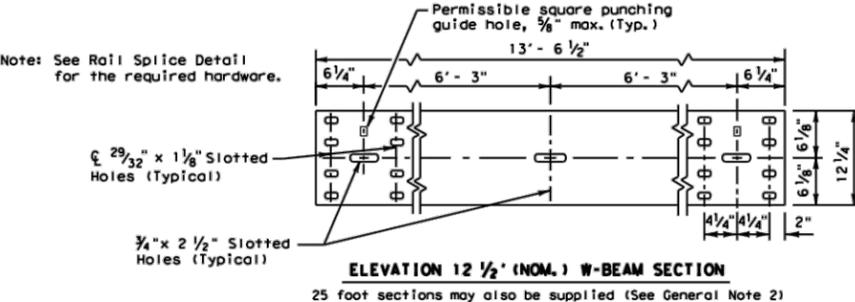


**ELEVATION 12 1/2" (NOM.) W-BEAM SECTION**  
25 foot sections may also be supplied (See General Note 2)


FOR USE ON NON-BRIDGE CLASS CULVERTS ONLY

**GENERAL NOTES**


- The type of post (round wood post, rectangular wood post, or steel post) will be shown elsewhere in the plans. The exact position of MBSG shall be shown elsewhere in the plans or as directed by the Engineer. Steel posts to be galvanized in accordance with Item 445, "Galvanizing."
- Rail element shall meet the requirements of Item 540, "Metal Beam Guard Fence" except as modified on the plans. The Contractor may furnish rail elements of 12 1/2 or 25 foot nominal lengths.
- Button head "post" bolts (ASTM A307) shall be of sufficient length to extend through the full thickness of the nut (ASTM A563) and Type A (1 3/4" O.D.) washer and not more than 1" beyond it. Button head "splice" bolts (ASTM A307) are 5/8" x 1 1/4" (or 2" long at triple rail splices) with a 3/8" double recessed nut (ASTM A563).
- Fittings (bolts, nuts, and washers) shall be galvanized in accordance with Item 445, "Galvanizing." Fittings shall be subsidiary to the bid item.
- Crown shall be widened to accommodate the Metal Beam Guard Fence.
- The lateral approach to the guard fence, shall have a slope rate of not more than 1V:10H.
- Unless otherwise shown in the plans, guard fence placed in the vicinity of curbs shall be positioned so that the face of curb is located directly below or behind the face of the block. Rail placed over curbs shall be installed so that the post bolt is located approximately 21 inches above the gutter pan or roadway surface.
- If solid rock is encountered within 0 to 18" of the finished grade, drill a 22" dia. hole, 24" into the rock, or drill two 12" dia. front to back overlapping holes, 24" into the rock. If solid rock is encountered below 18", drill a 12" dia. hole, 12" into the rock or to the standard embedment depth, whichever is less. Any excess post length, after meeting these depths, may be field cut to ensure proper guardrail mounting height. Backfill with a cohesionless material.
- Posts shall not be set in concrete, of any depth.
- Special fabrication will be required at installations having a curvature of less than 150 ft. radius.
- The terminal anchor section (TAS) post shall be set in Class A concrete (unless otherwise shown in the plans) in accordance with Item 421, "Hydraulic Cement Concrete." Concrete shall be subsidiary to the bid item requiring construction of the terminal anchor section (TAS). Terminal anchor post to be galvanized in accordance with Item 445, "Galvanizing."
- Unless otherwise shown in the plans, a composite material post and/or block that meets the requirements of DMS-7210, "Composite Material Posts and Blocks for Metal Beam Guard Fence" may be substituted for posts and/or blocks of similar dimensions. The Construction Division, TxDOT maintains a Material Producer List (MPL) for producers of materials conforming to DMS-7210. Only producers on the MPL can furnish composite material posts and/or blocks.

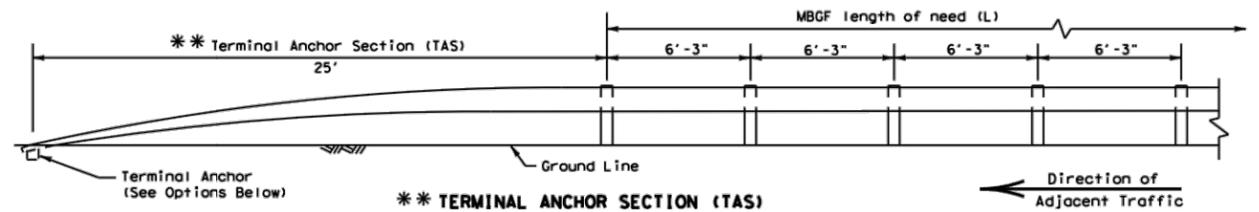

**\*\* TERMINAL ANCHOR SECTION (TAS)**  
Terminal anchor sections are only for downstream use, when located outside the horizontal clearance area of opposing traffic.

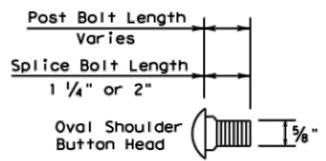


**BUTTON HEAD BOLT**  
Post and Splice Bolts (See General Note 3)

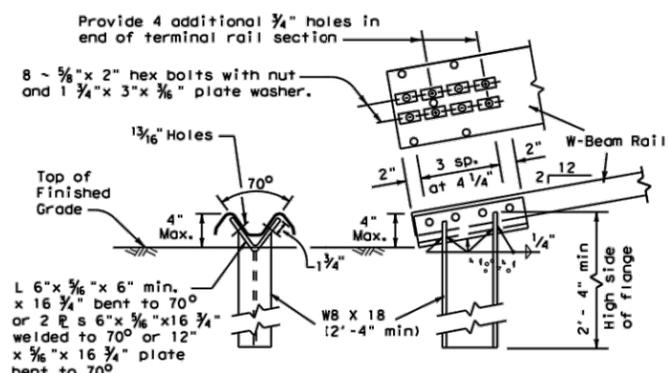

**OPTION (1)**

Note: This anchor post requires four additional 3/4" holes (shop or field) in the rail member with eight 3/8" hex bolts with nut and plate washer.

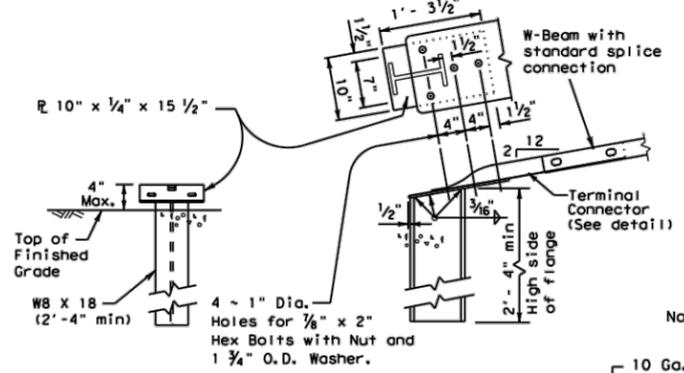


**OPTION (2)**

Note: This anchor post requires the use of the 10 ga. terminal connector with four 3/8" hex bolts with nut and washer.


Note: Terminal Connector to be used with terminal anchor post options 2.

**TERMINAL ANCHOR POST OPTIONS**  
(See General Note 11)

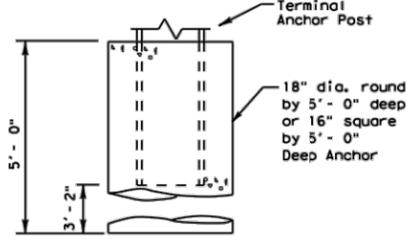


Notes:  
Either concrete anchor may be used with either post option above.  
No construction joint is allowed in the concrete anchor.  
Terminal rail may be bolted to post and in twist position prior to placing concrete anchor.  
If concrete anchor is precast, the area should be compacted as directed by the Engineer, when placed in the field.

**TERMINAL CONCRETE ANCHOR OPTIONS**  
(See General Note 11)

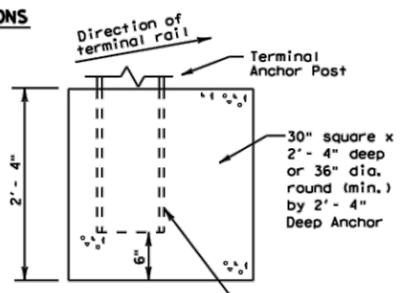

Place face of post approx. on center of anchor

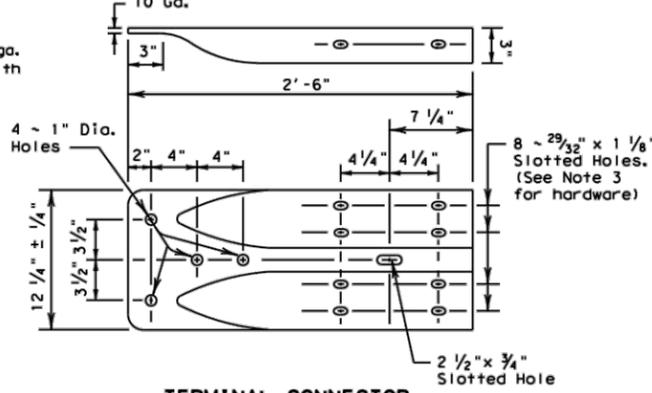

**TERMINAL CONNECTOR**  
For connection hardware to concrete rails, see the MBSG transition standards.

**ONLY FOR USE IN MAINTENANCE REPAIRS OR HIGHLY CONSTRAINED SITE CONDITIONS.**




**METAL BEAM GUARD FENCE**

**MBGF-19**


FILE: mbgf19.dgn	DN: TxDOT	CK: KM	DW: BD	CK: VP
© TxDOT NOVEMBER 2019	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	
			39	

DATE: FILE:

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY TxDOT FOR ANY PURPOSE WHATSOEVER. TxDOT ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

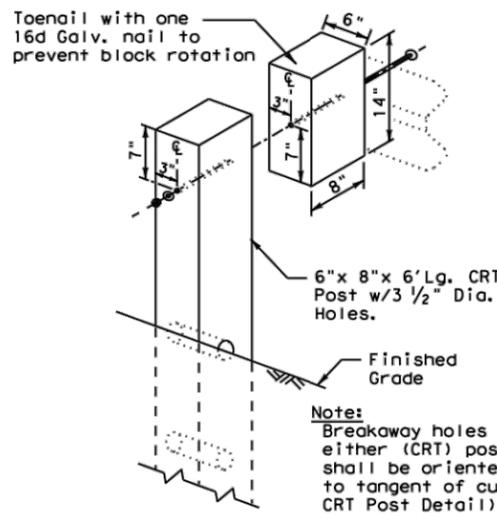


**WOOD BLOCK TO RECTANGULAR WOOD (CRT) POST**  
Showing the required 3 1/2" Dia. holes.

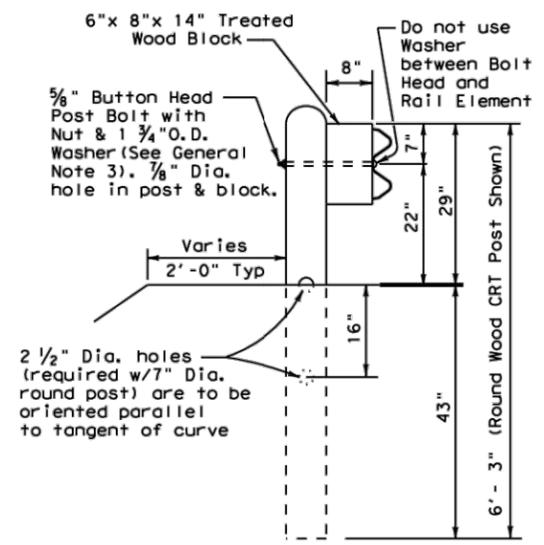


**(CRT) POST DETAIL CONTROLLED RELEASE TERMINAL POST**


Two or more wood CRT post(s) are required at any radius installation located at intersecting roadways or driveways.

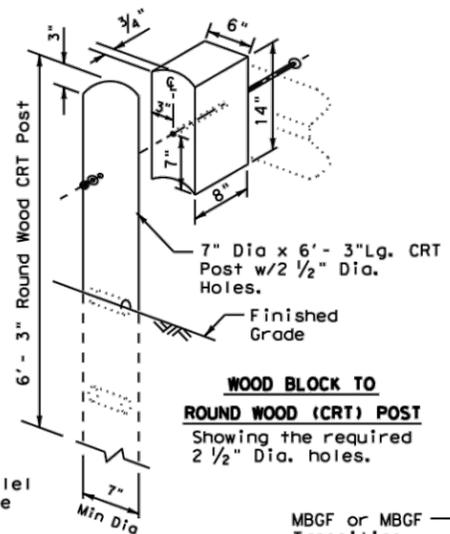

**WOOD BLOCK TO ROUND WOOD (CRT) POST**  
Showing the required 2 1/2" Dia. holes.

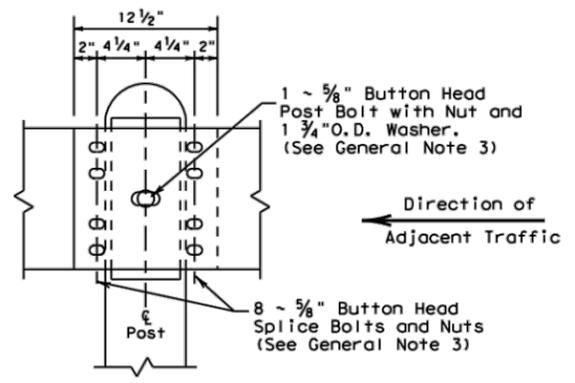

**RAIL SPLICE DETAIL**

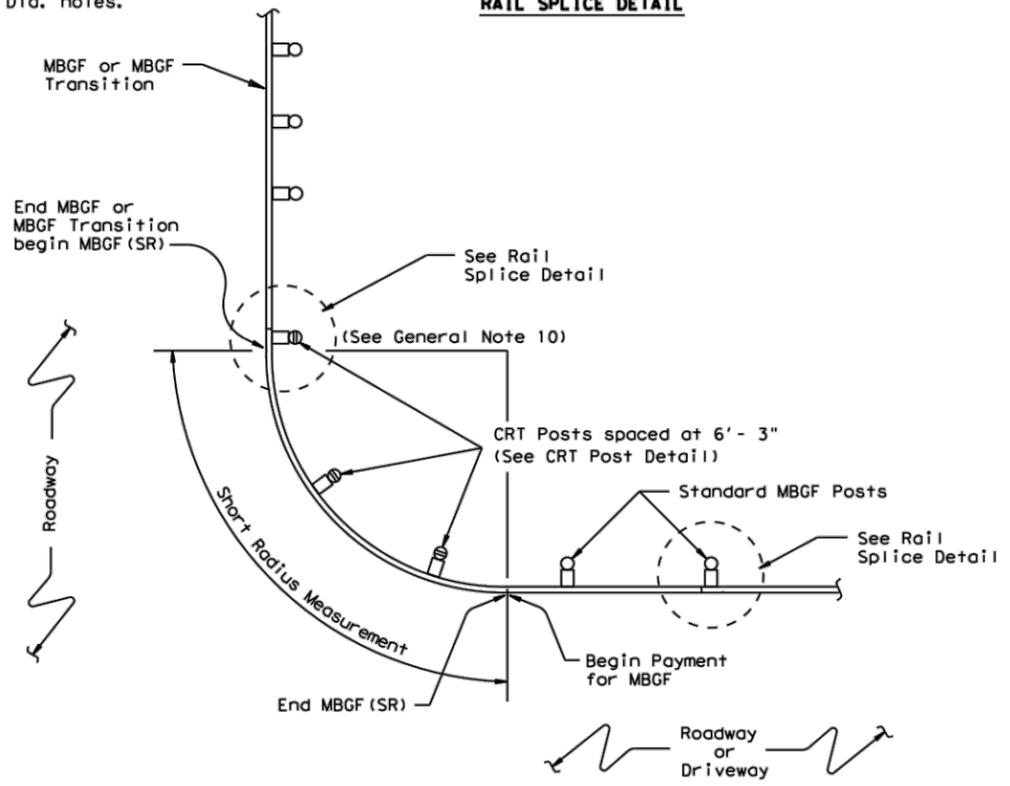

**PLAN VIEW SHOWING TYPICAL RADIUS**


The required radius is shown elsewhere on the plans.

**GENERAL NOTES**

- The type of (CRT) post (round wood post, or rectangular wood post) will be shown elsewhere in the plans. The exact position of MBGF shall be shown elsewhere in the plans or as directed by the Engineer.
- Steel posts are not permitted at CRT post positions.
- Rail element shall meet the requirements of Item 540, "Metal Beam Guard Fence" except as modified on the plans. The Contractor may furnish rail elements of 12 1/2 or 25 foot nominal lengths.
- Button head "post" bolts (ASTM A307) shall be of sufficient length to extend through the full thickness of the nut (ASTM A563) and Type A (1 3/4" O.D.) washer and not more than 1" beyond it. Button head "splice" bolts (ASTM A307) are 5/8" x 1 1/4" (or 2" long at triple rail splices) with a 5/8" double recessed nut (ASTM A563).
- Fittings (bolts, nuts, and washers) shall be galvanized in accordance with Item 445, "Galvanizing." Fittings shall be subsidiary to the bid item.
- Crown shall be widened to accommodate the Metal Beam Guard Fence.
- The lateral approach to the guard fence, shall have a slope rate of not more than 1V:10H.
- Unless otherwise shown in the plans, guard fence placed in the vicinity of curbs shall be positioned so that the face of curb is located directly below or behind the face of the block. Rail placed over curbs shall be installed so that the post bolt is located approximately 21 inches above the gutter pan or roadway surface.
- If solid rock is encountered within 0 to 18" of the finished grade, drill a 22" dia. hole, 24" into the rock, or drill two 12" dia. front to back overlapping holes, 24" into the rock. If solid rock is encountered below 18", drill a 12" dia. hole, 12" into the rock or to the standard embedment depth, whichever is less. Any excess post length, after meeting these depths, may be field cut to ensure proper guardrail mounting height. Backfill with a cohesionless material.
- Guardrail posts shall not be set in concrete, of any depth.
- Special rail fabrication will be required at installations having a curvature of less than 150 ft. radius. The required radius shall be shown on the plans.
- The terminal anchor section (TAS) post shall be set in Class A concrete (unless otherwise shown in the plans) in accordance with Item 421, "Hydraulic Cement Concrete." Concrete shall be subsidiary to the bid item requiring construction of the terminal anchor section (TAS). Terminal anchor post to be galvanized in accordance with Item 445, "Galvanizing."
- Unless otherwise shown in the plans, a composite material post and/or block that meets the requirements of DMS-7210, "Composite Material Posts and Blocks for Metal Beam Guard Fence" may be substituted for posts and/or blocks of similar dimensions. The Construction Division, TxDOT maintains a Material Producer List (MPL) for producers of materials conforming to DMS-7210. Only producers on the MPL can furnish composite material posts and/or blocks.


**"DRIVEWAY" TERMINAL ANCHOR SECTION**

Only for use within driveway locations, where a standard (TAS) Terminal Anchor Section can not be installed.

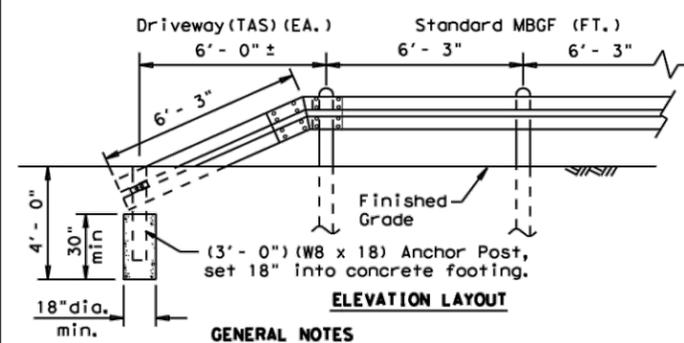


**GENERAL NOTES**

- The "Driveway" Terminal Anchor Section is ONLY to be used within driveway locations, where the ROW is limited and a standard 25 ft. (TAS) Terminal Anchor Section, is too long.
- Terminal anchor post shall be set in Class A concrete.
- All steel shall be galvanized after fabrication in accordance with Item 445, "Galvanizing."

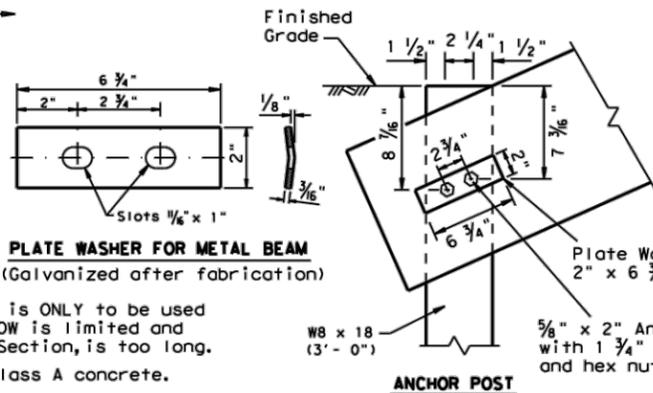

**PLATE WASHER FOR METAL BEAM**  
(Galvanized after fabrication)

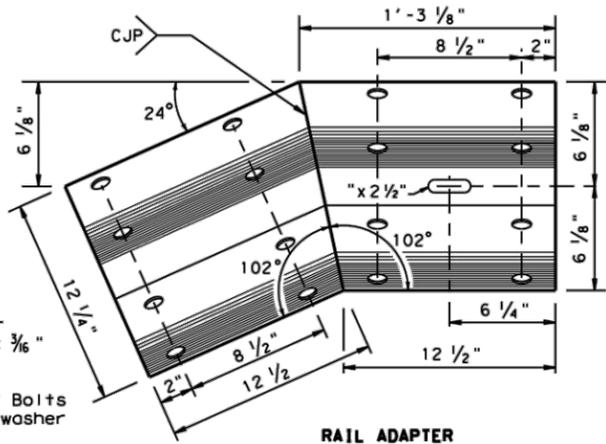

**RAIL ADAPTER**  
Rail - 10 gauge  
(Galvanized after fabrication)

**ONLY FOR USE IN MAINTENANCE REPAIRS OR HIGHLY CONSTRAINED SITE CONDITIONS.**




**METAL BEAM GUARD FENCE (SHORT RADIUS) MBGF (SR) - 19**

FILE: mbgfsr19.dgn	DW: TxDOT	CK: KM	DW: BD	CK: VP
© TxDOT NOVEMBER 2019	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	
			40	

DATE: FILE:





DISCLAIMER: THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY TxDOT FOR ANY PURPOSE WHATSOEVER. THE USE OF THIS STANDARD ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

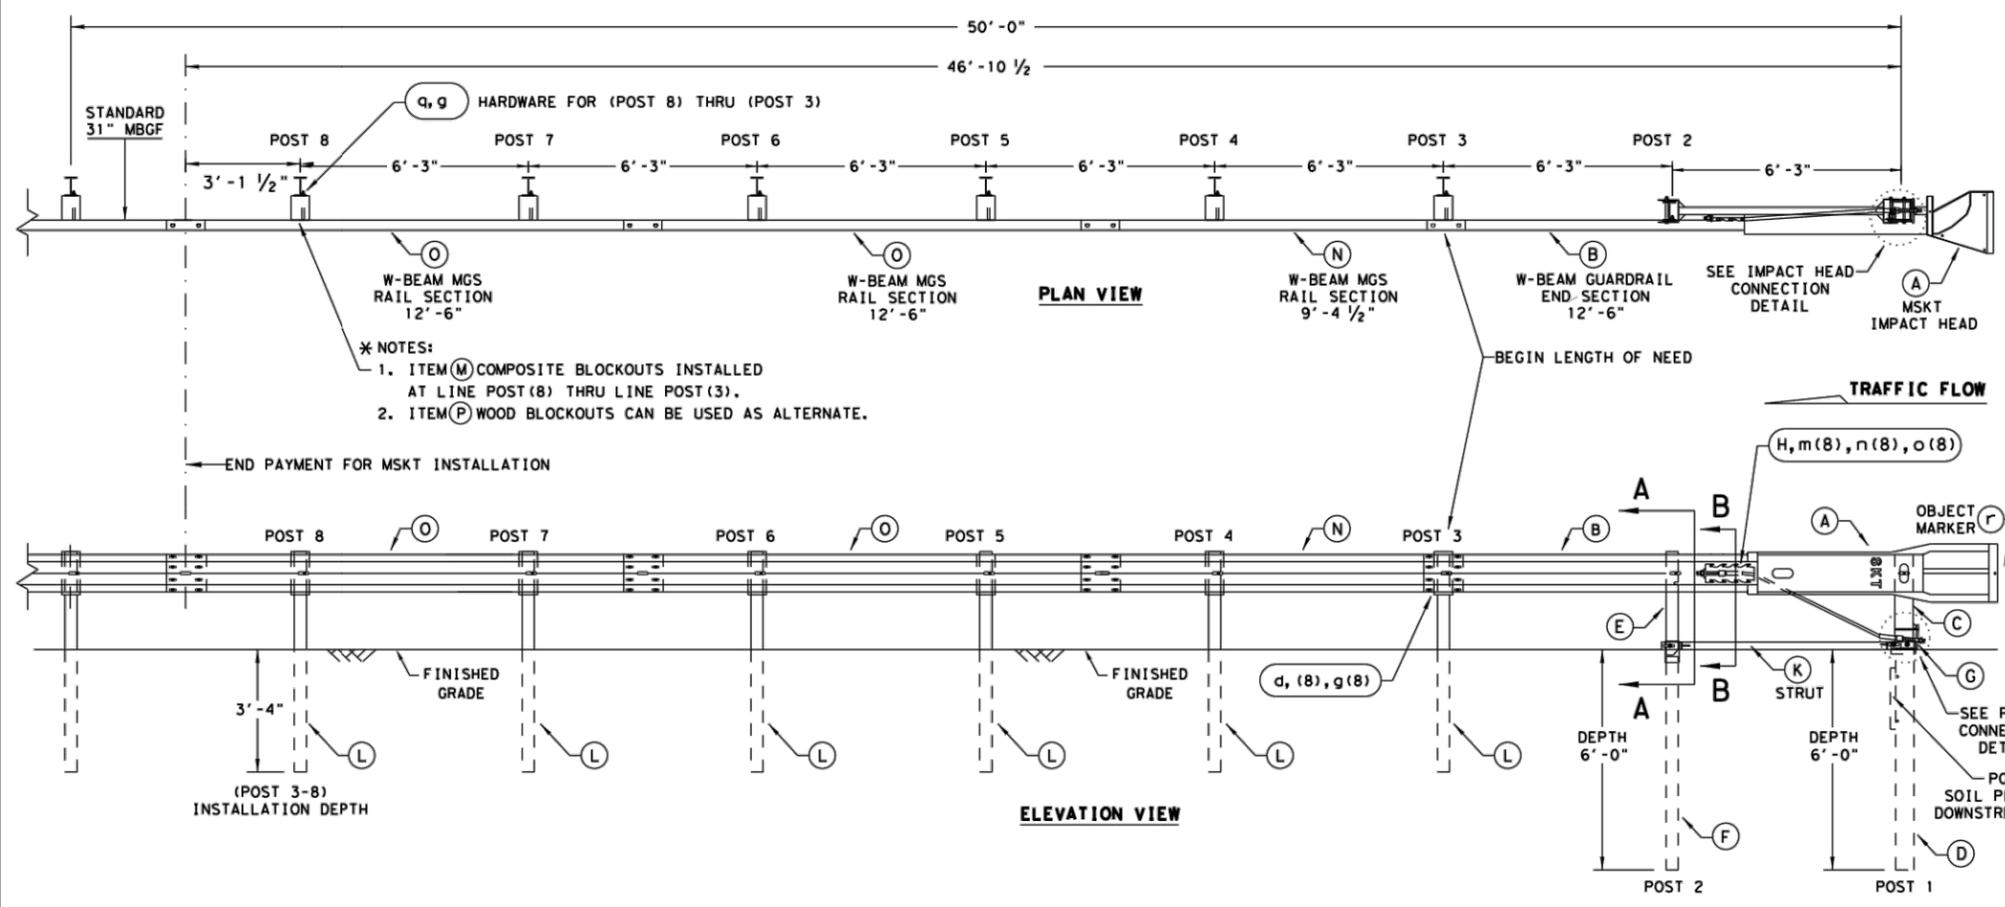


- \* NOTES:**
- ITEM (M) COMPOSITE BLOCKOUTS INSTALLED AT LINE POST (8) THRU LINE POST (3).
  - ITEM (P) WOOD BLOCKOUTS CAN BE USED AS ALTERNATE.

- GENERAL NOTES**
- FOR SPECIFIC INFORMATION REGARDING INSTALLATION AND TECHNICAL GUIDANCE OF THE SYSTEM, CONTACT: ROAD SYSTEMS, INC. (432)263-2435, 3616 OLD HOWARD COUNTY AIRPORT, BIG SPRING, TX 79720
  - FOR INSTALLATION, REPAIR AND MAINTENANCE REFER TO THE: MSKT END TERMINAL, PRODUCT DESCRIPTION ASSEMBLY MANUAL (PUBLICATION-062717).
  - APPLY HIGH INTENSITY REFLECTIVE SHEETING, "OBJECT MARKER" ON THE FRONT FACE OF THE DEVICE PER MANUFACTURER'S RECOMMENDATIONS. OBJECT MARKER SHALL CONFORM TO THE STANDARDS REQUIRED IN TEXAS MUTCD.
  - FOR POST (LEAVE-OUT) INSTALLATION AND GUIDANCE SEE TXDOT'S LATEST ROADWAY MOW STRIP STANDARD.
  - HARDWARE (BOLTS, NUTS, & WASHERS) SHALL BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING". FITTINGS SHALL BE SUBSIDIARY TO THE BID ITEM.
  - SYSTEM SHOWN USING STEEL WIDE FLANGE POSTS WITH COMPOSITE BLOCKOUTS.
  - A COMPOSITE MATERIAL BLOCKOUTS THAT MEETS THE REQUIREMENTS OF DMS-7210, MAY BE SUBSTITUTED FOR BLOCKOUTS OF SIMILAR DIMENSIONS. SEE CONSTRUCTION DIVISION MATERIAL PRODUCER LIST (MPL) FOR CERTIFIED PRODUCERS.
  - IF SOLID ROCK IS ENCOUNTERED IN THE AREA OF (POST 1) AND / OR (POST 2) CONTACT THE MANUFACTURER, & REFER TO THE LATEST ROADWAY MBGF STANDARD FOR INSTALLATION GUIDANCE.
  - POSTS SHALL NOT BE SET IN CONCRETE.
  - SYSTEM MUST BE ATTACHED TO STANDARD 31" MBGF.
  - UNDER NO CIRCUMSTANCES SHALL THE GUARDRAIL WITHIN THE MSKT SYSTEM BE CURVED.
  - A FLARE RATE OF UP TO 25:1 MAY BE USED TO PREVENT THE TERMINAL HEAD FROM ENCRANCHING ON THE SHOULDER. THE FLARE MAY BE DECREASED OR ELIMINATED FOR SPECIFIC INSTALLATIONS, IF DIRECTED BY THE ENGINEER.
  - THE SYSTEM IS SHOWN WITH TWO 12'-6" MBGF PANELS, ONE 25'-0" MBGF PANEL IS ALSO ALLOWED IN THEIR PLACE.
  - A DRIVING CAP WITH A TIMBER OR PLASTIC INSERT SHALL BE USED WHEN DRIVING POSTS 3-8 TO PREVENT DAMAGE TO THE GALVANIZING ON TOP OF THE POST. SPECIAL DRIVING CAP TO BE USED ON LOWER POSTS 1 & 2 TO PREVENT DAMAGE TO THE WELDED PLATES.

ITEM	QTY	MAIN SYSTEM COMPONENTS	ITEM NUMBERS
A	1	MSKT IMPACT HEAD	MS3000
B	1	W-BEAM GUARDRAIL END SECTION, 12 Ga.	SF1303
C	1	POST 1 - TOP (6" X 6" X 1/8" TUBE)	MTPHP1A
D	1	POST 1 - BOTTOM (6' W6X15)	MTPHP1B
E	1	POST 2 - ASSEMBLY TOP	UHP2A
F	1	POST 2 - ASSEMBLY BOTTOM (6' W6X9)	HP2B
G	1	BEARING PLATE	E750
H	1	CABLE ANCHOR BOX	S760
J	1	BCT CABLE ANCHOR ASSEMBLY	E770
K	1	GROUND STRUT	MS785
L	6	W6X9 OR W6X8.5 STEEL POST	P621
M	6	COMPOSITE BLOCKOUTS	CBSP-14
N	1	W-BEAM MGS RAIL SECTION (9'-4 1/2")	G12025
O	2	W-BEAM MGS RAIL SECTION (12'-6")	G1203A
P	6	WOOD BLOCKOUT 6" X 8" X 14"	P675
Q	1	W-BEAM MGS RAIL SECTION (25'-0")	G1209
SMALL HARDWARE			
a	2	3/16" x 1" HEX BOLT (GRD 5)	B5160104A
b	4	3/16" WASHER	W0516
c	2	3/16" HEX NUT	N0516
d	25	3/8" Dia. x 1 1/4" SPLICE BOLT (POST 2)	B580122
e	2	3/8" Dia. x 9" HEX BOLT (GRD A449)	B580904A
f	3	3/8" WASHER	W050
g	33	3/8" Dia. H.G.R NUT	N050
h	1	3/4" Dia. x 8 1/2" HEX BOLT (GRD A449)	B340854A
j	1	3/4" Dia. HEX NUT	N030
k	2	1 ANCHOR CABLE HEX NUT	N100
l	2	1 ANCHOR CABLE WASHER	W100
m	8	1/2" x 1 1/4" A325 BOLT WITH CAPTIVE WASHER	SB12A
n	8	1/2" STRUCTURAL NUTS	N012A
o	8	1 1/16" O.D. x 3/16" I.D. STRUCTURAL WASHERS	W012A
p	1	BEARING PLATE RETAINER TIE	CT-100ST
q	6	3/8" x 10" H.G.R. BOLT	B581002
r	1	OBJECT MARKER 18" X 18"	E3151

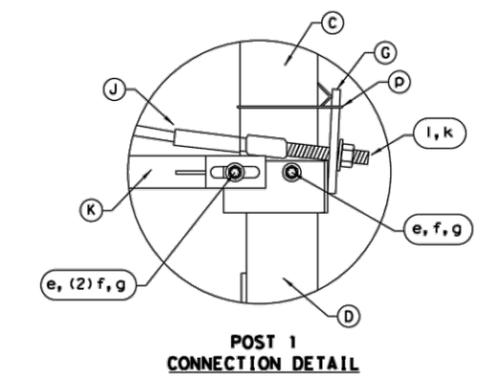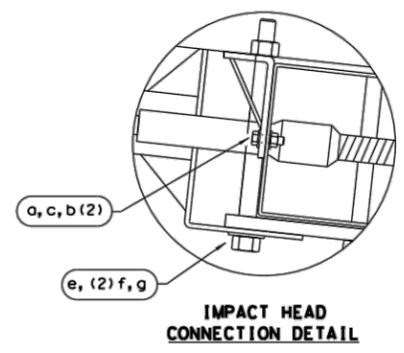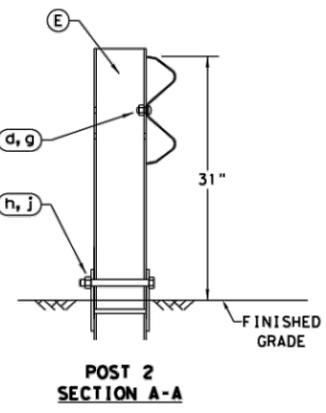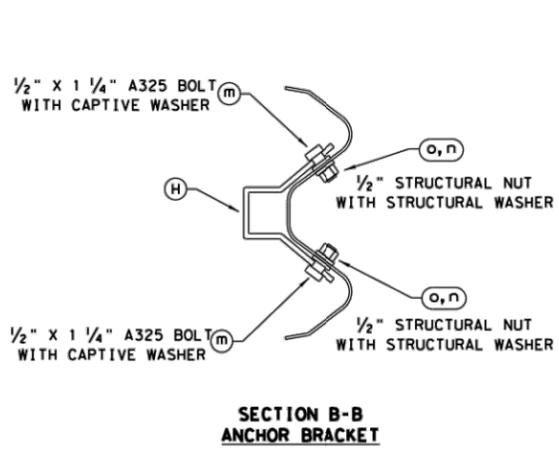

ALTERNATIVE ITEMS NOT SHOWN. \* \*  
 \* ITEM (P) 8" WOOD-BLOCKOUT  
 \* \* ITEM (Q) 25' GUARD FENCE PANEL

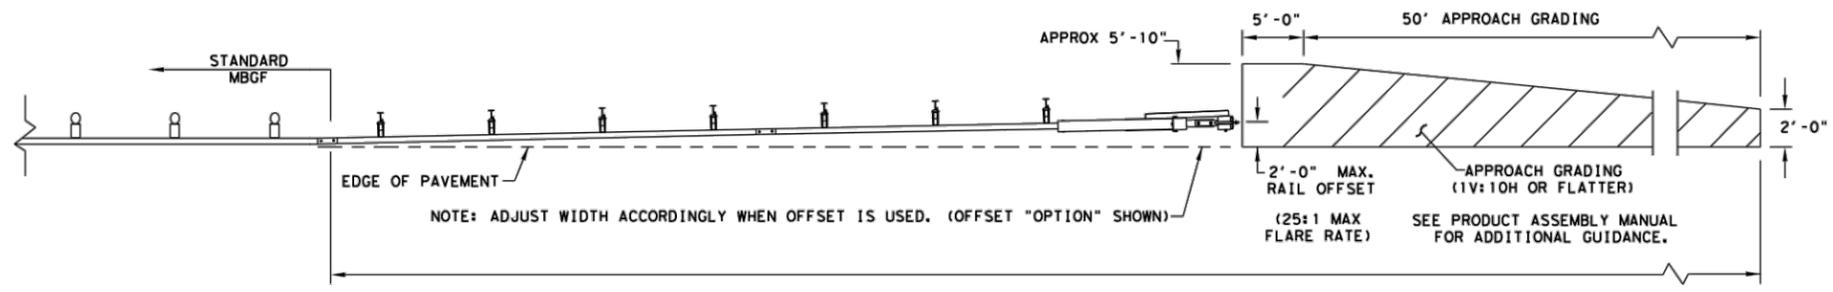

NOTE: TxDOT GENERIC APPROACH GRADING LAYOUT USED FOR ALL TANGENT TYPE END TREATMENTS.

NOTE: THIS STANDARD IS A BASIC REPRESENTATION OF THE MSKT END TERMINAL, IT IS NOT INTENDED TO REPLACE THE PRODUCT DESCRIPTION ASSEMBLY MANUAL.

Design Division Standard

**SINGLE GUARDRAIL TERMINAL**  
**MSKT-MASH-TL-3**  
**SGT (12S) 31-18**

FILE: sgt12s3118.dgn	DN: TxDOT	CK: KM	DW: VP	CK: CL
© TxDOT: APRIL 2018	CONT	SECT	JOB	HIGHWAY
REVISIONS		DIST	COUNTY	SHEET NO.
				41

DATE: FILE:


NOTES TO DESIGNER:

FOR INLET DEPTH "D" GREATER THAN 10'-0", DESIGNER IS REQUIRED TO PROVIDE SPECIAL DETAIL.


FOR INLET WIDTH "L" GREATER THAN 20'-0", DESIGNER IS REQUIRED TO PROVIDE SPECIAL DETAIL.

INLET SIZE	# OF INLET OPENINGS
10'	2
15'	3
20'	3


NUMBER OF INLET OPENINGS

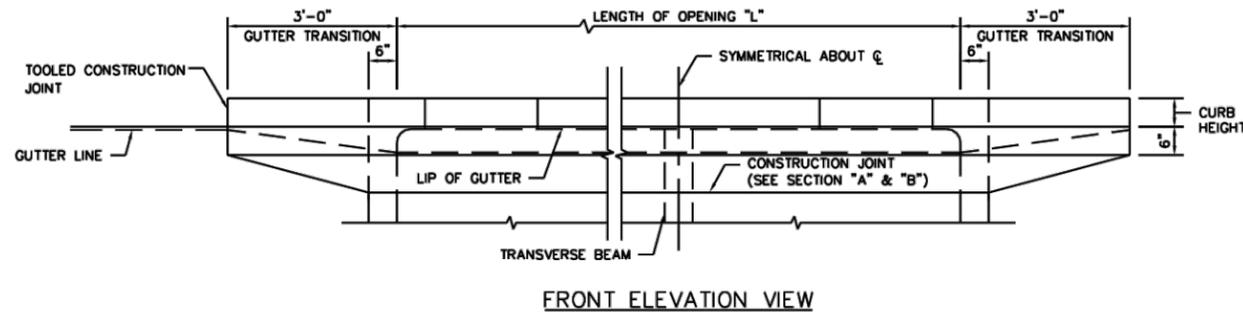

FRONT ELEVATION VIEW

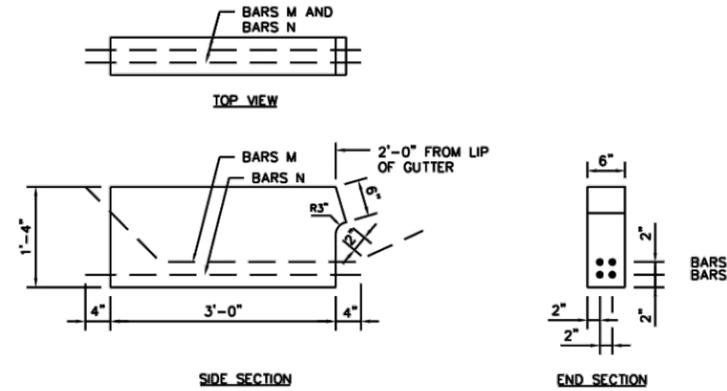

TRANSVERSE BEAM DETAIL  
(FOR 15' AND 20' INLETS)

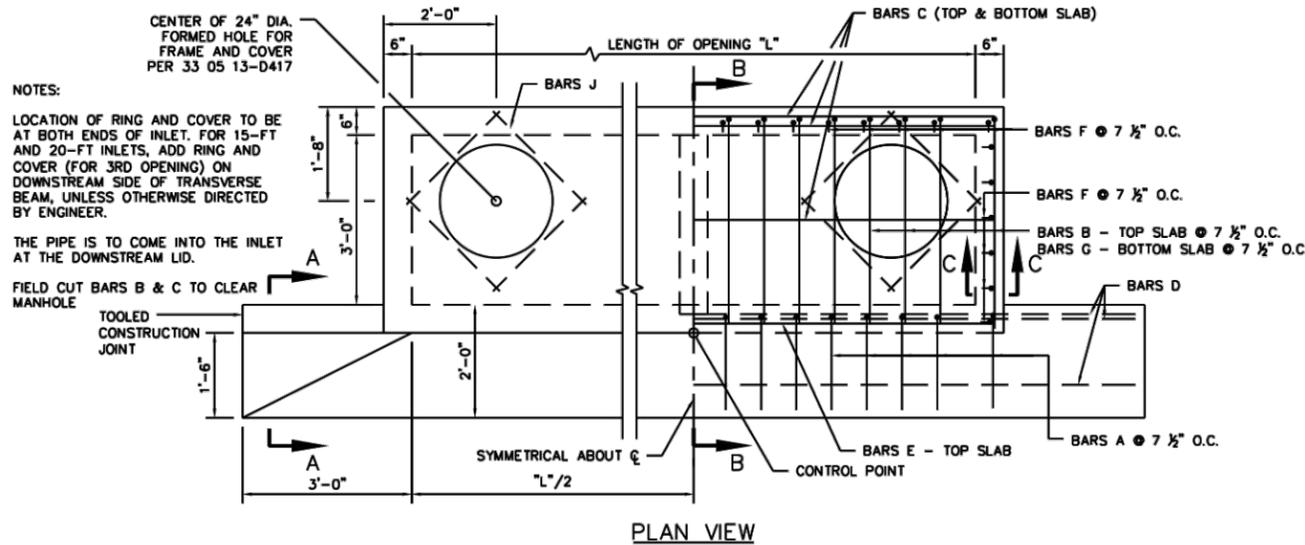

PLAN VIEW

NOTES:

1. MATERIALS AND WORKMANSHIP SHALL CONFORM WITH THE REQUIREMENTS OF CITY OF FORT WORTH STANDARD SPECIFICATION 33 49 20, CURB AND DROP INLETS.
2. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH  $f_c = 3,000$  PSI AT 28 DAYS.
3. ALL REINFORCING STEEL SHALL BE GRADE 60.
4. CHAMFER ALL EXPOSED EDGES  $\frac{3}{8}$ " EXCEPT WHERE OTHERWISE NOTED.
5. ALL REINFORCING STEEL SHALL HAVE MINIMUM 2" COVER TO CENTER OF BAR, UNLESS OTHERWISE NOTED.
6. ALL DIMENSIONS RELATING TO REINFORCING ARE TO CENTER OF BARS.
7. LOCATION OF STRUCTURE AS SHOWN IN PLANS REFERS TO CONTROL POINT AT THE FACE OF CURB AND MID-POINT OF THE INLET, AS SHOWN ON THIS DETAIL.
8. FIELD CUT AND BEND BARS AS NECESSARY TO ACCOMMODATE STORM DRAIN PIPE PER TYPICAL MANHOLE / PIPE PENETRATION DETAIL (33 49 10-D415).
9. A TOOLED CONSTRUCTION JOINT SHALL BE PLACED ALONG ALL VERTICAL FACES ABUTTING CONCRETE PAVEMENT.
10. STANDARD INLET DEPTH "D" FOR NEW CONSTRUCTION SHALL BE 4'-0" AT UPPER END, AND 4'-9" AT OUTLET END. OTHER DEPTHS MAY BE USED BASED ON PROJECT SPECIFIC CONDITIONS. MINIMUM 2% FALL SHALL BE USED IN ALL CASES.
11. CONTRACTOR TO PLACE THE REVERSIBLE RING WITH FLANGE ON TOP.



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

CKT:JMR  
 05/02/2023 - 11:42AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\330\_2018\5460-22.506\_DET1.DWG

	CITY OF FORT WORTH, TEXAS	REVISED 04-30-2021
	<b>STANDARD STORM DRAIN INLET</b> (SHEET 1 OF 2)	<b>33 49 20-D405</b>

NO.	DATE	REVISION

4060 BRYANT IRVIN ROAD  
FORT WORTH, TX 76109  
817-412-7155  
TX REG. ENGINEERING FIRM F-469  
TX REG. SURVEYING FIRM LS-10008001


**CITY OF FORT WORTH CURB INLET DETAIL**

**MARKUM RANCH ROAD WIDENING**

*TARRANT COUNTY, TEXAS*

DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	42

MARKUM RANCH ROAD WIDENING

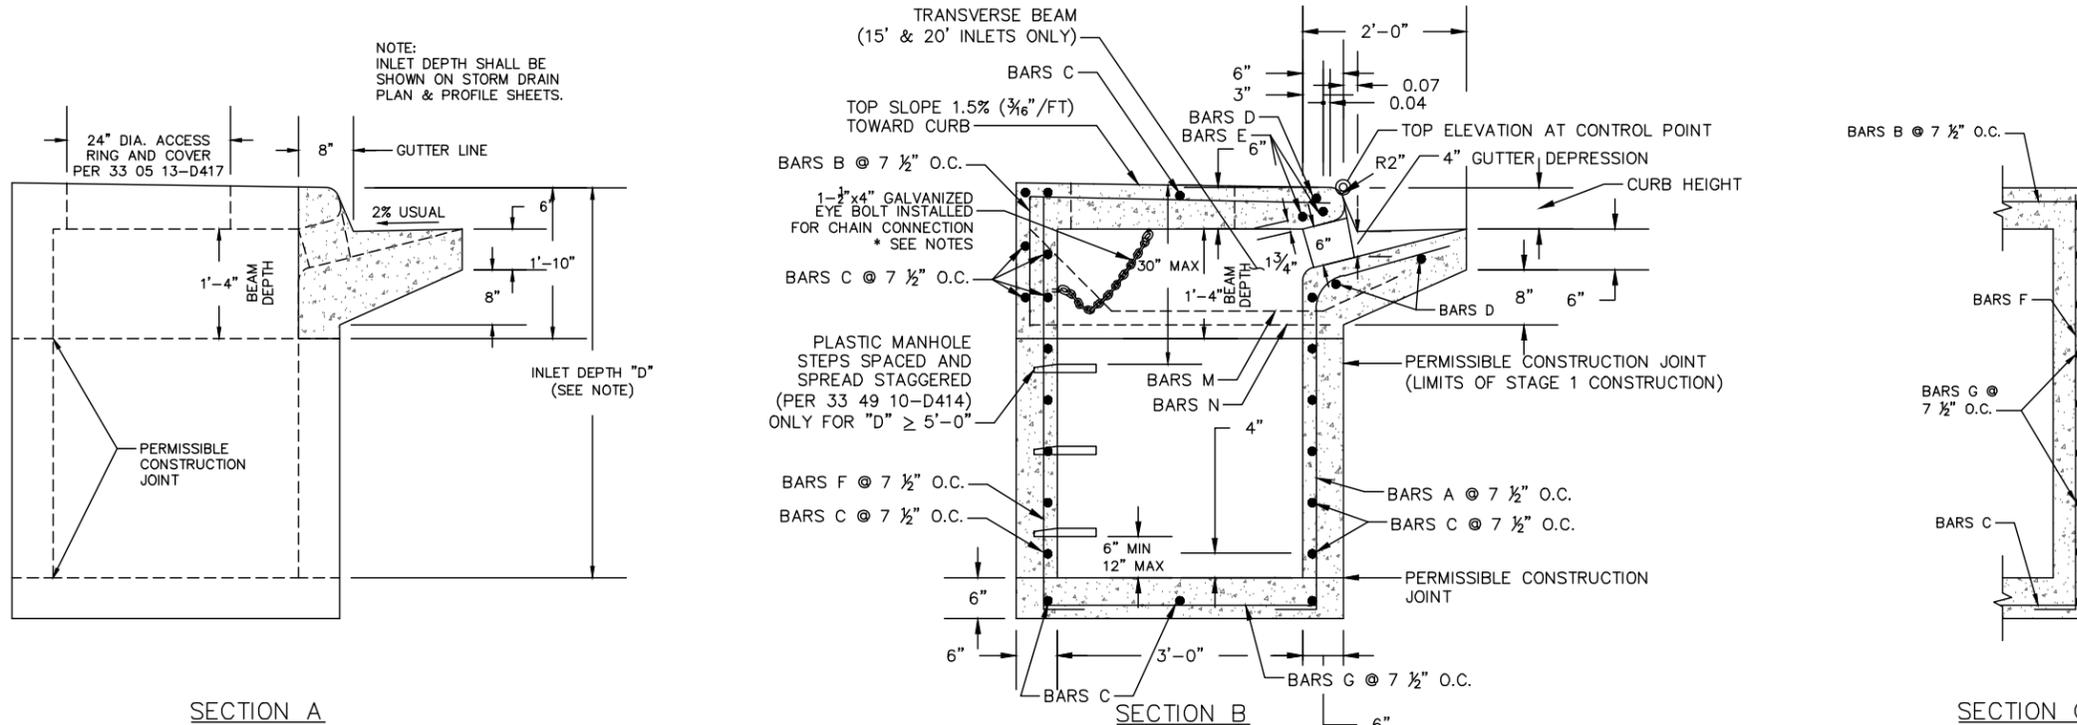


SECTION A

SECTION B

SECTION C

\* NOTE: DIMENSION SHOWN FOR 6" CURB. INCREASE LENGTH BY 1" FOR EACH ADDITIONAL 1" OF CURB HEIGHT.

- \* NOTES:
- CONNECT EYE BOLT TO INLET WALL ADJACENT TO CENTER OF MANHOLE LID
  - CONNECT EYE BOLT 18" BELOW TOP OF BOX
  - 3/8" HARDENED IRON CAST CHAIN SQUARE SHAPED TO RESIST CUTTING.
  - CHAIN LENGTH OF 3 1/2' ALLOWS GRATE LIDS TO BE SET ASIDE TO ACCESS CATCH BASIN.

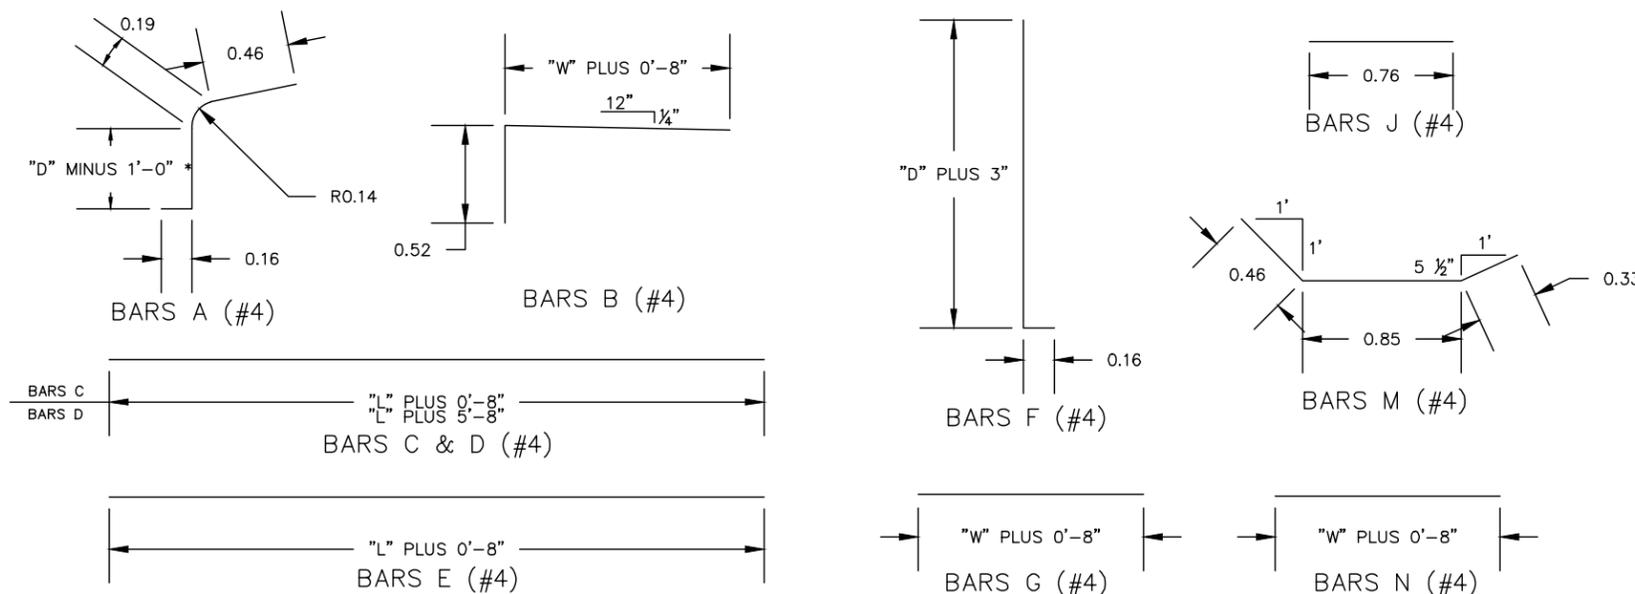

CKT:JRM  
 05/02/2023 - 11:42AM  
 N:\DWG-54\5460-22.506\DWG\CIVIL\330\_2018\5460-22.506\_DET1.DWG

	CITY OF FORT WORTH, TEXAS	REVISED 04-30-2021
	<b>STANDARD STORM DRAIN INLET (SHEET 2 OF 2)</b>	<b>33 49 20-D405</b>



THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHRISTOPHER J. CHA, P.E. 112732 ON 05/02/2023. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION TO THE RESPONSIBLE ENGINEER IS AN OFFENSE UNDER THE TEXAS ENGINEERING PRACTICE ACT.

NO.	DATE	REVISION






4060 BRYANT IRVIN ROAD  
 FORT WORTH, TX 76109  
 817-412-7155  
 TX REG. ENGINEERING FIRM F-469  
 TX REG. SURVEYING FIRM LS-1000801

<b>CITY OF FORT WORTH CURB INLET DETAIL</b>				
<b>MARKUM RANCH ROAD WIDENING</b>				
<i>TARRANT COUNTY, TEXAS</i>				
DESIGN	DRAWN	DATE	JOB NO.	SHEET NO.
CKT	ECW	MAY 2023	5460-22.506	43

MARKUM RANCH ROAD WIDENING

DISCLAIMER: This standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:  
FILE:

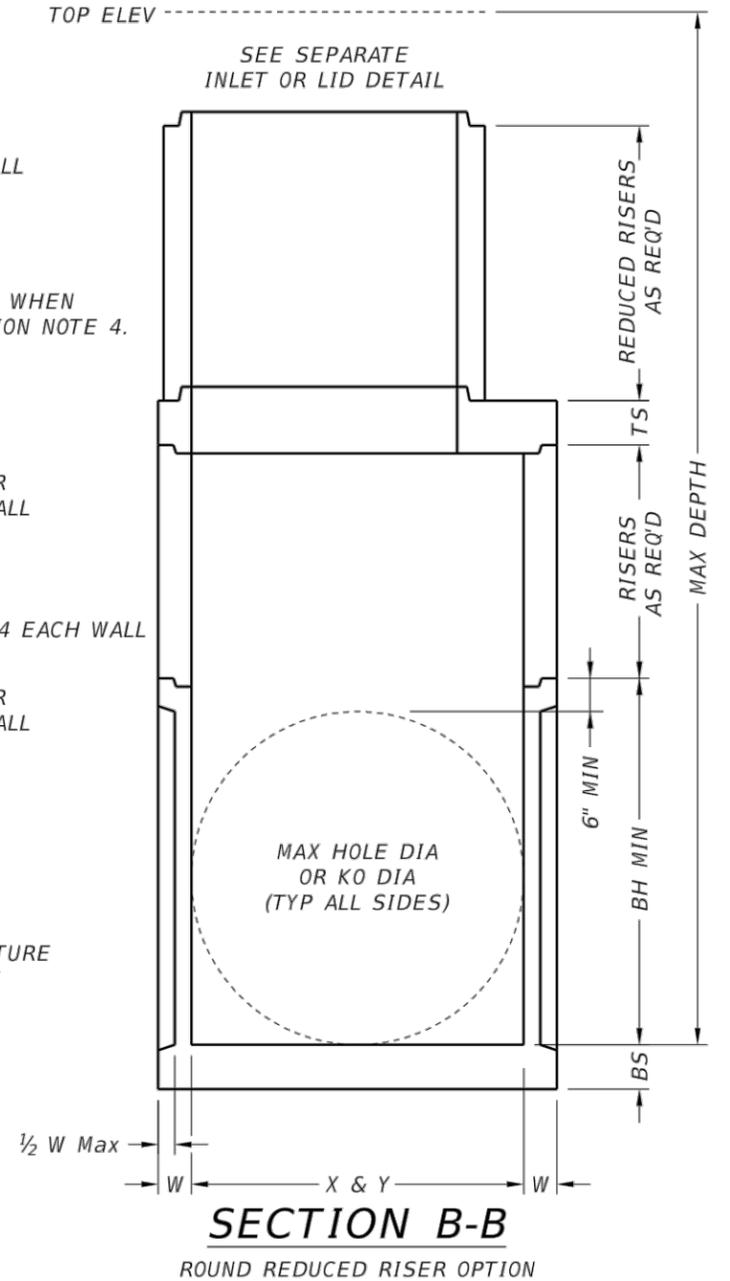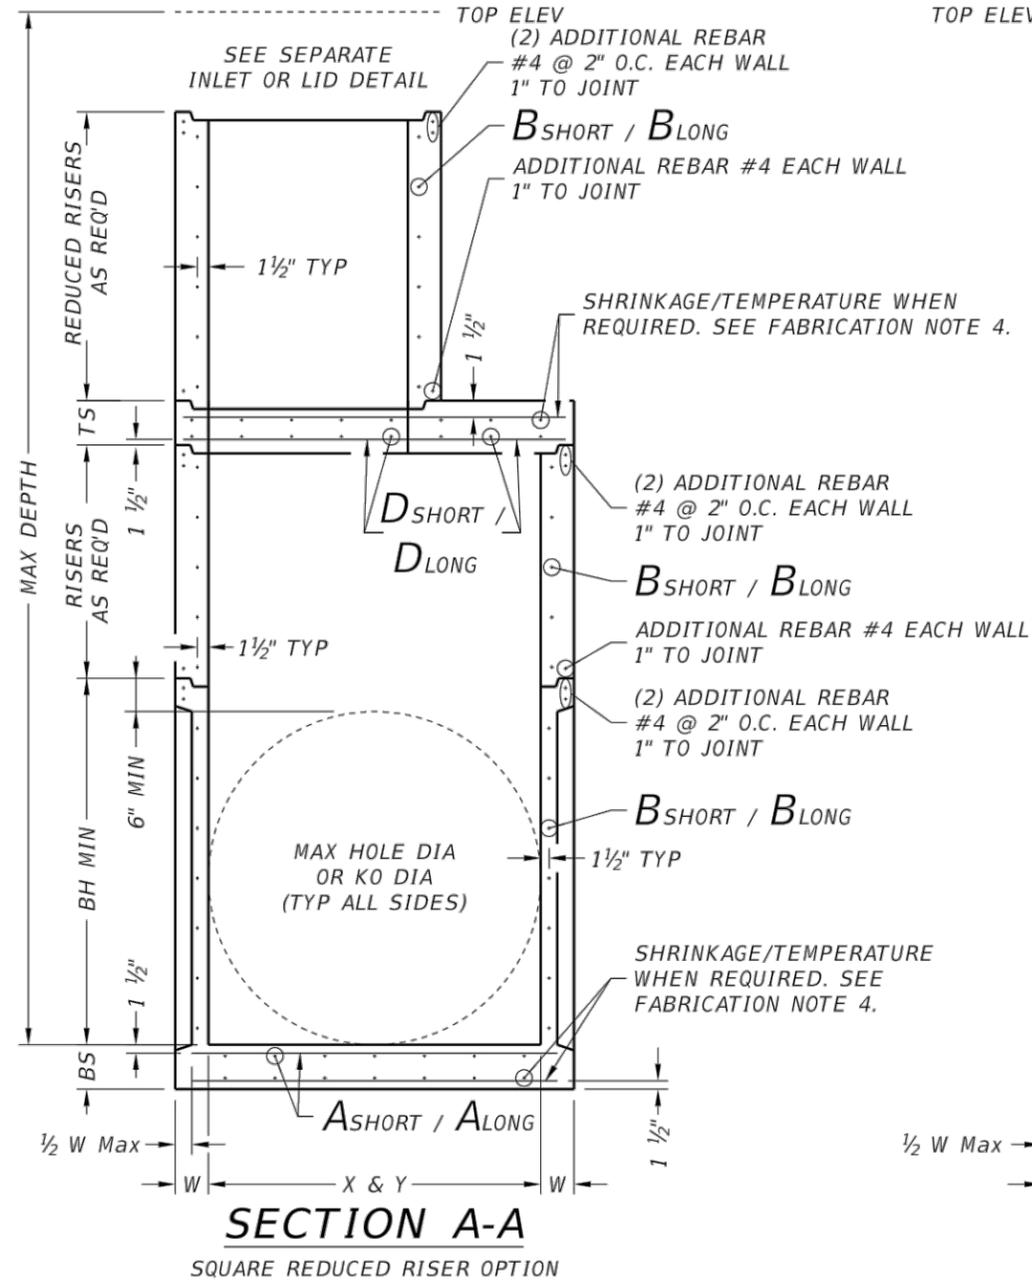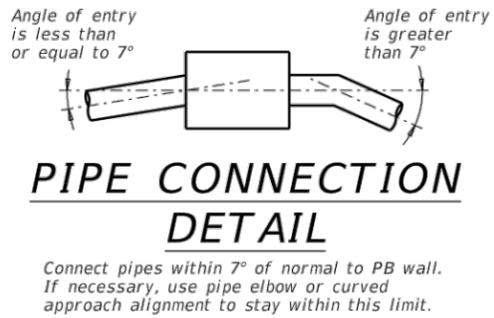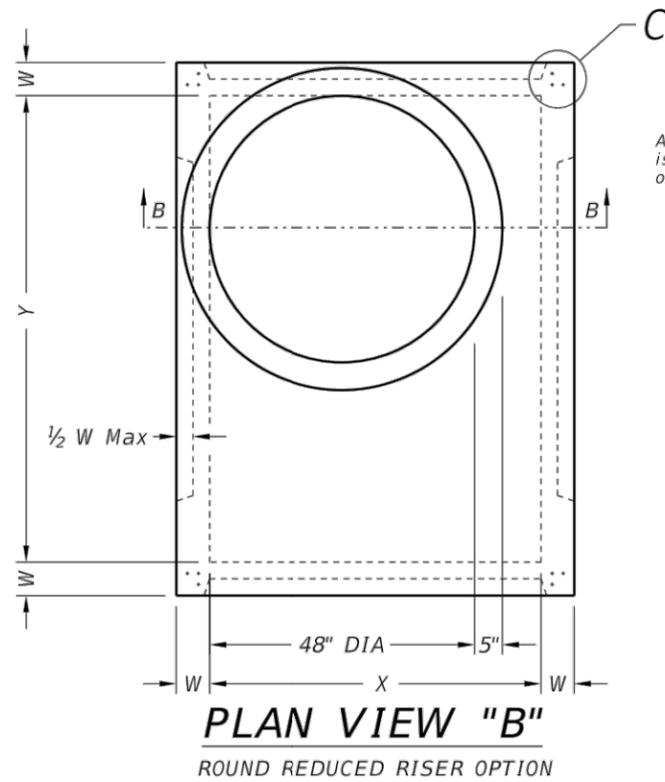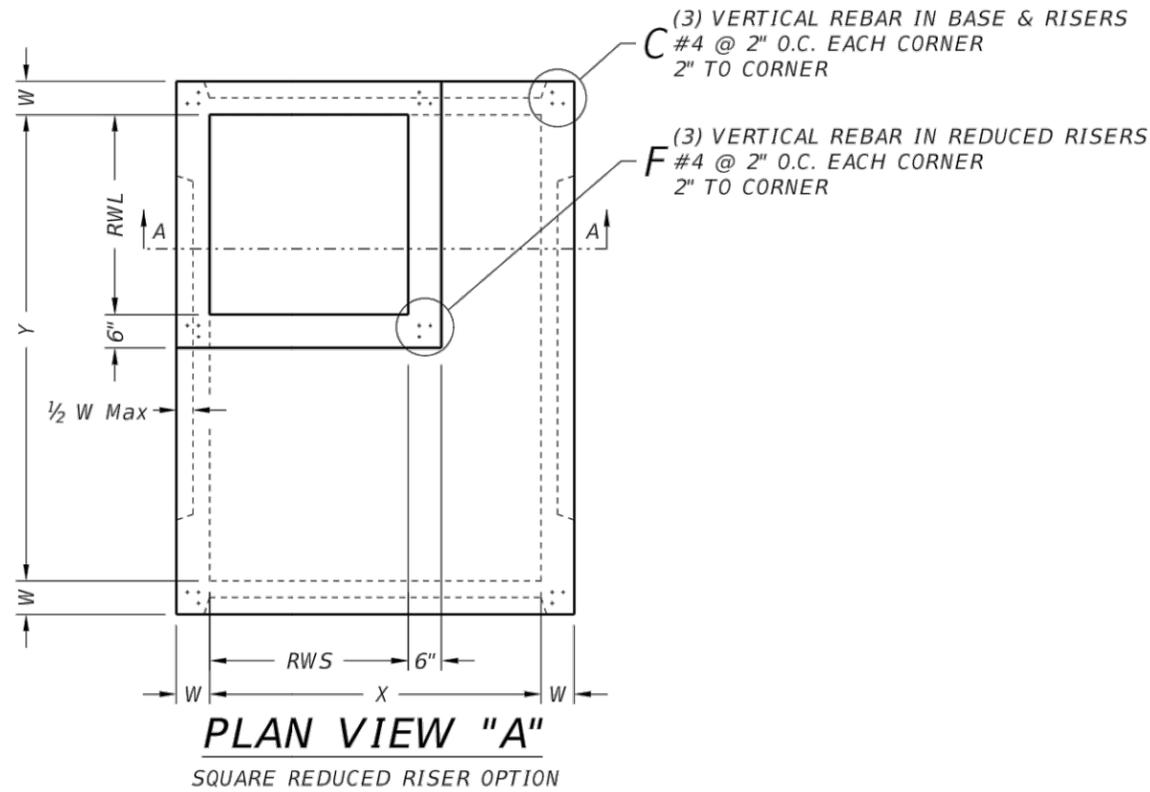

**FABRICATION NOTES:**

1. Provide Class "H" concrete in accordance with Item 421 and having a minimum compressive strength of 5,000 psi.
2. Provide Grade 60 reinforcing steel or equivalent area of WWR.
3. Provide typical clear cover of 1 1/2" to reinforcing steel at interior or exterior walls.
4. Walls or slabs with a thickness of 8" or greater require shrinkage and temperature reinforcing steel. Provide steel area = 0.11 in<sup>2</sup>/ft each way.
5. No substitution is allowed for vertical and horizontal #4 bars in corners.
6. Manufacture base and risers to nearest 3" increment.
7. Design tongue and groove joints for full closure on both shoulders. Minimum spigot depth is 3/4".
8. Provide lifting devices in conformance with Manufacturer's recommendations.
9. See sheet PDD for sizes, dimensions, and reinforcing steel not shown.

**INSTALLATION NOTES:**

1. If required elsewhere. Inverts (benching) to be provided by Contractor. Concrete or mortar used for invert is subsidiary to specified inlet or manhole.
2. Seal tongue and groove joints with preformed or bulk mastic in conformance with Manufacturer's recommendations. Tongue and groove joints may be grouted no more than 1" between each section, or 1/2 the joint depth, whichever is greater.
3. Do not grout rubber gasket joints without Manufacturer's recommendation.
4. For rigid pipe, cut hole in thin wall panel (KO) 4" Max, 2" Min larger than pipe OD.
5. For flexible pipe, consult boot/seal Manufacturer's specification for placement tolerance and hole size. Center pipe in hole and install boot/seal per Manufacturer's specification.

**GENERAL NOTES:**

1. Precast Base consists of base slab, base unit, risers (as required), reducing slab (as required), and reduced risers (as required). See sheet PDD for sizes.
2. Designed according to ASTM C913.
3. Payment for precast base is subsidiary to the specified inlet, per Item 465, "Junction Boxes, Manholes, and Inlets."

Cover dimensions are clear dimensions, unless noted otherwise.

HL93 LOADING




**PRECAST BASE**

PB















FILE: prest01-20.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS				
DIST	COUNTY		SHEET NO.	
				44

DISCLAIMER: This standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:  
FILE:

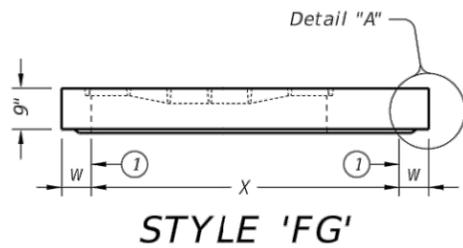

ORIENT TAPER TO CORRESPOND WITH ROADWAY CROSS-SLOPE.

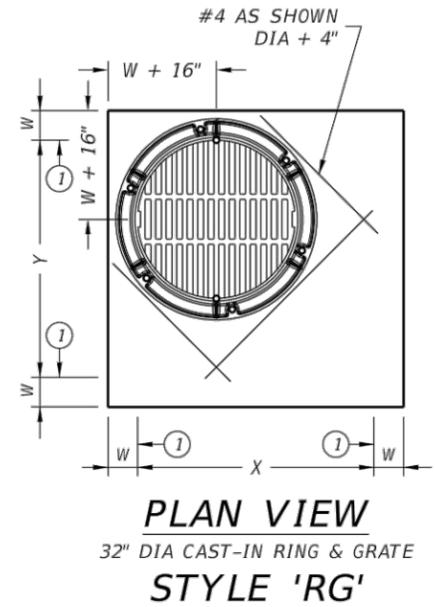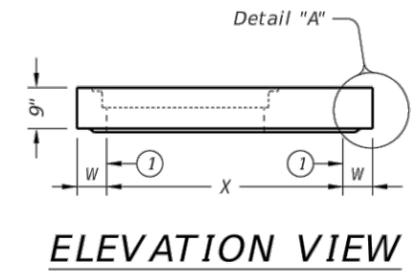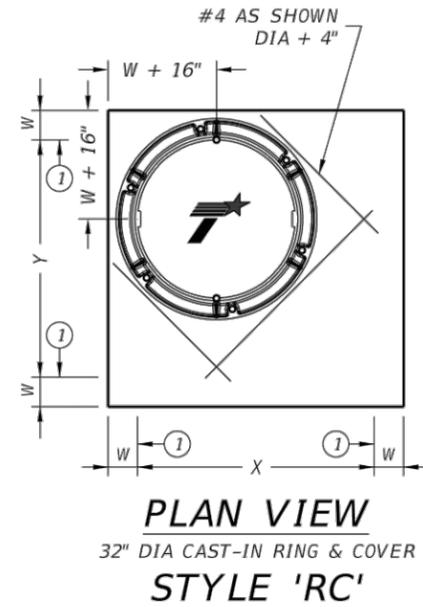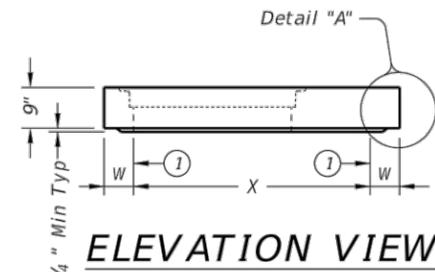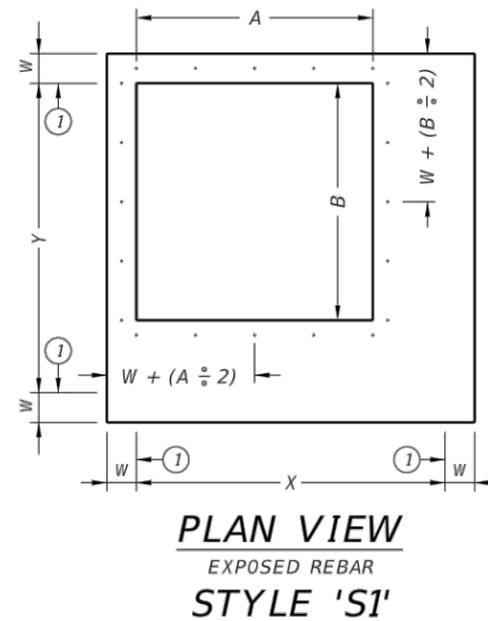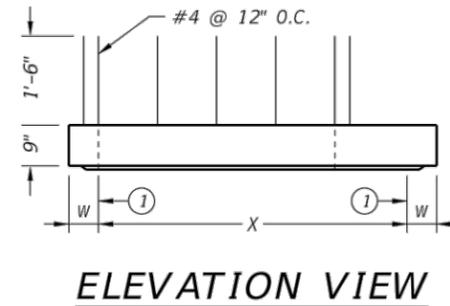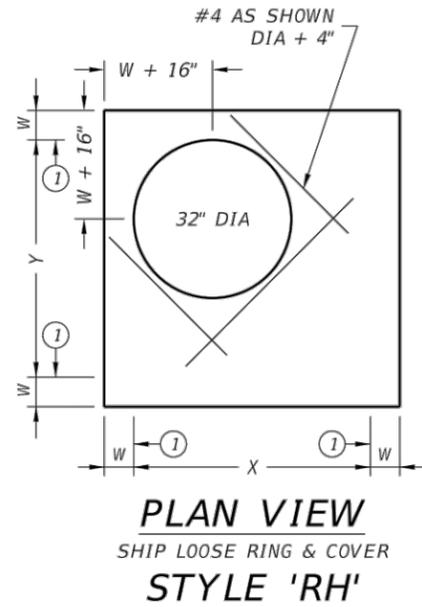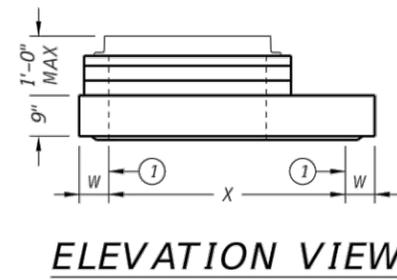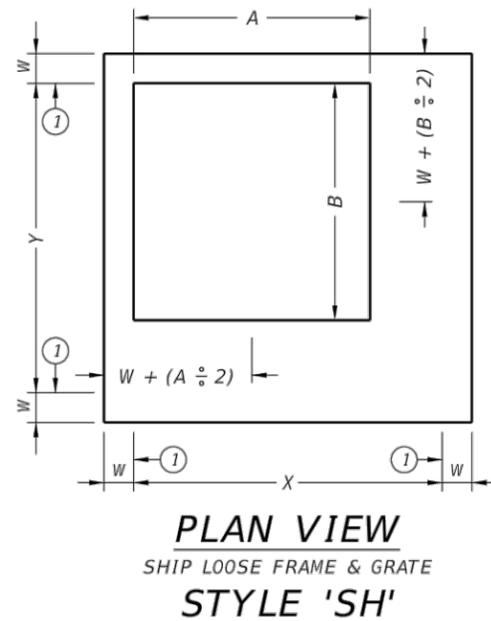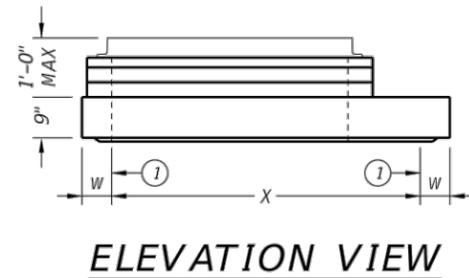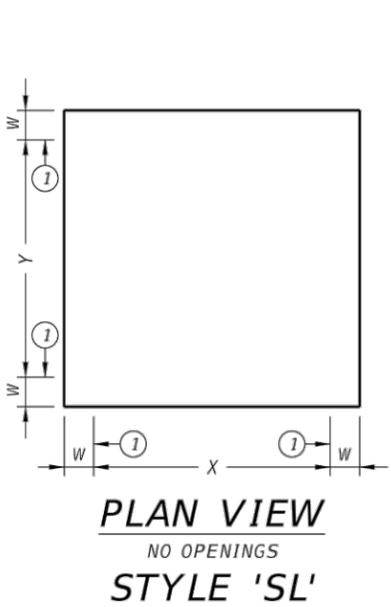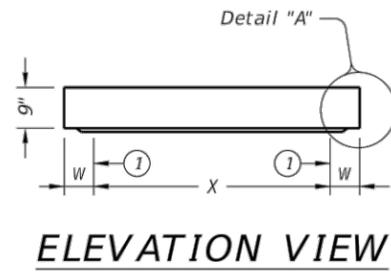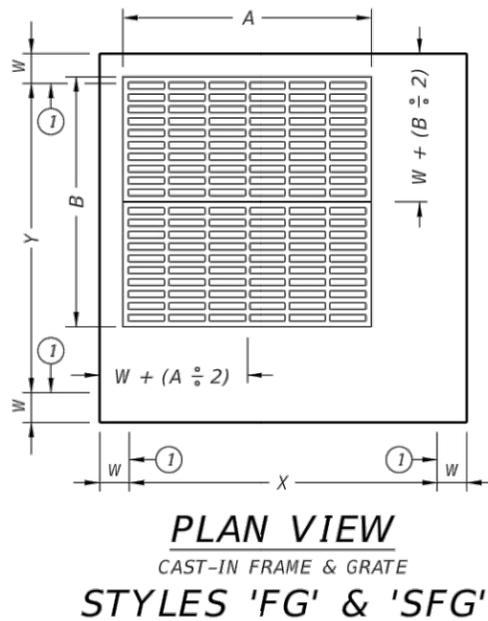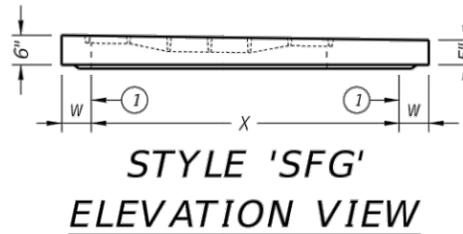

① Matches inside face of wall of precast base or riser below inlet.

HL93 LOADING

SHEET 1 OF 2

Texas Department of Transportation

Bridge Division Standard

PRECAST SLAB LID

PSL

FILE: prest05-20.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	
			45	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:  
 FILE:

Style	Size (X x Y)	W <sup>(2)</sup>	A x B (nominal)	Short Span Reinf Steel Area	Long Span Reinf Steel Area
SL	3'x3'	6"	n/a	0.37 in <sup>2</sup> /ft	0.37 in <sup>2</sup> /ft
RH,RC,RG,SH,S1,FG	3'x3'	6"	3'x3' or 32" Dia	0.37 in <sup>2</sup> /ft	0.37 in <sup>2</sup> /ft
SFG	3'x3'	6"	3'x3'	0.32 in <sup>2</sup> /ft	0.32 in <sup>2</sup> /ft
SL	4'x4'	6"	n/a	0.34 in <sup>2</sup> /ft	0.34 in <sup>2</sup> /ft
RH,RC,RG,SH,S1,FG	4'x4'	6"	3'x3' or 32" Dia	0.41 in <sup>2</sup> /ft	0.41 in <sup>2</sup> /ft
SH,S1,FG	4'x4'	6"	4'x4'	0.41 in <sup>2</sup> /ft	0.41 in <sup>2</sup> /ft
SFG	4'x4'	6"	4'x4'	0.32 in <sup>2</sup> /ft	0.32 in <sup>2</sup> /ft
SL	3'x5'	6"	n/a	0.39 in <sup>2</sup> /ft	0.39 in <sup>2</sup> /ft
RH,RC,RG,SH,S1,FG	3'x5'	6"	3'x3' or 32" Dia	0.48 in <sup>2</sup> /ft	0.48 in <sup>2</sup> /ft
SH,S1,FG	3'x5'	6"	3'x5'	0.48 in <sup>2</sup> /ft	0.48 in <sup>2</sup> /ft
SFG	3'x5'	6"	3'x5'	0.32 in <sup>2</sup> /ft	0.32 in <sup>2</sup> /ft
SL	4'x5'	6"	n/a	0.42 in <sup>2</sup> /ft	0.42 in <sup>2</sup> /ft
RH,RC,RG,SH,S1,FG	4'x5'	6"	3'x3' or 32" Dia	0.42 in <sup>2</sup> /ft	0.42 in <sup>2</sup> /ft
SH,S1,FG	4'x5'	6"	4'x4'	0.63 in <sup>2</sup> /ft	0.63 in <sup>2</sup> /ft
SH,S1,FG	4'x5'	6"	3'x5'	0.66 in <sup>2</sup> /ft	0.66 in <sup>2</sup> /ft
SL	5'x5'	6"	n/a	0.36 in <sup>2</sup> /ft	0.36 in <sup>2</sup> /ft
RH,RC,RG,SH,S1,FG	5'x5'	6"	3'x3' or 32" Dia	0.43 in <sup>2</sup> /ft	0.43 in <sup>2</sup> /ft
SH,S1,FG	5'x5'	6"	4'x4'	0.63 in <sup>2</sup> /ft	0.63 in <sup>2</sup> /ft
SH,S1,FG	5'x5'	6"	3'x5'	0.63 in <sup>2</sup> /ft	0.63 in <sup>2</sup> /ft
SL	5'x6'	6"/8"	n/a	0.48 in <sup>2</sup> /ft	0.48 in <sup>2</sup> /ft
RH,RC,RG,SH,S1,FG	5'x6'	6"/8"	3'x3' or 32" Dia	0.48 in <sup>2</sup> /ft	0.48 in <sup>2</sup> /ft
SH,S1,FG	5'x6'	6"/8"	4'x4'	0.60 in <sup>2</sup> /ft	0.60 in <sup>2</sup> /ft
SH,S1,FG	5'x6'	6"/8"	3'x5'	0.60 in <sup>2</sup> /ft	0.60 in <sup>2</sup> /ft
SL	6'x6'	6"/8"	n/a	0.43 in <sup>2</sup> /ft	0.43 in <sup>2</sup> /ft
RH,RC,RG,SH,S1,FG	6'x6'	6"/8"	3'x3' or 32" Dia	0.56 in <sup>2</sup> /ft	0.56 in <sup>2</sup> /ft
SH,S1,FG	6'x6'	6"/8"	4'x4'	0.56 in <sup>2</sup> /ft	0.56 in <sup>2</sup> /ft
SH,S1,FG	6'x6'	6"/8"	3'x5'	0.59 in <sup>2</sup> /ft	0.59 in <sup>2</sup> /ft
SL	8'x8'	8"/10"	n/a	0.45 in <sup>2</sup> /ft	0.45 in <sup>2</sup> /ft
RH,RC,RG,SH,S1,FG	8'x8'	8"/10"	3'x3' or 32" Dia	0.45 in <sup>2</sup> /ft	0.45 in <sup>2</sup> /ft
SH,S1,FG	8'x8'	8"/10"	4'x4'	0.45 in <sup>2</sup> /ft	0.45 in <sup>2</sup> /ft
SH,S1,FG	8'x8'	8"/10"	3'x5'	0.45 in <sup>2</sup> /ft	0.45 in <sup>2</sup> /ft

<sup>(2)</sup> See sheet PDD for corresponding wall thickness (W) of base unit or riser.

Construct cast-in-place reinforced concrete apron, when shown elsewhere in plans. Use Class "A" concrete. Apron is subsidiary to PSL. Apron is 1'-6" Min width around precast zone drain.

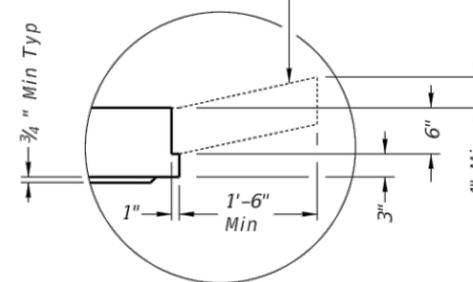

### DETAIL "A"

(Reinforcing not shown for clarity)  
 When an apron is to be cast around PSL, use detail above to create an apron ledge on all 4 sides.

### FABRICATION NOTES:

1. Locate penetration (Style 'RH'), ring and cover (Style 'RC'), ring and grate (Style 'RG'), and frame and grate (Style 'FG') in a corner. Only one penetration is allowed per slab lid.
2. Provide Class "H" concrete in accordance with Item 421 and having a minimum compressive strength of 5,000 psi.
3. Provide Grade 60 reinforcing steel or equivalent area of WWR.
4. Provide clear cover of 3/4" to reinforcing from lower outside shoulder of slab for structural reinforcement, and 2" from top of slab for shrinkage and temperature reinforcement. Place short span reinforcing closest to surface.
5. Slabs with a thickness of 8" or greater require shrinkage and temperature reinforcing. Provide steel area = 0.11 in<sup>2</sup>/ft each way.
6. No substitution is allowed for diagonal #4 bars around openings.
7. Design tongue and groove joints for full closure on both shoulders. Minimum spigot depth is 3/4".
8. Provide lifting devices in conformance with Manufacturer's recommendations.

### INSTALLATION NOTES:

1. Precast slab lids are intended for direct traffic and may be placed in roadway.
2. Seal tongue and groove joints with preformed or bulk mastic in conformance with Manufacturer's recommendations. Tongue and groove joints may be grouted no more than 1" between each section, or 1/2 the joint depth, whichever is greater.
3. Do not grout rubber gasket joints without Manufacturer's recommendation.
4. Initial installation of grade adjustment rings for Styles 'RH' and 'SH' is limited to 1'-0" Max as shown.
5. Grade adjustment rings for Styles 'RH' and 'SH' may be increased to 2'-0" Max when future construction affects final grade of structure. Make adjustments greater than 2'-0" with additional risers. Adjustments can be made up to Max depth shown on sheet PDD. Structure must be evaluated if Max depth will be exceeded.
6. Orient long dimension of grate slots perpendicular to traffic, unless noted otherwise on plans.

### GENERAL NOTES:

1. Designed according to ASTM C913.
2. Payment for lid is per Item 465, "Junction Boxes, Manholes, and Inlets" by type, style, size, and opening size (when applicable).

Cover dimensions are clear dimensions, unless noted otherwise.

HL93 LOADING

SHEET 2 OF 2




## PRECAST SLAB LID

### PSL

FILE: prestd05-20.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS				
	DIST	COUNTY	SHEET NO.	
			46	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: FILE:

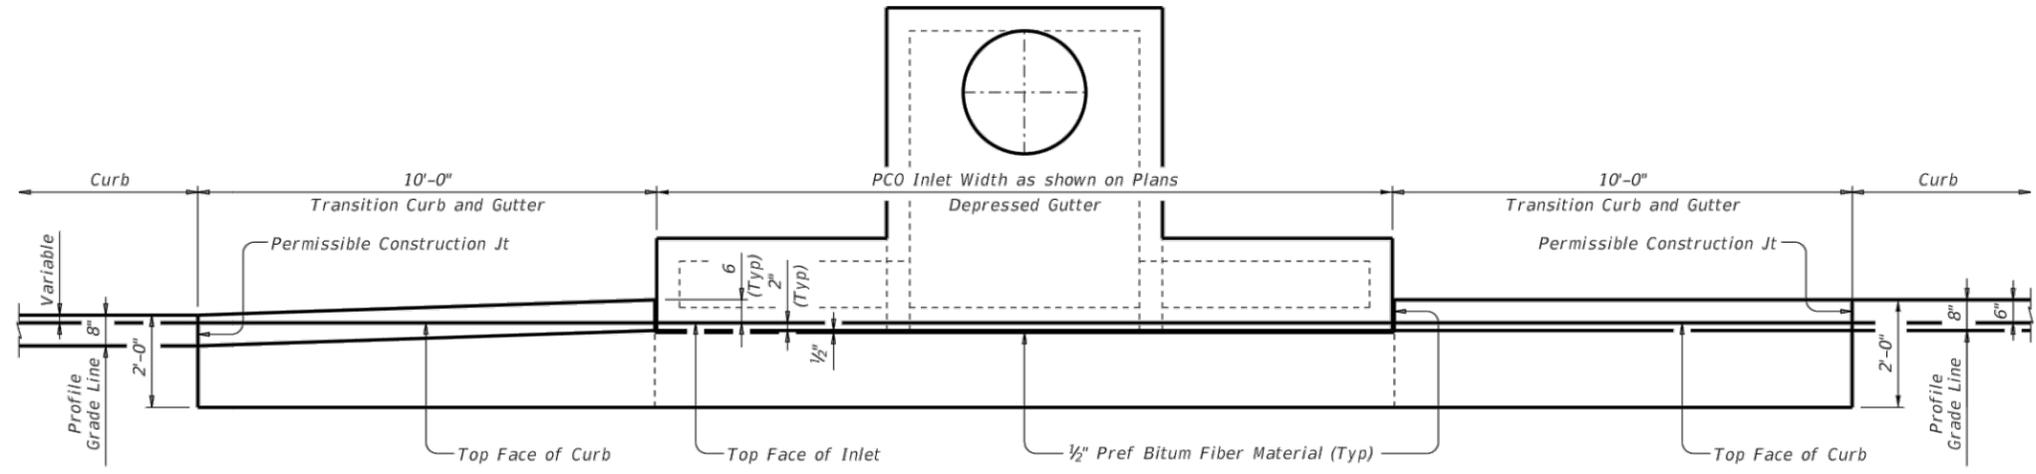

SHOWING TYPE I, IIa & III Curb and Gutter

SHOWING TYPE II & IV Curb and Gutter


**PLAN**

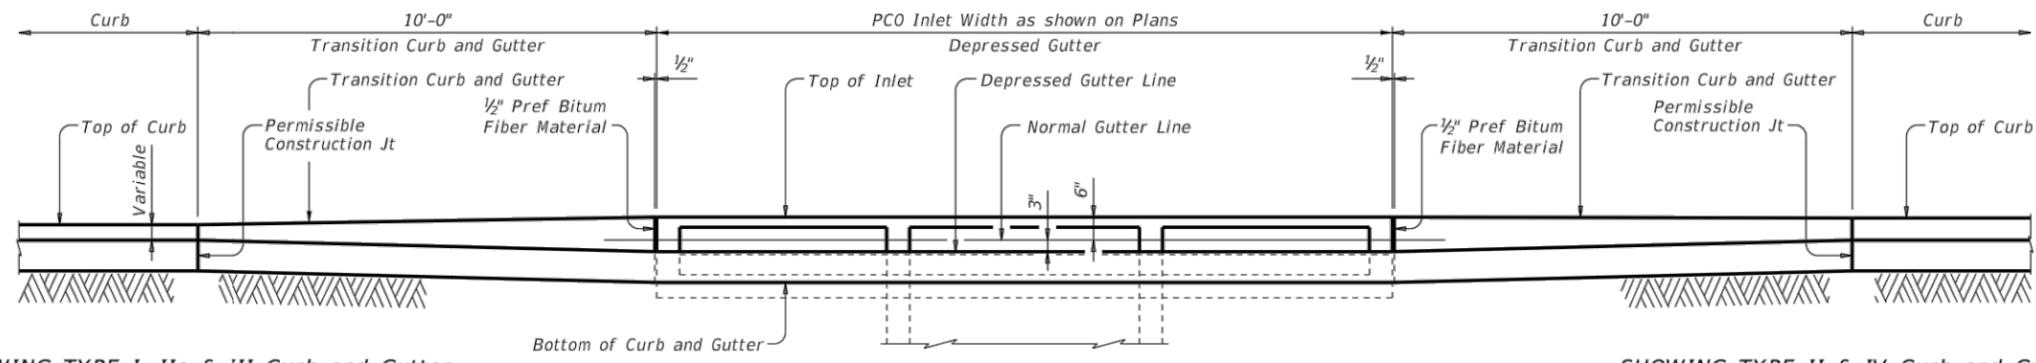

SHOWING TYPE I, IIa & III Curb and Gutter

SHOWING TYPE II & IV Curb and Gutter

**ELEVATION**

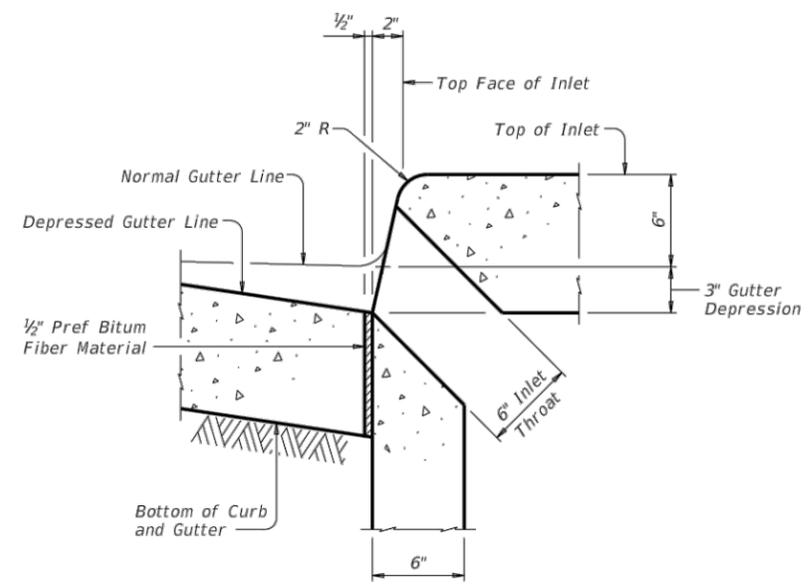

**SECTION AT GUTTER AND INLET**

Reinforcing steel not shown for clarity.

**CONSTRUCTION NOTES:**  
Align top face of curb with PCO Inlet as shown.

**MATERIAL NOTES:**  
Provide 1/2" Preformed Bituminous Fiber Material.

**GENERAL NOTES:**  
See Precast Curb Inlet Outside Roadway (PCO) standard for details and notes not shown.  
See Concrete Curb and Curb and Gutter (CCCG-12) standard for details and notes not shown.  
Curb and Gutter Transitions is paid for and in accordance with Item 529, "Concrete Curb, Gutter, and Combined Curb and Gutter."  
Preformed Bituminous Fiber Material is subsidiary to PCO Inlet.



**CURB AND GUTTER  
TRANSITION DETAILS  
FOR PCO INLET**

**CGT-PCO**

FILE: prest13-20.dgn	DN: TxDOT	CK: AES	DW: JTR	CK: AES
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS				
DIST	COUNTY		SHEET NO.	
				47


**BOX DATA**

SECTION DIMENSIONS					Fill Height (ft.)	M (Min) (in.)	REINFORCING (sq. in. / ft.) <sup>②</sup>							① Lift Weight (tons)
S (ft.)	H (ft.)	TT (in.)	TB (in.)	TS (in.)			AS1	AS2	AS3	AS4	AS5	AS7	AS8	
5	2	8	7	6	< 2	-	0.19	0.27	0.18	0.14	0.19	0.19	0.17	6.0
5	2	6	6	6	2 < 3	44	0.22	0.20	0.16	0.14	-	-	-	5.1
5	2	6	6	6	3 - 5	44	0.16	0.14	0.14	0.14	-	-	-	5.1
5	2	6	6	6	10	36	0.15	0.14	0.14	0.14	-	-	-	5.1
5	2	6	6	6	15	36	0.20	0.18	0.18	0.14	-	-	-	5.1
5	2	6	6	6	20	36	0.26	0.23	0.24	0.14	-	-	-	5.1
5	2	6	6	6	25	36	0.33	0.29	0.29	0.14	-	-	-	5.1
5	2	6	6	6	30	36	0.39	0.34	0.35	0.14	-	-	-	5.1
5	3	8	7	6	< 2	-	0.19	0.31	0.21	0.14	0.19	0.19	0.17	6.6
5	3	6	6	6	2 < 3	45	0.18	0.24	0.19	0.14	-	-	-	5.7
5	3	6	6	6	3 - 5	36	0.14	0.17	0.16	0.14	-	-	-	5.7
5	3	6	6	6	10	36	0.14	0.16	0.17	0.14	-	-	-	5.7
5	3	6	6	6	15	35	0.16	0.21	0.22	0.14	-	-	-	5.7
5	3	6	6	6	20	35	0.21	0.27	0.28	0.14	-	-	-	5.7
5	3	6	6	6	25	35	0.26	0.34	0.34	0.14	-	-	-	5.7
5	3	6	6	6	30	35	0.31	0.41	0.41	0.14	-	-	-	5.7
5	4	8	7	6	< 2	-	0.19	0.33	0.24	0.14	0.19	0.19	0.17	7.2
5	4	6	6	6	2 < 3	45	0.16	0.27	0.22	0.14	-	-	-	6.3
5	4	6	6	6	3 - 5	45	0.14	0.19	0.18	0.14	-	-	-	6.3
5	4	6	6	6	10	36	0.14	0.18	0.18	0.14	-	-	-	6.3
5	4	6	6	6	15	35	0.14	0.23	0.24	0.14	-	-	-	6.3
5	4	6	6	6	20	35	0.17	0.30	0.31	0.14	-	-	-	6.3
5	4	6	6	6	25	35	0.21	0.37	0.38	0.14	-	-	-	6.3
5	4	6	6	6	30	35	0.25	0.44	0.45	0.14	-	-	-	6.3
5	5	8	7	6	< 2	-	0.19	0.35	0.26	0.14	0.19	0.19	0.17	7.8
5	5	6	6	6	2 < 3	45	0.14	0.29	0.24	0.14	-	-	-	6.9
5	5	6	6	6	3 - 5	45	0.14	0.21	0.20	0.14	-	-	-	6.9
5	5	6	6	6	10	45	0.14	0.19	0.20	0.14	-	-	-	6.9
5	5	6	6	6	15	36	0.14	0.24	0.25	0.14	-	-	-	6.9
5	5	6	6	6	20	35	0.15	0.31	0.32	0.14	-	-	-	6.9
5	5	6	6	6	25	35	0.18	0.38	0.39	0.14	-	-	-	6.9
5	5	6	6	6	30	35	0.21	0.46	0.47	0.14	-	-	-	6.9


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:


① For box length = 8'-0"  
 ② AS1 thru AS4, AS7 and AS8 are minimum required areas of reinforcement per linear foot of box length. AS5 is minimum required area of reinforcement per linear foot of box width.

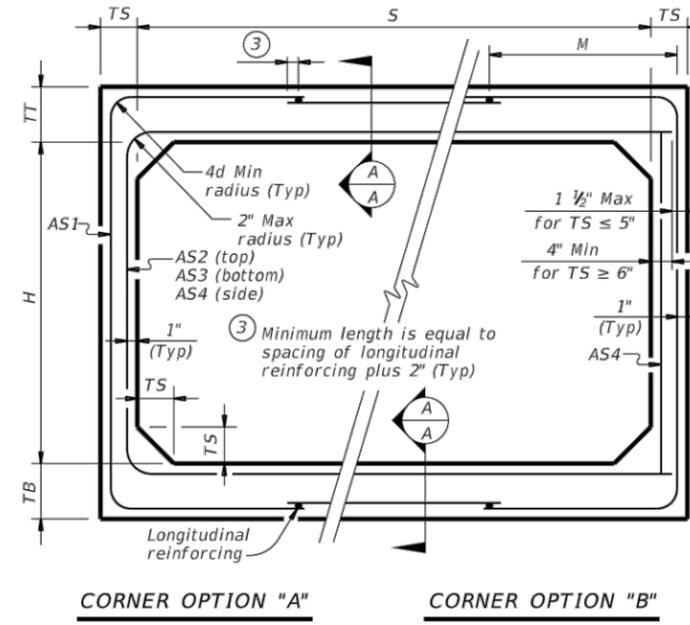

**FILL HEIGHT 2 FT AND GREATER**

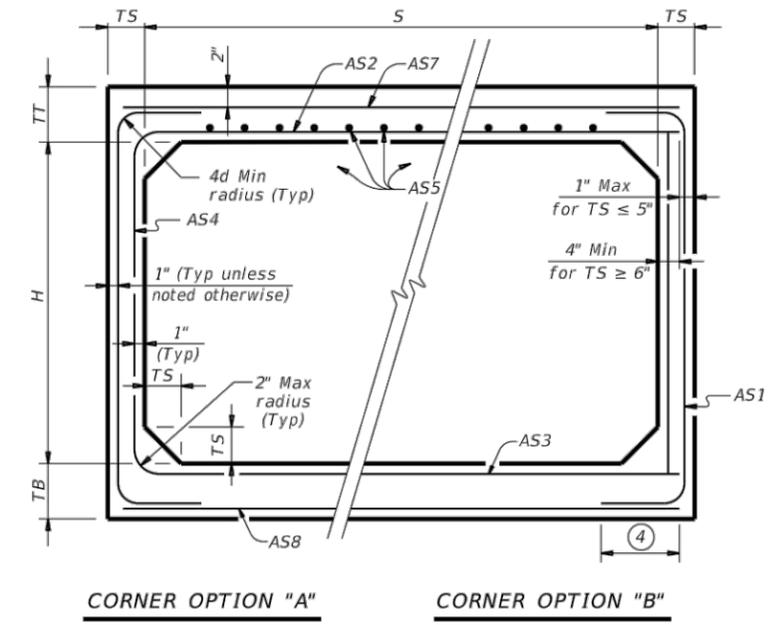

**FILL HEIGHT LESS THAN 2 FT**

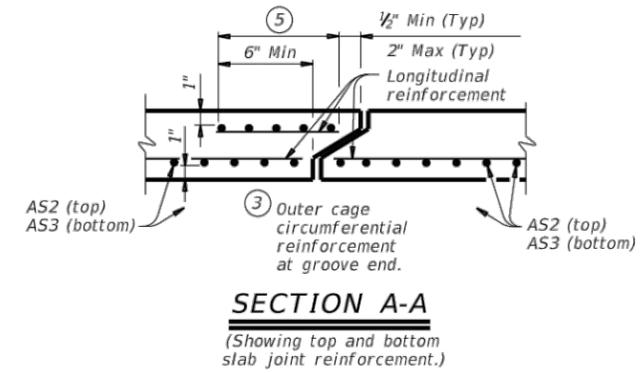

④ Length is equal to spacing of longitudinal reinforcing plus 2". (10" Min) (Typ)

**MATERIAL NOTES:**  
 Provide 0.03 sq. in./ft. minimum longitudinal reinforcement at each face in slabs and walls. This minimum requirement may be met by the transverse wires when wire mesh reinforcement is used.  
 Provide Class H concrete (f'c = 5,000 psi).

**GENERAL NOTES:**  
 Designs shown conform to ASTM C1577. Refer to ASTM C1577 for information or details not shown.  
 See Box Culverts Precast Miscellaneous Details (SCP-MD) standard sheet for details and notes not shown.  
 In lieu of furnishing the designs shown on this sheet, the contractor may furnish an alternate design that is equal to or exceeds the box design for the design fill height in the table. Submit shop plans for alternate designs in accordance with Item "Precast Concrete Structural Members (Fabrication)".

HL93 LOADING


**Texas Department of Transportation**  
 Bridge Division Standard

**SINGLE BOX CULVERTS  
 PRECAST  
 5'-0" SPAN**


**SCP-5**

FILE: scp05sts-20.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CR: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS				
DIST	COUNTY		SHEET NO.	
			48	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

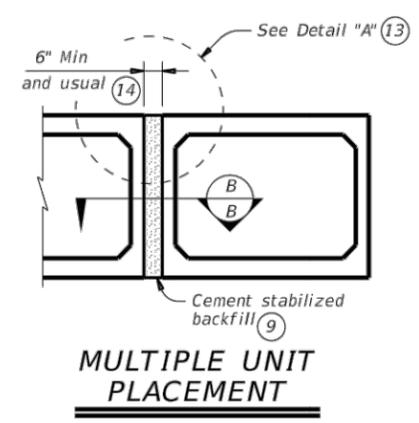


**MULTIPLE UNIT PLACEMENT**

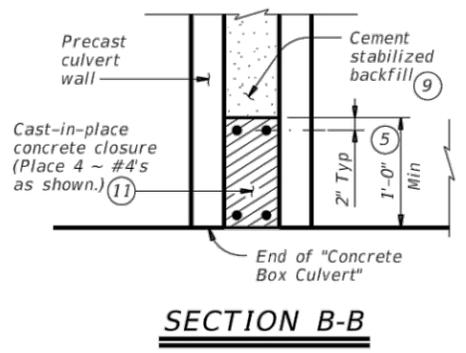

**SECTION B-B**

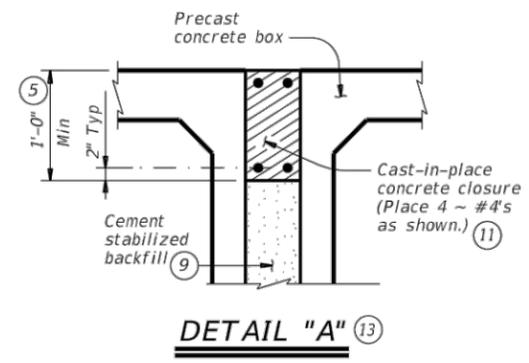


**DETAIL "A"**

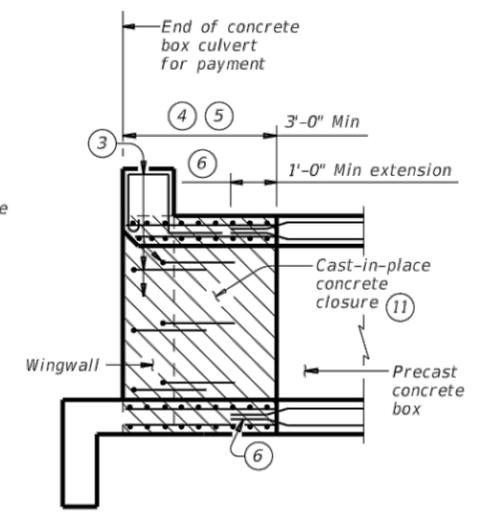


**WINGWALL CONNECTION**

(Also applies to safety end treatment.)

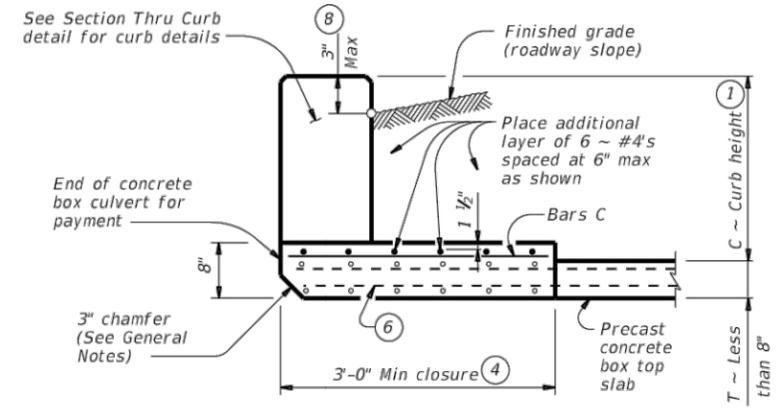


**SECTION THRU TOP SLABS LESS THAN 8"**

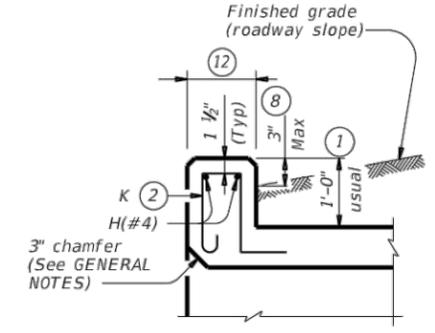


**SECTION THRU CURB**

QUANTITIES PER FOOT OF CURB	
Reinforcing Steel	4.12 Lb
Concrete	0.037 CY



**BARS C (#4)**  
(Spa = 1'-0" Max)

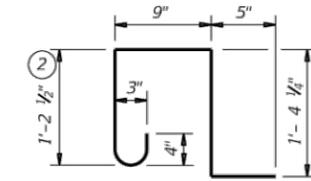

**BARS K (#4)**  
(Spa = 1'-0" Max)  
(Length = 4'-2")

- 1 0" Min to 5'-0" Max. Estimated curb heights are shown elsewhere in the plans. For structures with pedestrian rail, bicycle rail, or curbs taller than 1'-0, refer to the Extended Curb Details (ECD) standard sheet. For structures with T631 or T631LS bridge rail, refer to the Mounting Details for T631 & T631LS Rails (T631-CM) standard sheet. Refer to the Box Culvert Rail Mounting Details (RAC) standard sheet for structures with bridge rail other than T631 or T631LS.
- 2 For curbs less than 1'-0" high, tilt Bars K or reduce bar height as necessary to maintain cover. For curbs less than 3" high, Bars K may be omitted.
- 3 Extend curb, wingwall, or safety end treatment reinforcing into concrete closure. Bend or trim, as necessary, any reinforcing that does not fit into closure area.
- 4 Provide a 3'-0" Min cast-in-place concrete closure. Break back boxes in the field or cast boxes short. Provide bands of reinforcing in the closure that are the same size and spacing as in the precast box section. Provide #4 longitudinal reinforcement spaced at 12 inches Max within the closure. Except where shown otherwise, construct the cast-in-place closure flush with the inside and outside faces of the precast box section.
- 5 For multiple unit placements, adjust the length of the closure for the interior walls as necessary. Provide a 3'-0" Min cast-in-place closure in the top slab, bottom slab, and exterior wall. See Section B-B detail when interior walls are cast full length.
- 6 Extend precast box reinforcing a minimum of 1'-0" into concrete closure (Typ).
- 7 Place bands of reinforcing matching the inside and outside face reinforcing in the gaps of the top and bottom slabs. Place a band matching the outside face reinforcing of the wall in the gaps of the walls (placed in the outside face only). Tack weld the bands to the exposed reinforcing at each point of contact.
- 8 For vehicle safety, the following requirements must be met:
  - For structures without bridge rail, construct curbs no more than 3" above finished grade.
  - For structures with bridge rail, construct curbs flush with finished grade. Reduce curb heights, if necessary, to meet the above requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- 9 Cement stabilized backfill between boxes is considered part of the box culvert for payment.
- 10 All curb concrete and reinforcing is considered part of the box culvert for payment.
- 11 Any additional concrete and reinforcing required for the closures will be considered subsidiary to the box culvert for payment.
- 12 1'-0" typical, 2'-3" when the Box Culvert Rail Mounting Details (RAC) standard sheet is referred to elsewhere in the plans.
- 13 For multiple unit placement with overlay, with 1 to 2 course surface treatment, or with the top slab as the final riding surface, provide wall closure as shown in Detail "A".
- 14 This dimension may be increased with approval of the Engineer to allow the precast boxes to be tunneled or jacked in accordance with Item 476, "Jacking, Boring, or Tunneling Pipe or Box". No payment will be made for any additional material in the gap between adjacent boxes.


**MATERIAL NOTES:**

- Provide Grade 60 reinforcing steel.
- Provide ASTM A1064 welded wire reinforcement.
- Provide Class C concrete (f<sub>c</sub> = 3,600 psi) for the closures.
- Provide cement stabilized backfill meeting the requirements of Item 400, "Excavation and Backfill for Structures."
- Any additional concrete required for the closures will be considered subsidiary to the box culvert.


**GENERAL NOTES:**

- Designed according to AASHTO LRFD Bridge Design Specifications.
- Refer to the Single Box Culverts Precast (SCP) standard sheets for details and notes not shown.
- Chamfer the bottom edge of the top slab closure 3 inches at culvert closure ends.


Cover dimensions are clear dimensions, unless noted otherwise.  
Reinforcing bars dimensions are out-to-out of bars.

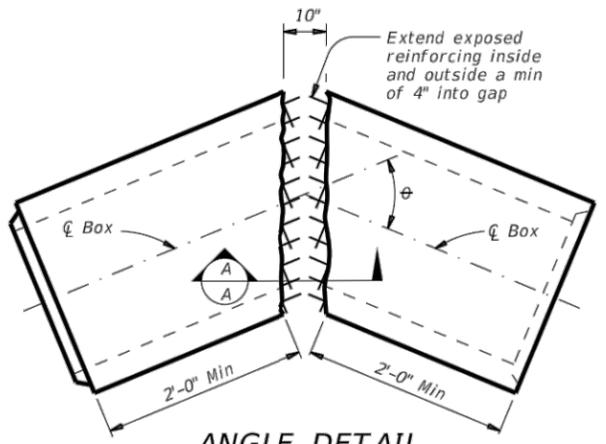

**ANGLE DETAIL**

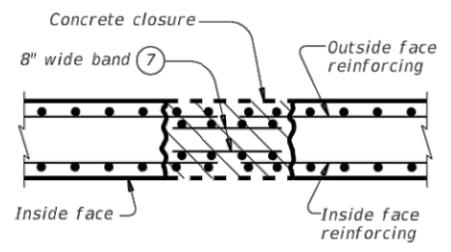

**SECTION A-A**

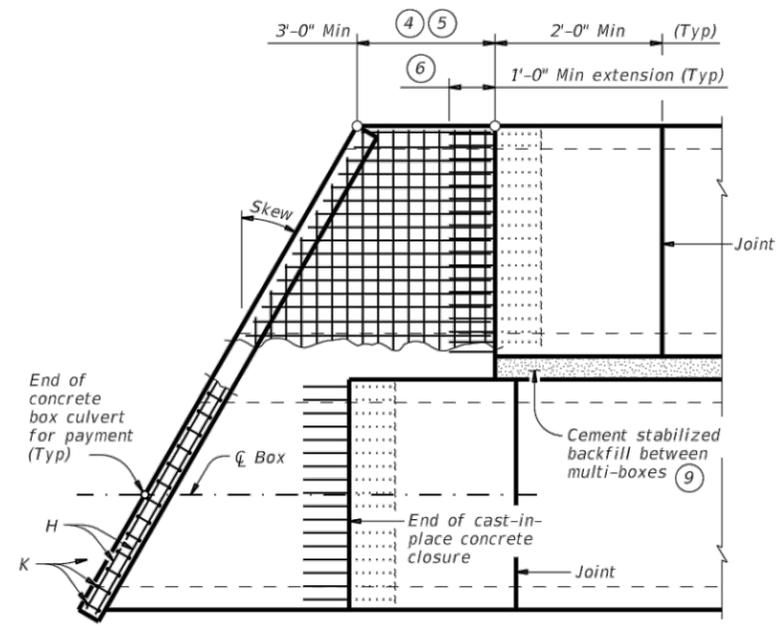

**PLAN OF SKEWED ENDS**

(Showing multi-box placement.)

**HL93 LOADING**

		<b>Bridge Division Standard</b>	
<b>BOX CULVERTS PRECAST MISCELLANEOUS DETAILS</b>			
<b>SCP-MD</b>			
FILE: scpmdsts-20.dgn	DN: GAF	CK: LMW	DW: BWH/TxDOT
©TxDOT February 2020	CONT	SECT	JOB HIGHWAY
REVISIONS		SHEET NO.	
DIST		COUNTY	
		<b>49</b>	

DATE: FILE:

**TABLE OF DIMENSIONS AND REINFORCING STEEL**  
(Wings for one structure end)




Maximum Wingwall Height Hw	Dimensions				Variable Reinforcing				Estimated Quantities per ft of wing (2-wings)		Estimated Quantities per ft of Toewall (1-toewall)	
	W	X	Y	Z	Bars J1		Bars J2		Reinf (Lb/Ft)	Conc (CY/Ft)	Reinf (Lb/Ft)	Conc (CY/Ft)
					Size	Spa	Size	Spa				
2'-6"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	48.64	0.406	6.85	0.071
2'-9"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	49.31	0.424	6.85	0.071
3'-0"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	49.98	0.444	6.85	0.071
3'-3"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	53.32	0.462	6.85	0.071
3'-6"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	53.98	0.480	6.85	0.071
4'-0"	3'-2"	1'-2"	1'-0"	7"	#4	1'-0"	#4	1'-0"	55.77	0.532	6.85	0.071
4'-6"	3'-2"	1'-2"	1'-0"	7"	#4	1'-0"	#4	1'-0"	59.77	0.568	6.85	0.071
5'-0"	3'-9"	1'-7"	1'-2"	7"	#4	1'-0"	#4	1'-0"	63.45	0.632	6.96	0.075
5'-6"	3'-9"	1'-7"	1'-2"	7"	#4	1'-0"	#4	1'-0"	67.46	0.668	6.96	0.075
6'-0"	4'-4"	2'-0"	1'-4"	7"	#5	1'-0"	#5	1'-0"	80.67	0.730	7.07	0.078
6'-6"	4'-4"	2'-0"	1'-4"	7"	#5	1'-0"	#5	1'-0"	85.05	0.768	7.07	0.078
7'-0"	5'-0"	2'-3"	1'-9"	8"	#5	1'-0"	#5	1'-0"	92.15	0.864	8.07	0.093
7'-6"	5'-0"	2'-3"	1'-9"	8"	#5	1'-0"	#5	1'-0"	96.54	0.902	8.07	0.093
8'-0"	5'-6"	2'-8"	1'-10"	8"	#5	6"	#5	6"	139.04	0.962	8.13	0.095
8'-6"	5'-6"	2'-8"	1'-10"	8"	#5	6"	#5	6"	144.47	1.000	8.13	0.095
9'-6"	6'-0"	2'-10"	2'-2"	9"	#5	6"	#5	6"	156.93	1.136	8.41	0.110
10'-6"	6'-5"	3'-0"	2'-5"	9"	#6	6"	#5	6"	196.27	1.234	8.57	0.117
11'-6"	7'-2"	3'-6"	2'-8"	11"	#6	6"	#6	6"	230.13	1.438	9.52	0.140
12'-6"	7'-8"	3'-9"	2'-11"	1'-0"	#7	6"	#6	6"	283.41	1.592	9.74	0.157
13'-6"	8'-2"	4'-0"	3'-2"	1'-2"	#8	6"	#6	6"	348.72	1.804	10.02	0.186
14'-6"	8'-10"	4'-5"	3'-5"	1'-4"	#9	6"	#6	6"	432.94	2.046	10.30	0.218
15'-6"	9'-6"	4'-10"	3'-8"	1'-6"	#9	6"	#7	6"	489.52	2.302	11.24	0.253
16'-0"	9'-11"	5'-0"	3'-11"	1'-7"	#9	6"	#7	6"	505.72	2.448	11.47	0.279

**TABLE OF WINGWALL REINFORCING**  
(2-wings)

Bar	Size	No.	Spa
D1	#6	~	1'-0"
D2	#6	~	1'-0"
E1	#4	~	1'-0"
F	#4	~	1'-0"
G	#6	~	8"
M1	#4	4	~
P	#4	~	1'-0"
V	#4	~	1'-0"

**TABLE OF TOEWALL REINFORCING**

Bar	Size	No.	Spa
J3	#4	~	1'-0"
M2	#4	2	~
E2	#4	~	1'-0"

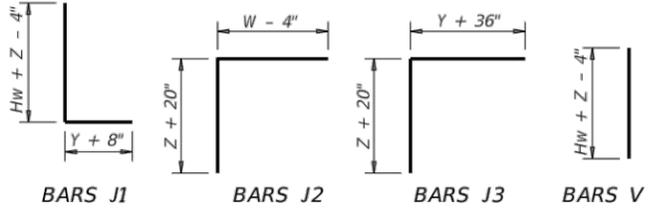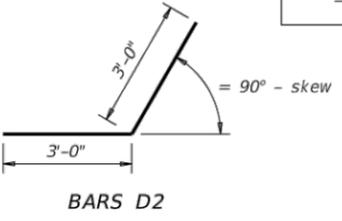

**WING DIMENSION FORMULAS:**  
(All values are in feet.)

$Hw = H + T + C$   
 $Lw = (Hw)(SL) + \cosine(\theta)$  for Type PW-1  
 $= (Hw - 1')(SL) + \cosine(\theta)$  for Type PW-2 and  $Hw \geq 4'$   
 $= (Hw - 0.5')(SL) + \cosine(\theta)$  for Type PW-2 and  $Hw < 4'$


For cast-in-place culverts:  
 $Ltw = [(N)(S) + (N + 1)(U)] + \cosine(\theta)$

For precast culverts:  
 $Ltw = [(N)(2U + S) + (N - 1)(0.5')] + \cosine(\theta)$   
 Total Wingwall Area (two wings ~ SF)  
 $= (2)(Hw)(Lw)$  for Type PW-1  
 $= (2)(Hw)(Lw) - 6 SF$  for Type PW-2 and  $Hw \geq 4'$   
 $= (2)(Hw)(Lw) - 1.5 SF$  for Type PW-2 and  $Hw < 4'$

$Hw$  = Height of wingwall  
 $Lw$  = Length of wingwall  
 $Ltw$  = Culvert toewall length  
 $N$  = Number of culvert spans  
 $SL:1$  = Channel slope ratio. (horizontal: 1 vertical, usual value is 2:1)  
 $\theta$  = Culvert skew

See applicable box culvert standard sheet for S, H, T, and U values.

- Skew = 0°
- At discharge end, chamfer may be 3/4" minimum.
- For 15° skew ~ 1"  
For 30° skew ~ 2"  
For 45° skew ~ 3"
- Quantities shown are for two Type PW-1 wings. Adjust concrete volume for Type PW-2 wings. To determine estimated quantities for two wings, multiply the tabulated values by Lw. Quantities shown do not include weight of Bars D.
- Provide weepholes for Hw = 5'-0" and greater. Fill around weepholes with coarse gravel.
- Extend Bars E2 1'-6" minimum into the wingwall footing.
- Lap Bars M1 1'-6" minimum with Bars M2.
- Place Bars G as shown, equally spaced at 8" maximum. Provide at least two pairs of Bars G per wing.
- 0" Min to 5'-0" Max. Estimated curb heights are shown elsewhere in the plans. For structures with pedestrian rail or curbs taller than 1'-0", refer to the Extended Curb Details (ECD) standard sheet. For structures with T631 or T631LS bridge rail, refer to the Mounting Details for T631 & T631LS Rails (T631-CM) standard sheet. Refer to the Box Culvert Rail Mounting Details (RAC) standard sheet for structures with bridge rail other than T631 or T631LS.
- For vehicle safety, the following requirements must be met:
  - For structures without bridge rail, construct curbs no more than 3" above finished grade.
  - For structures with bridge rail, construct curbs flush with finished grade.
 Reduce curb heights, if necessary, to meet the above requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- 1'-0" typical. 2'-3" when the Box Culvert Rail Mounting Details (RAC) standard sheet is referred to elsewhere in the plans.
- 3'-0" for Hw < 4'.
- 6" for Hw < 4'.





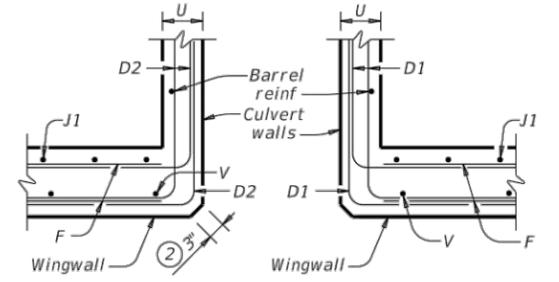


**DESIGNER NOTES:**  
 Type PW-1 can be used for all applications and must be used if railing is to be mounted to the wingwall. Type PW-2 can only be used for applications without a railing mounted to the wingwall.

**MATERIAL NOTES:**  
 Provide Class C concrete (f'c=3,600 psi).  
 Provide Grade 60 reinforcing steel.  
 Provide galvanized reinforcing steel if required elsewhere in the plans.

**GENERAL NOTES:**  
 Designed in accordance with AASHTO LRFD Bridge Design Specifications.  
 Depth of toewalls for wingwalls and culverts may be reduced or eliminated when founded on solid rock, when directed by the Engineer.  
 See Box Culvert Supplement (BCS) standard sheet for wingwall type and additional dimensions and information. Quantities for concrete and reinforcing steel resulting from the formulas given on this sheet are for the Contractor's information only.

Cover dimensions are clear dimensions, unless noted otherwise. Reinforcing dimensions are out-to-out of bars.

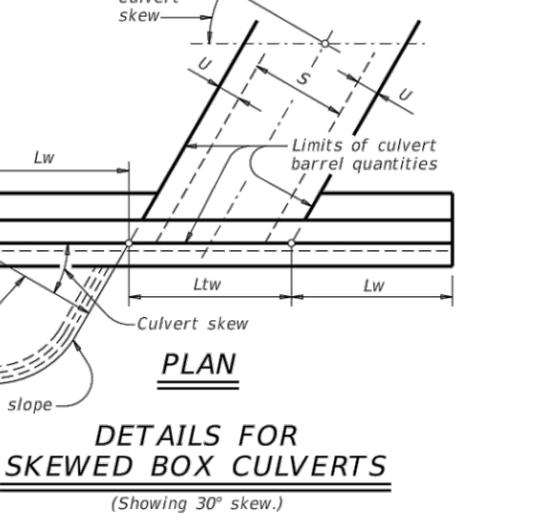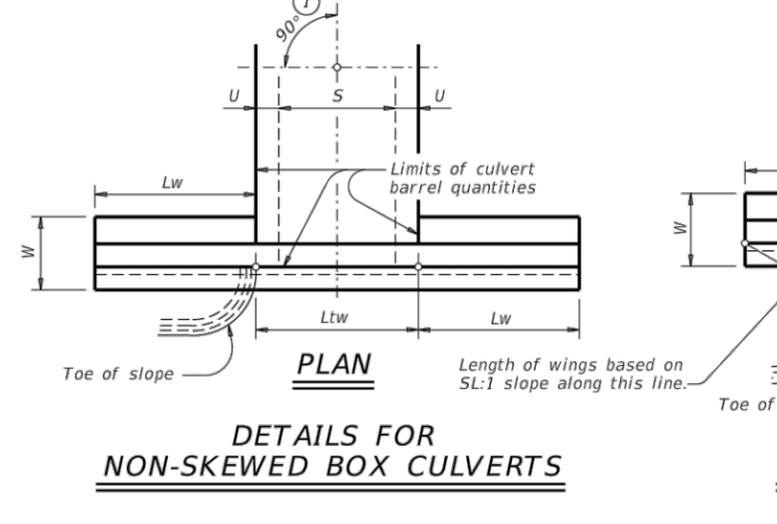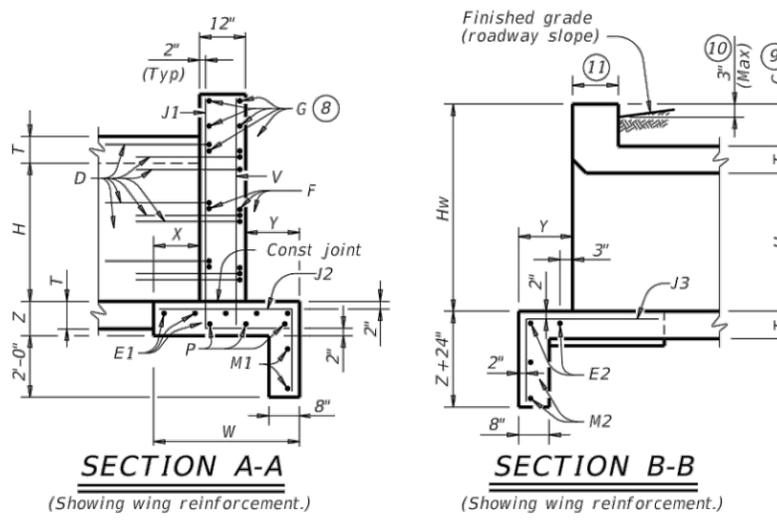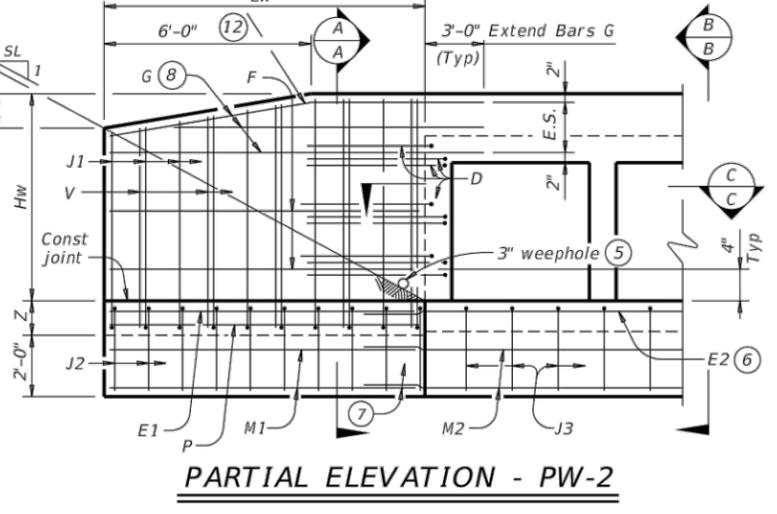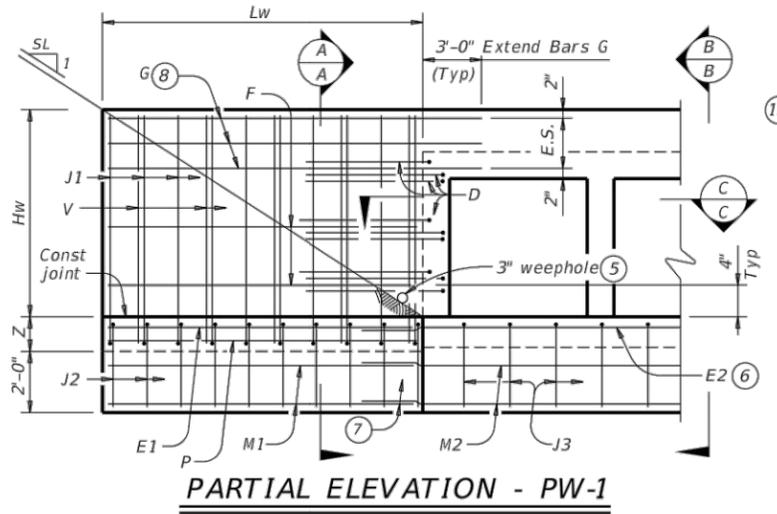

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

**Texas Department of Transportation** Bridge Division Standard


**CONCRETE WINGWALLS WITH PARALLEL WINGS FOR BOX CULVERTS TYPES PW-1 AND PW-2**

**PW**


FILE: pwstde01-20.dgn	DN: GAF	CK: CAT	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	

50

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

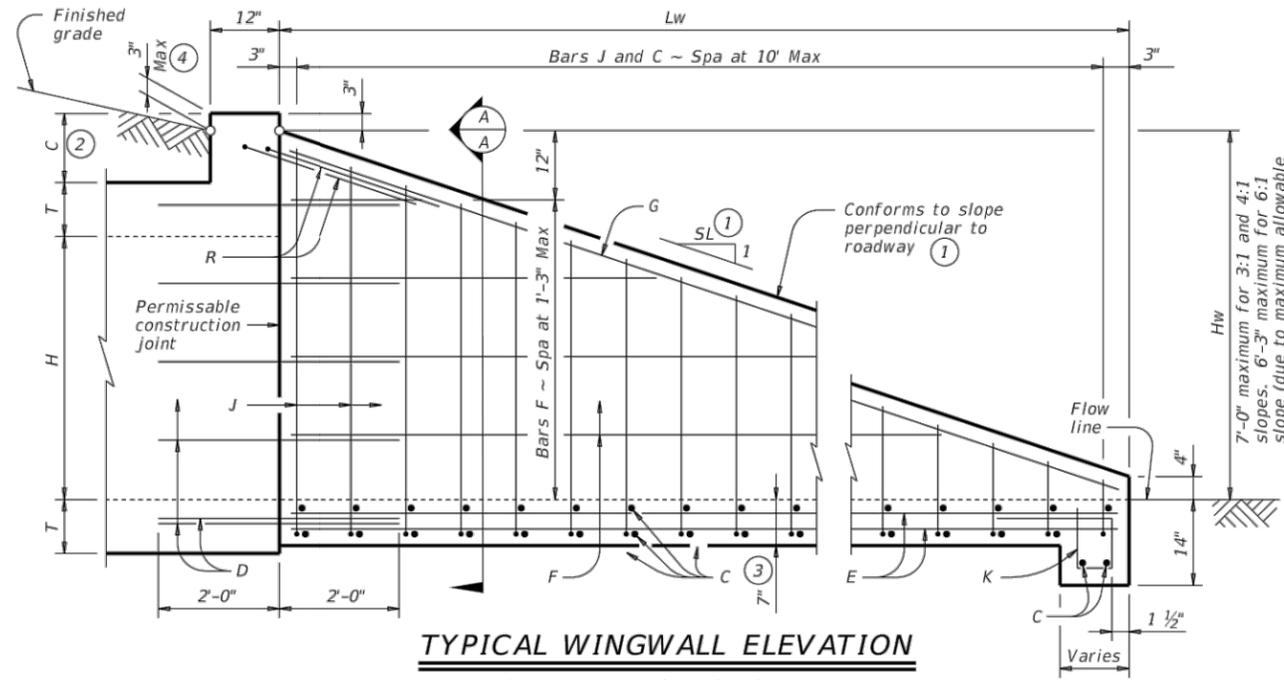

**TYPICAL WINGWALL ELEVATION**  
(Pipe runners not shown for clarity.)

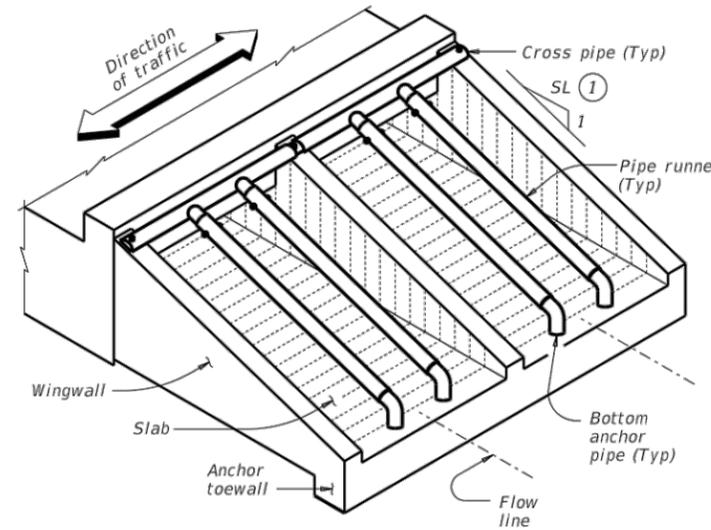

**ISOMETRIC VIEW OF TYPICAL INSTALLATION**

**WING DIMENSION CALCULATIONS:**

$$Hw = H + T + C - 0.250'$$

$$Lw = (Hw - 0.333') (SL)$$

For cast-in-place culverts:  
 $Atw = (N) (S) + (N + 1) (U)$

For precast culverts:  
 $Atw = (N) (2U + S) + (N - 1) (0.500')$

$$\text{Total Wingwall Area (SF)} = (0.5) (Hw + 0.333') (Lw) (N + 1)$$

$$\text{Total Concrete Volume (CY)} = [(Wingwall Area) (0.583') + (Lw) (Atw) (0.583') + (Atw) (1.167') (1.167' - 0.583')] \div (27)$$

**PIPE RUNNER DIMENSION CALCULATIONS:**

$$\text{Pipe Runner Length} = (Lw) (K1) - (1.917')$$

$$\text{Total Reinforcing (Lb)} = (1.55) (Lw) (Atw) + (4.43) (Atw) + (K2) (Hw) (N + 1) (\sqrt{Lw})$$

C = Height of curb above top of top slab (feet)  
Hw = Height of wingwall (feet)  
K = Constant value for use in formulas

Slope SL:1	K1	K2
3:1	~ 1.054	~ 7.45
4:1	~ 1.031	~ 8.49
6:1	~ 1.014	~ 10.30

Atw = Anchor toewall length (feet)  
Lw = Length of wingwall (feet)  
N = Number of culvert barrels  
SL:1 = Side slope ratio (horizontal : 1 vertical)

See applicable box culvert standard for H, S, T, and U values.


**MATERIAL NOTES:**

- Provide Grade 60 reinforcing steel.
- Provide galvanized reinforcing steel if required elsewhere in the plans.
- Adjust reinforcing as necessary to provide a minimum clear cover of 1 1/2".
- Provide Class "C" concrete (f'c = 3,600 psi).
- Provide pipe runners, cross pipes, and anchor pipes meeting the requirements of ASTM A53 (Type E or S, Gr B), ASTM A500 Gr B, or API 5LX52.
- Provide ASTM A307 bolts.
- Galvanize all steel components, except the concrete reinforcing, unless required elsewhere in the plans, after fabrication.
- Repair galvanizing damaged during transport or construction in accordance with the Item 445, "Galvanizing".

**GENERAL NOTES:**


- Designed according to AASHTO LRFD Bridge Design Specifications.
- The safety end treatments shown herein are intended for use in those installations where out of control vehicles are likely to traverse the openings approximately perpendicular to the pipe runners.
- Pipe runners are designed for a traversing load of 1,800 pounds at yield as recommended by Research Report 280-1, "Safety Treatment of Roadside Cross-Drainage Structures", Texas Transportation Institute, March 1981.
- The quantities for pipe runners, reinforcing steel, and concrete resulting from the formulas given herein are for Contractor's information only.
- See the Box Culvert Supplement (BCS) standard sheet for additional dimensions and information.
- Alternate design drawings bearing the seal of a professional engineer will be acceptable for precast construction of the safety end treatments.

Cover dimensions are clear dimensions, unless noted otherwise. Reinforcing dimensions are out-to-out of bars.

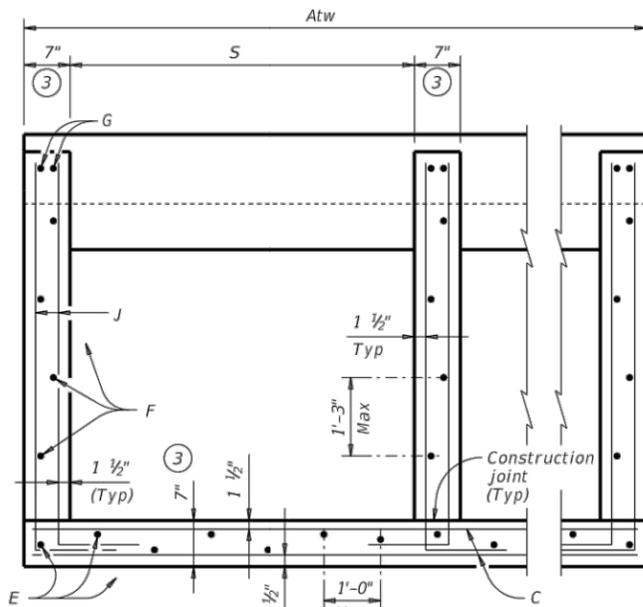

**SECTION A-A**

(Showing typical wingwall and wing slab reinforcing. Pipe runners not shown for clarity.)

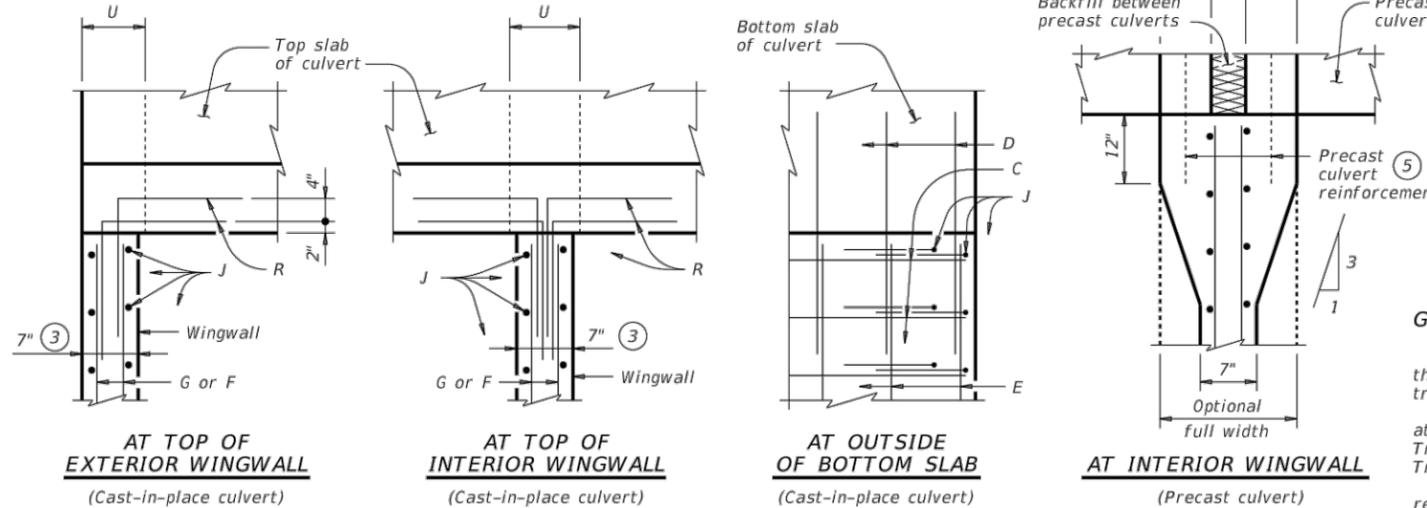


**PLAN VIEWS OF CORNER DETAILS**

- Recommended values of slope are: 3:1, 4:1, and 6:1. Provide 3:1 or flatter slope.
- 0" Min to 5'-0" Max. Estimated curb heights are shown elsewhere in the plans. For structures without railing and curbs taller than 1'-0", refer to the Extended Curb Details (ECD) standard sheet.
- Wingwall and slab thicknesses may be the same as the adjacent culvert wall and slab thicknesses (7" minimum). If thicknesses greater than the minimum (7") are used, no changes will be made in quantities and no additional compensation will be allowed.
- For vehicle safety, reduce curb height, if necessary, to provide a maximum 3" projection. No changes will be made in quantities and no additional compensation will be allowed for this work.
- For culverts with C = 0°, the precast culvert reinforcing may extend 1'-0" minimum into wingwall. Wingwall Bars D and R may be omitted. Otherwise, refer to the Wingwall Connection detail on the Box Culvert Precast Miscellaneous Details (SCP-MD) standard sheet.


**TABLE OF REINFORCING BAR SIZES AND SPACING**

Bar	Size	Spacing
C	#4	10" Max
D	#4	Match F and E
E	#4	1'-0" Max
F	#4	1'-3" Max
G	#6	As shown
J	#4	10" Max
K	#4	1'-0" Max
R	#4	As shown

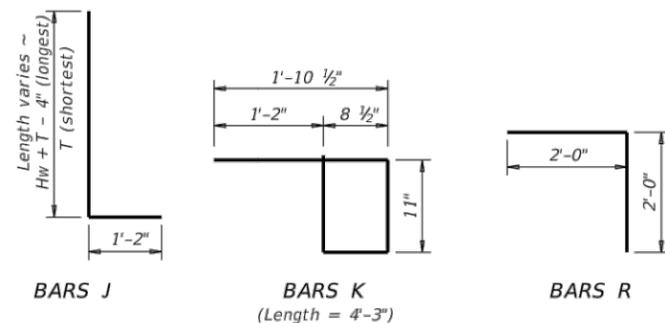


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

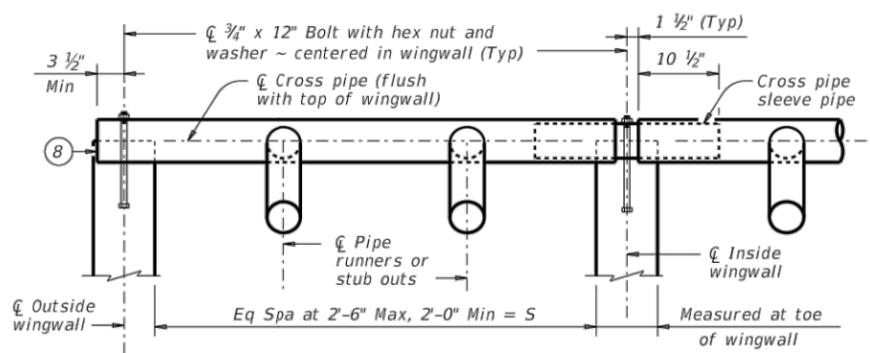

NOTE: At Contractor's option, make the cross pipe continuous across the inside wingwalls. If option is selected, omit the sleeve pipe and make a 15/16" diameter through hole in the cross pipe to accept the anchor bolt at the centerline of each inside wingwall.


**CROSS PIPE INSTALLATION DETAILS**

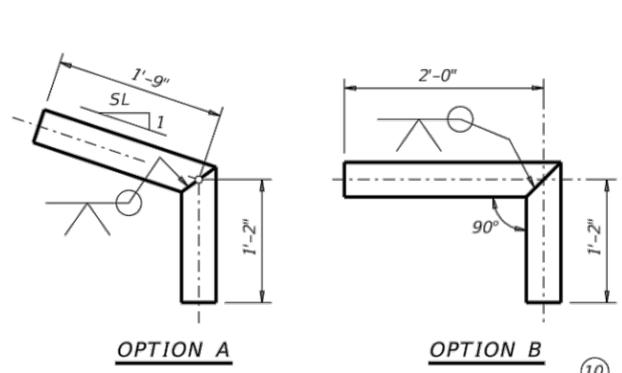


**OPTION A      OPTION B**  
**BOTTOM ANCHOR PIPE DETAILS**

- ⑥ Cross pipe is the same size as the pipe runner. Cross pipe stub out is the same size as the anchor pipe.
- ⑦ Note that actual slope of safety pipe runner may vary slightly from side slope.
- ⑧ Take care to ensure that riprap concrete does not flow into the cross pipe so as to permit disassembly of the bolted connection to allow cleanout access.
- ⑨ After installation, inspect the 1#2" hole to ensure that the lap of the safety pipe runner with the bottom anchor pipe is adequate.
- ⑩ At fabricator's option, a heat bend to a smooth 5" radius or a manufactured elbow (of the same material as the runner) may be substituted for the mitered and welded joint in the bottom anchor pipe.


Maximum Pipe Runner Length	Required Pipe Runner Size			Required Anchor Pipe Size		
	Pipe Size	Pipe O.D.	Pipe I.D.	Pipe Size	Pipe O.D.	Pipe I.D.
10'- 0"	3" STD	3.500"	3.068"	2" STD	2.375"	2.067"
19'- 8"	4" STD	4.500"	4.026"	3" STD	3.500"	3.068"
34'- 2"	5" STD	5.563"	5.047"	4" STD	4.500"	4.026"

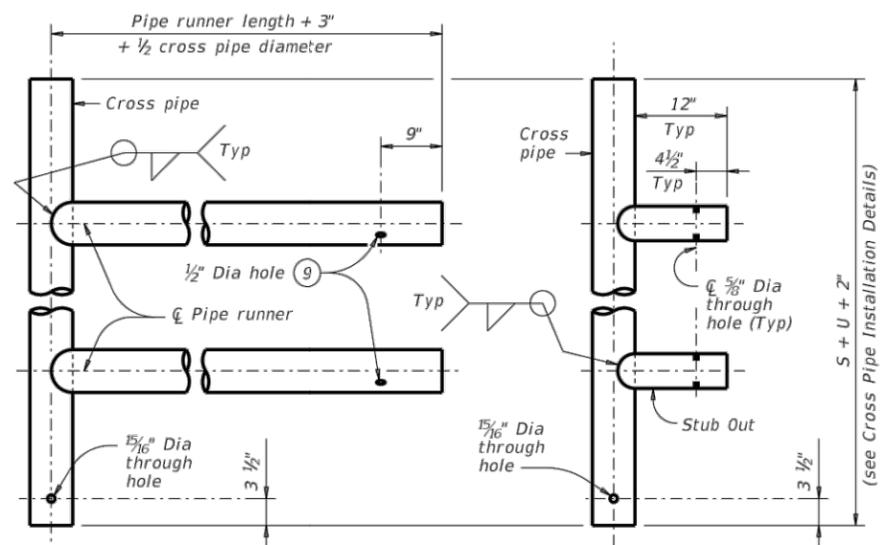

**OPTION A2      OPTION A1**  
**FOR USE IN OUTSIDE CULVERT BAY**

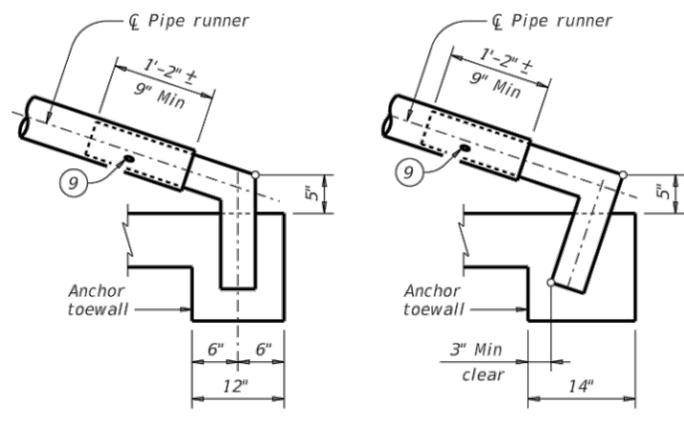


**OPTION B1      OPTION B2**  
**BOTTOM ANCHOR TOEWALL DETAILS**  
 (Wingwall not shown for clarity.)

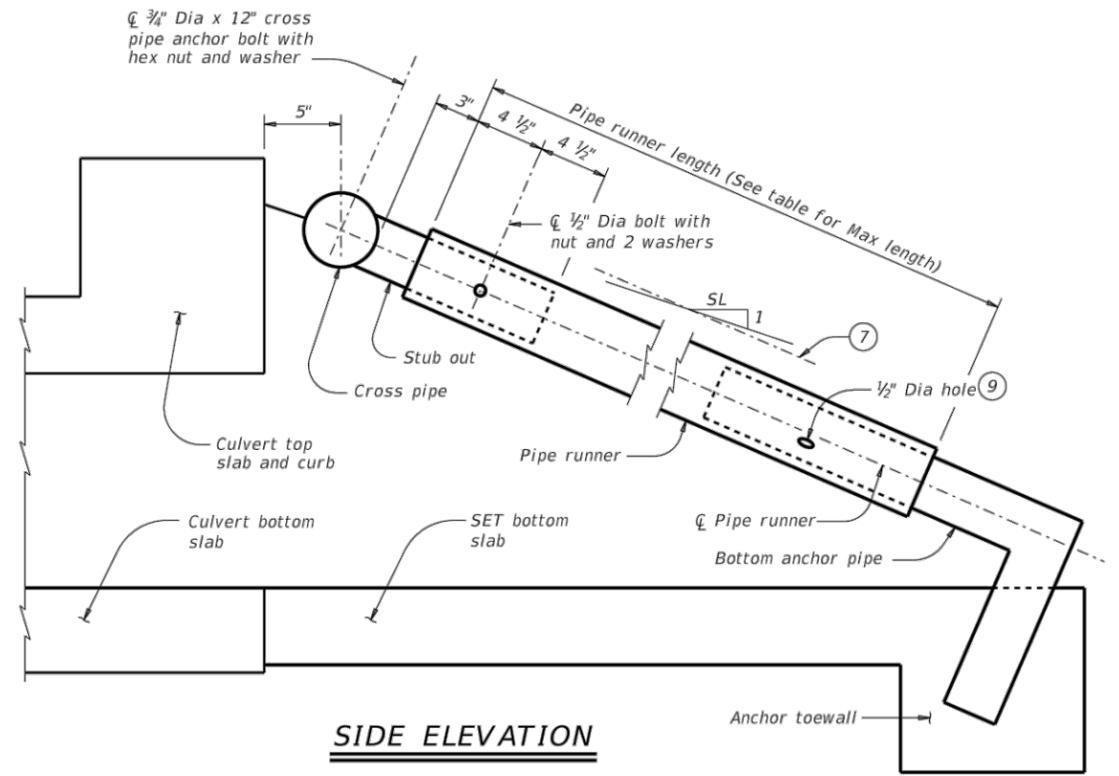


**SIDE ELEVATION**

(Showing pipe runner with Cross Pipe Connection Option A1 and Bottom Anchor Toewall Option B2. Wingwall not shown for clarity.)

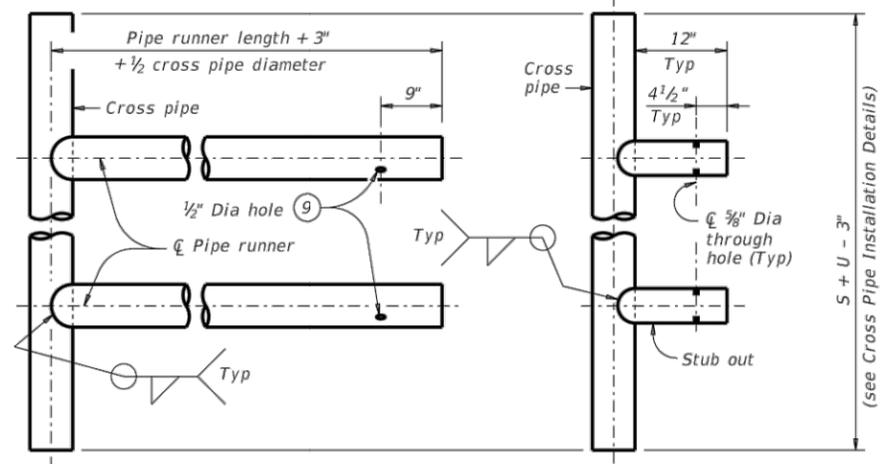


**OPTION A2      OPTION A1**  
**FOR USE IN INSIDE CULVERT BAY**

**CROSS PIPE AND CONNECTIONS DETAILS**

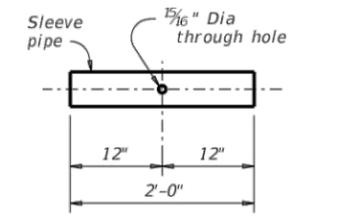

**CROSS PIPE SLEEVE PIPE DETAILS**

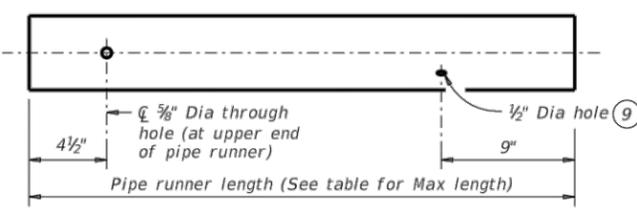

NOTE: The separate pipe runner shown is required when Cross Pipe Connection Option A1 is used.

**PIPE RUNNER DETAILS**

SHEET 2 OF 2



**SAFETY END TREATMENT FOR 0° SKEW BOX CULVERTS (MAXIMUM Hw = 7'-0") TYPE I ~ CROSS DRAINAGE**






**SETB-CD**

FILE: setbcdse-20.dgn	DN: GAF	CK: CAT	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	
			52	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

## REQUIREMENTS FOR CULVERT PIPES AND SAFETY PIPE RUNNERS

Pipe I.D.	RCP Wall "B" Thickness	TP Wall Thickness (7)	"D" (1)	Slope	Min Length	Pipe Runners Required		Required Pipe Runner Size		
						Single Pipe	Multiple Pipe	Nominal Dia.	O.D.	I.D.
12"	2"	1.15"	17.00"	6:1	4' - 9"	No	Yes, for > 2 pipes	3" STD	3.500"	3.068"
15"	2 1/4"	1.30"	20.50"	6:1	6' - 5"	No	Yes, for > 2 pipes	3" STD	3.500"	3.068"
18"	2 1/2"	1.60"	24.00"	6:1	8' - 0"	No	Yes, for > 2 pipes	3" STD	3.500"	3.068"
24"	3"	1.95"	31.00"	6:1	11' - 3"	No	Yes, for > 2 pipes	3" STD	3.500"	3.068"
30"	3 1/2"	2.65"	38.50"	6:1	14' - 8"	No	Yes	4" STD	4.500"	4.026"
36"	4"	2.75"	45.50"	6:1	17' - 11"	Yes	Yes	4" STD	4.500"	4.026"
42"	4 1/2"	2.7"	52.50"	6:1	21' - 2"	Yes	Yes	4" STD	4.500"	4.026"

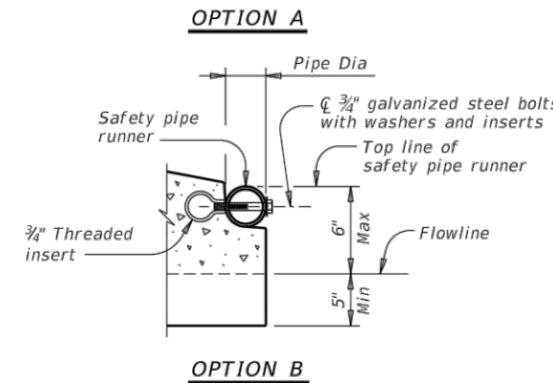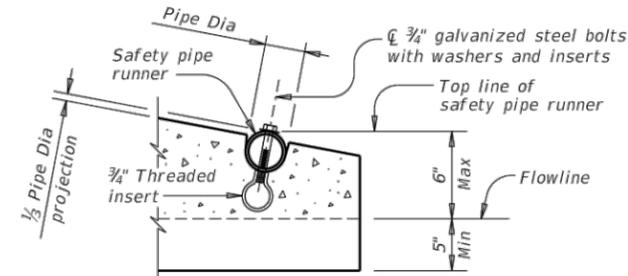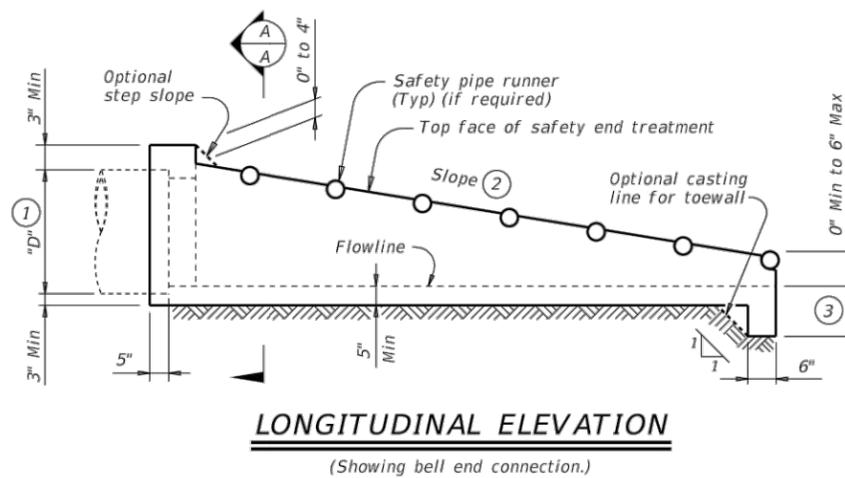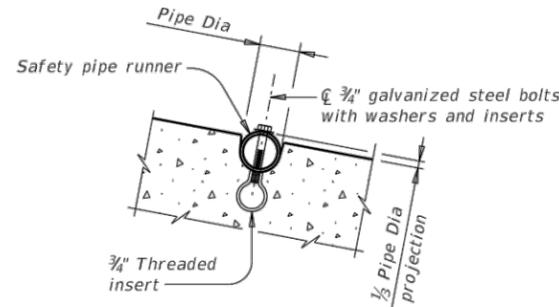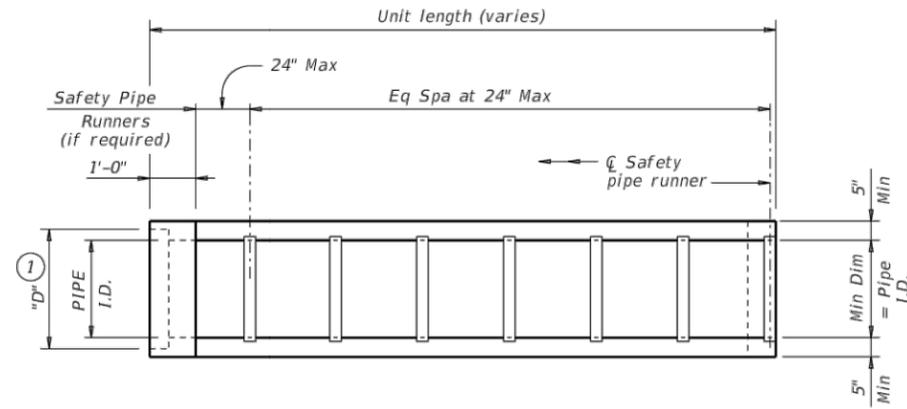

### END DETAILS FOR INSTALLATION OF SAFETY PIPE RUNNERS

(If required)

- ① Dimension "D" is based on reinforced concrete pipe (RCP) meeting the requirements of ASTM C-76, Class III, (RCP Wall "B" thickness). Adjust "D" for any other wall thickness used. For thermoplastic pipe (TP) take into account the annular space requirements for grouted connections.
- ② Slope as shown elsewhere in the plans. Slope of 6:1 or flatter is required for vehicle safety.
- ③ Toewall to be used only when dimension is shown elsewhere in the plans.
- ④ Fill the top 4" of void between precast end treatments with concrete riprap. Concrete riprap is considered subsidiary to the Item 467, "Safety End Treatment".
- ⑤ Adjust clear distance between pipes to provide for the minimum distance between safety end treatments.
- ⑥ Provide cement stabilized bedding and backfill in accordance with the Item 400, "Excavation and Backfill for Structures". Bedding and backfill is considered subsidiary to the Item 467, "Safety End Treatment". When concrete riprap is specified around the safety end treatment, backfill as directed by Engineer.
- ⑦ Thermoplastic pipe wall thickness may vary. Adjust accordingly. Thermoplastic pipe requires the safety end treatments to have a bell end for grouted connections.

#### GENERAL NOTES:

Precast safety end treatment for reinforced concrete pipe (RCP), and thermoplastic pipe (TP) may be used for TYPE II end treatment as specified in Item "Safety End Treatment".

When precast safety end treatment is used as a Contractor's alternate to mitered RCP, riprap will not be required unless noted otherwise on the plans.

Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise.

Manufacture this product in accordance with Item 467, "Safety End Treatment" except as noted below:

- A. Provide minimum reinforcing of #4 at 6" (Grade 40) or #4 at 9" (Grade 60) each way or 6"x6" - D12 x D12 or 5"x5" - D10 x D10 welded wire reinforcement (WWR).
- B. For precast (steel formed) sections, provide Class "C" concrete ( $f'_c = 3,600$  psi).




At the option and expense of the Contractor the next larger size of safety end treatment may be furnished; as long as the "D" dimension cast is that of the required size of pipe.

Pipe runners are designed for a traversing load of 10,000 lbs at yield as recommended by Research Report 280-2F, "Safety Treatment of Roadside Parallel-Drainage Structures", Texas Transportation Institute, March 1981.

Provide pipe runners meeting the requirements of ASTM A53 (Type E or S, Grade B), ASTM A500 (Grade B), or API 5LX52.

Galvanize all steel components except reinforcing steel after fabrication. Repair galvanizing damaged during transport or construction in accordance with the specifications.

Connect RCP using the Optional Joint for RCP detail shown or in accordance with Item 464, "Reinforced Concrete Pipe". Connect TP by grouting. See Pipe and Box Grouted Connections (PBG) standard for grouted connections with TP and precast safety end treatment.

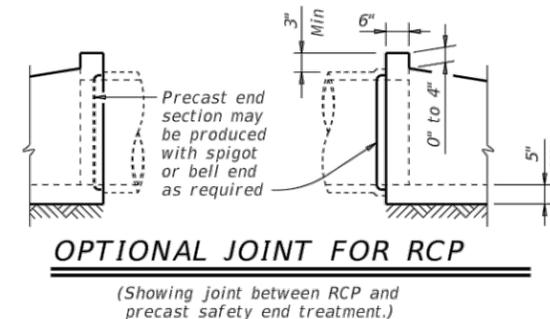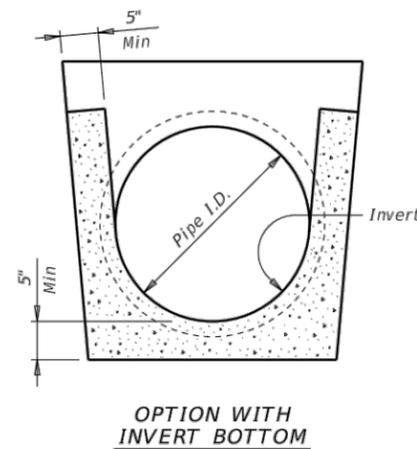
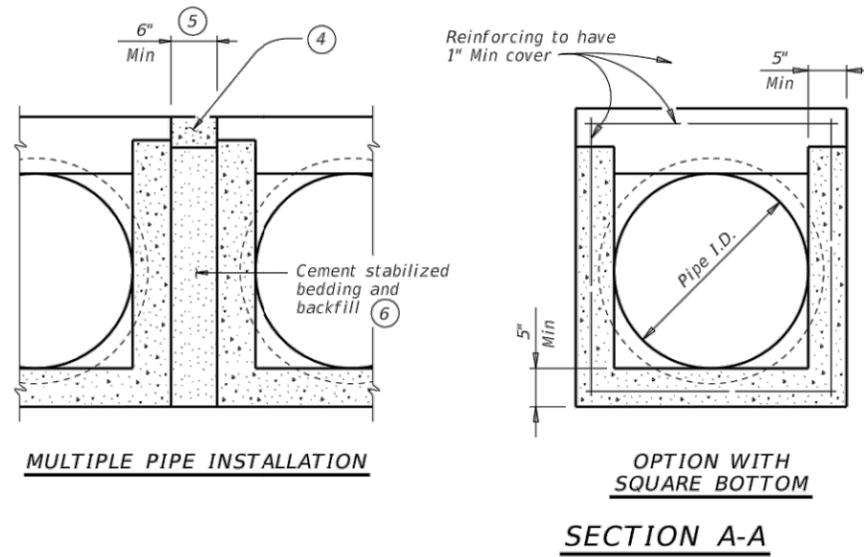


		<b>Bridge Division Standard</b>	
<b>PRECAST SAFETY END TREATMENT TYPE II ~ PARALLEL DRAINAGE</b>			
<b>PSET-SP</b>			
FILE: psetsps-21.dgn	DN: RLW	CK: KLR	DW: JTR
©TxDOT February 2020	CONT	SECT	JOB
REVISIONS 12-21: Added 42" TP	DIST		COUNTY
		SHEET NO.	
		<b>53</b>	

DATE:  
FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

PIPE I. D.	PIPE WALL "B" THICKNESS	"D"	SLOPE	MINIMUM LENGTH OF UNIT	SINGLE PIPE		MULTIPLE PIPE	
					SKEW	PIPE RUNNERS REQUIRED	SKEW	PIPE RUNNERS REQUIRED
12"	2"	17"	3:1	2'-11"	<=45 deg	No	<=45 deg	No
			4:1	3'-6"				
			6:1	4'-9"				
15"	2 1/4"	20 1/2"	3:1	3'-8"	<=45 deg	No	<=45 deg	No
			4:1	4'-7"				
			6:1	6'-5"				
18"	2 1/2"	24"	3:1	4'-6"	<=45 deg	No	<=45 deg	No
			4:1	5'-8"				
			6:1	8'-0"				
24"	3"	31"	3:1	6'-2"	<=45 deg	No	<=30 deg	No
			4:1	7'-10"				
			6:1	11'-3"				
30"	3 1/2"	38 1/2"	3:1	7'-10"	<=15 deg	No	<=15 deg	No
			4:1	10'-1"				
			6:1	14'-8"				
36"	4"	45 1/2"	3:1	9'-5"	=0 deg	No	=>0 deg	Yes
			4:1	12'-3"				
			6:1	17'-11"				
42"	4 1/2"	52 1/2"	3:1	11'-1"	=>0 deg	Yes	=>0 deg	Yes
			4:1	14'-5"				
			6:1	21'-2"				

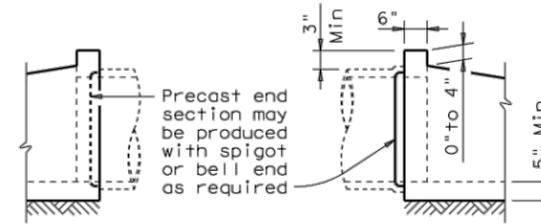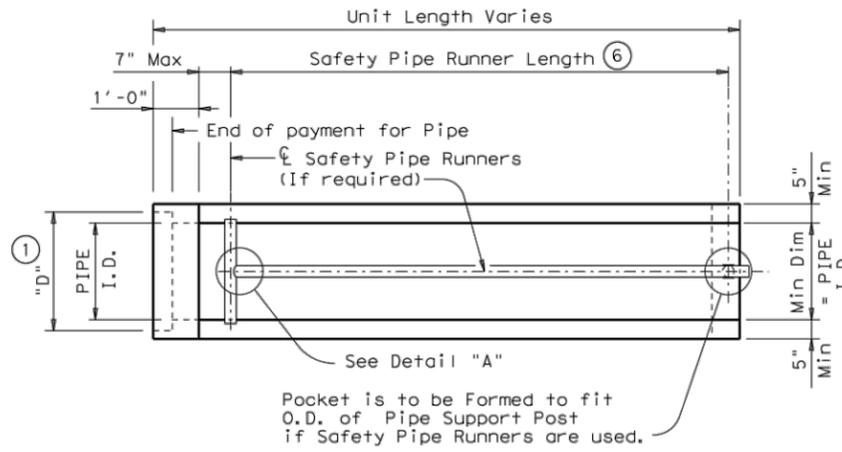


**OPTIONAL JOINT**


(Showing joint between RCP and Precast Safety End Treatment)

Maximum Safety Pipe Runner Length	Required Pipe Runner Size		
	Pipe Size	Pipe O.D.	Pipe I.D.
11'- 2"	3" STD	3.500"	3.068"
15'- 6"	3 1/2" STD	4.000"	3.548"
20'-10"	4" STD	4.500"	4.026"
35'- 4"	5" STD	5.563"	5.047"

- Dimension "D" is based on ASTM C-76, Class III, Wall thickness "B". If any other wall thickness is used, dimension "D" must be adjusted accordingly.
- Slope as shown elsewhere in plans. Slope of 3:1 or flatter is required for vehicle safety.
- Toewall to be used only when dimension is shown elsewhere in the plans.
- The top 4" of void between precast end treatments shall be filled with concrete riprap and shall be considered subsidiary to Safety End Treatment.
- Clear distance between pipes shall be adjusted to provide for the minimum distance between safety end treatments.
- Measured along Slope.
- Cement stabilized bedding and backfill shall be in accordance with the Item, "Excavation and Backfill for Structures". Bedding and backfill shall be considered subsidiary to the Item "Safety End Treatment". When concrete riprap is specified around the safety end treatment, backfill shall be as directed by Engineer.

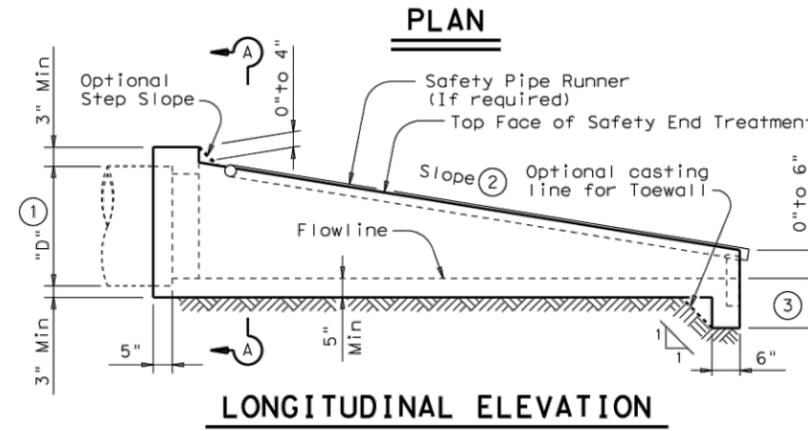


**LONGITUDINAL ELEVATION**

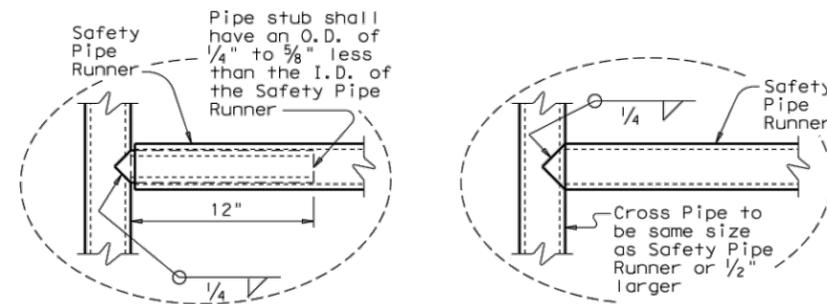


**OPTION A DETAIL A OPTION B**

(If required)

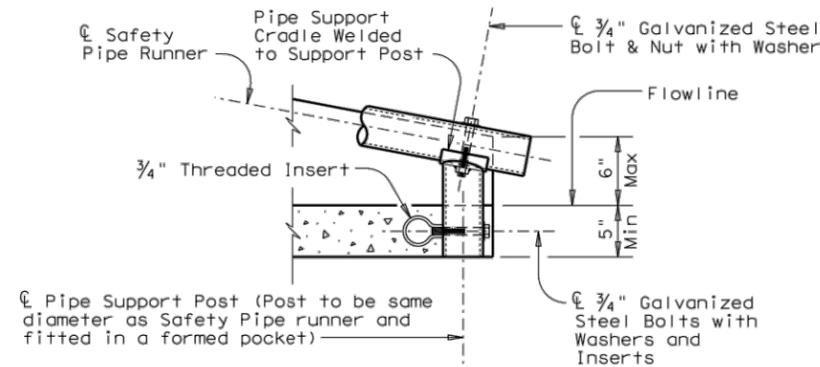


**END DETAIL FOR INSTALLATION OF SAFETY PIPE RUNNERS**

(If required)

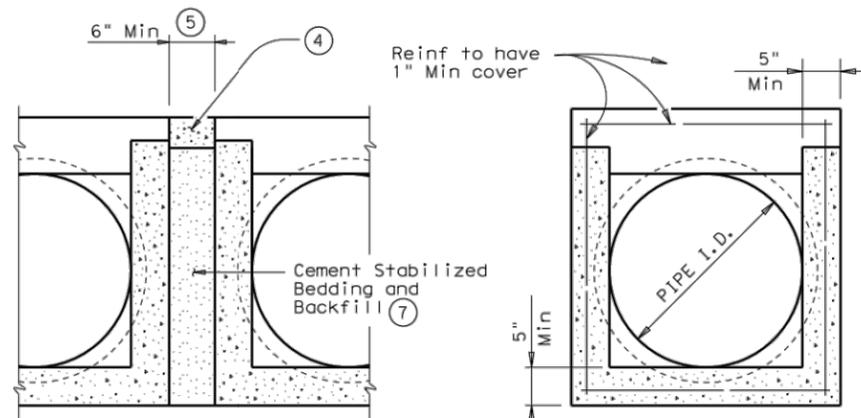


**MULTIPLE PIPE INSTALLATION**

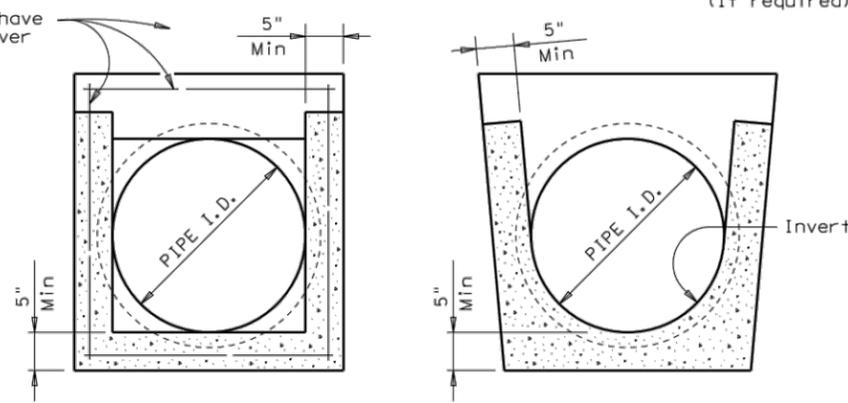

**OPTION WITH SQUARE BOTTOM**

**SECTION A-A**

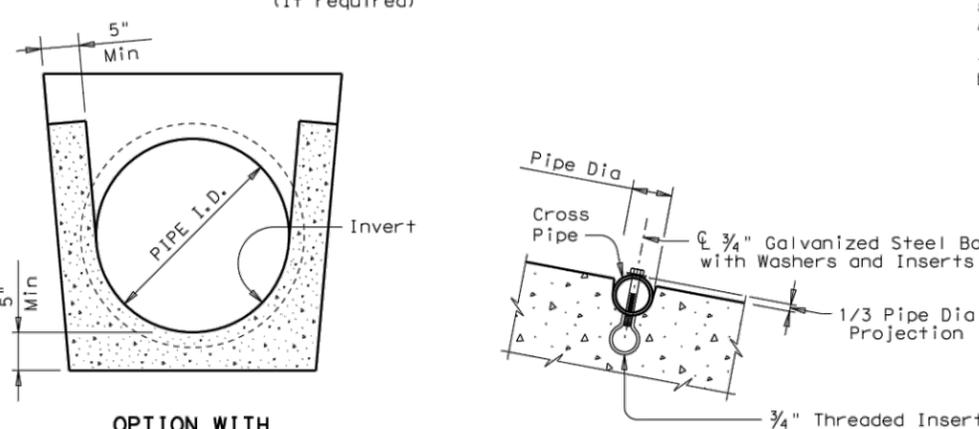

**INSTALLATION DETAIL FOR SAFETY PIPE RUNNERS**

(If required)

**GENERAL NOTES:**

Precast safety end treatment for reinforced concrete pipe may be used for TYPE II end treatment as specified in Item "Safety End Treatment". When Precast Safety End Treatment is used as a Contractor's alternate to mitered RCP, Riprap will not be required unless noted otherwise on the plans.

Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise.

Manufacture of this product shall conform to requirements of Item "Safety End Treatment" except as noted below:

- Minimum reinforcing shall be #4 at 6" (Grade 40) or #4 at 9" (Grade 60) each way or 6 x 6 - W12 x W12 or 5 x 5 - W10 x W10 welded wire reinforcement (WWR).
- Concrete for precast (steel formed) sections shall be Class "C" with a minimum compressive strength of 3600 psi.

At the option and expense of the Contractor the next larger size of Safety End Treatment may be furnished; as long as the "D" dimension cast is that of the required size of pipe.

Pipe Runners are designed for a traversing load of 1,800 Lbs at yield as recommended by Research Report 280-1, "Safety Treatment of Roadside Cross-Drainage Structures", Texas Transportation Institute, March 1981.

Safety Pipe Runners, Cross Pipes, Pipe Support Posts, and Pipe Stubs shall conform to the requirements of ASTM A53 (Type E or S, Grade B), ASTM A500 (Grade B), or API 5LX52.

All steel components except reinforcing, shall be galvanized after fabrication. Galvanizing damaged during transport or construction shall be repaired in accordance with the specifications.

**Texas Department of Transportation** Bridge Division Standard

**PRECAST SAFETY END TREATMENT TYPE II ~ CROSS DRAINAGE**


**PSET-SC**

FILE: psetscs.dgn DN: RLW CK: KLR DW: JTR CK: GAF  
 ©TxDOT February 2010 CONF SECT JOB HIGHWAY  
 REVISIONS  
 11-10: Add note for synthetic fibers. DIST COUNTY SHEET NO. 54

DATE: FILE:


**TABLE OF VARIABLE DIMENSIONS AND QUANTITIES FOR ONE HEADWALL** ④

SLOPE	DIA OF PIPE, D	Values for one Pipe				Values to be added for each add'l Pipe				
		W	X	Y	L	Reinf (Lbs)	Conc (CY)	X and W	Reinf (Lbs)	Conc (CY)
2:1	12"	4'-7 1/2"	2'-6"	2'-10"	3'-3 1/4"	84	0.6	1'-9"	20	0.2
	15"	5'-5 3/4"	2'-9 1/2"	3'-4"	3'-10 1/4"	99	0.7	2'-2"	24	0.3
	18"	6'-4 1/4"	3'-1"	3'-10"	4'-5"	120	0.9	2'-8"	32	0.3
	21"	7'-2 3/4"	3'-4 1/2"	4'-4"	5'-0"	137	1.1	3'-1"	43	0.4
	24"	8'-2 1/2"	3'-9 1/2"	4'-10"	5'-7"	158	1.3	3'-7"	50	0.5
	27"	9'-1"	4'-1"	5'-4"	6'-2"	173	1.5	3'-11"	56	0.6
	30"	9'-11 1/2"	4'-4 1/2"	5'-10"	6'-8 3/4"	197	1.7	4'-4"	65	0.8
	33"	10'-10"	4'-8"	6'-4"	7'-3 3/4"	216	2.0	4'-8"	71	0.9
	36"	11'-8 1/4"	4'-11 1/2"	6'-10"	7'-10 3/4"	241	2.2	5'-1"	81	1.0
	42"	13'-5 1/4"	5'-6 1/2"	7'-10"	9'-0 1/2"	290	2.8	5'-10"	97	1.3
	48"	15'-9"	6'-1 1/2"	9'-4"	10'-9 1/4"	350	3.8	6'-7"	117	1.7
	54"	17'-5 3/4"	6'-8 1/2"	10'-4"	11'-11 1/4"	415	4.5	7'-6"	151	2.1
60"	19'-2 3/4"	7'-3 1/2"	11'-4"	13'-1"	469	5.3	8'-3"	174	2.5	
66"	20'-11 1/2"	7'-10 1/2"	12'-4"	14'-3"	530	6.2	8'-9"	194	2.9	
72"	22'-8 1/2"	8'-5 1/2"	13'-4"	15'-4 3/4"	587	7.1	9'-4"	213	3.3	
3:1	12"	6'-3"	2'-6"	4'-3"	4'-11"	114	0.8	1'-9"	22	0.2
	15"	7'-5"	2'-9 1/2"	5'-0"	5'-9 1/4"	133	1.1	2'-2"	28	0.3
	18"	8'-6 3/4"	3'-1"	5'-9"	6'-7 3/4"	166	1.3	2'-8"	37	0.5
	21"	9'-8 3/4"	3'-4 1/2"	6'-6"	7'-6"	189	1.6	3'-1"	48	0.6
	24"	11'-0"	3'-9 1/2"	7'-3"	8'-4 1/2"	221	2.0	3'-7"	58	0.7
	27"	12'-2"	4'-1"	8'-0"	9'-2 3/4"	245	2.3	3'-11"	67	0.8
	30"	13'-4"	4'-4 1/2"	8'-9"	10'-1 1/4"	287	2.7	4'-4"	77	1.0
	33"	14'-5 3/4"	4'-8"	9'-6"	10'-11 3/4"	310	3.1	4'-8"	84	1.2
	36"	15'-7 3/4"	4'-11 1/2"	10'-3"	11'-10"	343	3.5	5'-1"	96	1.4
	42"	17'-11 1/2"	5'-6 1/2"	11'-9"	13'-6 3/4"	424	4.5	5'-10"	119	1.7
	48"	21'-1 3/4"	6'-1 1/2"	14'-0"	16'-2"	527	6.1	6'-7"	146	2.3
	54"	23'-5 1/2"	6'-8 1/2"	15'-6"	17'-10 3/4"	618	7.3	7'-6"	186	2.9
60"	25'-9 1/4"	7'-3 1/2"	17'-0"	19'-7 1/2"	707	8.7	8'-3"	219	3.4	
66"	28'-1"	7'-10 1/2"	18'-6"	21'-4 1/4"	797	10.1	8'-9"	242	3.9	
72"	30'-4 3/4"	8'-5 1/2"	20'-0"	23'-1 1/4"	910	11.7	9'-4"	272	4.4	
4:1	12"	7'-10 3/4"	2'-6"	5'-8"	6'-6 1/2"	144	1.1	1'-9"	24	0.3
	15"	9'-4"	2'-9 1/2"	6'-8"	7'-8 1/2"	177	1.5	2'-2"	32	0.4
	18"	10'-9 1/2"	3'-1"	7'-8"	8'-10 1/4"	217	1.9	2'-8"	42	0.5
	21"	12'-2 3/4"	3'-4 1/2"	8'-8"	10'-0"	254	2.3	3'-1"	57	0.7
	24"	13'-9 1/2"	3'-9 1/2"	9'-8"	11'-2"	295	2.8	3'-7"	67	0.9
	27"	15'-3"	4'-1"	10'-8"	12'-3 3/4"	328	3.3	3'-11"	77	1.0
	30"	16'-8 1/4"	4'-4 1/2"	11'-8"	13'-5 3/4"	379	3.8	4'-4"	89	1.3
	33"	18'-1 3/4"	4'-8"	12'-8"	14'-7 1/2"	417	4.5	4'-8"	101	1.4
	36"	19'-7"	4'-11 1/2"	13'-8"	15'-9 1/4"	464	5.1	5'-1"	115	1.7
	42"	22'-5 3/4"	5'-6 1/2"	15'-8"	18'-1"	575	6.5	5'-10"	141	2.1
	48"	26'-6 1/4"	6'-1 1/2"	18'-8"	21'-6 3/4"	720	8.9	6'-7"	175	2.8
	54"	29'-5"	6'-8 1/2"	20'-8"	23'-10 1/4"	863	10.7	7'-6"	226	3.6
60"	32'-3 3/4"	7'-3 1/2"	22'-8"	26'-2"	984	12.7	8'-3"	264	4.3	
66"	35'-2 1/2"	7'-10 1/2"	24'-8"	28'-5 3/4"	1126	14.9	8'-9"	300	4.9	
72"	38'-1 1/4"	8'-5 1/2"	26'-8"	30'-9 1/2"	1283	17.3	9'-4"	334	5.6	
6:1	12"	11'-2"	2'-6"	8'-6"	9'-9 3/4"	220	1.9	1'-9"	28	0.4
	15"	13'-2 1/4"	2'-9 1/2"	10'-0"	11'-6 1/2"	264	2.5	2'-2"	37	0.5
	18"	15'-2 1/2"	3'-1"	11'-6"	13'-3 1/4"	326	3.2	2'-8"	50	0.7
	21"	17'-2 3/4"	3'-4 1/2"	13'-0"	15'-0 1/4"	381	3.9	3'-1"	69	0.9
	24"	19'-4 1/2"	3'-9 1/2"	14'-6"	16'-9"	447	4.8	3'-7"	80	1.2
	27"	21'-4 3/4"	4'-1"	16'-0"	18'-5 3/4"	506	5.7	3'-11"	96	1.4
	30"	23'-5 1/4"	4'-4 1/2"	17'-6"	20'-2 1/2"	587	6.7	4'-4"	110	1.7
	33"	25'-5 1/2"	4'-8"	19'-0"	21'-11 1/4"	667	7.8	4'-8"	127	2.0
	36"	27'-5 3/4"	4'-11 1/2"	20'-6"	23'-8"	727	9.0	5'-1"	144	2.3
	42"	31'-6 1/4"	5'-6 1/2"	23'-6"	27'-1 1/2"	914	11.5	5'-10"	179	3.0
	48"	37'-3 1/2"	6'-1 1/2"	28'-0"	32'-4"	1181	15.9	6'-7"	231	4.0
	54"	41'-4 1/4"	6'-8 1/2"	31'-0"	35'-9 1/2"	1412	19.2	7'-6"	300	5.0
60"	45'-4 3/4"	7'-3 1/2"	34'-0"	39'-3"	1619	22.9	8'-3"	353	6.0	

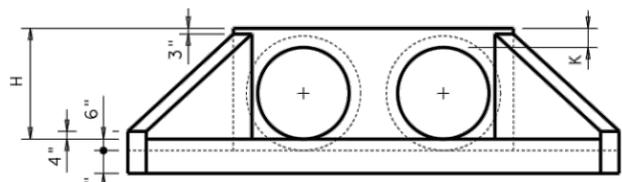


**ELEVATION**  
Showing dimensions


- Quantities shown are for concrete pipe and will increase slightly for metal pipe installations.
- For vehicle safety, curbs shall project no more than 3" above finished grade. Curb heights shall be reduced, if necessary, to meet these requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- Provide a 1'-0" footing as shown where required to maintain 4" Min cover for pipes.
- Quantities shown are for one structure end only (one headwall).
- Min Length =  $6" + 3" \times \left( \frac{12 \times H - 7}{12 \times L} \right)$   
Max Length =  $12 \times H - 3" \times \left( \frac{12 \times H - 7}{12 \times L} \right) - 1"$
- Lengths of wings based on SL:1 Slope along this line.

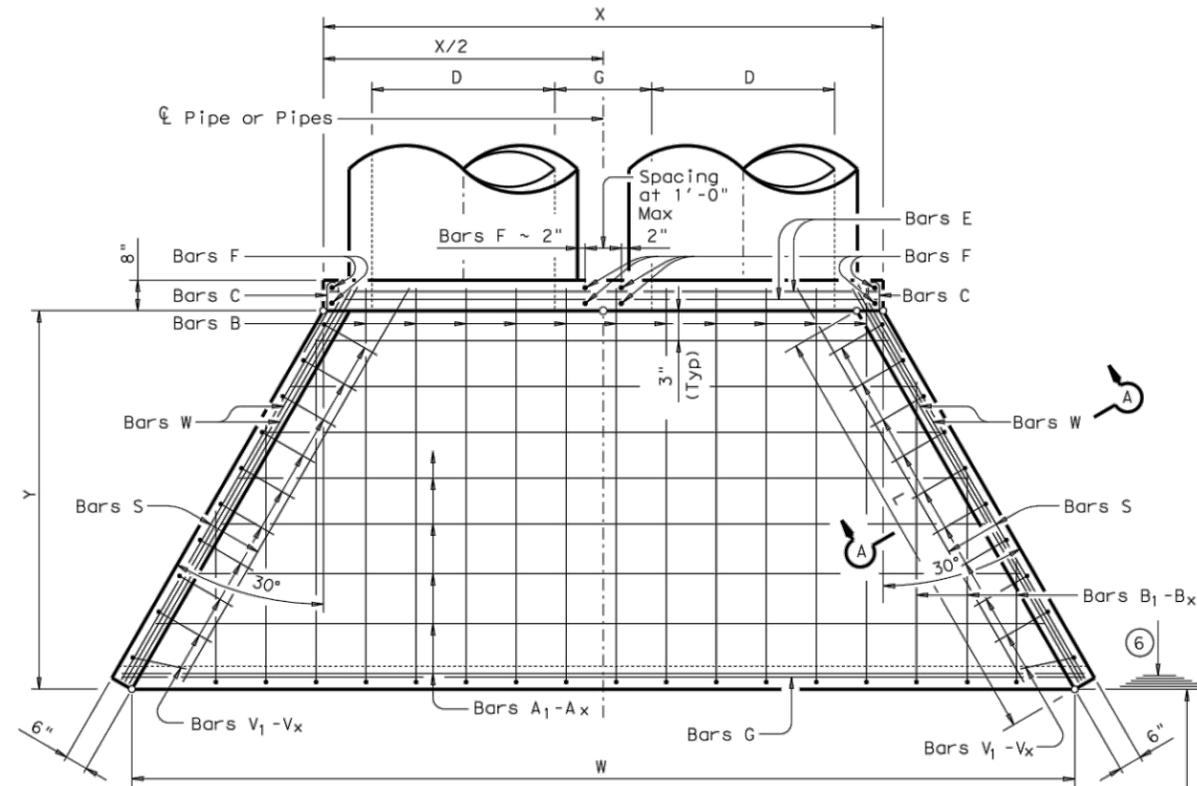

**PLAN**

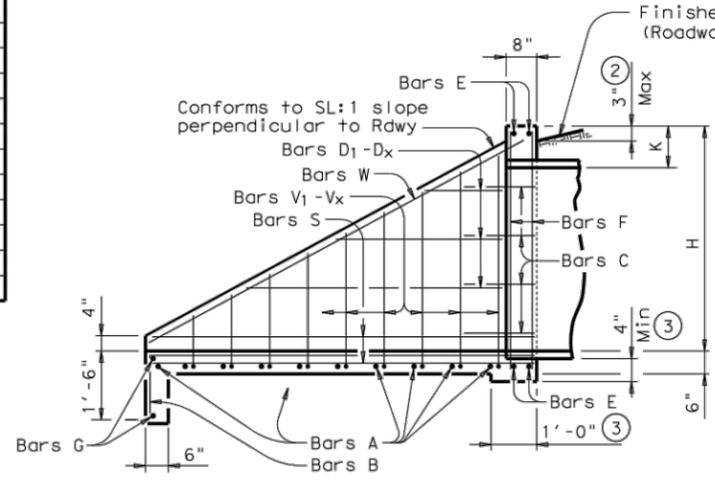

**TYPICAL WING ELEVATION**

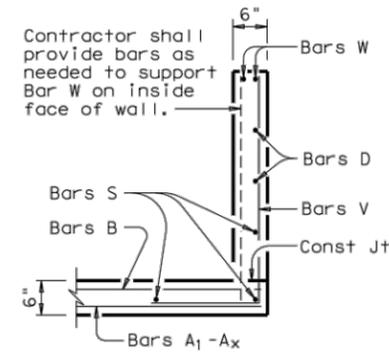



**SECTION A-A**

**TABLE OF REINFORCING STEEL** ④

Bar	Size	Spa	No.
A	# 4	1'-0"	~
B	# 3	1'-6"	~
C	# 4	1'-0"	~
D	# 3	1'-0"	~
E	# 5	~	4
F	# 5	~	~
G	# 3	~	2
S	# 4	~	6
V	# 4	1'-0"	~
W	# 5	~	4

**TABLE OF CONSTANT DIMENSIONS**

DIA OF PIPE, D	G	K	H
12"	9"	1'-0"	2'-0"
15"	11"	1'-0"	2'-3"
18"	1'-2"	1'-0"	2'-6"
21"	1'-4"	1'-0"	2'-9"
24"	1'-7"	1'-0"	3'-0"
27"	1'-8"	1'-0"	3'-3"
30"	1'-10"	1'-0"	3'-6"
33"	1'-11"	1'-0"	3'-9"
36"	2'-1"	1'-0"	4'-0"
42"	2'-4"	1'-0"	4'-6"
48"	2'-7"	1'-3"	5'-3"
54"	3'-0"	1'-3"	5'-9"
60"	3'-3"	1'-3"	6'-3"
66"	3'-3"	1'-3"	6'-9"
72"	3'-4"	1'-3"	7'-3"

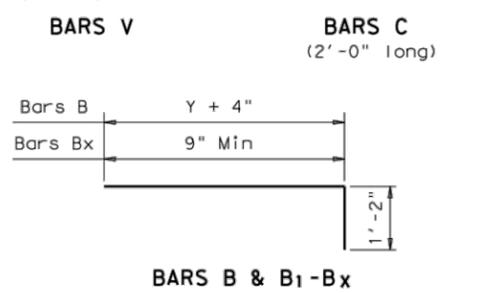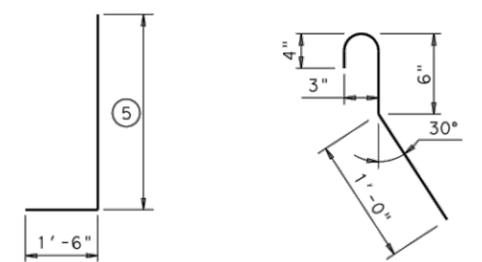

**GENERAL NOTES:**  
 Designed according to AASHTO LRFD Specifications.  
 Reinforcing steel shall be placed with the center of the outside layer of bars 2" from the surface of the concrete.  
 All reinforcing steel shall be Grade 60.  
 All concrete shall be Class "C" and shall have a minimum compressive strength of 3600 psi.  
 No bridge rails of any type may be mounted directly to these culvert headwalls.

**Texas Department of Transportation**  
 Bridge Division Standard


**CONCRETE HEADWALLS WITH FLARED WINGS FOR 0° SKEW PIPE CULVERTS**

**CH-FW-0**


FILE: chfw00se.dgn    DN: TxDOT    CK: TxDOT    DW: TxDOT    CK: GAF  
 ©TxDOT February 2010    CONF    SECT    JOB    HIGHWAY  
 REVISIONS    DIST    COUNTY    SHEET NO.  
 55

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.  
 DATE:    FILE:


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

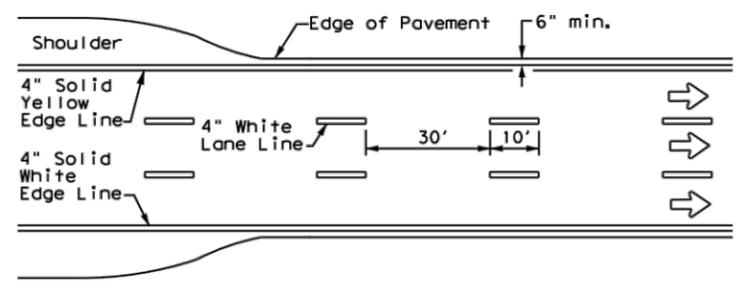


**EDGE LINE AND LANE LINES  
ONE-WAY ROADWAY  
WITH OR WITHOUT SHOULDERS**

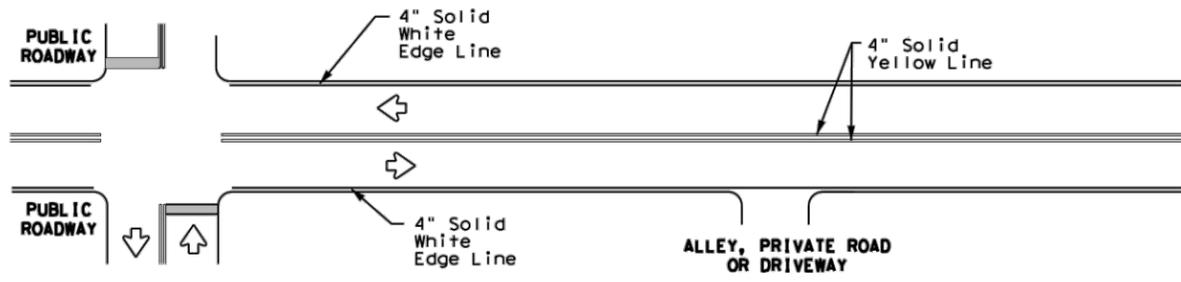


**TYPICAL TWO-LANE, TWO-WAY PAVEMENT  
MARKINGS THROUGH INTERSECTIONS**

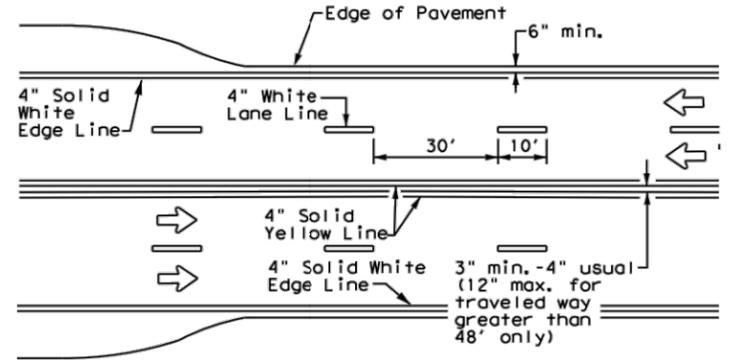


**CENTERLINE AND LANE LINES  
FOUR LANE TWO-WAY ROADWAY  
WITH OR WITHOUT SHOULDERS**

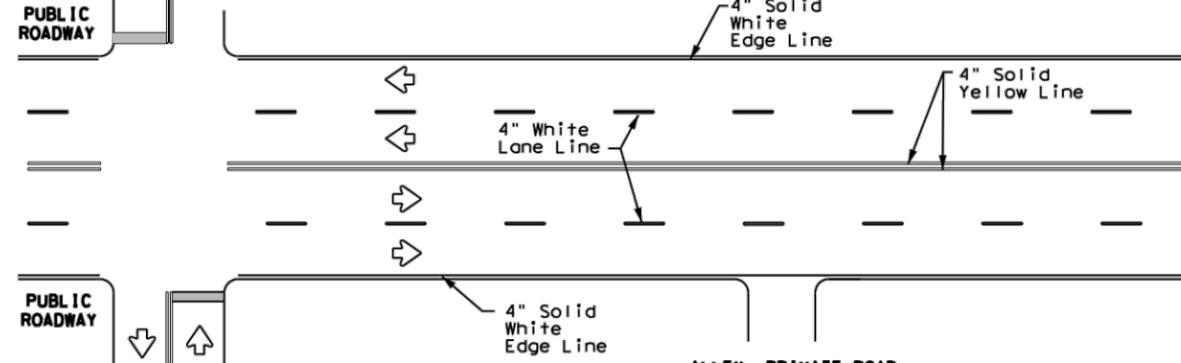

**TYPICAL MULTI-LANE, TWO-WAY PAVEMENT  
MARKINGS THROUGH INTERSECTIONS**

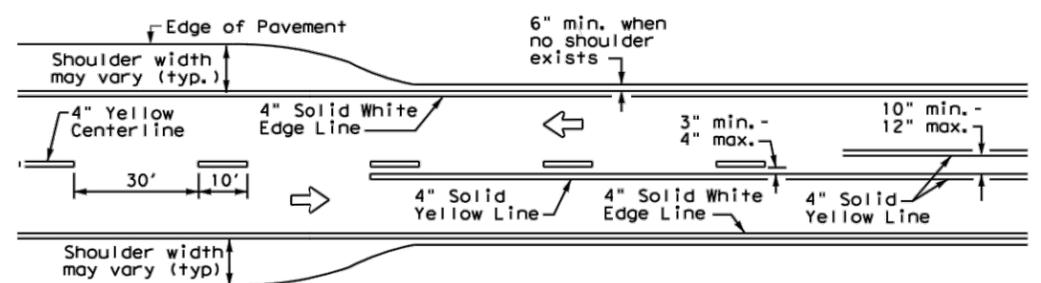

**TWO LANE TWO-WAY ROADWAY  
WITH OR WITHOUT SHOULDERS**

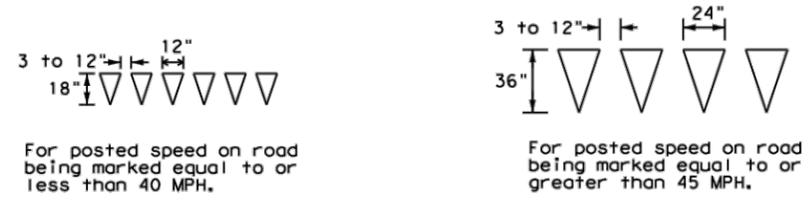


**YIELD LINES**

**GENERAL NOTES**

1. Edgeline striping shall be as shown in the plans or as directed by the Engineer. The edgeline should not be placed less than 6 inches from the edge of pavement. This distance may vary due to pavement raveling or other conditions. Edgelines are not required in curb and gutter sections of roadways.
2. The traveled way includes only that portion of the roadway used for vehicular travel. It does not include the parking lanes, sidewalks, berms and shoulders. The traveled ways shall be measured from the inside of edgeline to the inside of edgeline of a two lane roadway.


MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

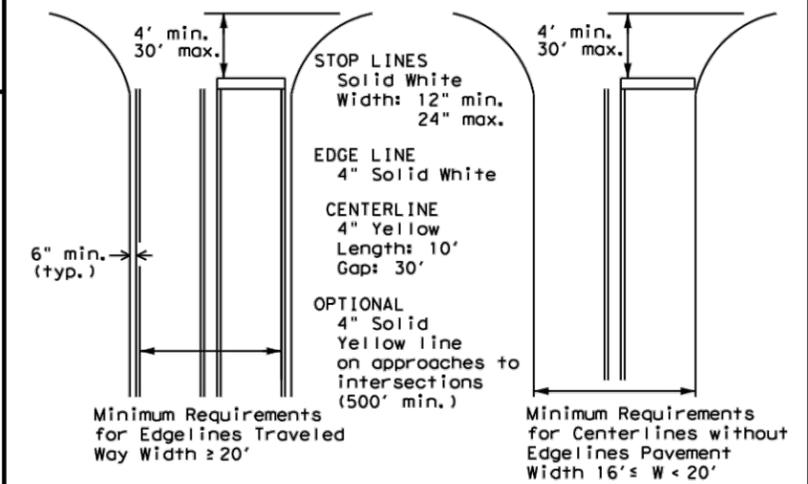

**GUIDE FOR PLACEMENT OF STOP LINES,  
EDGE LINE & CENTERLINE**


Based on Traveled Way and Pavement Widths for Undivided Highways

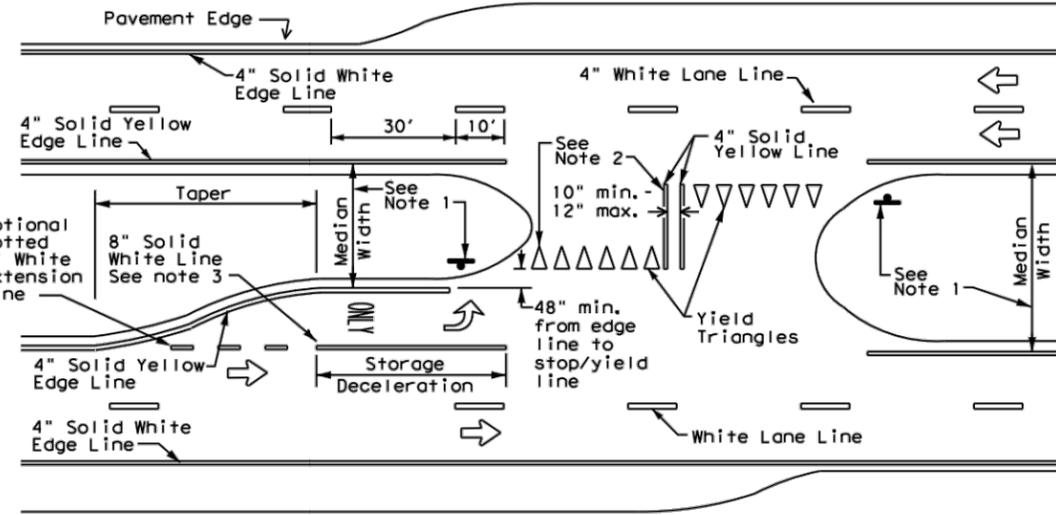

**FOUR LANE DIVIDED ROADWAY CROSSOVERS**

**NOTES**

1. Where divided highways are separated by median widths at the median opening itself of 30 feet or more, median openings shall be signed as two separate intersections. Each median opening has two width measurements, with one measurement for each approach. The narrow median width will be the controlling width to determine if signs are required. Yield signs are the typical intersection control. Stop signs are optional as determined by the Engineer.
2. Install median striping (double yellow centerlines and stop bars/yield triangles) when a 50' or greater median centerline can be placed. Stop bars shall only be used with stop signs. Yield triangles shall only be used with yield signs.
3. Length of turn bays, including taper, deceleration, and storage lengths shall be as shown on the plans or as directed by the Engineer.



**TYPICAL STANDARD  
PAVEMENT MARKINGS**


**PM(1)-20**

FILE: pml-20.dgn	DN:	CK:	DW:	CK:
© TxDOT November 1978	CONT	SECT	JOB	HIGHWAY
8-95 3-03	REVISIONS			
5-00 2-12	DIST	COUNTY	SHEET NO.	
8-00 6-20			56	

DATE: FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

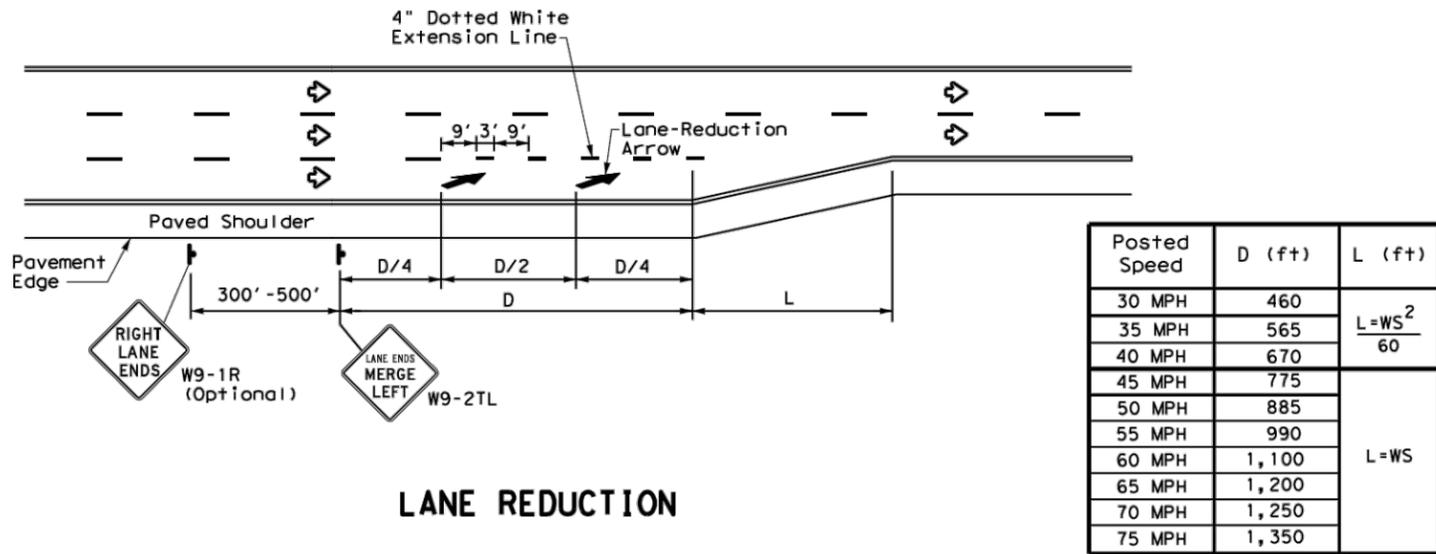

Posted Speed	D (ft)	L (ft)
30 MPH	460	$L = \frac{WS^2}{60}$
35 MPH	565	
40 MPH	670	L=WS
45 MPH	775	
50 MPH	885	
55 MPH	990	
60 MPH	1,100	
65 MPH	1,200	
70 MPH	1,250	
75 MPH	1,350	


**LANE REDUCTION**

**NOTES**

- Lane reduction pavement markings are used where the number of through lanes is reduced because of narrowing of the roadway or because of a section of on-street parking in what would otherwise be a through lane. For Texas Super 2 Passing Lanes, see TS2(PL) standard sheets.
- On divided highways, an additional W9-1R "RIGHT LANE ENDS" sign may be installed in the median aligned with the W9-1R sign on the right side of the highway.
- Lane reduction arrows are required for speeds of 45 mph or greater. An optional third lane reduction arrow may be added based on engineering judgement. If used, the optional third lane reduction arrow should be centered between the first and last lane reduction arrows.
- For lane reductions on Freeways and Expressways, signing shall conform to the TxDOT Freeway Signing Handbook.

**GENERAL NOTES**


- Lane use word and arrow markings shall be used where through lanes approaching an intersection become mandatory turn lanes. Lane use word and arrow markings should be used in auxiliary lanes of substantial length. Lane use arrow markings or word and arrow markings may be used in other lanes and turn bays for emphasis. Details for words and arrows are as shown in the Standard Highway Sign Designs for Texas.
- When lane-use words and arrow markings are used, two sets of arrows should be used if the length of the bay is greater than 180 feet. When a single lane use arrow or word and arrow marking is used for a short turn lane, it should be located at or near the upstream end of the full-width turn lane.
- Use raised pavement marker Type I-C with undivided highways, flush medians and two way left turn lanes. Use raised pavement marker Type II-C-R with divided highways and raised medians.
- Length of turn bays, including taper, deceleration, and storage lengths shall be as shown on the plans or as directed by the Engineer.

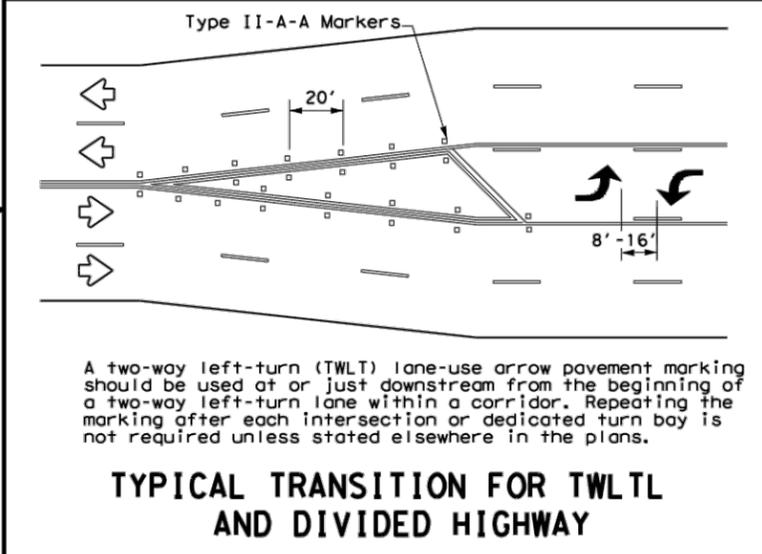


**TYPICAL TRANSITION FOR TWLTL AND DIVIDED HIGHWAY**

MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240


All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

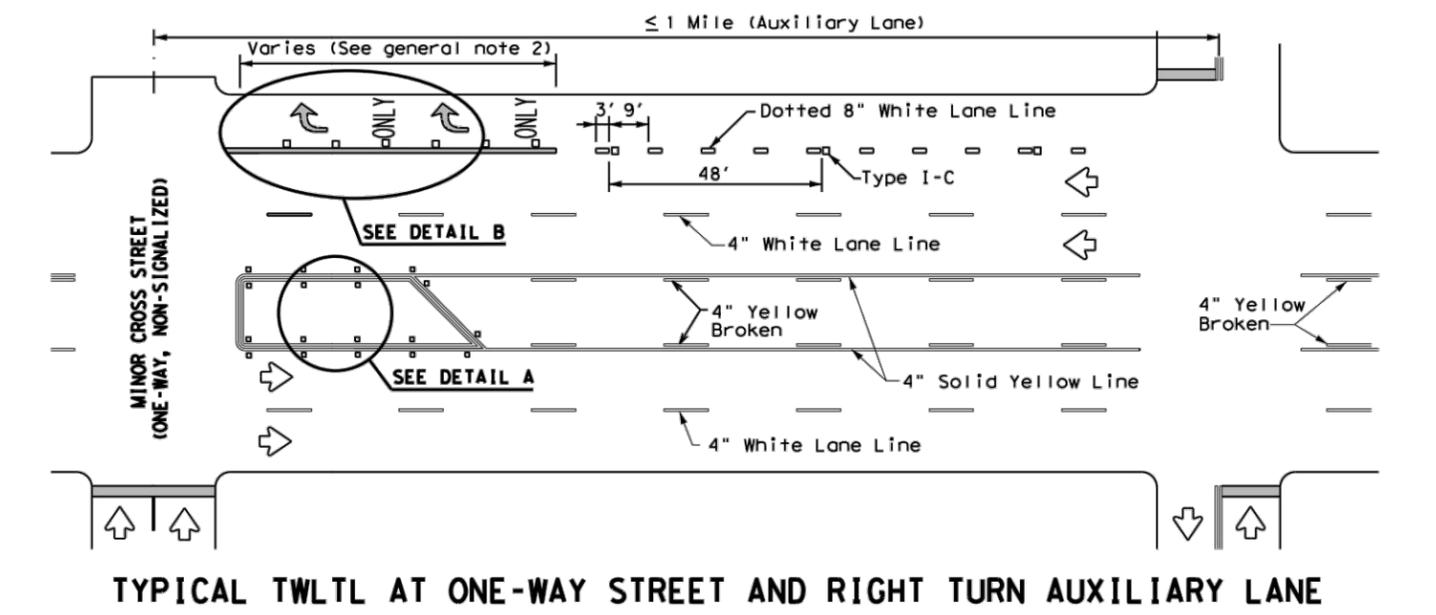


**TYPICAL TWLTL AT ONE-WAY STREET AND RIGHT TURN AUXILIARY LANE**

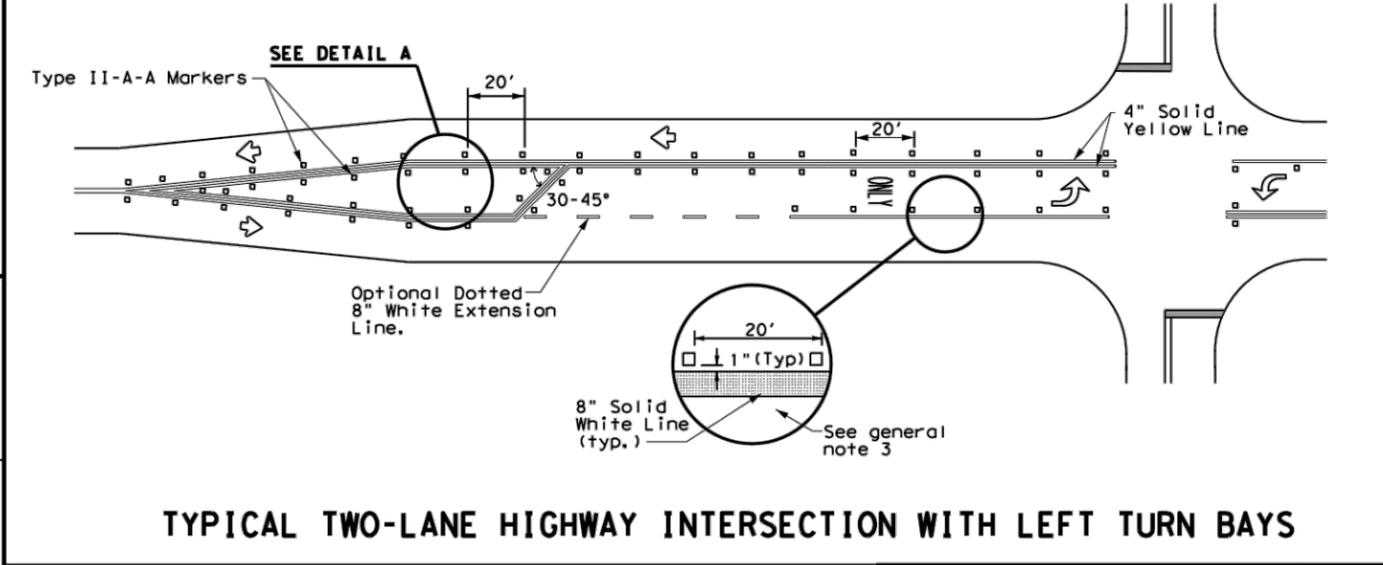

**TYPICAL TWO-LANE HIGHWAY INTERSECTION WITH LEFT TURN BAYS**

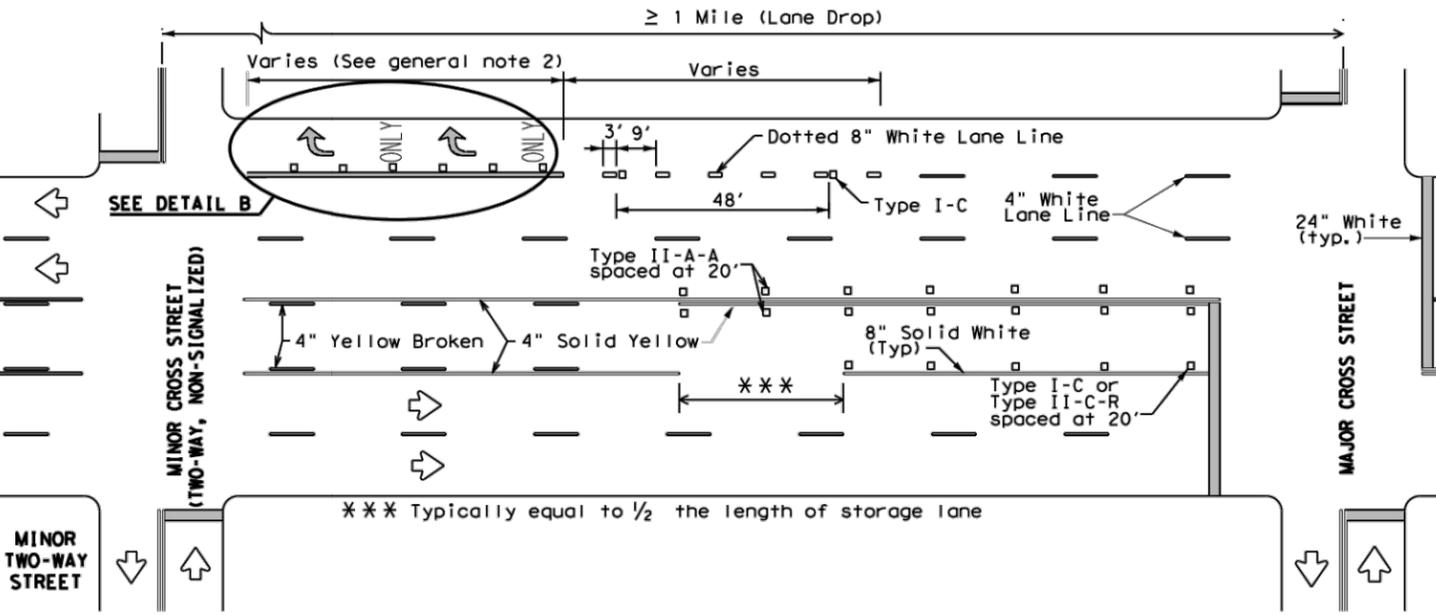

**TYPICAL TWLTL AT TWO-WAY CROSS STREET AND RIGHT TURN LANE DROP**

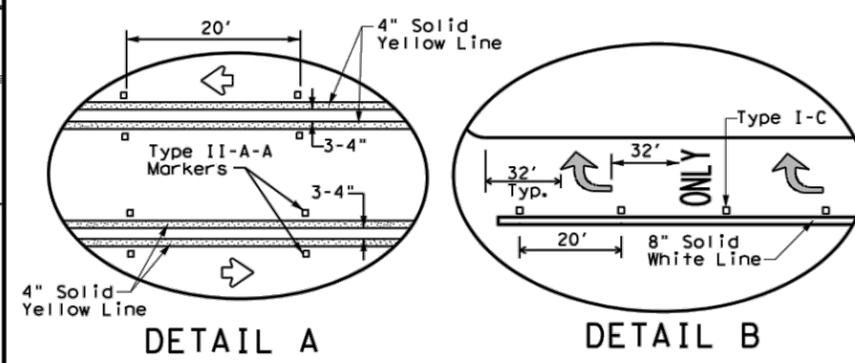

**DETAIL A**

**DETAIL B**


Texas Department of Transportation  
Traffic Safety Division Standard

**TWO-WAY LEFT TURN LANES, RURAL LEFT TURN BAYS, AND LANE REDUCTION PAVEMENT MARKINGS PM(3)-20**

FILE: pm3-20.dgn	DN:	CK:	DW:	CK:
© TxDOT April 1998	CONT	SECT	JOB	HIGHWAY
5-00 2-10	REVISIONS			
8-00 2-12	DIST	COUNTY	SHEET NO.	
3-03 6-20			57	


22C

DISCLAIMER: This standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. The use of this standard for the conversion of this standard to other formats or for incorrect results or damages resulting from its use. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

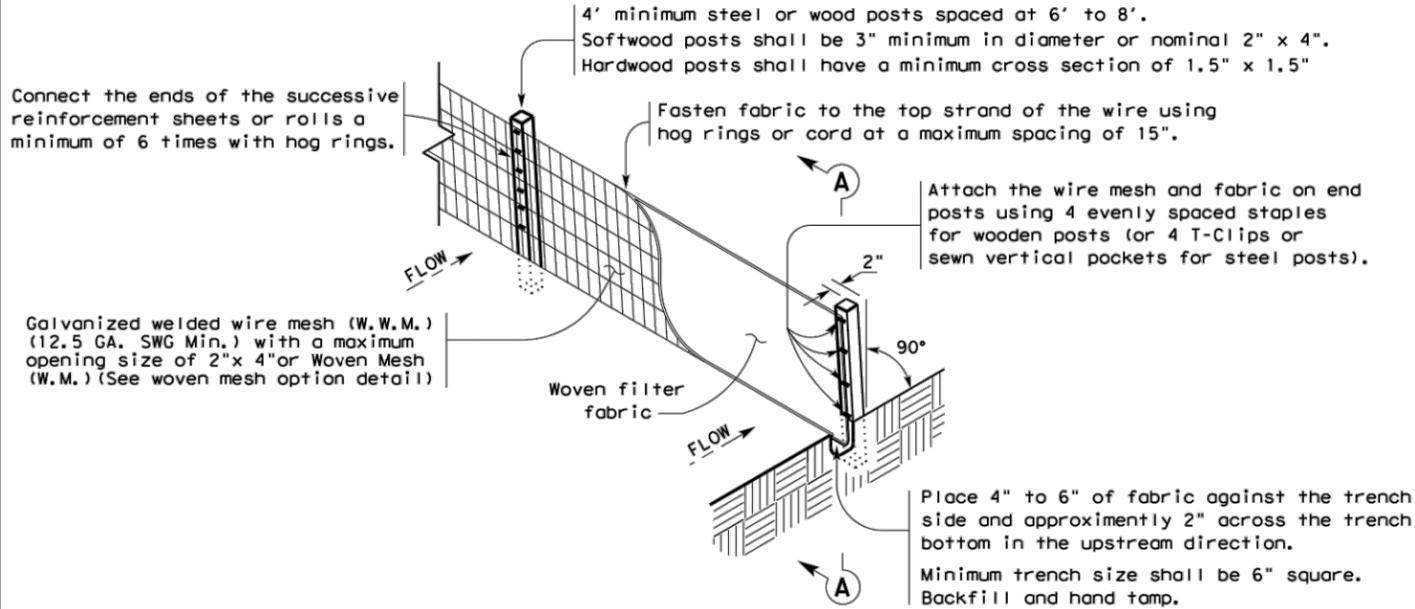

**TEMPORARY SEDIMENT CONTROL FENCE**

SCF

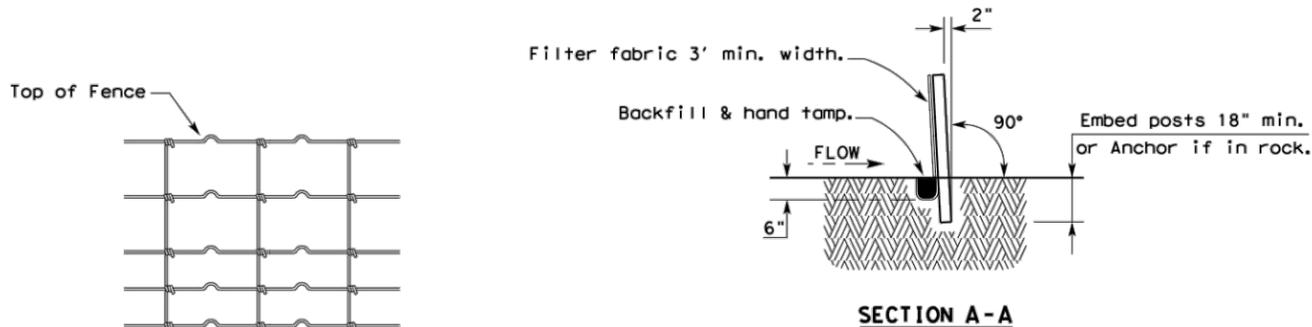

**HINGE JOINT KNOT WOVEN MESH (OPTION) DETAIL**

Galvanized hinge joint knot woven mesh (12.5 GA. SWG Min.) requires a minimum of five horizontal wires spaced at a maximum of 12 inches apart and all vertical wires spaced at a maximum of 12 inches apart.

**SEDIMENT CONTROL FENCE USAGE GUIDELINES**

A sediment control fence may be constructed near the downstream perimeter of a disturbed area along a contour to intercept sediment from overland runoff. A 2 year storm frequency may be used to calculate the flow rate to be filtered.


Sediment control fence should be sized to filter a maximum flow through rate of 100 GPM/FT<sup>2</sup>. Sediment control fence is not recommended to control erosion from a drainage area larger than 2 acres.

**LEGEND**

Sediment Control Fence  
SCF

**GENERAL NOTES**

1. Vertical tracking is required on projects where soil distributing activities have occurred unless otherwise approved.
2. Perform vertical tracking on slopes to temporarily stabilize soil.
3. Provide equipment with a track undercarriage capable of producing linear soil impressions measuring a minimum of 12" in length by 2" to 4" in width by 1/2" to 2" in depth.
4. Do not exceed 12" between track impressions.
5. Install continuous linear track impressions where the minimum 12" length impressions are perpendicular to the slope or direction of water flow.

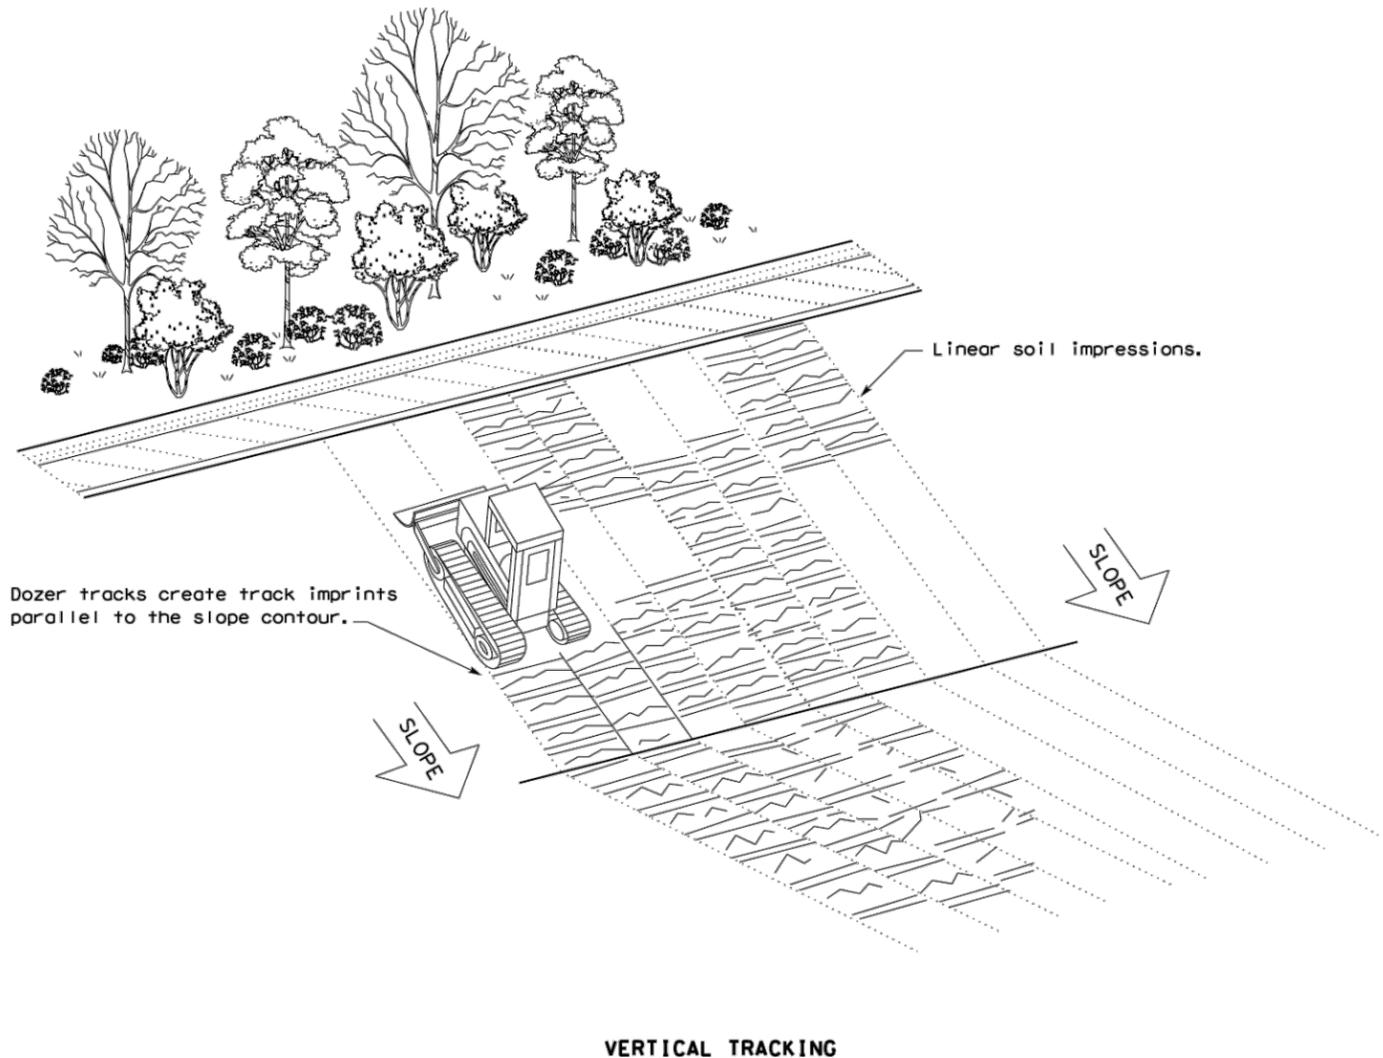


Texas Department of Transportation  
Design Division Standard

**TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES FENCE & VERTICAL TRACKING**  
EC(1)-16


FILE: ec116	DN: TxDOT	CK: KM	DW: VP	DN/CK: LS
© TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY
REVISIONS				
DIST	COUNTY			SHEET NO.
				58

DISCLAIMER: This standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. The use of this standard is the responsibility of the user. TxDOT assumes no responsibility for the conversion to other formats or for incorrect results or damages resulting from its use.

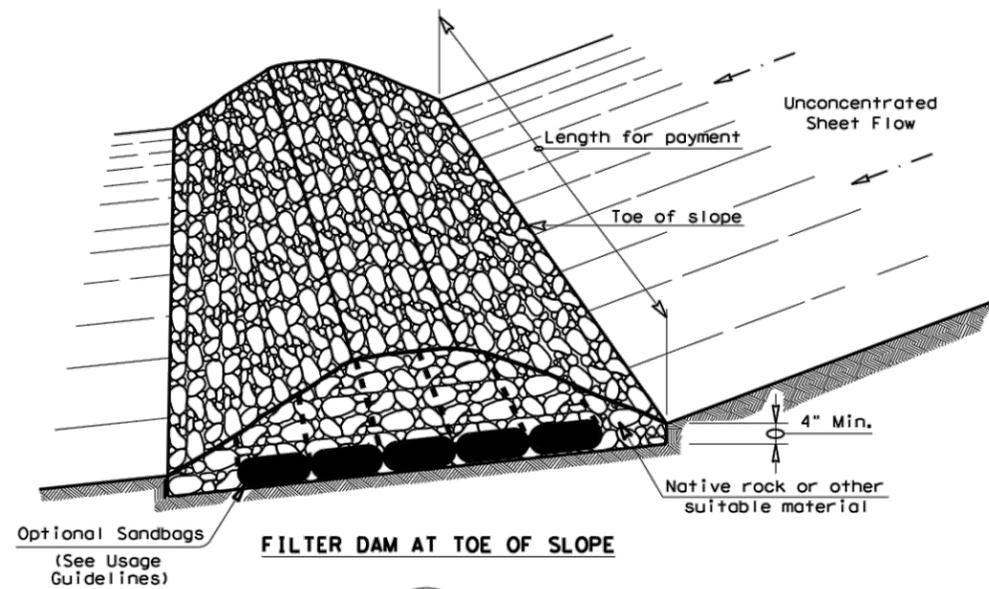


**FILTER DAM AT TOE OF SLOPE**

(RFD1)

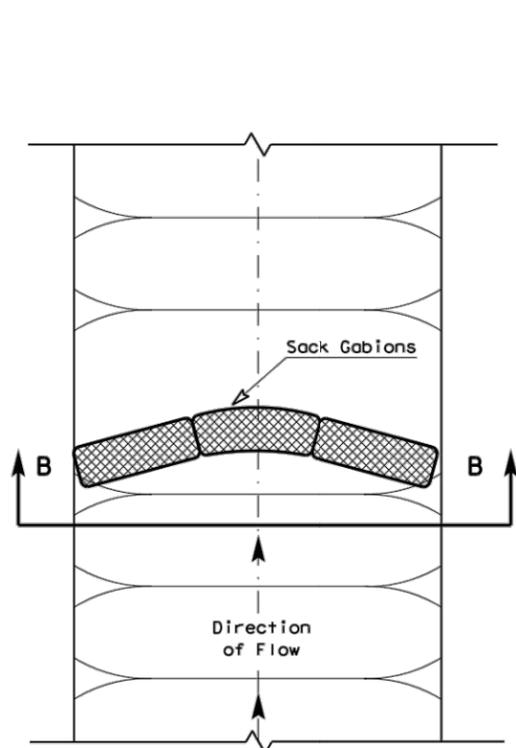


**PLAN VIEW**

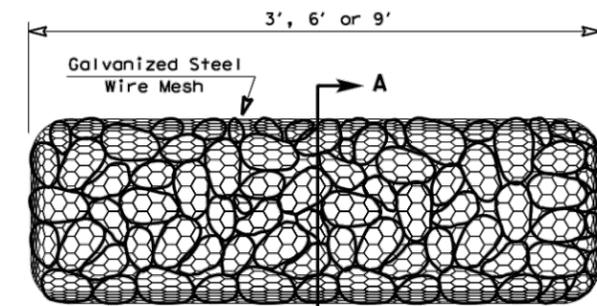


**TYPE 4 (SACK GABIONS)**


(RFD4)

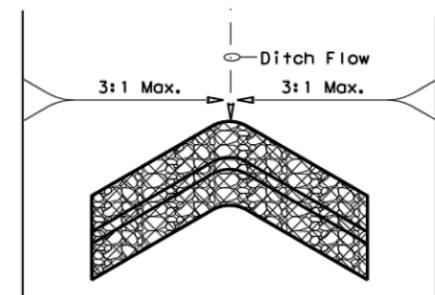


**"V" SHAPE PLAN VIEW**

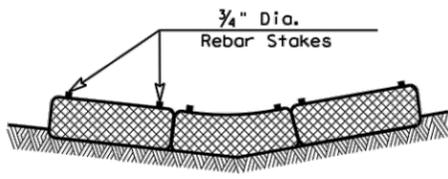

**SECTION B-B**

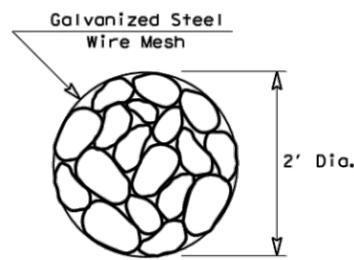


**SECTION A-A**

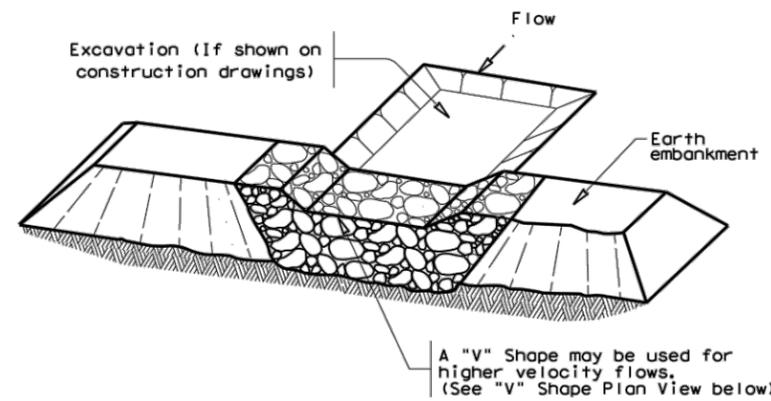


**FILTER DAM AT SEDIMENT TRAP**

(RFD1) OR (RFD2)

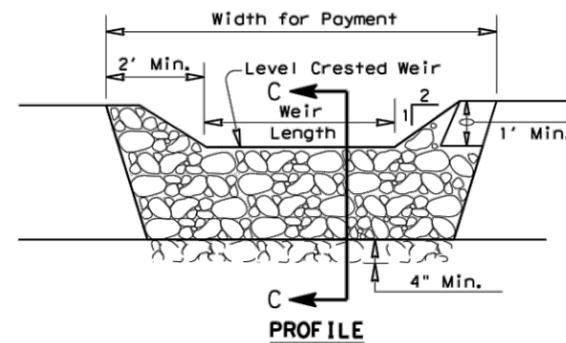

**PROFILE**

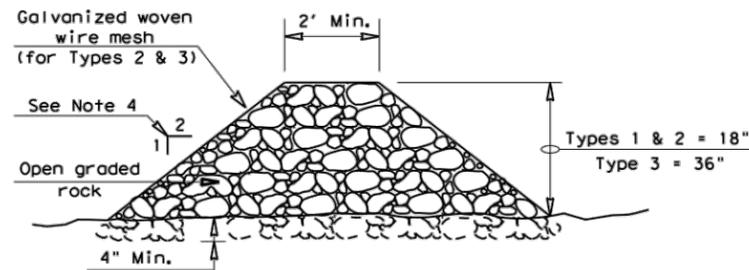

**SECTION C-C**

**ROCK FILTER DAM USAGE GUIDELINES**

Rock Filter Dams should be constructed downstream from disturbed areas to intercept sediment from overland runoff and/or concentrated flow. The dams should be sized to filter a maximum flow through rate of 60 GPM/FT<sup>2</sup> of cross sectional area. A 2 year storm frequency may be used to calculate the flow rate.


**Type 1 (18" high with no wire mesh) (3" to 6" aggregate):** Type 1 may be used at the toe of slopes, around inlets, in small ditches, and at dike or swale outlets. This type of dam is recommended to control erosion from a drainage area of 5 acres or less. Type 1 may not be used in concentrated high velocity flows (approximately 8 Ft/Sec or more) in which aggregate wash out may occur. Sandbags may be used at the embedded foundation (4" deep min.) for better filtering efficiency of low flows if called for on the plans or directed by the Engineer.

**Type 2 (18" high with wire mesh) (3" to 6" aggregate):** Type 2 may be used in ditches and at dike or swale outlets.

**Type 3 (36" high with wire mesh) (4" to 8" aggregate):** Type 3 may be used in stream flow and should be secured to the stream bed.

**Type 4 (Sack gabions) (3" to 6" aggregate):** Type 4 May be used in ditches and smaller channels to form an erosion control dam.

**Type 5:** Provide rock filter dams as shown on plans.

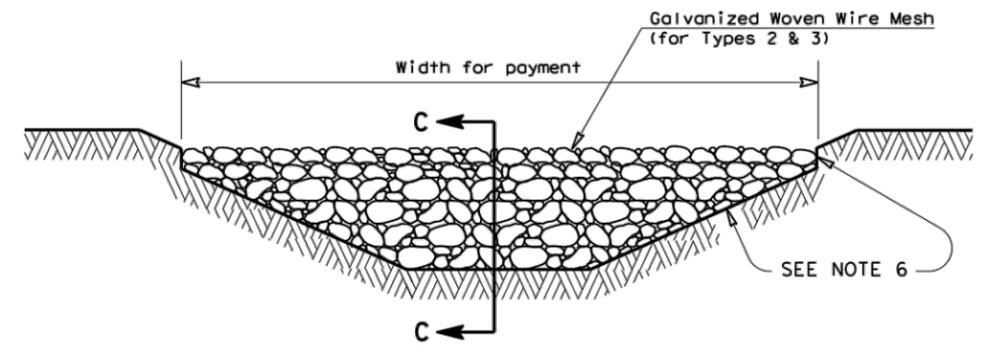

**FILTER DAM AT CHANNEL SECTIONS**


(RFD1) OR (RFD2) OR (RFD3)

**GENERAL NOTES**

1. If shown on the plans or directed by the Engineer, filter dams should be placed near the toe of slopes where erosion is anticipated, upstream and/or downstream at drainage structures, and in roadway ditches and channels to collect sediment.
2. Materials (aggregate, wire mesh, sandbags, etc.) shall be as indicated by the specification for "Rock Filter Dams for Erosion and Sedimentation Control".
3. The rock filter dam dimensions shall be as indicated on the SW3P plans.
4. Side slopes should be 2:1 or flatter. Dams within the safety zone shall have sideslopes of 6:1 or flatter.
5. Maintain a minimum of 1' between top of rock filter dam weir and top of embankment for filter dams at sediment traps.
6. Filter dams should be embedded a minimum of 4" into existing ground.
7. The sediment trap for ponding of sediment laden runoff shall be of the dimensions shown on the plans.
8. Rock filter dam types 2 & 3 shall be secured with 20 gauge galvanized woven wire mesh with 1" diameter hexagonal openings. The aggregate shall be placed on the mesh to the height & slopes specified. The mesh shall be folded at the upstream side over the aggregate and tightly secured to itself on the downstream side using wire ties or hog rings. For in stream use, the mesh should be secured or staked to the stream bed prior to aggregate placement.
9. Sack Gabions should be staked down with 3/4" dia. rebar stakes, and have a double-twisted hexagonal weave with a nominal mesh opening of 2 1/2" x 3 1/4".
10. Flow outlet should be onto a stabilized area (vegetation, rock, etc.).
11. The guidelines shown hereon are suggestions only and may be modified by the Engineer.

**PLAN SHEET LEGEND**

- Type 1 Rock Filter Dam (RFD1)
- Type 2 Rock Filter Dam (RFD2)
- Type 3 Rock Filter Dam (RFD3)
- Type 4 Rock Filter Dam (RFD4)



**TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES  
ROCK FILTER DAMS  
EC(2)-16**

FILE: ec216	DN: TxDOT	CK: KM	DW: VP	DN/CK: LS
© TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY
REVISIONS				
	DIST	COUNTY	SHEET NO.	
			59	

DATE: FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

**BARRICADE AND CONSTRUCTION (BC) STANDARD SHEETS GENERAL NOTES:**

1. The Barricade and Construction Standard Sheets (BC sheets) are intended to show typical examples for placement of temporary traffic control devices, construction pavement markings, and typical work zone signs. The information contained in these sheets meet or exceed the requirements shown in the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
2. The development and design of the Traffic Control Plan (TCP) is the responsibility of the Engineer.
3. The Contractor may propose changes to the TCP that are signed and sealed by a licensed professional engineer for approval. The Engineer may develop, sign and seal Contractor proposed changes.
4. The Contractor is responsible for installing and maintaining the traffic control devices as shown in the plans. The Contractor may not move or change the approximate location of any device without the approval of the Engineer.
5. Geometric design of lane shifts and detours should, when possible, meet the applicable design criteria contained in manuals such as the American Association of State Highway and Transportation Officials (AASHTO), "A Policy on Geometric Design of Highways and Streets," the TxDOT "Roadway Design Manual" or engineering judgment.
6. When projects abut, the Engineer(s) may omit the END ROAD WORK, TRAFFIC FINES DOUBLE, and other advance warning signs if the signing would be redundant and the work areas appear continuous to the motorists. If the adjacent project is completed first, the Contractor shall erect the necessary warning signs as shown on these sheets, the TCP sheets or as directed by the Engineer. The BEGIN ROAD WORK NEXT X MILES sign shall be revised to show appropriate work zone distance.
7. The Engineer may require duplicate warning signs on the median side of divided highways where median width will permit and traffic volumes justify the signing.
8. All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.
9. The temporary traffic control devices shown in the illustrations of the BC sheets are examples. As necessary, the Engineer will determine the most appropriate traffic control devices to be used.
10. Where highway construction or maintenance work is being undertaken, other than mobile operations as defined by the Texas Manual on Uniform Traffic Control Devices, CSJ limit signs are required. CSJ limit signs are shown on BC(2). The OBEY WARNING SIGNS STATE LAW sign, STAY ALERT TALK OR TEXT LATER and the WORK ZONE TRAFFIC FINES DOUBLE sign with plaque shall be erected in advance of the CSJ limits. The BEGIN ROAD WORK NEXT X MILES, CONTRACTOR and END ROAD WORK signs shall be erected at or near the CSJ limits. For mobile operations, CSJ limit signs are not required.
11. Traffic control devices should be in place only while work is actually in progress or a definite need exists.
12. The Engineer has the final decision on the location of all traffic control devices.
13. Inactive equipment and work vehicles, including workers' private vehicles must be parked away from travel lanes. They should be as close to the right-of-way line as possible, or located behind a barrier or guardrail, or as approved by the Engineer.

DATE:  
FILE:

**WORKER SAFETY NOTES:**

1. Workers on foot who are exposed to traffic or to construction equipment within the right-of-way shall wear high-visibility safety apparel meeting the requirements of ISEA "American National Standard for High-Visibility Apparel," or equivalent revisions, and labeled as ANSI 107-2004 standard performance for Class 2 or 3 risk exposure. Class 3 garments should be considered for high traffic volume work areas or night time work.
2. Except in emergency situations, flagger stations shall be illuminated when flagging is used at night.

**COMPLIANT WORKZONE TRAFFIC CONTROL DEVICES**

1. Only pre-qualified products shall be used. The "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-qualified products and their sources.
2. Work zone traffic control devices shall be compliant with the Manual for Assessing safety Hardware (MASH).

<p><b>THE DOCUMENTS BELOW CAN BE FOUND ON-LINE AT</b>  <a href="http://www.txdot.gov">http://www.txdot.gov</a></p>
COMPLIANT WORK ZONE TRAFFIC CONTROL DEVICES LIST (CWZTCD)
DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS)
MATERIAL PRODUCER LIST (MPL)
ROADWAY DESIGN MANUAL - SEE "MANUALS (ONLINE MANUALS)"
STANDARD HIGHWAY SIGN DESIGNS FOR TEXAS (SHSD)
TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (TMUTCD)
TRAFFIC ENGINEERING STANDARD SHEETS

SHEET 1 OF 12




**BARRICADE AND CONSTRUCTION  
GENERAL NOTES  
AND REQUIREMENTS**

**BC(1)-21**

FILE: bc-21.dgn	DW: TxDOT	CR: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS				
4-03 7-13	DIST		COUNTY	SHEET NO.
9-07 8-14				60
5-10 5-21				


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for damages resulting from its use.

**TYPICAL LOCATION OF CROSSROAD SIGNS**

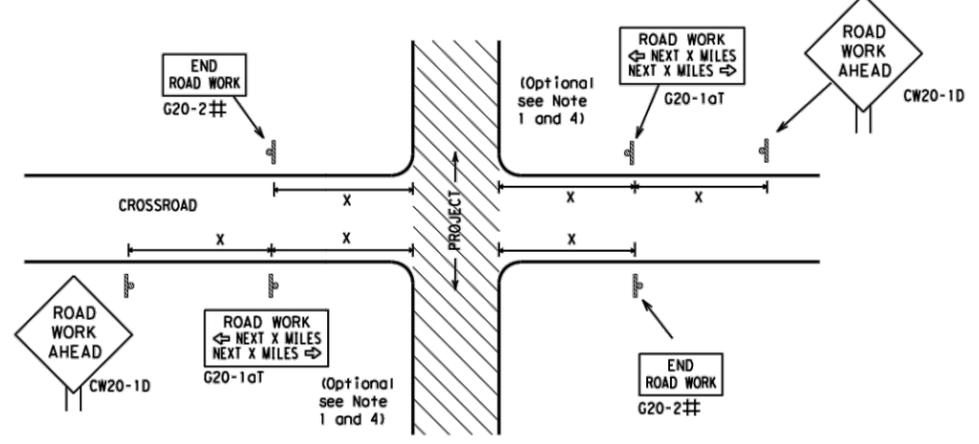

- ## May be mounted on back of "ROAD WORK AHEAD" (CW20-1D) sign with approval of Engineer. (See note 2 below)
- The typical minimum signing on a crossroad approach should be a "ROAD WORK AHEAD" (CW20-1D) sign and a (G20-2) "END ROAD WORK" sign, unless noted otherwise in plans.
  - The Engineer may use the reduced size 36" x 36" ROAD WORK AHEAD (CW20-1D) sign mounted back to back with the reduced size 36" x 18" "ROAD WORK NEXT X MILES" (G20-2) sign on low volume crossroads (see Note 4 under "Typical Construction Warning Sign Size and Spacing"). See the "Standard Highway Sign Designs for Texas" manual for sign details. The Engineer may omit the advance warning signs on low volume crossroads. The Engineer will determine whether a road is low volume as per TMUTCD Part 5. This information shall be shown in the plans.
  - Based on existing field conditions, the Engineer/Inspector may require additional signs such as FLAGGER AHEAD, LOOSE GRAVEL, or other appropriate signs. When additional signs are required, these signs will be considered part of the minimum requirements. The Engineer/Inspector will determine the proper location and spacing of any sign not shown on the BC sheets, Traffic Control Plan sheets or the Work Zone Standard Sheets.
  - The "ROAD WORK NEXT X MILES" (G20-1aT) sign shall be required at high volume crossroads to advise motorists of the length of construction in either direction from the intersection. The Engineer will determine whether a roadway is considered high volume.
  - Additional traffic control devices may be shown elsewhere in the plans for higher volume crossroads.
  - When work occurs in the intersection area, appropriate traffic control devices, as shown elsewhere in the plans or as determined by the Engineer/Inspector, shall be in place.

**T-INTERSECTION**

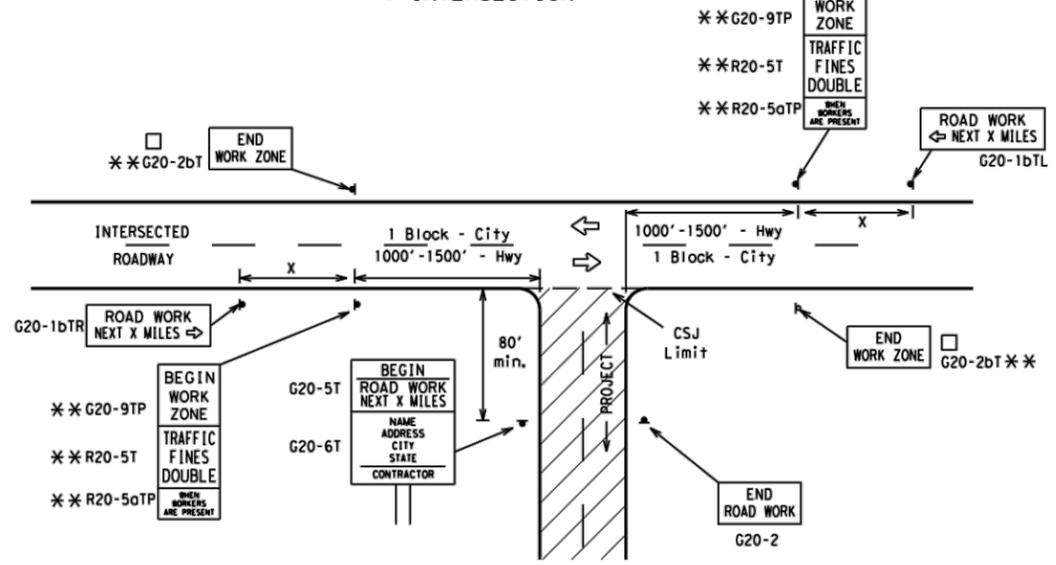

**CSJ LIMITS AT T-INTERSECTION**

- The Engineer will determine the types and location of any additional traffic control devices, such as a flagger and accompanying signs, or other signs, that should be used when work is being performed at or near an intersection.
- If construction closes the road at a T-intersection, the Contractor shall place the "CONTRACTOR NAME" (G20-6T) sign behind the Type 3 Barricades for the road closure (see BC(10) also). The "ROAD WORK NEXT X MILES" left arrow (G20-1bTL) and "ROAD WORK NEXT X MILES" right arrow (G20-1bTR) signs shall be replaced by the detour signing called for in the plans.

**TYPICAL CONSTRUCTION WARNING SIGN SIZE AND SPACING<sup>1,5,6</sup>**

Sign Number or Series	SIZE		SPACING	
	Conventional Road	Expressway/Freeway	Posted Speed MPH	Sign Spacing "X" (Feet (Apprx.))
CW20 <sup>4</sup>	48" x 48"	48" x 48"	30	120
CW21			35	160
CW22			40	240
CW23			45	320
CW25			50	400
CW1, CW2, CW7, CW8, CW9, CW11, CW14	36" x 36"	48" x 48"	55	500 <sup>2</sup>
CW3, CW4, CW5, CW6, CW8-3, CW10, CW12	48" x 48"	48" x 48"	60	600 <sup>2</sup>
			65	700 <sup>2</sup>
			70	800 <sup>2</sup>
			75	900 <sup>2</sup>
			80	1000 <sup>2</sup>
			*	* <sup>3</sup>


\* For typical sign spacings on divided highways, expressways and freeways, see Part 6 of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) typical application diagrams or TCP Standard Sheets.

△ Minimum distance from work area to first Advance Warning sign nearest the work area and/or distance between each additional sign.

**GENERAL NOTES**


- Special or larger size signs may be used as necessary.
- Distance between signs should be increased as required to have 1500 feet advance warning.
- Distance between signs should be increased as required to have 1/2 mile or more advance warning.
- 36" x 36" "ROAD WORK AHEAD" (CW20-1D) signs may be used on low volume crossroads at the discretion of the Engineer as per TMUTCD Part 5. See Note 2 under "Typical Location of Crossroad Signs".
- Only diamond shaped warning sign sizes are indicated.
- See sign size listing in "TMUTCD", Sign Appendix or the "Standard Highway Sign Designs for Texas" manual for complete list of available sign design sizes.

**WORK AREAS IN MULTIPLE LOCATIONS WITHIN CSJ LIMITS**

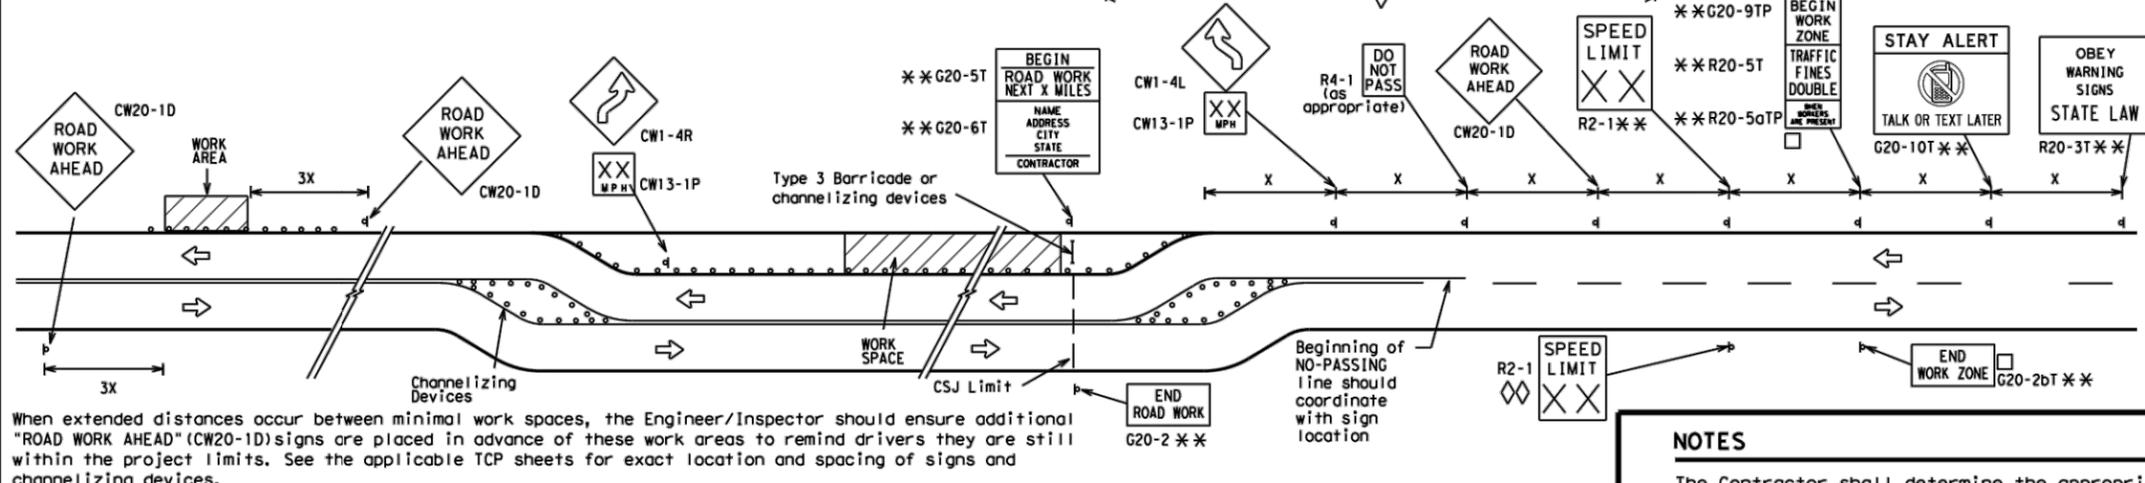


When extended distances occur between minimal work spaces, the Engineer/Inspector should ensure additional "ROAD WORK AHEAD" (CW20-1D) signs are placed in advance of these work areas to remind drivers they are still within the project limits. See the applicable TCP sheets for exact location and spacing of signs and channelizing devices.

**SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING AT THE CSJ LIMITS**

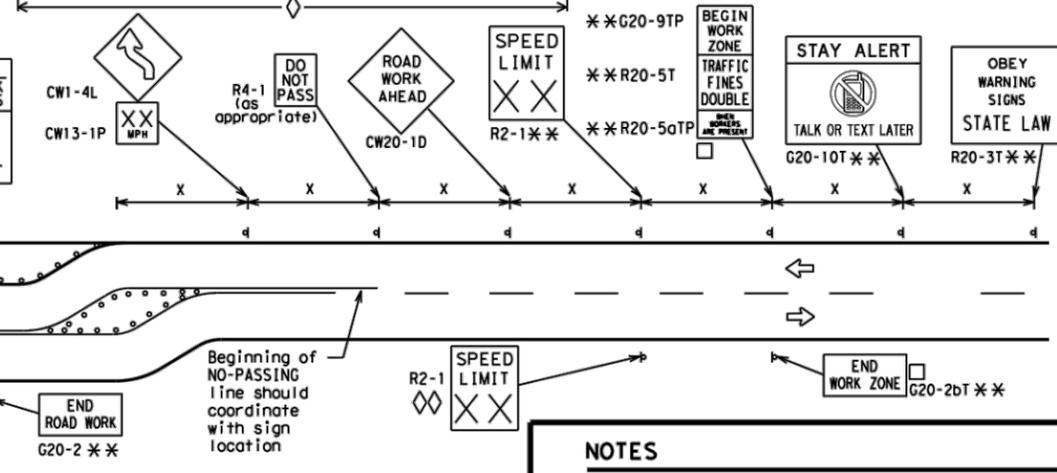

**SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING DOWNSTREAM OF THE CSJ LIMITS**

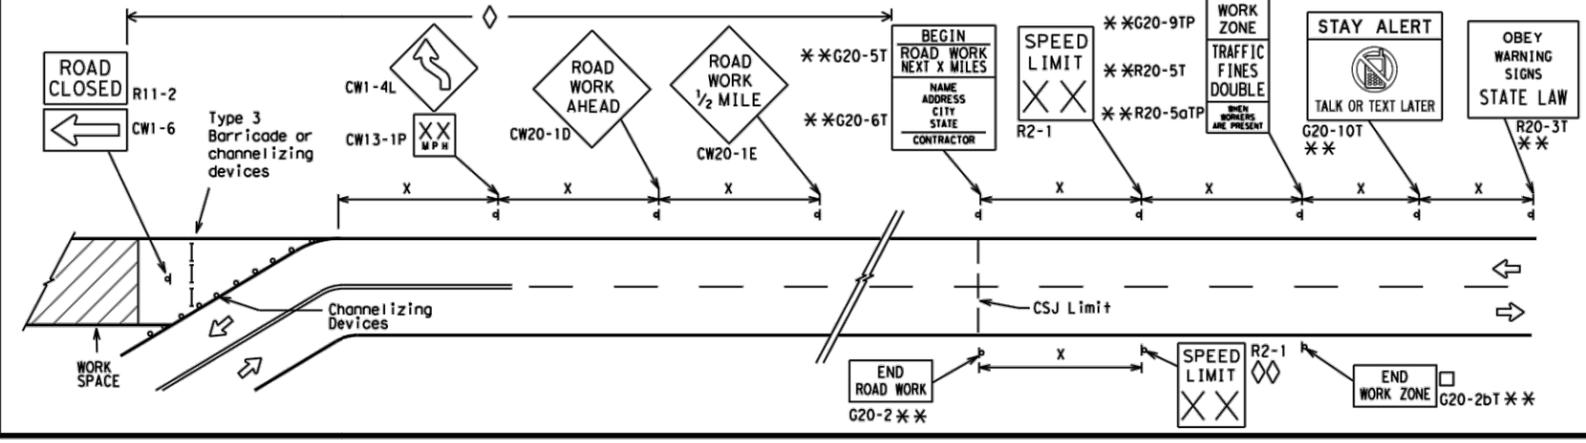

**NOTES**

- The Contractor shall determine the appropriate distance to be placed on the G20-1 series signs and "BEGIN ROAD WORK NEXT X MILES" (G20-5T) sign for each specific project. This distance shall replace the "X" and shall be rounded to the nearest whole mile with the approval of the Engineer. No decimals shall be used.
- The "BEGIN WORK ZONE" (G20-9TP) and "END WORK ZONE" (G20-2bT) shall be used as shown on the sample layout when advance signs are required outside the CSJ Limits. They inform the motorist of entering or leaving a part of the work zone lying outside the CSJ Limits where traffic fines may double if workers are present.
  - CSJ limit signing is required for highway construction and maintenance work, with the exception of mobile operations.
  - Area for placement of "ROAD WORK AHEAD" (CW20-1D) sign and other signs or devices as called for on the Traffic Control Plan.
  - Contractor will install a regulatory speed limit sign at the end of the work zone.

**LEGEND**

—	Type 3 Barricade
○ ○ ○	Channelizing Devices
—	Sign
X	See Typical Construction Warning Sign Size and Spacing chart or the TMUTCD for sign spacing requirements.

SHEET 2 OF 12



**BARRICADE AND CONSTRUCTION PROJECT LIMIT**

**BC(2)-21**

FILE: bc-21.dgn	DW: TxDOT	CR: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS				
9-07	8-14			
7-13	5-21			
DIST			COUNTY	SHEET NO.
				61


DATE: FILE:

# TYPICAL APPLICATION OF WORK ZONE SPEED LIMIT SIGNS

Work zone speed limits shall be regulatory, established in accordance with the "Procedures for Establishing Speed Zones," and approved by the Texas Transportation Commission, or by City Ordinance when within Incorporated City Limits.

Reduced speeds should only be posted in the vicinity of work activity and not throughout the entire project.

Regulatory work zone speed signs (R2-1) shall be removed or covered during periods when they are not needed.

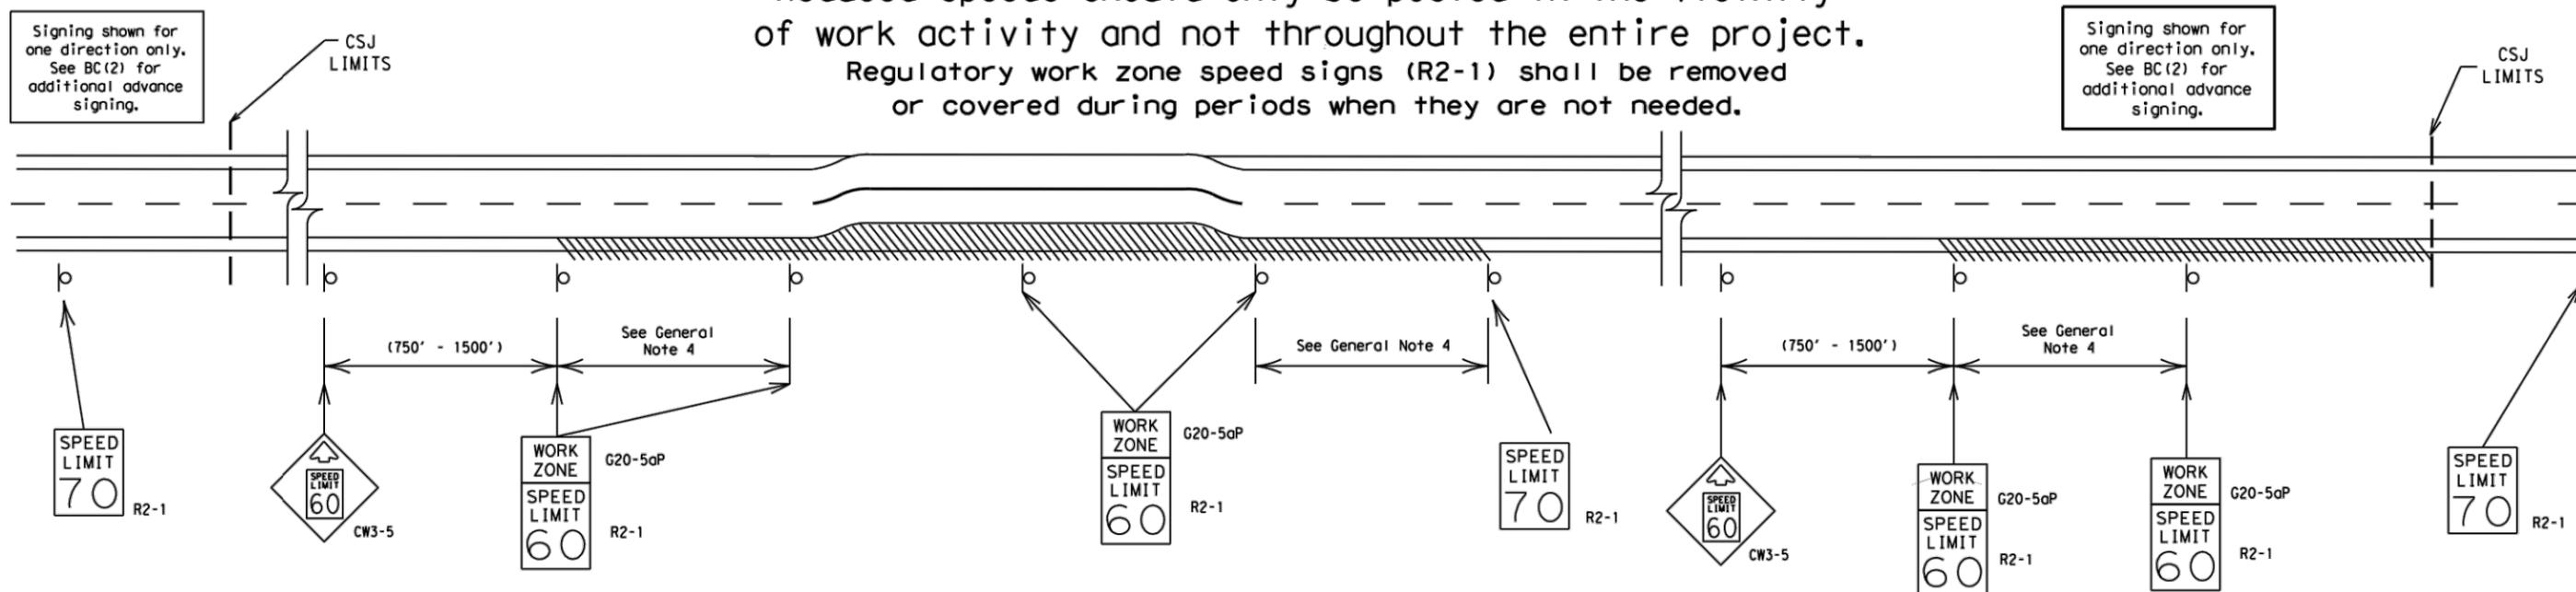

## GUIDANCE FOR USE:

### LONG/INTERMEDIATE TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit should be included on the design of the traffic control plans when restricted geometrics with a lower design speed are present in the work zone and modification of the geometrics to a higher design speed is not feasible.

Long/Intermediate Term Work Zone Speed Limit signs, when approved as described above, should be posted and visible to the motorist when work activity is present. Work activity may also be defined as a change in the roadway that requires a reduced speed for motorists to safely negotiate the work area, including:

- rough road or damaged pavement surface
- substantial alteration of roadway geometrics (diversions)
- construction detours
- grade
- width
- other conditions readily apparent to the driver

As long as any of these conditions exist, the work zone speed limit signs should remain in place.

### SHORT TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit may be included on the design of the traffic control plans when workers or equipment are not behind concrete barrier, when work activity is within 10 feet of the traveled way or actually in the traveled way.

Short Term Work Zone Speed Limit signs should be posted and visible to the motorists only when work activity is present. When work activity is not present, signs shall be removed or covered. (See Removing or Covering on BC(4)).


### GENERAL NOTES

- Regulatory work zone speed limits should be used only for sections of construction projects where speed control is of major importance.
- Regulatory work zone speed limit signs shall be placed on supports at a 7 foot minimum mounting height.
- Speed zone signs are illustrated for one direction of travel and are normally posted for each direction of travel.
- Frequency of work zone speed limit signs should be:
  - 40 mph and greater 0.2 to 2 miles
  - 35 mph and less 0.2 to 1 mile
- Regulatory speed limit signs shall have black legend and border on a white reflective background (See "Reflective Sheeting" on BC(4)).
- Fabrication, erection and maintenance of the "ADVANCE SPEED LIMIT" (CW3-5) sign, "WORK ZONE" (G20-5aP) plaque and the "SPEED LIMIT" (R2-1) signs shall not be paid for directly, but shall be considered subsidiary to Item 502.
- Turning signs from view, laying signs over or down will not be allowed, unless as otherwise noted under "REMOVING OR COVERING" on BC(4).
- Techniques that may help reduce traffic speeds include but are not limited to:
  - Law enforcement.
  - Flagger stationed next to sign.
  - Portable changeable message sign (PCMS).
  - Low-power (drone) radar transmitter.
  - Speed monitor trailers or signs.
- Speeds shown on details above are for illustration only. Work Zone Speed Limits should only be posted as approved for each project.
- For more specific guidance concerning the type of work, work zone conditions and factors impacting allowable regulatory construction speed zone reduction see TxDOT form #1204 in the TxDOT e-form system.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:  
FILE:

SHEET 3 OF 12




## BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT

BC(3)-21

FILE: bc-21.dgn	DW: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
9-07 8-14	REVISIONS		DIST	COUNTY
7-13 5-21				SHEET NO.
				62

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


**TYPICAL MINIMUM CLEARANCES FOR LONG TERM AND INTERMEDIATE TERM SIGNS**

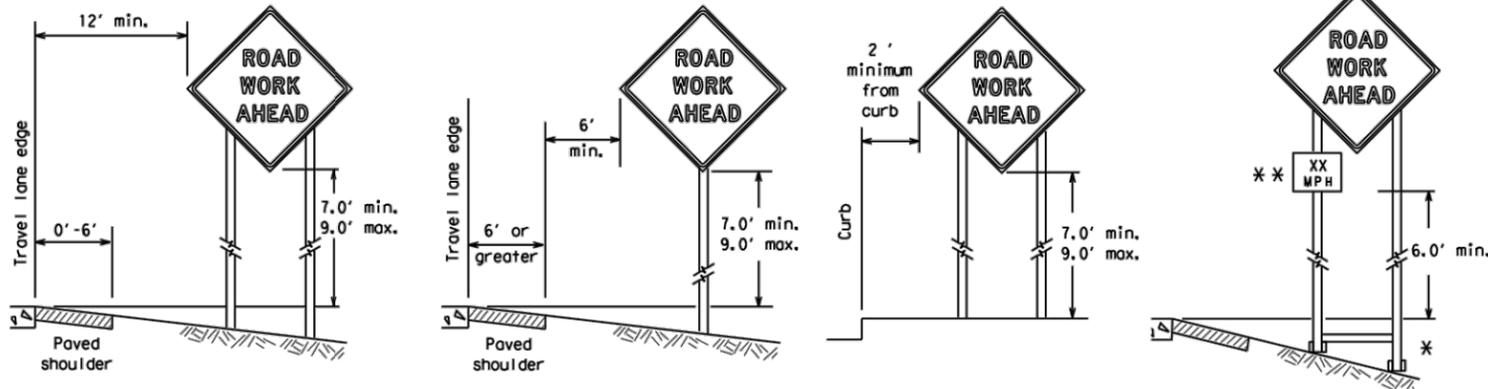

\* When placing skid supports on unlevel ground, the leg post lengths must be adjusted so the sign appears straight and plumb. Objects shall NOT be placed under skids as a means of leveling.

\*\* When plaques are placed on dual-leg supports, they should be attached to the upright nearest the travel lane. Supplemental plaques (advisory or distance) should not cover the surface of the parent sign.

**ATTACHMENT FOR SIGN SUPPORTS**

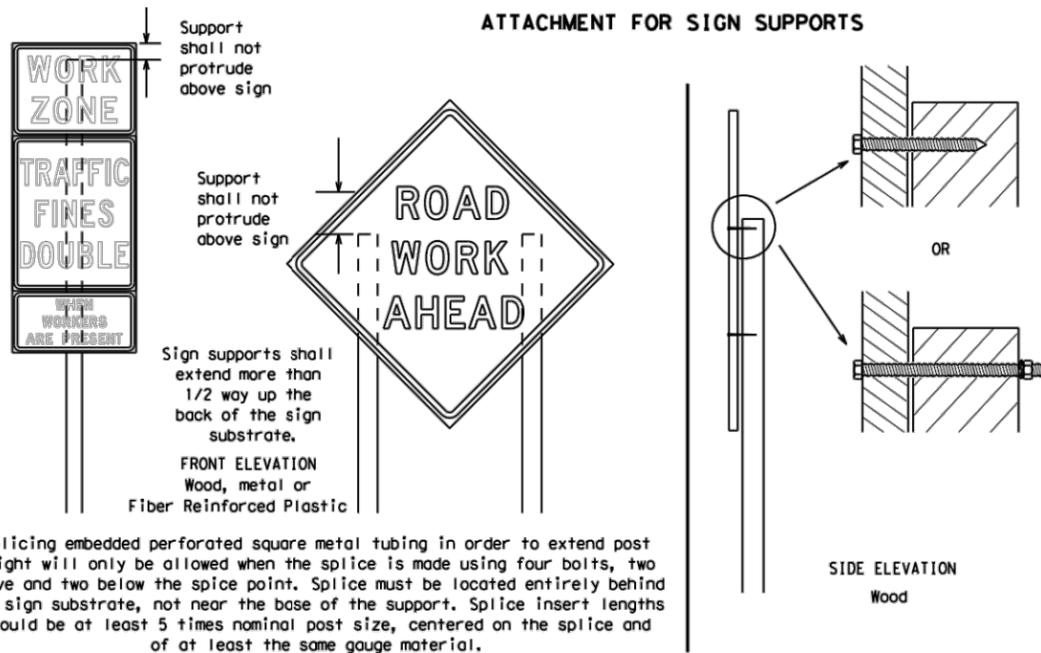

Splicing embedded perforated square metal tubing in order to extend post height will only be allowed when the splice is made using four bolts, two above and two below the splice point. Splice must be located entirely behind the sign substrate, not near the base of the support. Splice insert lengths should be at least 5 times nominal post size, centered on the splice and of at least the same gauge material.

**GENERAL NOTES FOR WORK ZONE SIGNS**

- Contractor shall install and maintain signs in a straight and plumb condition and/or as directed by the Engineer.
- Wooden sign posts shall be painted white.
- Barricades shall NOT be used as sign supports.
- All signs shall be installed in accordance with the plans or as directed by the Engineer. Signs shall be used to regulate, warn, and guide the traveling public safely through the work zone.
- The Contractor may furnish either the sign design shown in the plans or in the "Standard Highway Sign Designs for Texas" (SHSD). The Engineer/Inspector may require the Contractor to furnish other work zone signs that are shown in the TMUTCD but may have been omitted from the plans. Any variation in the plans shall be documented by written agreement between the Engineer and the Contractor's Responsible Person. All changes must be documented in writing before being implemented. This can include documenting the changes in the Inspector's TxDOT diary and having both the Inspector and Contractor initial and date the agreed upon changes.
- The Contractor shall furnish sign supports listed in the "Compliant Work Zone Traffic Control Device List" (CWZTCD) for small roadside signs. Supports for temporary large roadside signs shall meet the requirements detailed on the Temporary Large Roadside Signs (TLRS) standard sheets. The Contractor shall install the sign support in accordance with the manufacturer's recommendations. If there is a question regarding installation procedures, the Contractor shall furnish the Engineer a copy of the manufacturer's installation recommendations so the Engineer can verify the correct procedures are being followed.
- The Contractor is responsible for installing signs on approved supports and replacing signs with damaged or cracked substrates and/or damaged or marred reflective sheeting as directed by the Engineer/Inspector.
- Identification markings may be shown only on the back of the sign substrate. The maximum height of letters and/or company logos used for identification shall be 1 inch.
- The Contractor shall replace damaged wood posts. New or damaged wood sign posts shall not be spliced.

**DURATION OF WORK (as defined by the "Texas Manual on Uniform Traffic Control Devices" Part 6)**

- The types of sign supports, sign mounting height, the size of signs, and the type of sign substrates can vary based on the type of work being performed. The Engineer is responsible for selecting the appropriate size sign for the type of work being performed. The Contractor is responsible for ensuring the sign support, sign mounting height and substrate meets manufacturer's recommendations in regard to crashworthiness and duration of work requirements.
  - Long-term stationary - work that occupies a location more than 3 days.
  - Intermediate-term stationary - work that occupies a location more than one daylight period up to 3 days, or nighttime work lasting more than one hour.
  - Short-term stationary - daytime work that occupies a location for more than 1 hour in a single daylight period.
  - Short, duration - work that occupies a location up to 1 hour.
  - Mobile - work that moves continuously or intermittently (stopping for up to approximately 15 minutes.)

**SIGN MOUNTING HEIGHT**

- The bottom of Long-term/Intermediate-term signs shall be at least 7 feet, but not more than 9 feet, above the paved surface, except as shown for supplemental plaques mounted below other signs.
- The bottom of Short-term/Short Duration signs shall be a minimum of 1 foot above the pavement surface but no more than 2 feet above the ground.
- Long-term/Intermediate-term Signs may be used in lieu of Short-term/Short Duration signing.
- Short-term/Short Duration signs shall be used only during daylight and shall be removed at the end of the workday or raised to appropriate Long-term/Intermediate sign height.
- Regulatory signs shall be mounted at least 7 feet, but not more than 9 feet, above the paved surface regardless of work duration.

**SIZE OF SIGNS**

- The Contractor shall furnish the sign sizes shown on BC (2) unless otherwise shown in the plans or as directed by the Engineer.

**SIGN SUBSTRATES**

- The Contractor shall ensure the sign substrate is installed in accordance with the manufacturer's recommendations for the type of sign support that is being used. The CWZTCD lists each substrate that can be used on the different types and models of sign supports.
- "Mesh" type materials are NOT an approved sign substrate, regardless of the tightness of the weave.
- All wooden individual sign panels fabricated from 2 or more pieces shall have one or more plywood cleat, 1/2" thick by 6" wide, fastened to the back of the sign and extending fully across the sign. The cleat shall be attached to the back of the sign using wood screws that do not penetrate the face of the sign panel. The screws shall be placed on both sides of the splice and spaced at 6" centers. The Engineer may approve other methods of splicing the sign face.

**REFLECTIVE SHEETING**

- All signs shall be retroreflective and constructed of sheeting meeting the color and retro-reflectivity requirements of DMS-8300 for rigid signs or DMS-8310 for roll-up signs. The web address for DMS specifications is shown on BC(1).
- White sheeting, meeting the requirements of DMS-8300 Type A, shall be used for signs with a white background.
- Orange sheeting, meeting the requirements of DMS-8300 Type B<sub>FL</sub> or Type C<sub>FL</sub>, shall be used for rigid signs with orange backgrounds.

**SIGN LETTERS**

- All sign letters and numbers shall be clear, and open rounded type uppercase alphabet letters as approved by the Federal Highway Administration (FHWA) and as published in the "Standard Highway Sign Design for Texas" manual. Signs, letters and numbers shall be of first class workmanship in accordance with Department Standards and Specifications.

**REMOVING OR COVERING**

- When sign messages may be confusing or do not apply, the signs shall be removed or completely covered.
- Long-term stationary or intermediate stationary signs installed on square metal tubing may be turned away from traffic 90 degrees when the sign message is not applicable. This technique may not be used for signs installed in the median of divided highways or near any intersections where the sign may be seen from approaching traffic.
- Signs installed on wooden skids shall not be turned at 90 degree angles to the roadway. These signs should be removed or completely covered when not required.
- When signs are covered, the material used shall be opaque, such as heavy mil black plastic, or other materials which will cover the entire sign face and maintain their opaque properties under automobile headlights at night, without damaging the sign sheeting.
- Burlap shall NOT be used to cover signs.
- Duct tape or other adhesive material shall NOT be affixed to a sign face.
- Signs and anchor stubs shall be removed and holes backfilled upon completion of work.

**SIGN SUPPORT WEIGHTS**


- Where sign supports require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand should be used.
- The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight.
- Rock, concrete, iron, steel or other solid objects shall not be permitted for use as sign support weights.
- Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
- Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall NOT be used.
- Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber bases may be used when shown on the CWZTCD list.
- Sandbags shall only be placed along or laid over the base supports of the traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the skids to weigh down the sign support.
- Sandbags shall NOT be placed under the skid and shall not be used to level sign supports placed on slopes.

**FLAGS ON SIGNS**

- Flags may be used to draw attention to warning signs. When used, the flag shall be 16 inches square or larger and shall be orange or fluorescent red-orange in color. Flags shall not be allowed to cover any portion of the sign face.

**STOP/SLOW PADDLES**

- STOP/SLOW paddles are the primary method to control traffic by flaggers. The STOP/SLOW paddle size should be 24" x 24".
- STOP/SLOW paddles shall be retroreflectorized when used at night.
- STOP/SLOW paddles may be attached to a staff with a minimum length of 6' to the bottom of the sign.
- Any lights incorporated into the STOP or SLOW paddle faces shall only be as specifically described in Section 6E.03 Hand Signaling Devices in the TMUTCD.

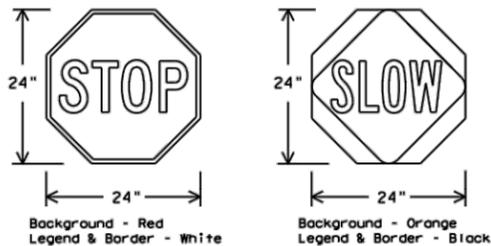

SHEETING REQUIREMENTS (WHEN USED AT NIGHT)		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	RED	TYPE B OR C SHEETING
BACKGROUND	ORANGE	TYPE B <sub>FL</sub> OR C <sub>FL</sub> SHEETING
LEGEND & BORDER	WHITE	TYPE B OR C SHEETING
LEGEND & BORDER	BLACK	ACRYLIC NON-REFLECTIVE FILM

**CONTRACTOR REQUIREMENTS FOR MAINTAINING PERMANENT SIGNS WITHIN THE PROJECT LIMITS**

- Permanent signs are used to give notice of traffic laws or regulations, call attention to conditions that are potentially hazardous to traffic operations, show route designations, destinations, directions, distances, services, points of interest, and other geographical, recreational, specific service (LOGO), or cultural information. Drivers proceeding through a work zone need the same, if not better route guidance as normally installed on a roadway without construction.
- When permanent regulatory or warning signs conflict with work zone conditions, remove or cover the permanent signs until the permanent sign message matches the roadway condition. For details for covering large guide signs see the TS-CD standard.
- When existing permanent signs are moved and relocated due to construction purposes, they shall be visible to motorists at all times.
- If existing signs are to be relocated on their original supports, they shall be installed on crashworthy bases as shown on the SMD Standard sheets. The signs shall meet the required mounting heights shown on the BC Sheets or the SMD Standards. This work should be paid for under the appropriate pay item for relocating existing signs.
- If permanent signs are to be removed and relocated using temporary supports, the Contractor shall use crashworthy supports as shown on the BC standard sheets, TLRS standard sheets or the CWZTCD list. The signs shall meet the required mounting heights shown on the BC, or the SMD standard sheets during construction. This work should be paid for under the appropriate pay item for relocating existing signs.
- Any sign or traffic control device that is struck or damaged by the Contractor or his/her construction equipment shall be replaced as soon as possible by the Contractor to ensure proper guidance for the motorists. This will be subsidiary to Item 502.





**BARRICADE AND CONSTRUCTION TEMPORARY SIGN NOTES**

**BC (4) -21**


FILE: bc-21.dgn	DN: TxDOT	CR: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS				
9-07 8-14	DIST		COUNTY	SHEET NO.
7-13 5-21				63

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

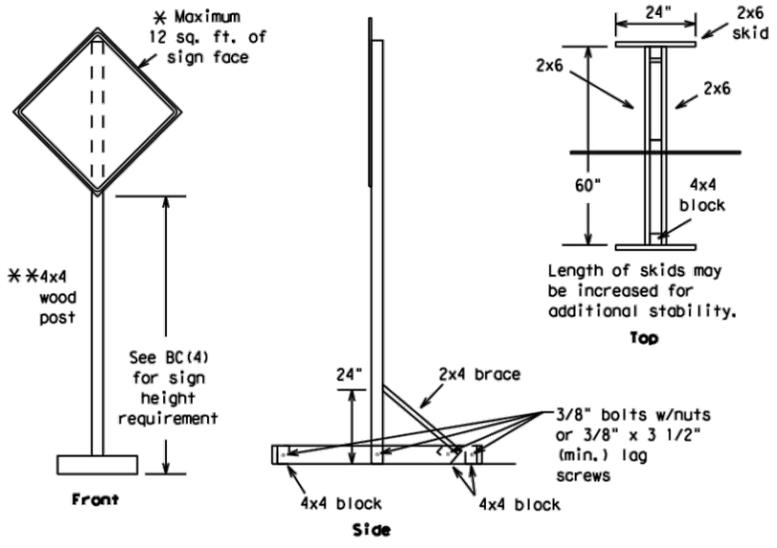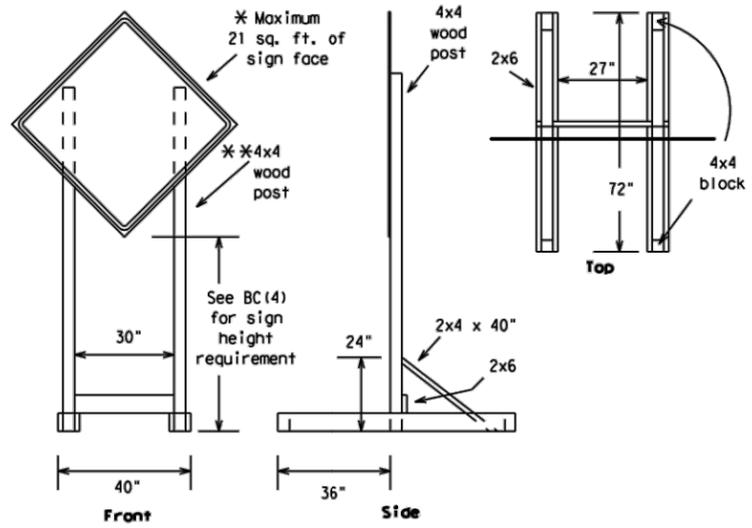



### SKID MOUNTED WOOD SIGN SUPPORTS

\* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

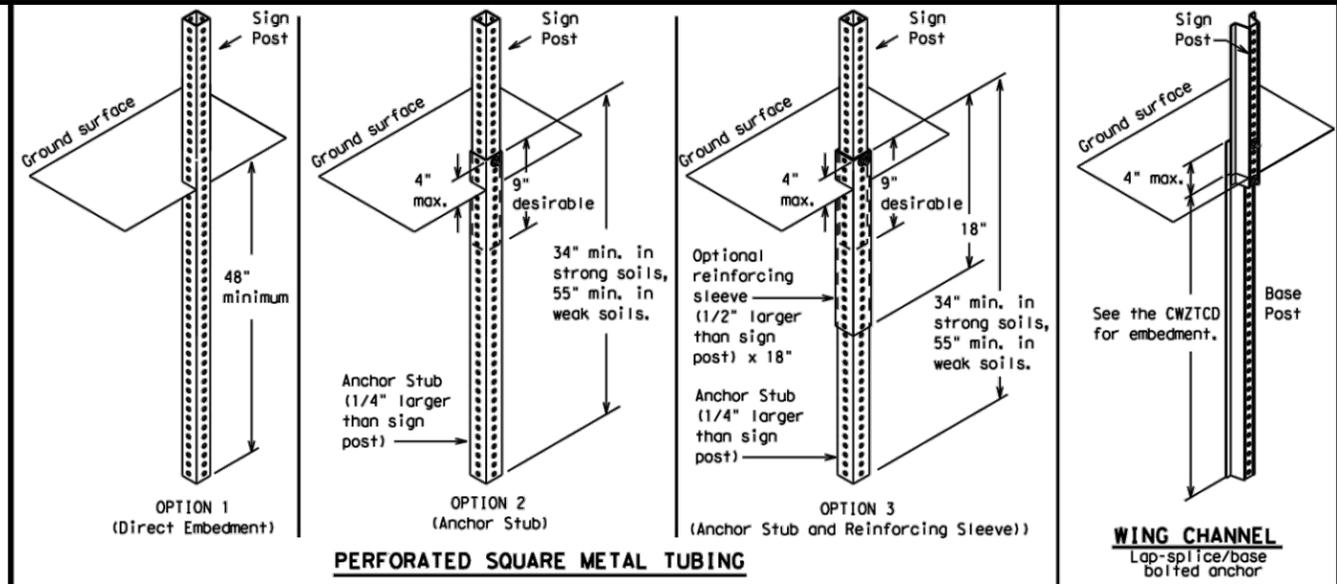

### GROUND MOUNTED SIGN SUPPORTS

Refer to the CWZTCD and the manufacturer's installation procedure for each type sign support. The maximum sign square footage shall adhere to the manufacturer's recommendation. Two post installations can be used for larger signs.

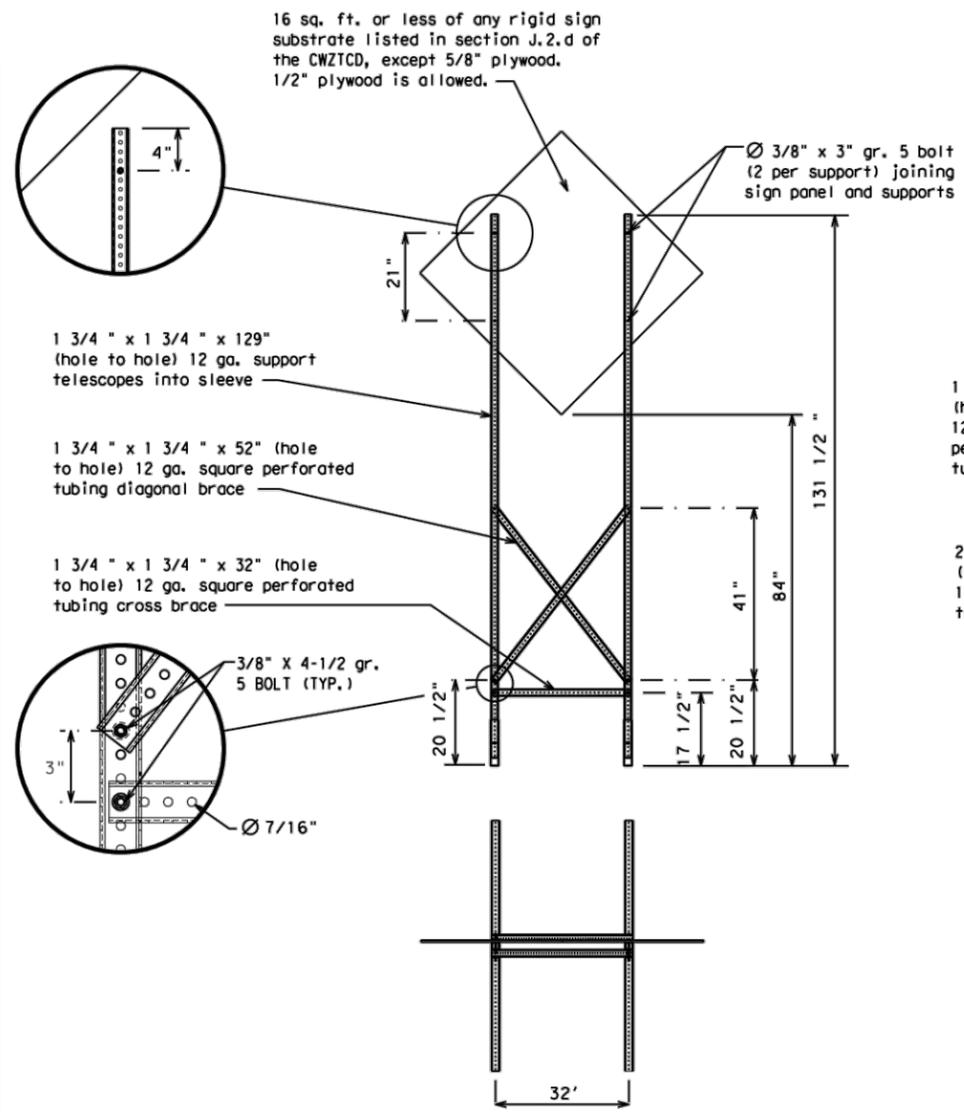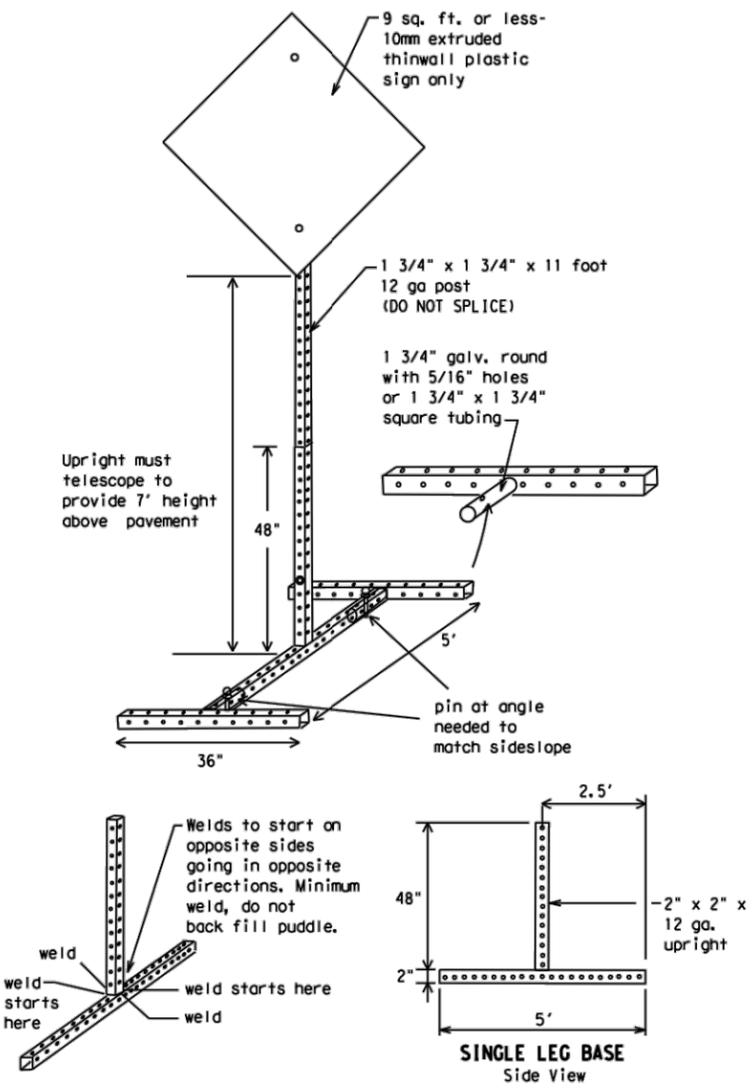

### SKID MOUNTED PERFORATED SQUARE STEEL TUBING SIGN SUPPORTS

\* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

**WEDGE ANCHORS**  
Both steel and plastic Wedge Anchor Systems as shown on the SMD Standard Sheets may be used as temporary sign supports for signs up to 10 square feet of sign face. They may be set in concrete or in sturdy soils if approved by the Engineer. (See web address for "Traffic Engineering Standard Sheets" on BC(1)).

**OTHER DESIGNS**  
MORE DETAILS OF APPROVED LONG/INTERMEDIATE AND SHORT TERM SUPPORTS CAN BE FOUND ON THE CWZTCD LIST. SEE BC(1) FOR WEBSITE LOCATION.

- GENERAL NOTES**
- Nails may be used in the assembly of wooden sign supports, but 3/8" bolts with nuts or 3/8" x 3 1/2" lag screws must be used on every joint for final connection.
  - No more than 2 sign posts shall be placed within a 7 ft. circle, except for specific materials noted on the CWZTCD List.
  - When project is completed, all sign supports and foundations shall be removed from the project site. This will be considered subsidiary to Item 502.
- \* See BC(4) for definition of "Work Duration."  
\*\* Wood sign posts MUST be one piece. Splicing will NOT be allowed. Posts shall be painted white.  
□ See the CWZTCD for the type of sign substrate that can be used for each approved sign support.

### BARRICADE AND CONSTRUCTION TYPICAL SIGN SUPPORT

### BC(5) - 21

FILE: bc-21.dgn	DW: TxDOT	CR: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS				
9-07 8-14				
7-13 5-21	DIST	COUNTY	SHEET NO.	
			64	

DATE: FILE:

WHEN NOT IN USE, REMOVE THE PCMS FROM THE RIGHT-OF-WAY OR PLACE THE PCMS BEHIND BARRIER OR GUARDRAIL WITH SIGN PANEL TURNED PARALLEL TO TRAFFIC

**PORTABLE CHANGEABLE MESSAGE SIGNS**

- The Engineer/Inspector shall approve all messages used on portable changeable message signs (PCMS).
- Messages on PCMS should contain no more than 8 words (about four to eight characters per word), not including simple words such as "TO," "FOR," "AT," etc.
- Messages should consist of a single phase, or two phases that alternate. Three-phase messages are not allowed. Each phase of the message should convey a single thought, and must be understood by itself.
- Use the word "EXIT" to refer to an exit ramp on a freeway; i.e., "EXIT CLOSED." Do not use the term "RAMP."
- Always use the route or interstate designation (IH, US, SH, FM) along with the number when referring to a roadway.
- When in use, the bottom of a stationary PCMS message panel should be a minimum 7 feet above the roadway, where possible.
- The message term "WEEKEND" should be used only if the work is to start on Saturday morning and end by Sunday evening at midnight. Actual days and hours of work should be displayed on the PCMS if work is to begin on Friday evening and/or continue into Monday morning.
- The Engineer/Inspector may select one of two options which are available for displaying a two-phase message on a PCMS. Each phase may be displayed for either four seconds each or for three seconds each.
- Do not "flash" messages or words included in a message. The message should be steady burn or continuous while displayed.
- Do not present redundant information on a two-phase message; i.e., keeping two lines of the message the same and changing the third line.
- Do not use the word "Danger" in message.
- Do not display the message "LANES SHIFT LEFT" or "LANES SHIFT RIGHT" on a PCMS. Drivers do not understand the message.
- Do not display messages that scroll horizontally or vertically across the face of the sign.
- The following table lists abbreviated words and two-word phrases that are acceptable for use on a PCMS. Both words in a phrase must be displayed together. Words or phrases not on this list should not be abbreviated, unless shown in the TMUTCD.
- PCMS character height should be at least 18 inches for trailer mounted units. They should be visible from at least 1/2 (.5) mile and the text should be legible from at least 600 feet at night and 800 feet in daylight. Truck mounted units must have a character height of 10 inches and must be legible from at least 400 feet.
- Each line of text should be centered on the message board rather than left or right justified.
- If disabled, the PCMS should default to an illegible display that will not alarm motorists and will only be used to alert workers that the PCMS has malfunctioned. A pattern such as a series of horizontal solid bars is appropriate.

DISCLAIMER: Use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

WORD OR PHRASE	ABBREVIATION	WORD OR PHRASE	ABBREVIATION
Access Road	ACCS RD	Major	MAJ
Alternate	ALT	Miles	MI
Avenue	AVE	Miles Per Hour	MPH
Best Route	BEST RTE	Minor	MNR
Boulevard	BLVD	Monday	MON
Bridge	BRDG	Normal	NORM
Cannot	CANT	North	N
Center	CTR	Northbound	(route) N
Construction Ahead	CONST AHD	Parking	PKING
CROSSING	XING	Road	RD
Detour Route	DETOUR RTE	Right Lane	RT LN
Do Not	DONT	Saturday	SAT
East	E	Service Road	SERV RD
Eastbound	(route) E	Shoulder	SHLDR
Emergency	EMER	Slippery	SLIP
Emergency Vehicle	EMER VEH	South	S
Entrance, Enter	ENT	Southbound	(route) S
Express Lane	EXP LN	Speed	SPD
Expressway	EXPWY	Street	ST
XXXX Feet	XXXX FT	Sunday	SUN
Fog Ahead	FOG AHD	Telephone	PHONE
Freeway	FRWY, FWY	Temporary	TEMP
Freeway Blocked	FWY BLKD	Thursday	THURS
Friday	FRI	To Downtown	TO DWTN
Hazardous Driving	HAZ DRIVING	Traffic	TRAF
Hazardous Material	HAZMAT	Travelers	TRVLR
High-Occupancy Vehicle	HOV	Tuesday	TUES
Highway	HWY	Time Minutes	TIME MIN
Hour(s)	HR, HRS	Upper Level	UPR LEVEL
Information	INFO	Vehicles (s)	VEH, VEHS
It Is	ITS	Warning	WARN
Junction	JCT	Wednesday	WED
Left	LFT	Weight Limit	WT LIMIT
Left Lane	LFT LN	West	W
Lane Closed	LN CLOSED	Westbound	(route) W
Lower Level	LWR LEVEL	Wet Pavement	WET PVMT
Maintenance	MAINT	Will Not	WONT

Roadway designation # IH-number, US-number, SH-number, FM-number

**RECOMMENDED PHASES AND FORMATS FOR PCMS MESSAGES DURING ROADWORK ACTIVITIES**

(The Engineer may approve other messages not specifically covered here.)

**Phase 1: Condition Lists**

**Road/Lane/Ramp Closure List**

FREEWAY CLOSED X MILE
ROAD CLOSED AT SH XXX
ROAD CLSD AT FM XXXX
RIGHT X LANES CLOSED
CENTER LANE CLOSED
NIGHT LANE CLOSURES
VARIOUS LANES CLOSED
EXIT CLOSED
MALL DRIVEWAY CLOSED
XXXXXXXXX BLVD CLOSED

**Other Condition List**

FRONTAGE ROAD CLOSED
SHOULDER CLOSED XXX FT
RIGHT LN CLOSED XXX FT
RIGHT X LANES OPEN
DAYTIME LANE CLOSURES
I-XX SOUTH EXIT CLOSED
EXIT XXX CLOSED X MILE
RIGHT LN TO BE CLOSED
X LANES CLOSED TUE - FRI

**Roadwork**

ROADWORK XXX FT
FLAGGER XXXX FT
RIGHT LN NARROWS XXXX FT
MERGING TRAFFIC XXXX FT
LOOSE GRAVEL XXXX FT
DETOUR X MILE
ROADWORK PAST SH XXXX
BUMP XXXX FT
TRAFFIC SIGNAL XXXX FT

**Other**

ROAD REPAIRS XXXX FT
LANE NARROWS XXXX FT
TWO-WAY TRAFFIC XX MILE
CONST TRAFFIC XXX FT
UNEVEN LANES XXXX FT
ROUGH ROAD XXXX FT
ROADWORK NEXT FRI-SUN
US XXX EXIT X MILES
LANES SHIFT *

\* LANES SHIFT in Phase 1 must be used with STAY IN LANE in Phase 2.

**Phase 2: Possible Component Lists**

**Action to Take/Effect on Travel List**

MERGE RIGHT
DETOUR NEXT X EXITS
USE EXIT XXX
STAY ON US XXX SOUTH
TRUCKS USE US XXX N
WATCH FOR TRUCKS
EXPECT DELAYS
REDUCE SPEED XXX FT
USE OTHER ROUTES
STAY IN LANE *

**Location List**

FORM X LINES RIGHT
USE XXXX RD EXIT
USE EXIT I-XX NORTH
USE I-XX E TO I-XX N
WATCH FOR TRUCKS
EXPECT DELAYS
PREPARE TO STOP
END SHOULDER USE
WATCH FOR WORKERS

**Warning List**

AT FM XXXX
BEFORE RAILROAD CROSSING
NEXT X MILES
PAST US XXX EXIT
XXXXXXXXX TO XXXXXXXX
US XXX TO FM XXXX
USE CAUTION
DRIVE SAFELY
DRIVE WITH CARE

**\*\* Advance Notice List**

SPEED LIMIT XX MPH
MAXIMUM SPEED XX MPH
MINIMUM SPEED XX MPH
ADVISORY SPEED XX MPH
RIGHT LANE EXIT
USE CAUTION
DRIVE SAFELY
DRIVE WITH CARE

TUE-FRI XX AM - X PM
APR XX-XX X PM-X AM
BEGINS MONDAY
BEGINS MAY XX
MAY X-X XX PM - XX AM
NEXT FRI-SUN
XX AM TO XX PM
NEXT TUE AUG XX
TONIGHT XX PM-XX AM

\*\* See Application Guidelines Note 6.

**APPLICATION GUIDELINES**

- Only 1 or 2 phases are to be used on a PCMS.
- The 1st phase (or both) should be selected from the "Road/Lane/Ramp Closure List" and the "Other Condition List".
- A 2nd phase can be selected from the "Action to Take/Effect on Travel, Location, General Warning, or Advance Notice Phase Lists".
- A Location Phase is necessary only if a distance or location is not included in the first phase selected.
- If two PCMS are used in sequence, they must be separated by a minimum of 1000 ft. Each PCMS shall be limited to two phases, and should be understandable by themselves.
- For advance notice, when the current date is within seven days of the actual work date, calendar days should be replaced with days of the week. Advance notification should typically be for no more than one week prior to the work.

**WORDING ALTERNATIVES**

- The words RIGHT, LEFT and ALL can be interchanged as appropriate.
- Roadway designations IH, US, SH, FM and LP can be interchanged as appropriate.
- EAST, WEST, NORTH and SOUTH (or abbreviations E, W, N and S) can be interchanged as appropriate.
- Highway names and numbers replaced as appropriate.
- ROAD, HIGHWAY and FREEWAY can be interchanged as needed.
- AHEAD may be used instead of distances if necessary.
- FT and MI, MILE and MILES interchanged as appropriate.
- AT, BEFORE and PAST interchanged as needed.
- Distances or AHEAD can be eliminated from the message if a location phase is used.

PCMS SIGNS WITHIN THE R.O.W. SHALL BE BEHIND GUARDRAIL OR CONCRETE BARRIER OR SHALL HAVE A MINIMUM OF FOUR (4) PLASTIC DRUMS PLACED PERPENDICULAR TO TRAFFIC ON THE UPSTREAM SIDE OF THE PCMS, WHEN EXPOSED TO ONE DIRECTION OF TRAFFIC. WHEN EXPOSED TO TWO WAY TRAFFIC, THE FOUR DRUMS SHOULD BE PLACED WITH ONE DRUM AT EACH OF THE FOUR CORNERS OF THE UNIT.

**FULL MATRIX PCMS SIGNS**

- When Full Matrix PCMS signs are used, the character height and legibility/visibility requirements shall be maintained as listed in Note 15 under "PORTABLE CHANGEABLE MESSAGE SIGNS" above.
- When symbol signs, such as the "Flagger Symbol" (CW20-7) are represented graphically on the Full Matrix PCMS sign and, with the approval of the Engineer, it shall maintain the legibility/visibility requirement listed above.
- When symbol signs are represented graphically on the Full Matrix PCMS, they shall only supplement the use of the static sign represented, and shall not substitute for, or replace that sign.
- A full matrix PCMS may be used to simulate a flashing arrow board provided it meets the visibility, flash rate and dimming requirements on BC(7), for the same size arrow.




**BARRICADE AND CONSTRUCTION PORTABLE CHANGEABLE MESSAGE SIGN (PCMS)**

**BC (6) -21**

FILE: bc-21.dgn	DN: TxDOT	CR: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS				
9-07 8-14				
7-13 5-21				
DIST	COUNTY	SHEET NO.		65


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

- Barrier Reflectors shall be pre-qualified, and conform to the color and reflectivity requirements of DMS-8600. A list of prequalified Barrier Reflectors can be found at the Material Producer List web address shown on BC(1).
- Color of Barrier Reflectors shall be as specified in the TMUTCD. The cost of the reflectors shall be considered subsidiary to Item 512.

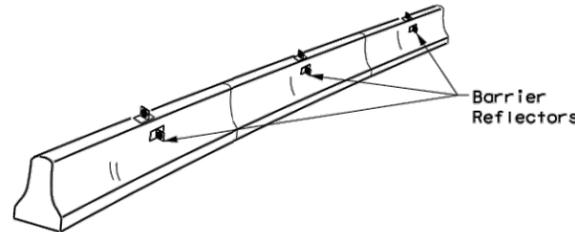

**CONCRETE TRAFFIC BARRIER (CTB)**

- Where traffic is on one side of the CTB, two (2) Barrier Reflectors shall be mounted in approximately the midsection of each section of CTB. An alternate mounting location is uniformly spaced at one end of each CTB. This will allow for attachment of a barrier grapple without damaging the reflector. The Barrier Reflector mounted on the side of the CTB shall be located directly below the reflector mounted on top of the barrier, as shown in the detail above.
- Where CTB separates two-way traffic, three barrier reflectors shall be mounted on each section of CTB. The reflector unit on top shall have two yellow reflective faces (Bi-Directional) while the reflectors on each side of the barrier shall have one yellow reflective face, as shown in the detail above.
- When CTB separates traffic traveling in the same direction, no barrier reflectors will be required on top of the CTB.
- Barrier Reflector units shall be yellow or white in color to match the edgeline being supplemented.
- Maximum spacing of Barrier Reflectors is forty (40) feet.
- Pavement markers or temporary flexible-reflective roadway marker tabs shall NOT be used as CTB delineation.
- Attachment of Barrier Reflectors to CTB shall be per manufacturer's recommendations.
- Missing or damaged Barrier Reflectors shall be replaced as directed by the Engineer.
- Single slope barriers shall be delineated as shown on the above detail.

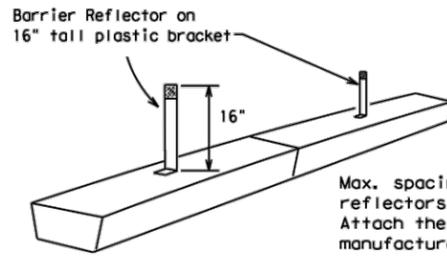


**LOW PROFILE CONCRETE BARRIER (LPCB)**

**LOW PROFILE CONCRETE BARRIER (LPCB) USED IN WORK ZONES**

LPCB is approved for use in work zone locations, where the posted speed is 45mph, or less. See Roadway Standard Sheet LPCB.

Max. spacing of barrier reflectors is 20 feet. Attach the delineators as per manufacturer's recommendations.

See D & OM (VIA)

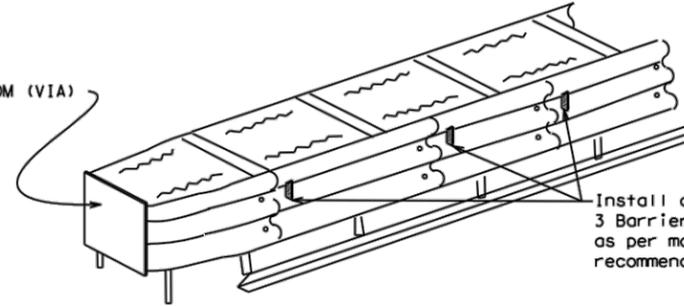

**DELINEATION OF END TREATMENTS**


**END TREATMENTS FOR CTB'S USED IN WORK ZONES**

End treatments used on CTB's in work zones shall meet the appropriate crashworthy standards as defined in the Manual for Assessing Safety Hardware (MASH). Refer to the CWZTCD List for approved end treatments and manufacturers.

**BARRIER REFLECTORS FOR CONCRETE TRAFFIC BARRIER AND ATTENUATORS**

**WARNING LIGHTS**


- Warning lights shall meet the requirements of the TMUTCD.
- Warning lights shall NOT be installed on barricades.
- Type A-Low Intensity Flashing Warning Lights are commonly used with drums. They are intended to warn of or mark a potentially hazardous area. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "FL". The Type A Warning Lights shall not be used with signs manufactured with Type B<sub>FL</sub> or C<sub>FL</sub> Sheeting meeting the requirements of Departmental Material Specification DMS-8300.
- Type-C and Type D 360 degree Steady Burn Lights are intended to be used in a series for delineation to supplement other traffic control devices. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "SB".
- The Engineer/Inspector or the plans shall specify the location and type of warning lights to be installed on the traffic control devices.
- When required by the Engineer, the Contractor shall furnish a copy of the warning lights certification. The warning light manufacturer will certify the warning lights meet the requirements of the latest ITE Purchase Specifications for Flashing and Steady-Burn Warning Lights.
- When used to delineate curves, Type-C and Type D Steady Burn Lights should only be placed on the outside of the curve, not the inside.
- The location of warning lights and warning reflectors on drums shall be as shown elsewhere in the plans.

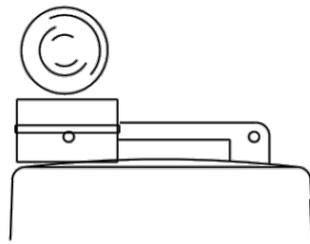

Type C Warning Light or approved substitute mounted on a drum adjacent to the travel way.

**WARNING LIGHTS MOUNTED ON PLASTIC DRUMS**

- Type A flashing warning lights are intended to warn drivers that they are approaching or are in a potentially hazardous area.
- Type A random flashing warning lights are not intended for delineation and shall not be used in a series.
- A series of sequential flashing warning lights placed on channelizing devices to form a merging taper may be used for delineation. If used, the successive flashing of the sequential warning lights should occur from the beginning of the taper to the end of the merging taper in order to identify the desired vehicle path. The rate of flashing for each light shall be 65 flashes per minute, plus or minus 10 flashes.
- Type C and D steady-burn warning lights are intended to be used in a series to delineate the edge of the travel lane on detours, on lane changes, on lane closures, and on other similar conditions.
- Type A, Type C and Type D warning lights shall be installed at locations as detailed on other sheets in the plans.
- Warning lights shall not be installed on a drum that has a sign, chevron or vertical panel.
- The maximum spacing for warning lights on drums should be identical to the channelizing device spacing.

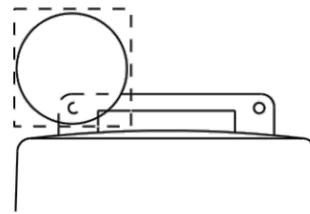


Warning reflector may be round or square. Must have a yellow reflective surface area of at least 30 square inches

**WARNING REFLECTORS MOUNTED ON PLASTIC DRUMS AS A SUBSTITUTE FOR TYPE C (STEADY BURN) WARNING LIGHTS**

- A warning reflector or approved substitute may be mounted on a plastic drum as a substitute for a Type C, steady burn warning light at the discretion of the Contractor unless otherwise noted in the plans.
- The warning reflector shall be yellow in color and shall be manufactured using a sign substrate approved for use with plastic drums listed on the CWZTCD.
- The warning reflector shall have a minimum retroreflective surface area (one-side) of 30 square inches.
- Round reflectors shall be fully reflectorized, including the area where attached to the drum.
- Square substrates must have a minimum of 30 square inches of reflectorized sheeting. They do not have to be reflectorized where it attaches to the drum.
- The side of the warning reflector facing approaching traffic shall have sheeting meeting the color and retroreflectivity requirements for DMS 8300-Type B or Type C.
- When used near two-way traffic, both sides of the warning reflector shall be reflectorized.
- The warning reflector should be mounted on the side of the handle nearest approaching traffic.
- The maximum spacing for warning reflectors should be identical to the channelizing device spacing requirements.

Arrow Boards may be located behind channelizing devices in place for a shoulder taper or merging taper, otherwise they shall be delineated with four (4) channelizing devices placed perpendicular to traffic on the upstream side of traffic.

- The Flashing Arrow Board should be used for all lane closures on multi-lane roadways, or slow moving maintenance or construction activities on the travel lanes.
- Flashing Arrow Boards should not be used on two-lane, two-way roadways, detours, diversions or work on shoulders unless the "CAUTION" display (see detail below) is used.
- The Engineer/Inspector shall choose all appropriate signs, barricades and/or other traffic control devices that should be used in conjunction with the Flashing Arrow Board.
- The Flashing Arrow Board should be able to display the following symbols:

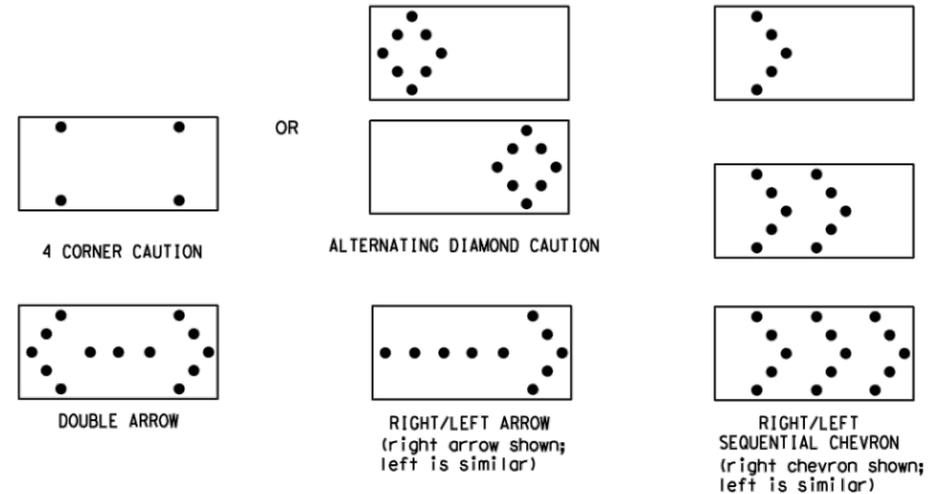

- The "CAUTION" display consists of four corner lamps flashing simultaneously, or the Alternating Diamond Caution mode as shown.
- The straight line caution display is NOT ALLOWED.
- The Flashing Arrow Board shall be capable of minimum 50 percent dimming from rated lamp voltage. The flashing rate of the lamps shall not be less than 25 nor more than 40 flashes per minute.
- Minimum lamp "on time" shall be approximately 50 percent for the flashing arrow and equal intervals of 25 percent for each sequential phase of the flashing chevron.
- The sequential arrow display is NOT ALLOWED.
- The flashing arrow display is the TxDOT standard; however, the sequential chevron display may be used during daylight operations.
- The Flashing Arrow Board shall be mounted on a vehicle, trailer or other suitable support.
- A Flashing Arrow Board SHALL NOT BE USED to laterally shift traffic.
- A full matrix PCMS may be used to simulate a Flashing Arrow Board provided it meets visibility, flash rate and dimming requirements on this sheet for the same size arrow.
- Minimum mounting height of trailer mounted Arrow Boards should be 7 feet from roadway to bottom of panel.

REQUIREMENTS			
TYPE	MINIMUM SIZE	MINIMUM NUMBER OF PANEL LAMPS	MINIMUM VISIBILITY DISTANCE
B	30 x 60	13	3/4 mile
C	48 x 96	15	1 mile

**ATTENTION**  
Flashing Arrow Boards shall be equipped with automatic dimming devices.

WHEN NOT IN USE, REMOVE THE ARROW BOARD FROM THE RIGHT-OF-WAY OR PLACE THE ARROW BOARD BEHIND CONCRETE TRAFFIC BARRIER OR GUARDRAIL.

**FLASHING ARROW BOARDS**

SHEET 7 OF 12

**TRUCK-MOUNTED ATTENUATORS**

- Truck-mounted attenuators (TMA) used on TxDOT facilities must meet the requirements outlined in the Manual for Assessing Safety Hardware (MASH).
- Refer to the CWZTCD for the requirements of Level 2 or Level 3 TMAs.
- Refer to the CWZTCD for a list of approved TMAs.
- TMAs are required on freeways unless otherwise noted in the plans.
- A TMA should be used anytime that it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the work performance.
- The only reason a TMA should not be required is when a work area is spread down the roadway and the work crew is an extended distance from the TMA.



**BARRICADE AND CONSTRUCTION ARROW PANEL, REFLECTORS, WARNING LIGHTS & ATTENUATOR**

**BC(7)-21**

FILE: bc-21.dgn	DW: TxDOT	CR: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS				
9-07	8-14			
7-13	5-21			
	DIST	COUNTY		SHEET NO.
				66

DATE: FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

**GENERAL NOTES**

- For long term stationary work zones on freeways, drums shall be used as the primary channelizing device.
- For intermediate term stationary work zones on freeways, drums should be used as the primary channelizing device but may be replaced in tangent sections by vertical panels, or 42" two-piece cones. In tangent sections, one-piece cones may be used with the approval of the Engineer but only if personnel are present on the project at all times to maintain the cones in proper position and location.
- For short term stationary work zones on freeways, drums are the preferred channelizing device but may be replaced in tapers, transitions and tangent sections by vertical panels, two-piece cones or one-piece cones as approved by the Engineer.
- Drums and all related items shall comply with the requirements of the current version of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Drums, bases, and related materials shall exhibit good workmanship and shall be free from objectionable marks or defects that would adversely affect their appearance or serviceability.
- The Contractor shall have a maximum of 24 hours to replace any plastic drums identified for replacement by the Engineer/Inspector. The replacement device must be an approved device.

**GENERAL DESIGN REQUIREMENTS**

Pre-qualified plastic drums shall meet the following requirements:




- Plastic drums shall be a two-piece design; the "body" of the drum shall be the top portion and the "base" shall be the bottom.
- The body and base shall lock together in such a manner that the body separates from the base when impacted by a vehicle traveling at a speed of 20 MPH or greater but prevents accidental separation due to normal handling and/or air turbulence created by passing vehicles.
- Plastic drums shall be constructed of lightweight flexible, and deformable materials. The Contractor shall NOT use metal drums or single piece plastic drums as channelization devices or sign supports.
- Drums shall present a profile that is a minimum of 18 inches in width at the 36 inch height when viewed from any direction. The height of drum unit (body installed on base) shall be a minimum of 36 inches and a maximum of 42 inches.
- The top of the drum shall have a built-in handle for easy pickup and shall be designed to drain water and not collect debris. The handle shall have a minimum of two widely spaced 9/16 inch diameter holes to allow attachment of a warning light, warning reflector unit or approved compliant sign.
- The exterior of the drum body shall have a minimum of four alternating orange and white retroreflective circumferential stripes not less than 4 inches nor greater than 8 inches in width. Any non-reflectORIZED space between any two adjacent stripes shall not exceed 2 inches in width.
- Bases shall have a maximum width of 36 inches, a maximum height of 4 inches, and a minimum of two footholds of sufficient size to allow base to be held down while separating the drum body from the base.
- Plastic drums shall be constructed of ultra-violet stabilized, orange, high-density polyethylene (HDPE) or other approved material.
- Drum body shall have a maximum unballasted weight of 11 lbs.
- Drum and base shall be marked with manufacturer's name and model number.

**RETROREFLECTIVE SHEETING**

- The stripes used on drums shall be constructed of sheeting meeting the color and retroreflectivity requirements of Departmental Materials Specification DMS-8300, "Sign Face Materials," Type A or Type B reflective sheeting shall be supplied unless otherwise specified in the plans.
- The sheeting shall be suitable for use on and shall adhere to the drum surface such that, upon vehicular impact, the sheeting shall remain adhered in-place and exhibit no delaminating, cracking, or loss of retroreflectivity other than that loss due to abrasion of the sheeting surface.

**BALLAST**

- Unballasted bases shall be large enough to hold up to 50 lbs. of sand. This base, when filled with the ballast material, should weigh between 35 lbs (minimum) and 50 lbs (maximum). The ballast may be sand in one to three sandbags separate from the base, sand in a sand-filled plastic base, or other ballasting devices as approved by the Engineer. Stacking of sandbags will be allowed, however height of sandbags above pavement surface may not exceed 12 inches.
- Bases with built-in ballast shall weigh between 40 lbs. and 50 lbs. Built-in ballast can be constructed of an integral crumb rubber base or a solid rubber base.
- Recycled truck tire sidewalls may be used for ballast on drums approved for this type of ballast on the CWZTCD list.
- The ballast shall not be heavy objects, water, or any material that would become hazardous to motorists, pedestrians, or workers when the drum is struck by a vehicle.
- When used in regions susceptible to freezing, drums shall have drainage holes in the bottoms so that water will not collect and freeze becoming a hazard when struck by a vehicle.
- Ballast shall not be placed on top of drums.
- Adhesives may be used to secure base of drums to pavement.

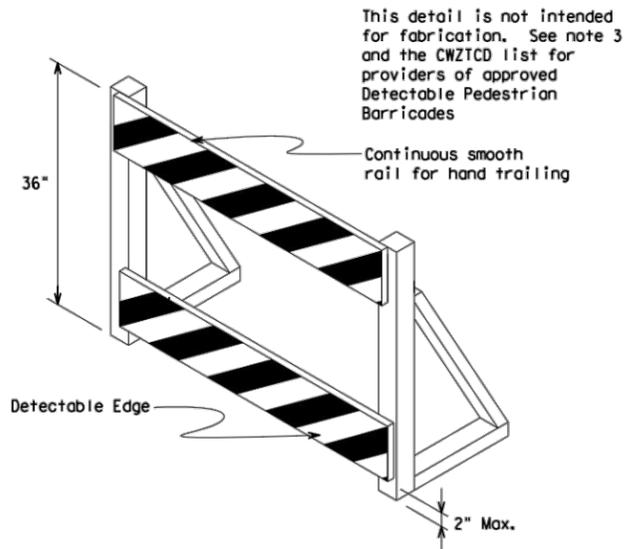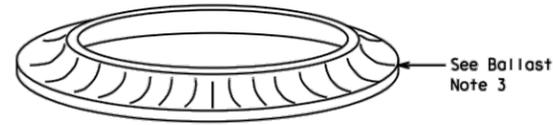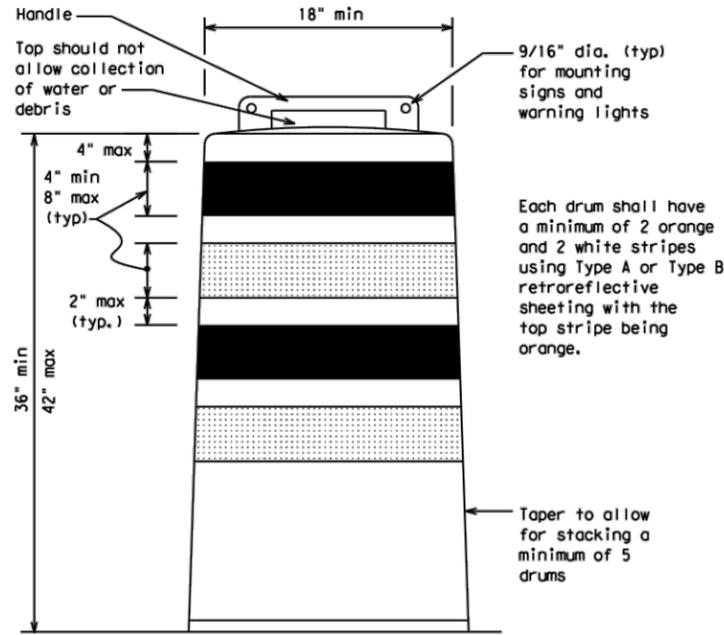


**DETECTABLE PEDESTRIAN BARRICADES**

- When existing pedestrian facilities are disrupted, closed, or relocated in a TTC zone, the temporary facilities shall be detectable and include accessibility features consistent with the features present in the existing pedestrian facility. Refer to WZ(BTS-2) for Pedestrian Control requirements for Sidewalk Diversions, Sidewalk Detours and Crosswalk Closures.
- Where pedestrians with visual disabilities normally use the closed sidewalk, a Detectable Pedestrian Barricade shall be placed across the full width of the closed sidewalk instead of a Type 3 Barricade.
- Detectable pedestrian barricades similar to the one pictured above, longitudinal channelizing devices, some concrete barriers, and wood or chain link fencing with a continuous detectable edging can satisfactorily delineate a pedestrian path.
- Tape, rope, or plastic chain strung between devices are not detectable, do not comply with the design standards in the "Americans with Disabilities Act Accessibility Guidelines (ADAAG)" and should not be used as a control for pedestrian movements.
- Warning lights shall not be attached to detectable pedestrian barricades.
- Detectable pedestrian barricades should use 8" nominal barricade rails as shown on BC(10) provided that the top rail provides a smooth continuous rail suitable for hand trailing with no splinters, burrs, or sharp edges.



18" x 24" Sign  
(Maximum Sign Dimension)  
Chevron CW1-8, Opposing Traffic Lane Divider, Driveway sign D70a, Keep Right R4 series or other signs as approved by Engineer



12" x 24" Vertical Panel  
mount with diagonals sloping down towards travel way

Plywood, Aluminum or Metal sign substrates shall NOT be used on plastic drums

**SIGNS, CHEVRONS, AND VERTICAL PANELS MOUNTED ON PLASTIC DRUMS**

- Signs used on plastic drums shall be manufactured using substrates listed on the CWZTCD.
- Chevrons and other work zone signs with an orange background shall be manufactured with Type B<sub>FL</sub> or Type C<sub>FL</sub> Orange sheeting meeting the color and retroreflectivity requirements of DMS-8300, "Sign Face Material," unless otherwise specified in the plans.
- Vertical Panels shall be manufactured with orange and white sheeting meeting the requirements of DMS-8300 Type A or Type B. Diagonal stripes on Vertical Panels shall slope down toward the intended traveled lane.
- Other sign messages (text or symbolic) may be used as approved by the Engineer. Sign dimensions shall not exceed 18 inches in width or 24 inches in height, except for the R9 series signs discussed in note 8 below.
- Signs shall be installed using a 1/2 inch bolt (nominal) and nut, two washers, and one locking washer for each connection.
- Mounting bolts and nuts shall be fully engaged and adequately torqued. Bolts should not extend more than 1/2 inch beyond nuts.
- Chevrons may be placed on drums on the outside of curves, on merging tapers or on shifting tapers. When used in these locations, they may be placed on every drum or spaced not more than an every third drum. A minimum of three (3) should be used at each location called for in the plans.
- R9-9, R9-10, R9-11 and R9-11a Sidewalk Closed signs which are 24 inches wide may be mounted on plastic drums, with approval of the Engineer.

SHEET 8 OF 12




**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**

**BC (8) - 21**

FILE: bc-21.dgn	DN: TxDOT	CR: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS				
4-03 8-14				
9-07 5-21				
7-13				
DIST COUNTY				SHEET NO. 67


DATE: FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

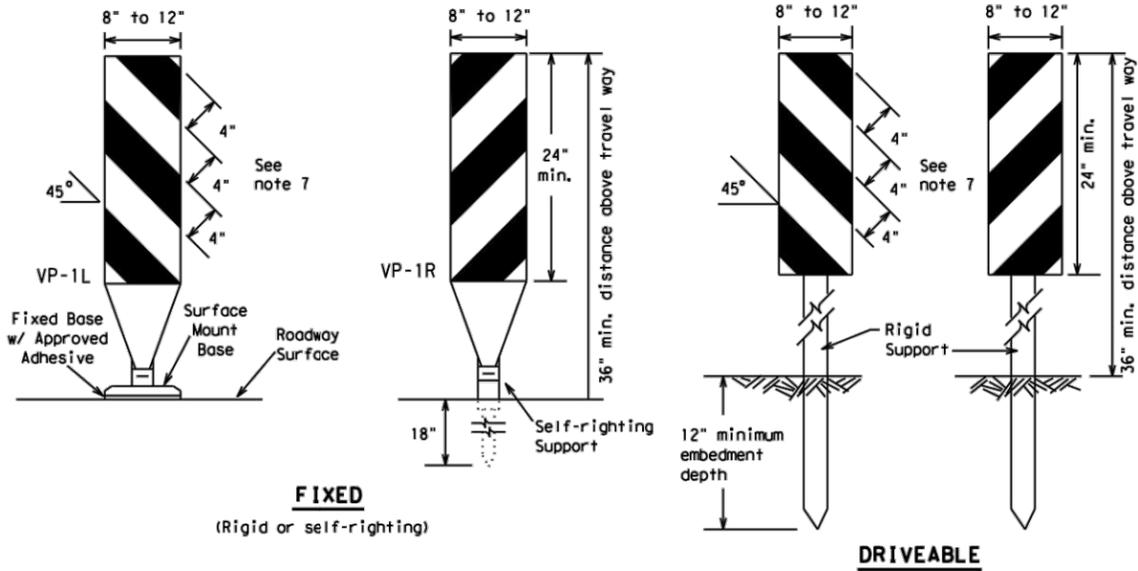

**FIXED**  
(Rigid or self-righting)


**DRIVEABLE**

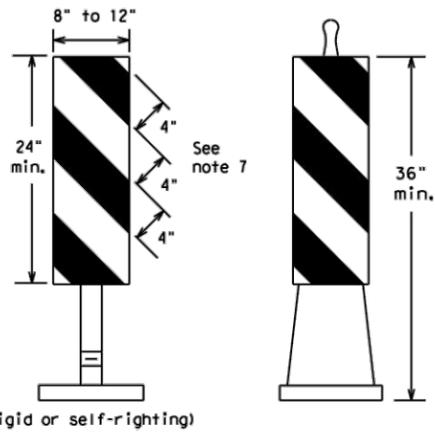

**PORTABLE**

**VERTICAL PANELS (VPs)**

1. Vertical Panels (VP's) are normally used to channelize traffic or divide opposing lanes of traffic.
2. VP's may be used in daytime or nighttime situations. They may be used at the edge of shoulder drop-offs and other areas such as lane transitions where positive daytime and nighttime delineation is required. The Engineer/Inspector shall refer to the Roadway Design Manual for additional requirements on the use VP's for drop-offs.
3. VP's should be mounted back to back if used at the edge of cuts adjacent to two-way two lane roadways. Stripes are to be reflective orange and reflective white and should always slope downward toward the travel lane.
4. VP's used on expressways and freeways or other high speed roadways, may have more than 270 square inches of retroreflective area facing traffic.
5. Self-righting supports are available with portable base. See "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
6. Sheeting for the VP's shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300, unless noted otherwise.
7. Where the height of reflective material on the vertical panel is 36 inches or greater, a panel stripe of 6 inches shall be used.

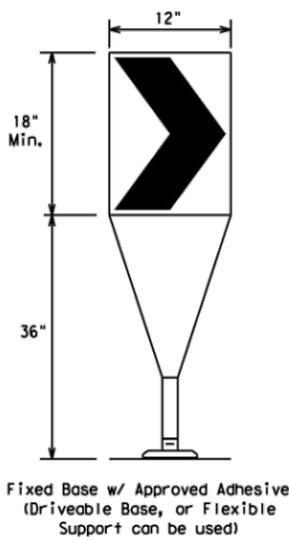


**CHEVRONS**

1. The chevron shall be a vertical rectangle with a minimum size of 12 by 18 inches.
2. Chevrons are intended to give notice of a sharp change of alignment with the direction of travel and provide additional emphasis and guidance for vehicle operators with regard to changes in horizontal alignment of the roadway.
3. Chevrons, when used, shall be erected on the outside of a sharp curve or turn, or on the far side of an intersection. They shall be in line with and at right angles to approaching traffic. Spacing should be such that the motorist always has three in view, until the change in alignment eliminates its need.
4. To be effective, the chevron should be visible for at least 500 feet.
5. Chevrons shall be orange with a black nonreflective legend. Sheeting for the chevron shall be retroreflective Type B<sub>FL</sub> or Type C<sub>FL</sub> conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.
6. For Long Term Stationary use on tapers or transitions on freeways and divided highways, self-righting chevrons may be used to supplement plastic drums but not to replace plastic drums.

**GENERAL NOTES**

1. Work Zone channelizing devices illustrated on this sheet may be installed in close proximity to traffic and are suitable for use on high or low speed roadways. The Engineer/Inspector shall ensure that spacing and placement is uniform and in accordance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
2. Channelizing devices shown on this sheet may have a driveable, fixed or portable base. The requirement for self-righting channelizing devices must be specified in the General Notes or other plan sheets.
3. Channelizing devices on self-righting supports should be used in work zone areas where channelizing devices are frequently impacted by errant vehicles or vehicle related wind gusts making alignment of the channelizing devices difficult to maintain. Locations of these devices shall be detailed elsewhere in the plans. These devices shall conform to the TMUTCD and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
4. The Contractor shall maintain devices in a clean condition and replace damaged, nonreflective, faded, or broken devices and bases as required by the Engineer/Inspector. The Contractor shall be required to maintain proper device spacing and alignment.
5. Portable bases shall be fabricated from virgin and/or recycled rubber. The portable bases shall weigh a minimum of 30 lbs.
6. Pavement surfaces shall be prepared in a manner that ensures proper bonding between the adhesives, the fixed mount bases and the pavement surface. Adhesives shall be prepared and applied according to the manufacturer's recommendations.
7. The installation and removal of channelizing devices shall not cause detrimental effects to the final pavement surfaces, including pavement surface discoloration or surface integrity. Driveable bases shall not be permitted on final pavement surfaces. The Engineer/Inspector shall approve all application and removal procedures of fixed bases.

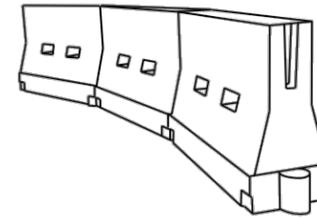

**LONGITUDINAL CHANNELIZING DEVICES (LCD)**


1. LCDs are crashworthy, lightweight, deformable devices that are highly visible, have good target value and can be connected together. They are not designed to contain or redirect a vehicle on impact.
2. LCDs may be used instead of a line of cones or drums.
3. LCDs shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
4. LCDs should not be used to provide positive protection for obstacles, pedestrians or workers.
5. LCDs shall be supplemented with retroreflective delineation as required for temporary barriers on BC(7) when placed roughly parallel to the travel lanes.
6. LCDs used as barricades placed perpendicular to traffic should have at least one row of reflective sheeting meeting the requirements for barricade rails as shown on BC(10). Place reflective sheeting near the top of the LCD along the full length of the device.

**WATER BALLASTED SYSTEMS USED AS BARRIERS**

1. Water ballasted systems used as barriers shall not be used solely to channelize road users, but also to protect the work space per the appropriate Manual for Assessing Safety Hardware (MASH) crashworthiness requirements based on roadway speed and barrier application.
2. Water ballasted systems used to channelize vehicular traffic shall be supplemented with retroreflective delineation or channelizing devices to improve daytime/nighttime visibility. They may also be supplemented with pavement markings.
3. Water ballasted systems used as barriers shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
4. Water ballasted systems used as barriers should not be used for a merging taper except in low speed (less than 45 MPH) urban areas. When used on a taper in a low speed urban area, the taper shall be delineated and the taper length should be designed to optimize road user operations considering the available geometric conditions.
5. When water ballasted systems used as barriers have blunt ends exposed to traffic, they should be attenuated as per manufacturer recommendations or flared to a point outside the clear zone.

If used to channelize pedestrians, longitudinal channelizing devices or water ballasted systems must have a continuous detectable bottom for users of long cones and the top of the unit shall not be less than 32 inches in height.

**HOLLOW OR WATER BALLASTED SYSTEMS USED AS LONGITUDINAL CHANNELIZING DEVICES OR BARRIERS**

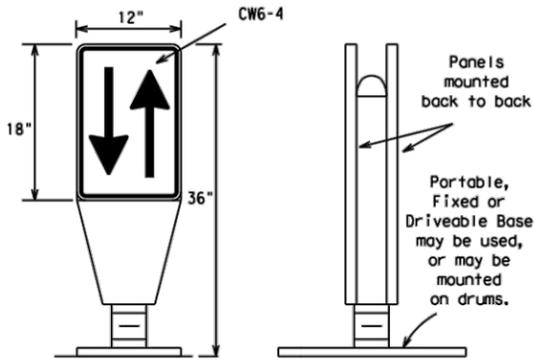

**OPPOSING TRAFFIC LANE DIVIDERS (OTLD)**

1. Opposing Traffic Lane Dividers (OTLD) are delineation devices designed to convert a normal one-way roadway section to two-way operation. OTLD's are used on temporary centerlines. The upward and downward arrows on the sign's face indicate the direction of traffic on either side of the divider. The base is secured to the pavement with an adhesive or rubber weight to minimize movement caused by a vehicle impact or wind gust.
2. The OTLD may be used in combination with 42" cones or VPs.
3. Spacing between the OTLD shall not exceed 500 feet. 42" cones or VPs placed between the OTLD's should not exceed 100 foot spacing.
4. The OTLD shall be orange with a black non-reflective legend. Sheeting for the OTLD shall be retroreflective Type B<sub>FL</sub> or Type C<sub>FL</sub> conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.

Posted Speed	Formula	Minimum Desirable Taper Lengths			Suggested Maximum Spacing of Channelizing Devices	
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent
30	L = WS <sup>2</sup> / 60	150'	165'	180'	30'	60'
35		205'	225'	245'	35'	70'
40		265'	295'	320'	40'	80'
45	L = WS	450'	495'	540'	45'	90'
50		500'	550'	600'	50'	100'
55		550'	605'	660'	55'	110'
60		600'	660'	720'	60'	120'
65		650'	715'	780'	65'	130'
70		700'	770'	840'	70'	140'
75		750'	825'	900'	75'	150'
80	800'	880'	960'	80'	160'	

\*\*Taper lengths have been rounded off.  
L=Length of Taper (FT.) W=Width of Offset (FT.)  
S=Posted Speed (MPH)

**SUGGESTED MAXIMUM SPACING OF CHANNELIZING DEVICES AND MINIMUM DESIRABLE TAPER LENGTHS**

SHEET 9 OF 12



**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**

**BC (9) - 21**

FILE:	bc-21.dgn	DN:	TxDOT	CR:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS									
9-07	8-14								
7-13	5-21	DIST	COUNTY	SHEET NO.					
						68			

DATE: FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


**TYPE 3 BARRICADES**

1. Refer to the Compliant Work Zone Traffic Control Devices List (CWZTCD) for details of the Type 3 Barricades and a list of all materials used in the construction of Type 3 Barricades.
2. Type 3 Barricades shall be used at each end of construction projects closed to all traffic.
3. Barricades extending across a roadway should have stripes that slope downward in the direction toward which traffic must turn in detouring. When both right and left turns are provided, the chevron striping may slope downward in both directions from the center of the barricade. Where no turns are provided at a closed road, striping should slope downward in both directions toward the center of roadway.
4. Striping of rails, for the right side of the roadway, should slope downward to the left. For the left side of the roadway, striping should slope downward to the right.
5. Identification markings may be shown only on the back of the barricade rails. The maximum height of letters and/or company logos used for identification shall be 1".
6. Barricades shall not be placed parallel to traffic unless an adequate clear zone is provided.
7. Warning lights shall NOT be installed on barricades.
8. Where barricades require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand is recommended. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight. Sand bags shall not be stacked in a manner that covers any portion of a barricade rails reflective sheeting. Rock, concrete, iron, steel or other solid objects will NOT be permitted. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall not be used for sandbags. Sandbags shall only be placed along or upon the base supports of the device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners.
9. Sheeting for barricades shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300 unless otherwise noted.

Barricades shall NOT be used as a sign support.




**TYPICAL STRIPING DETAIL FOR BARRICADE RAIL**

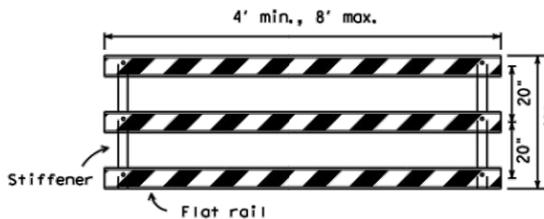

Stiffener may be inside or outside of support, but no more than 2 stiffeners shall be allowed on one barricade.


**TYPICAL PANEL DETAIL FOR SKID OR POST TYPE BARRICADES**

Each roadway of a divided highway shall be barricaded in the same manner.

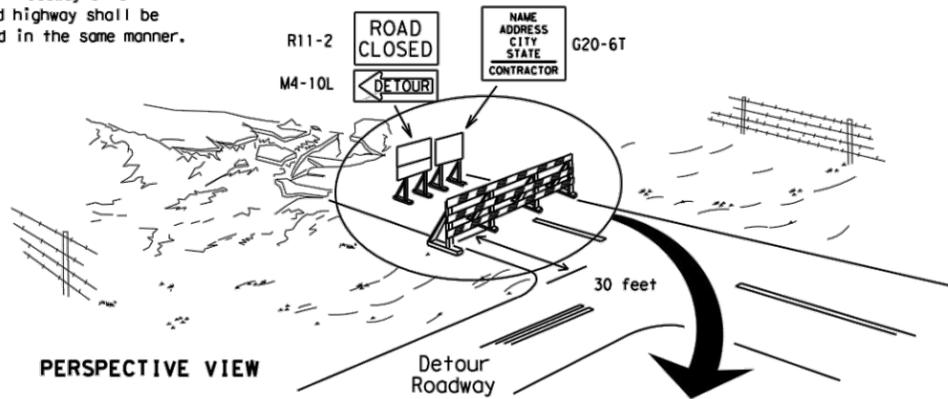

PERSPECTIVE VIEW


The three rails on Type 3 barricades shall be reflectorized orange and reflective white stripes on one side facing one-way traffic and both sides for two-way traffic. Barricade striping should slant downward in the direction of detour.

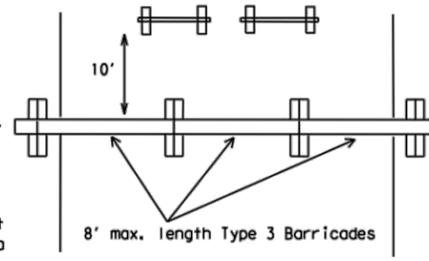

PLAN VIEW


1. Signs should be mounted on independent supports at a 7 foot mounting height in center of roadway. The signs should be a minimum of 10 feet behind Type 3 Barricades.
2. Advance signing shall be as specified elsewhere in the plans.

**TYPE 3 BARRICADE (POST AND SKID) TYPICAL APPLICATION**

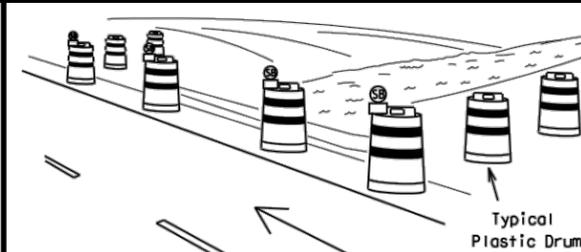

PERSPECTIVE VIEW

These drums are not required on one-way roadway

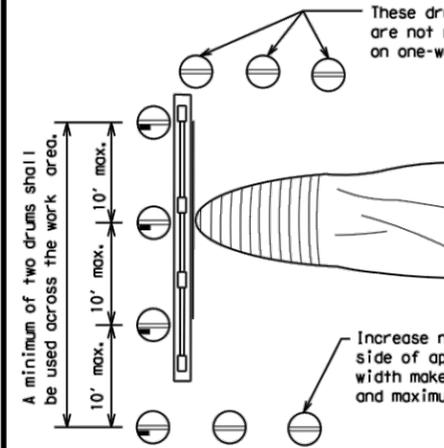


PLAN VIEW

**CULVERT WIDENING OR OTHER ISOLATED WORK WITHIN THE PROJECT LIMITS**

1. Where positive redirection capability is provided, drums may be omitted.
2. Plastic construction fencing may be used with drums for safety as required in the plans.
3. Vertical Panels on flexible support may be substituted for drums when the shoulder width is less than 4 feet.
4. When the shoulder width is greater than 12 feet, steady-burn lights may be omitted if drums are used.
5. Drums must extend the length of the culvert widening.

LEGEND	
	Plastic drum
	Plastic drum with steady burn light or yellow warning reflector
	Steady burn warning light or yellow warning reflector

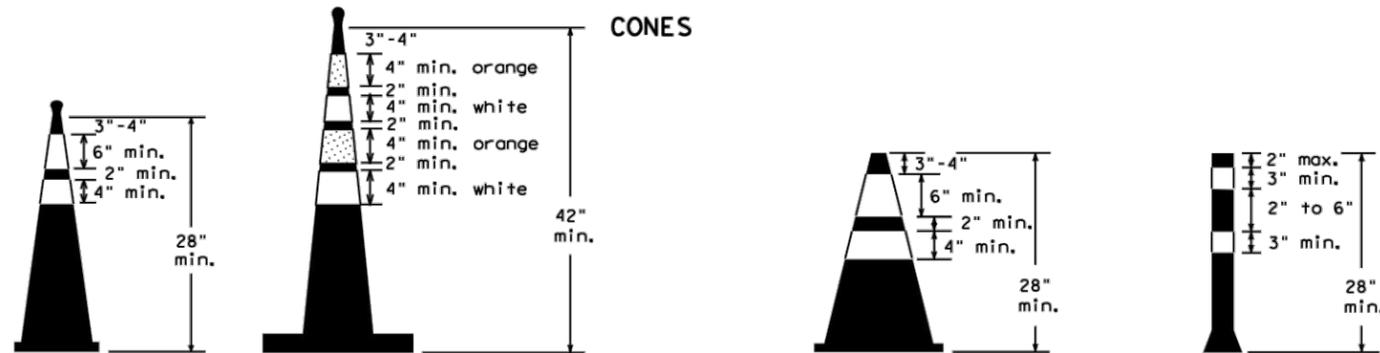


Two-Piece cones

One-Piece cones

Tubular Marker

28" Cones shall have a minimum weight of 9 1/2 lbs.  
42" 2-piece cones shall have a minimum weight of 30 lbs. including base.

1. Traffic cones and tubular markers shall be predominantly orange, and meet the height and weight requirements shown above.
2. One-piece cones have the body and base of the cone molded in one consolidated unit. Two-piece cones have a cone shaped body and a separate rubber base, or ballast, that is added to keep the device upright and in place.
3. Two-piece cones may have a handle or loop extending up to 8" above the minimum height shown, in order to aid in retrieving the device.
4. Cones or tubular markers shall have white or white and orange reflective bands as shown above. The reflective bands shall have a smooth, sealed outer surface and meet the requirements of Departmental Material Specification DMS-8300 Type A or Type B.
5. 28" cones and tubular markers are generally suitable for short duration and short-term stationary work as defined on BC(4). These should not be used for intermediate-term or long-term stationary work unless personnel is on-site to maintain them in their proper upright position.
6. 42" two-piece cones, vertical panels or drums are suitable for all work zone durations.
7. Cones or tubular markers used on each project should be of the same size and shape.

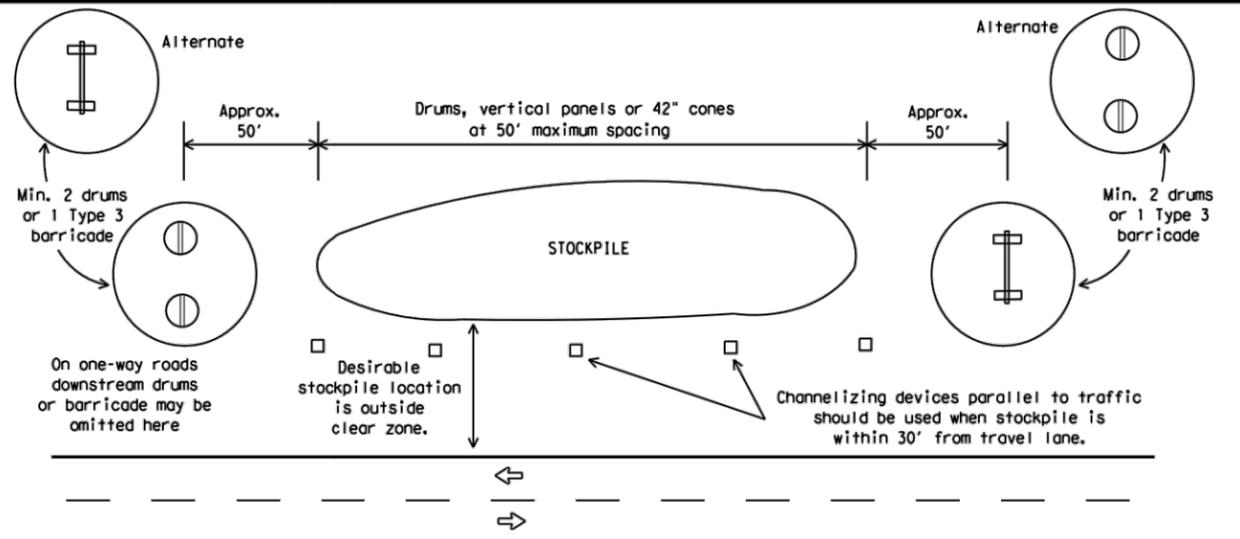

**TRAFFIC CONTROL FOR MATERIAL STOCKPILES**



**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**

**BC(10)-21**

FILE: bc-21.dgn	DW: TxDOT	CR: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS				
9-07 8-14	DIST		COUNTY	SHEET NO.
7-13 5-21				69

## WORK ZONE PAVEMENT MARKINGS

### GENERAL

- The Contractor shall be responsible for maintaining work zone and existing pavement markings, in accordance with the standard specifications and special provisions, on all roadways open to traffic within the CSJ limits unless otherwise stated in the plans.
- Color, patterns and dimensions shall be in conformance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- Additional supplemental pavement marking details may be found in the plans or specifications.
- Pavement markings shall be installed in accordance with the TMUTCD and as shown on the plans.
- When short term markings are required on the plans, short term markings shall conform with the TMUTCD, the plans and details as shown on the Standard Plan Sheet WZ(STPM).
- When standard pavement markings are not in place and the roadway is opened to traffic, DO NOT PASS signs shall be erected to mark the beginning of the sections where passing is prohibited and PASS WITH CARE signs at the beginning of sections where passing is permitted.
- All work zone pavement markings shall be installed in accordance with Item 662, "Work Zone Pavement Markings."

### RAISED PAVEMENT MARKERS

- Raised pavement markers are to be placed according to the patterns on BC(12).
- All raised pavement markers used for work zone markings shall meet the requirements of Item 672, "RAISED PAVEMENT MARKERS" and Departmental Material Specification DMS-4200 or DMS-4300.

### PREFABRICATED PAVEMENT MARKINGS

- Removable prefabricated pavement markings shall meet the requirements of DMS-8241.
- Non-removable prefabricated pavement markings (foil back) shall meet the requirements of DMS-8240.


### MAINTAINING WORK ZONE PAVEMENT MARKINGS

- The Contractor will be responsible for maintaining work zone pavement markings within the work limits.
- Work zone pavement markings shall be inspected in accordance with the frequency and reporting requirements of work zone traffic control device inspections as required by Form 599.
- The markings should provide a visible reference for a minimum distance of 300 feet during normal daylight hours and 160 feet when illuminated by automobile low-beam headlights at night, unless sight distance is restricted by roadway geometrics.
- Markings failing to meet this criteria within the first 30 days after placement shall be replaced at the expense of the Contractor as per Specification Item 662.

### REMOVAL OF PAVEMENT MARKINGS

- Pavement markings that are no longer applicable, could create confusion or direct a motorist toward or into the closed portion of the roadway shall be removed or obliterated before the roadway is opened to traffic.
- The above shall not apply to detours in place for less than three days, where flaggers and/or sufficient channelizing devices are used in lieu of markings to outline the detour route.
- Pavement markings shall be removed to the fullest extent possible, so as not to leave a discernable marking. This shall be by any method approved by TxDOT Specification Item 677 for "Eliminating Existing Pavement Markings and Markers".
- The removal of pavement markings may require resurfacing or seal coating portions of the roadway as described in Item 677.
- Subject to the approval of the Engineer, any method that proves to be successful on a particular type pavement may be used.
- Blast cleaning may be used but will not be required unless specifically shown in the plans.
- Over-painting of the markings SHALL NOT BE permitted.
- Removal of raised pavement markers shall be as directed by the Engineer.
- Removal of existing pavement markings and markers will be paid for directly in accordance with Item 677, "ELIMINATING EXISTING PAVEMENT MARKINGS AND MARKERS," unless otherwise stated in the plans.
- Black-out marking tape may be used to cover conflicting existing markings for periods less than two weeks when approved by the Engineer.

## Temporary Flexible-Reflective Roadway Marker Tabs

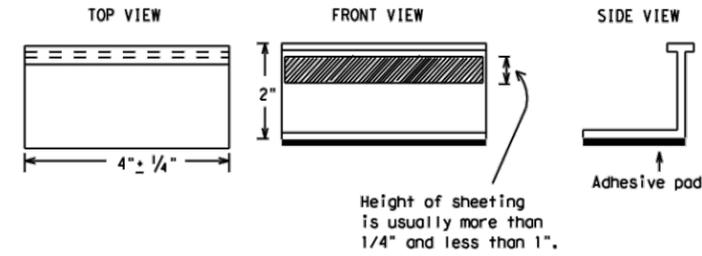

**STAPLES OR NAILS SHALL NOT BE USED TO SECURE  
TEMPORARY FLEXIBLE-REFLECTIVE ROADWAY MARKER  
TABS TO THE PAVEMENT SURFACE**

- Temporary flexible-reflective roadway marker tabs used as guidemarks shall meet the requirements of DMS-8242.
- Tabs detailed on this sheet are to be inspected and accepted by the Engineer or designated representative. Sampling and testing is not normally required, however at the option of the Engineer, either "A" or "B" below may be imposed to assure quality before placement on the roadway.
  - Select five (5) or more tabs at random from each lot or shipment and submit to the Construction Division, Materials and Pavement Section to determine specification compliance.
  - Select five (5) tabs and perform the following test. Affix five (5) tabs at 24 inch intervals on an asphaltic pavement in a straight line. Using a medium size passenger vehicle or pickup, run over the markers with the front and rear tires at a speed of 35 to 40 miles per hour, four (4) times in each direction. No more than one (1) out of the five (5) reflective surfaces shall be lost or displaced as a result of this test.
- Small design variances may be noted between tab manufacturers.
- See Standard Sheet WZ(STPM) for tab placement on new pavements. See Standard Sheet TCP(7-1) for tab placement on seal coat work.

### RAISED PAVEMENT MARKERS USED AS GUIDEMARKS

- Raised pavement markers used as guidemarks shall be from the approved product list, and meet the requirements of DMS-4200.
- All temporary construction raised pavement markers provided on a project shall be of the same manufacturer.
- Adhesive for guidemarks shall be bituminous material hot applied or butyl rubber pad for all surfaces, or thermoplastic for concrete surfaces.

Guidemarks shall be designated as:

- YELLOW - (two amber reflective surfaces with yellow body).
- WHITE - (one silver reflective surface with white body).

DEPARTMENTAL MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
TRAFFIC BUTTONS	DMS-4300
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240
TEMPORARY REMOVABLE, PREFABRICATED PAVEMENT MARKINGS	DMS-8241
TEMPORARY FLEXIBLE, REFLECTIVE ROADWAY MARKER TABS	DMS-8242

A list of prequalified reflective raised pavement markers, non-reflective traffic buttons, roadway marker tabs and other pavement markings can be found at the Material Producer List web address shown on BC(1).

SHEET 11 OF 12



## BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS

**BC(11)-21**





FILE: bc-21.dgn	DN: TxDOT	CR: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS				
2-98	9-07	5-21		
1-02	7-13			
11-02	8-14			
	DIST	COUNTY	SHEET NO.	
			70	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:  
FILE:



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

## PAVEMENT MARKING PATTERNS

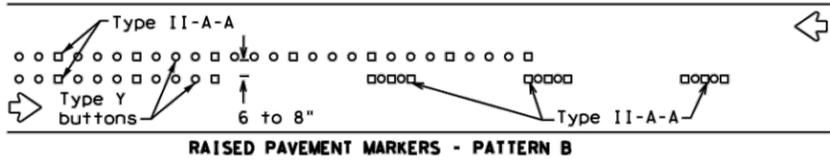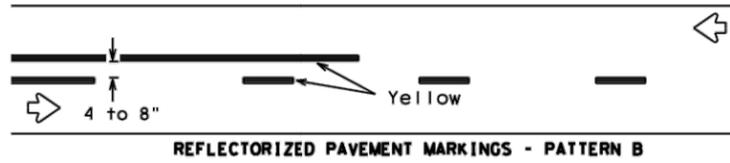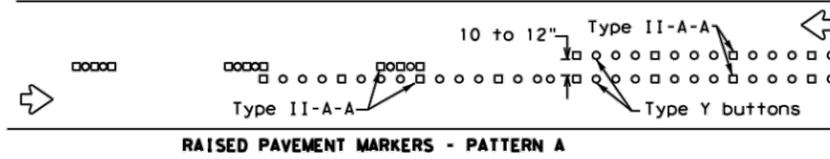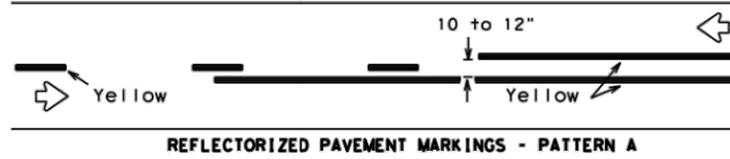



Pattern A is the TxDOT Standard, however Pattern B may be used if approved by the Engineer. Prefabricated markings may be substituted for reflectorized pavement markings.

## CENTER LINE & NO-PASSING ZONE BARRIER LINES FOR TWO-LANE, TWO-WAY HIGHWAYS

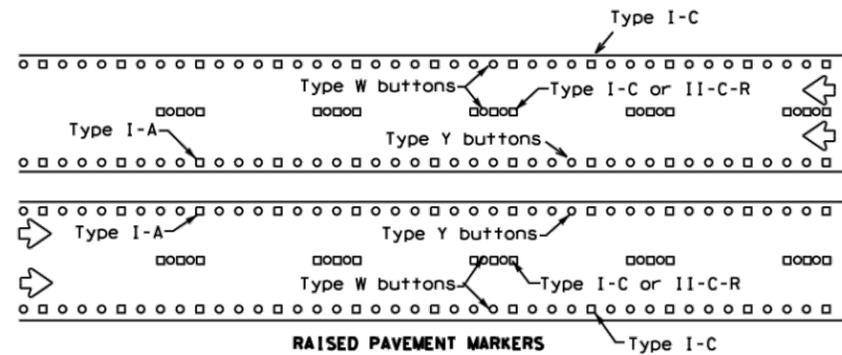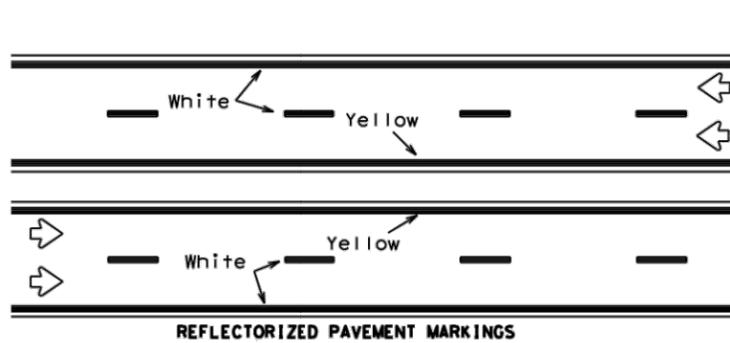



Prefabricated markings may be substituted for reflectorized pavement markings.

## EDGE & LANE LINES FOR DIVIDED HIGHWAY

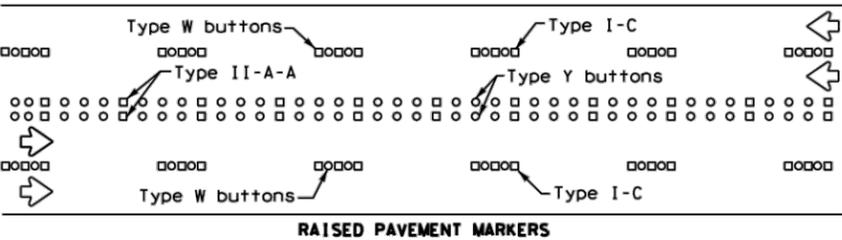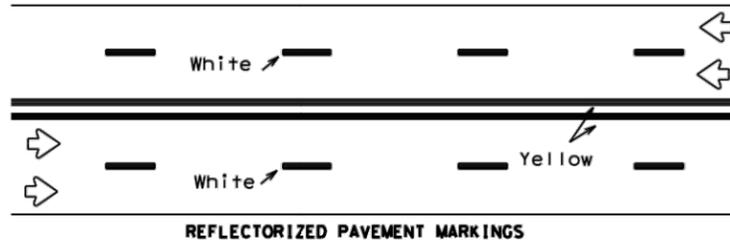

Prefabricated markings may be substituted for reflectorized pavement markings.


## LANE & CENTER LINES FOR MULTILANE UNDIVIDED HIGHWAYS

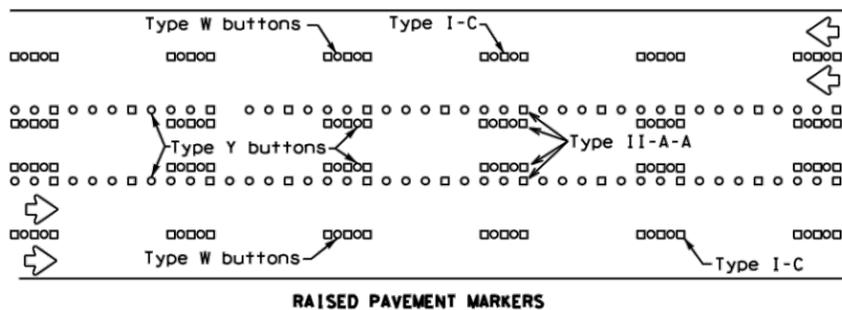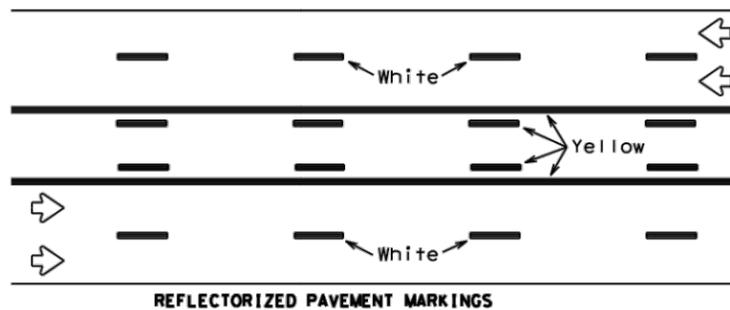




Prefabricated markings may be substituted for reflectorized pavement markings.

## TWO-WAY LEFT TURN LANE


## STANDARD WORK ZONE PAVEMENT MARKINGS DETAILS

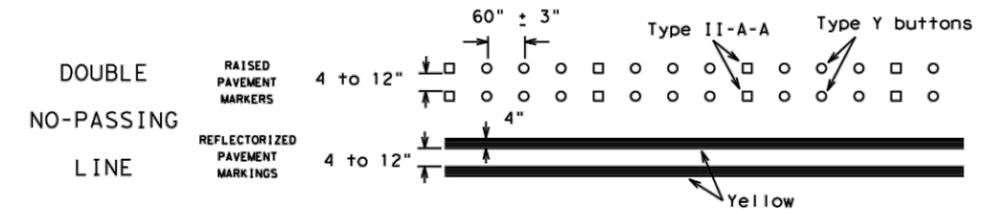

### SOLID LINES

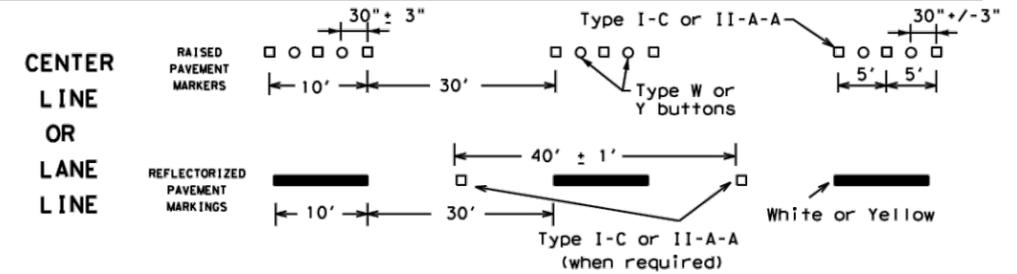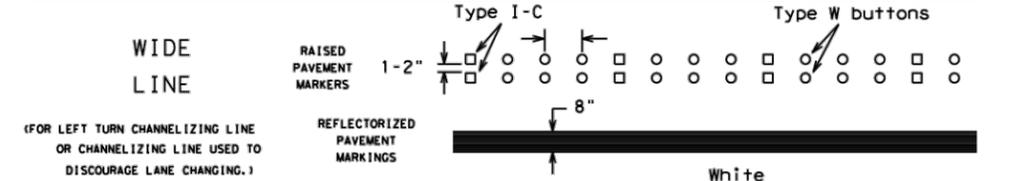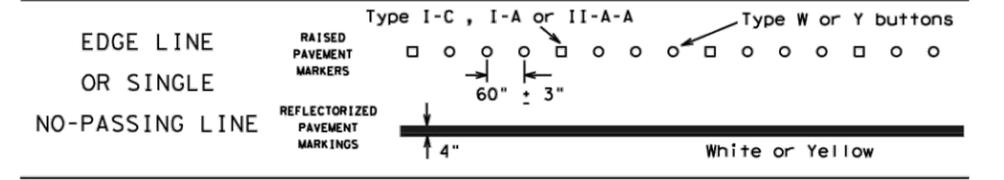


### BROKEN LINES

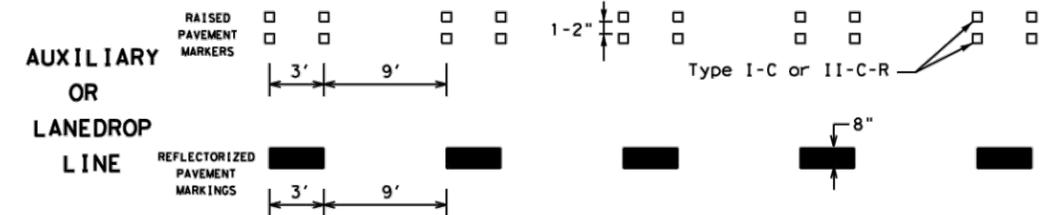

### REMOVABLE MARKINGS WITH RAISED PAVEMENT MARKERS

If raised pavement markers are used to supplement REMOVABLE markings, the markers shall be applied to the top of the tape at the approximate mid length of tape used for broken lines or at 20 foot spacing for solid lines. This allows an easier removal of raised pavement markers and tape.

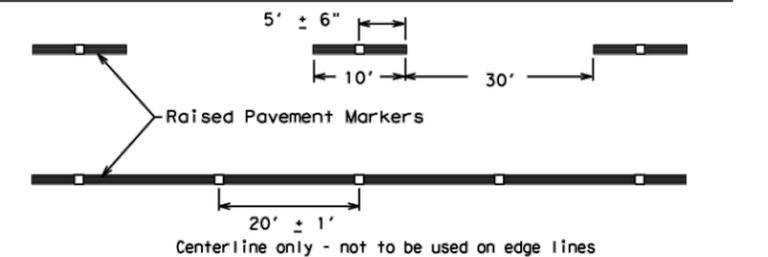

SHEET 12 OF 12



## BARRICADE AND CONSTRUCTION PAVEMENT MARKING PATTERNS


BC(12)-21

Raised pavement markers used as standard pavement markings shall be from the approved products list and meet the requirements of Item 672 "RAISED PAVEMENT MARKERS."

FILE: bc-21.dgn	DN: TxDOT	CR: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
1-97 9-07 5-21	DIST	COUNTY	SHEET NO.	
2-98 7-13			71	
11-02 8-14				

DATE:  
FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

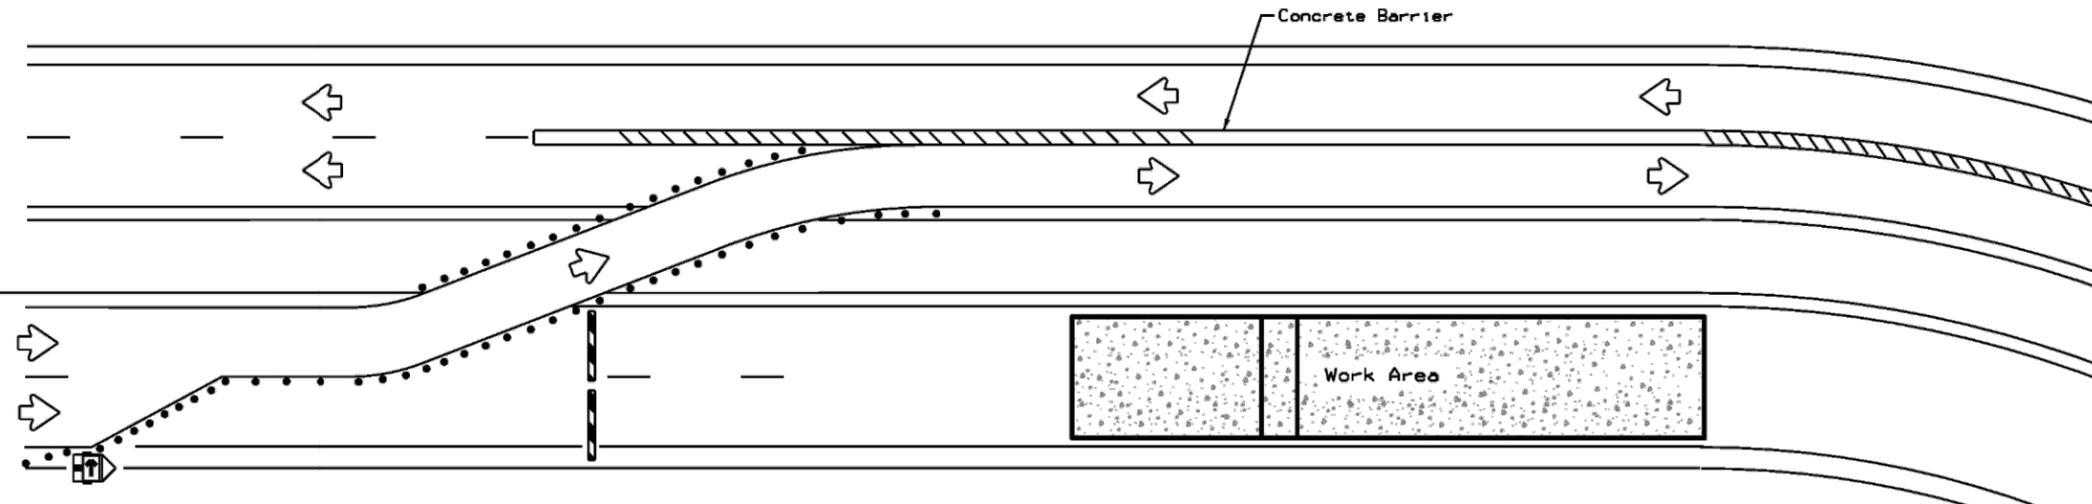

- NOTES:**
1. Length of Safety Glare screen will be specified elsewhere in the plans.
  2. The cumulative nominal length of the modular safety glare screen units shall equal the length of the individual sections of temporary concrete traffic barrier on which they are installed so the joint between barrier sections will not be spanned by any one safety glare screen unit.
  3. Screen Panel/blades will be designed such that reflective sheeting conforming with Departmental Material Specification DMS-8300, Sign Face Materials, Type B or C Yellow, minimum size of 2 inches by 12 inches can be attached to the edge of the panel/blade. The sheeting shall be attached to one glare screen panel/blade per section of concrete barrier not to exceed a spacing of 30 feet. Barrier reflectors are not necessary when panel/blades are installed with reflective sheeting as described.
  4. Payment for these devices will be under statewide Special Specification "Modular Glare Screens for Headlight Barrier."
  5. This detail is only intended to show types of locations where Glare Screens would be appropriate. Required signing and other devices shall be as shown elsewhere in the plans.


**BARRIER DELINEATION WITH MODULAR GLARE SCREENS**

LEGEND	
	Type 3 Barricade
	Channelizing Devices
	Trailer Mounted Flashing Arrow Board
	Sign
	Safety glare screen

DEPARTMENTAL MATERIAL SPECIFICATIONS	
SIGN FACE MATERIALS	DMS-8300
DELINEATORS AND OBJECT MARKERS	DMS-8600
MODULAR GLARE SCREENS FOR HEADLIGHT BARRIER	DMS-8610

Only pre-qualified products shall be used. A copy of the Compliant Work Zone Traffic Control Devices List (CWZTCD) describes pre-qualified products and their sources and may be found at the following web address:

<http://www.txdot.gov/business/resources/producer-list.html>

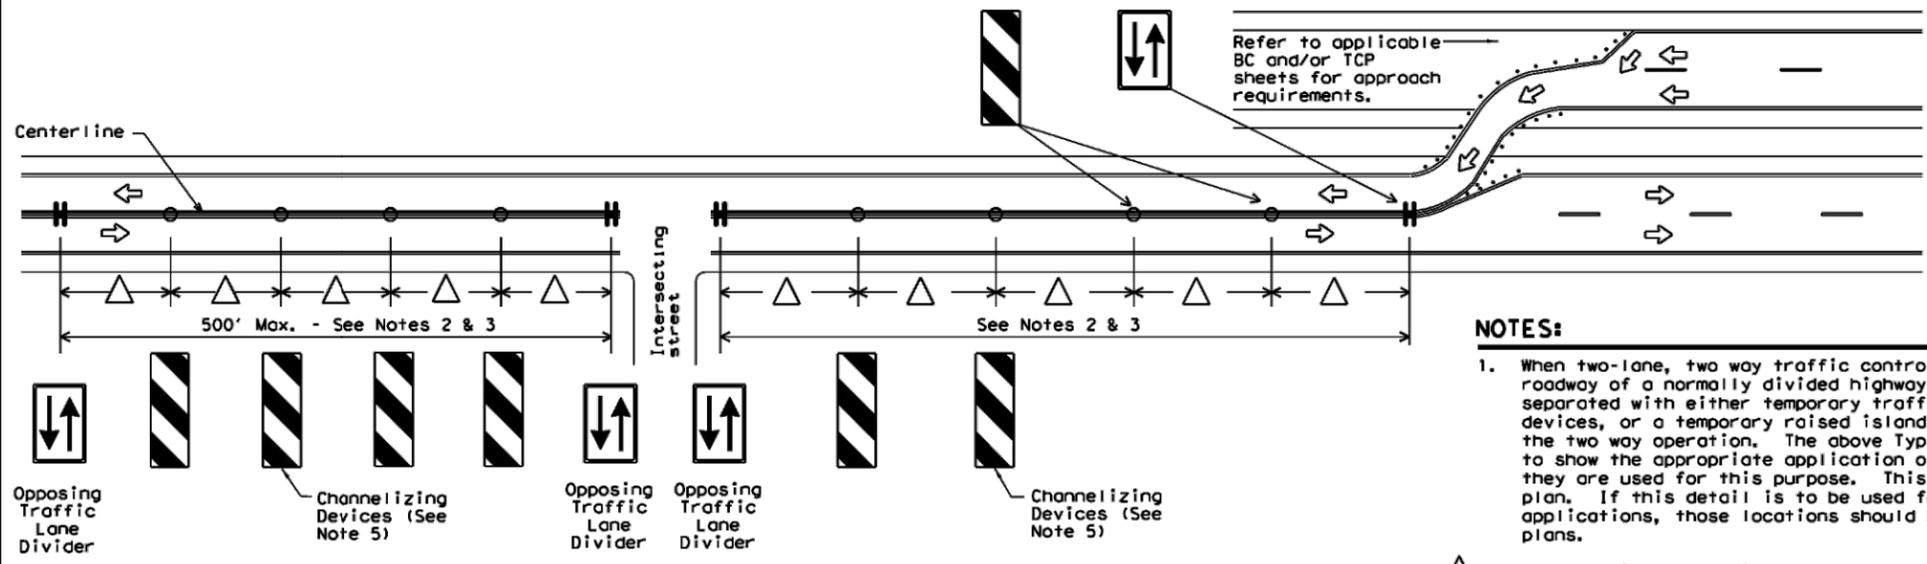

- NOTES:**
1. When two-lane, two way traffic control must be maintained on one roadway of a normally divided highway, opposing traffic shall be separated with either temporary traffic barriers, channelizing devices, or a temporary raised island throughout the length of the two way operation. The above Typical Application is intended to show the appropriate application of channelizing devices when they are used for this purpose. This is not a traffic control plan. If this detail is to be used for other types of roads or applications, those locations should be stated elsewhere in the plans.
  2. Space devices according to the Tangent Spacing shown on the Device Spacing table on BC(9) but not exceeding 100'.
  3. Every fifth device should be an OTLD except when spaced closer to accommodate an intersection. An OTLD should be the first device on each side of intersecting streets or roads.
  4. Locations where surface mount bases with adhesives or self-righting devices will be required in order to maintain them in their proper position should be noted elsewhere in the plans.
  5. Channelizing devices are to be vertical panels, 42" cones or tubular markers that are at least 36" tall. Tubular markers used to separate traffic should have a rubber base weighing at least 30 pounds. Tubular markers that are 42" tall or more shall have four bands of reflective material as detailed for 42" cones on BC(10). Tubular markers less than 42" but at least 36" tall shall have three bands of 3" wide white reflective material spaced 2" apart. Reflective material shall meet DMS-8300, Type A.


**VERTICAL PANELS & OPPOSING TRAFFIC LANE DIVIDERS (OTLD) SEPARATING TWO-WAY TRAFFIC ON NORMALLY DIVIDED HIGHWAYS**

		Traffic Operations Division Standard	
<b>TRAFFIC CONTROL PLAN TYPICAL DETAILS</b>			
<b>WZ(TD) - 17</b>			
FILE: wzt-d-17.dgn	DATE: TxDOT	CR: TxDOT	DW: TxDOT
© TxDOT February 1998	CONT	SECT	JOB
4-98	2-17	DIST	COUNTY
3-03			SHEET NO.
7-13			72

DATE: FILE:


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

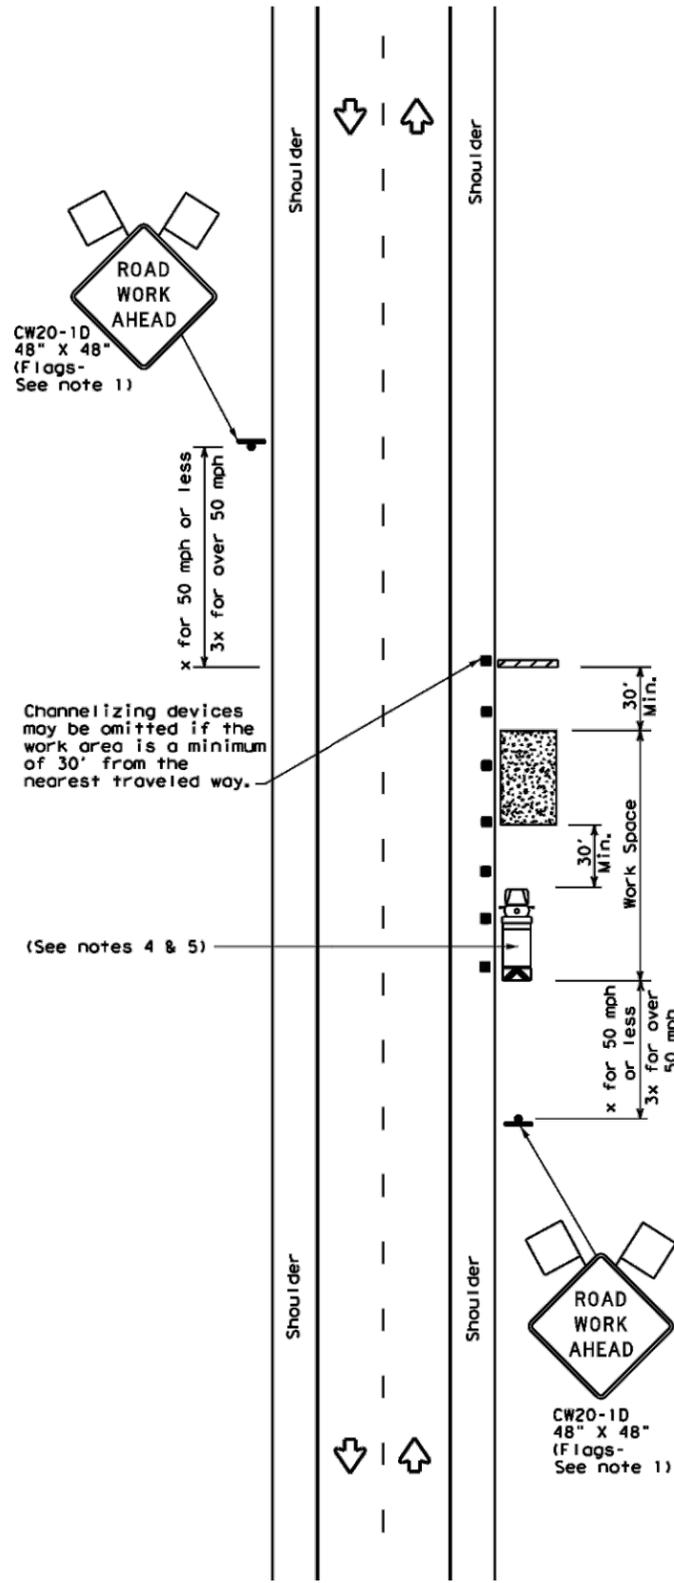


TCP (2-1a)

**WORK SPACE NEAR SHOULDER**  
Conventional Roads

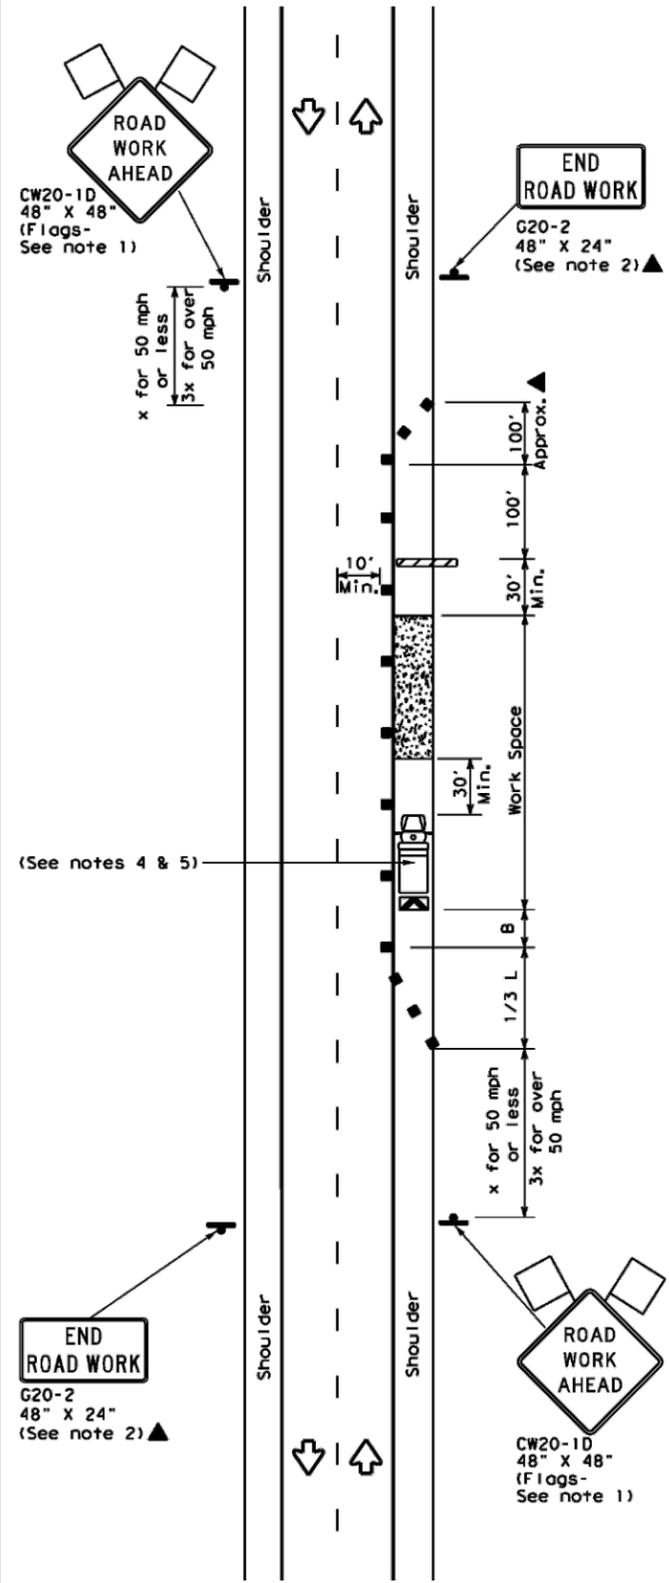

TCP (2-1b)

**WORK SPACE ON SHOULDER**  
Conventional Roads

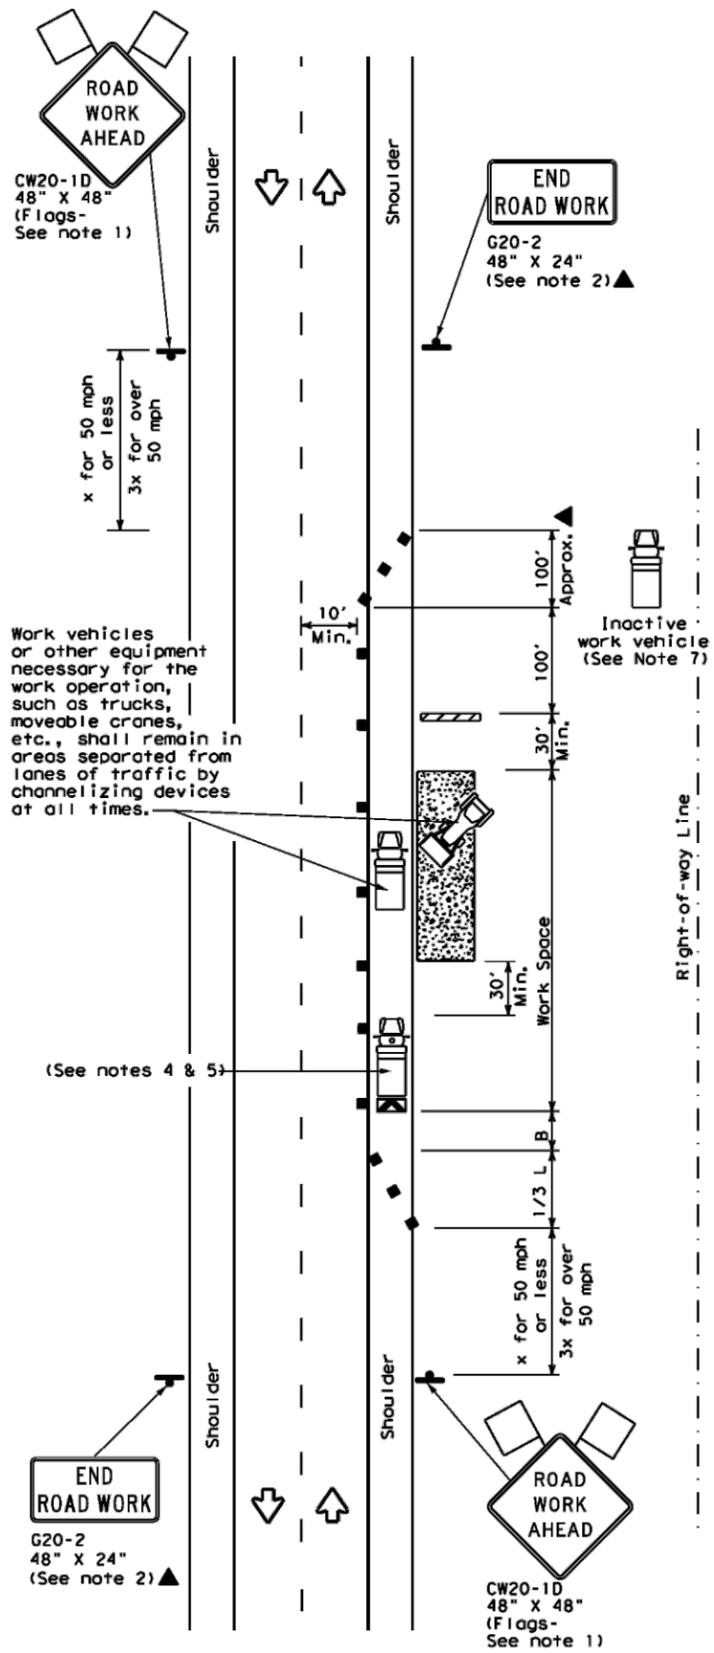

TCP (2-1c)

**WORK VEHICLES ON SHOULDER**  
Conventional Roads

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "x" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40	L = WS	265'	295'	320'	40'	80'	240'	155'
45		450'	495'	540'	45'	90'	320'	195'
50	L = WS	500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60	L = WS	600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70	L = WS	700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

\* Conventional Roads Only  
\*\* Taper lengths have been rounded off.  
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	✓

- GENERAL NOTES**
- Flags attached to signs where shown, are REQUIRED.
  - All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated in the plans, or for routine maintenance work, when approved by the Engineer.
  - Stockpiled material should be placed a minimum of 30 feet from nearest traveled way.
  - Shadow Vehicle with TMA and high intensity rotating, flashing, oscillating or strobe lights. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
  - Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect a wider work space.
  - See TCP(5-1) for shoulder work on divided highways, expressways and freeways.
  - Inactive work vehicles or other equipment should be parked near the right-of-way line and not parked on the paved shoulder.
  - CW21-5 "SHOULDER WORK" signs may be used in place of CW20-1D "ROAD WORK AHEAD" signs for shoulder work on conventional roadways.


**TRAFFIC CONTROL PLAN**  
**CONVENTIONAL ROAD**  
**SHOULDER WORK**

**TCP (2-1) - 18**


FILE: tcp2-1-18.dgn	EN: [ ]	CKI: [ ]	DW: [ ]	CKI: [ ]
© TxDOT December 1985	CONT: [ ]	SECT: [ ]	JOB: [ ]	HIGHWAY: [ ]
2-94 4-98	REVISIONS			
8-95 2-12	DIST: [ ]	COUNTY: [ ]	SHEET NO. [ ]	
1-97 2-18	[ ]			

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect or damages resulting from its use.

DATE: FILE:

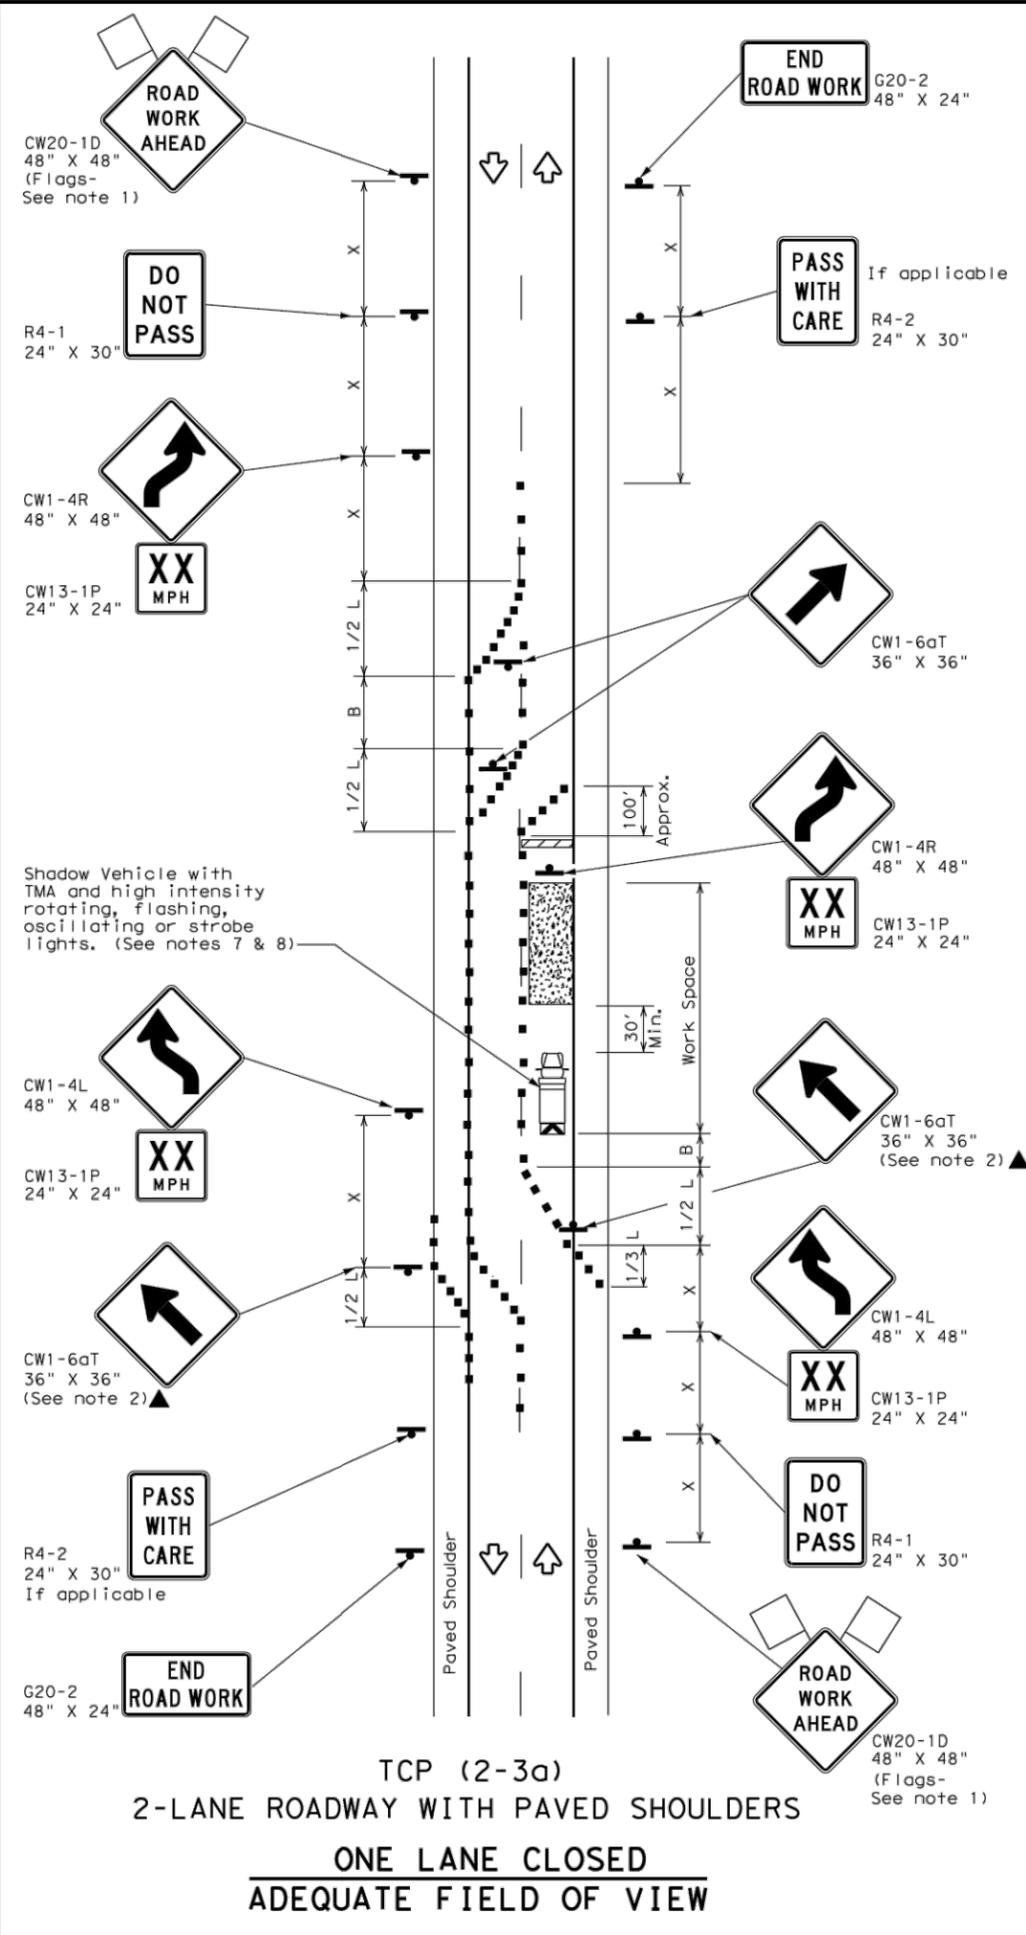

TCP (2-3a)  
2-LANE ROADWAY WITH PAVED SHOULDERS  
**ONE LANE CLOSED**  
ADEQUATE FIELD OF VIEW

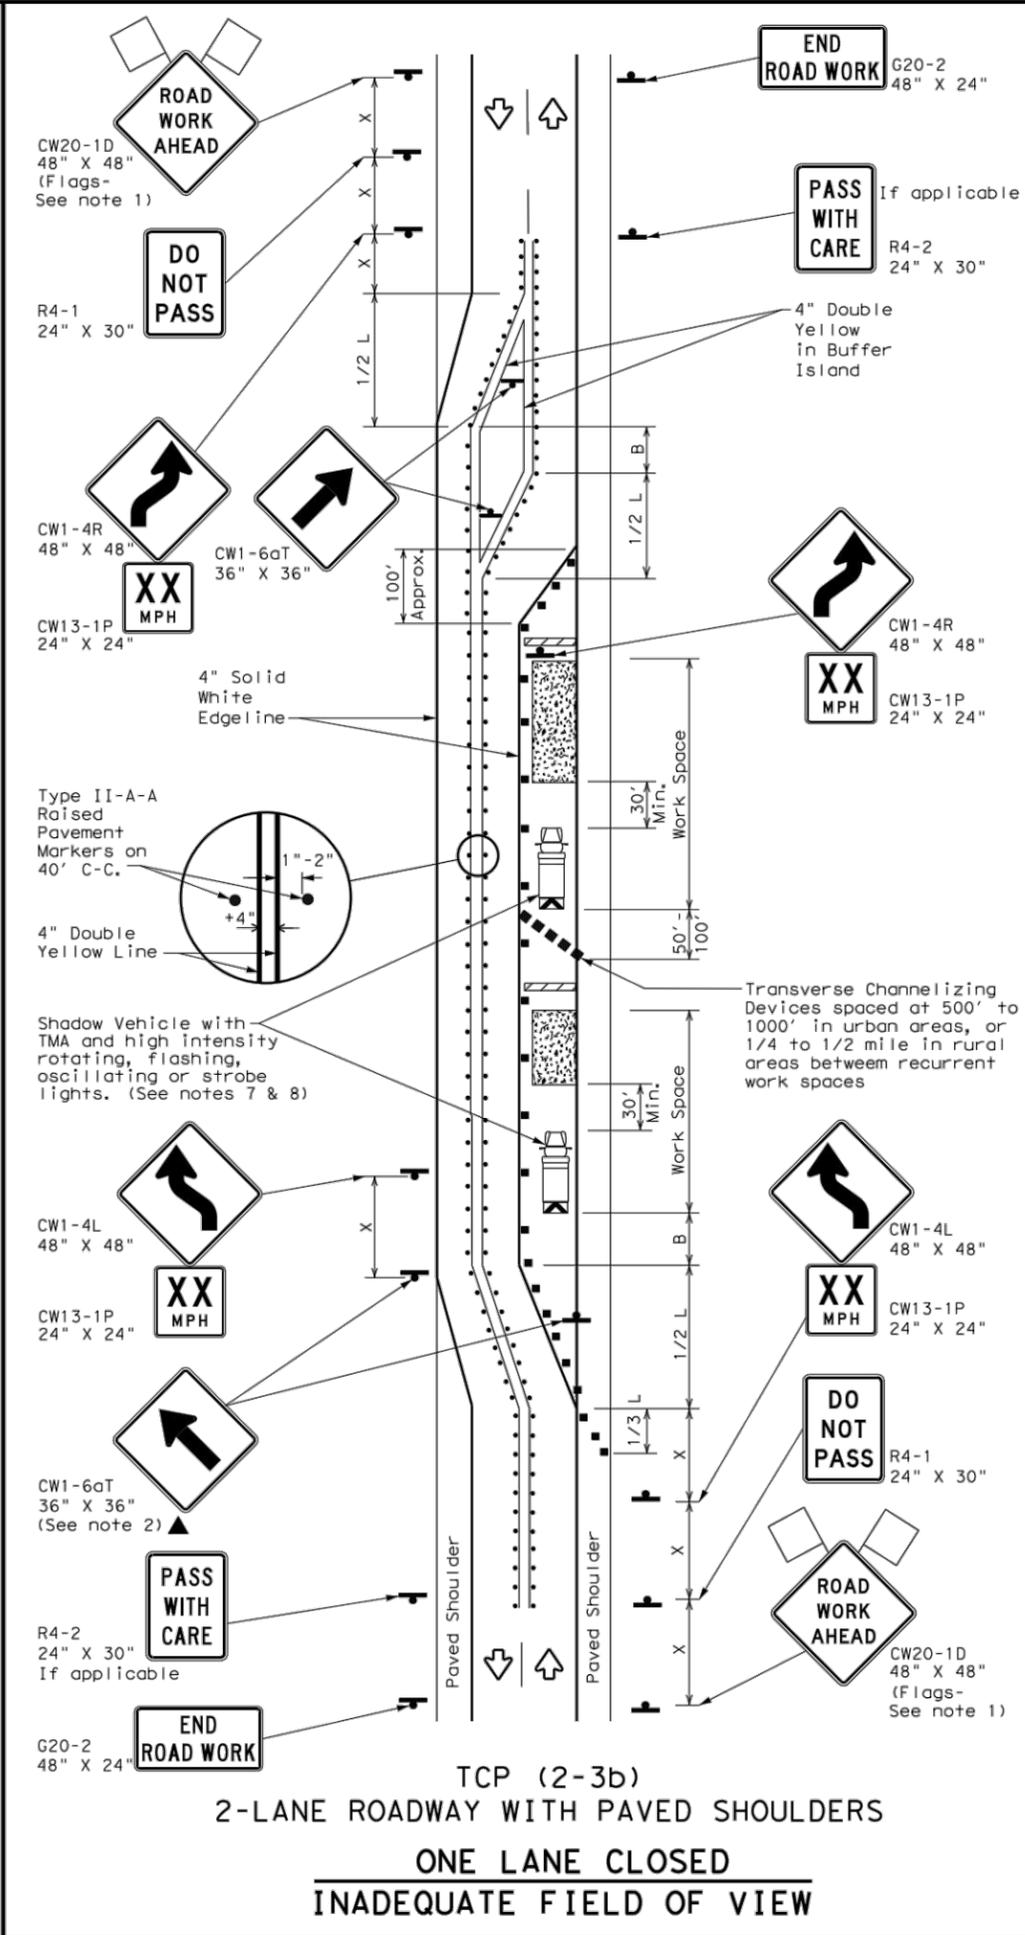

TCP (2-3b)  
2-LANE ROADWAY WITH PAVED SHOULDERS  
**ONE LANE CLOSED**  
INADEQUATE FIELD OF VIEW

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Raised Pavement Markers Ty II-AA
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "X" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L = WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70		700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

\* Conventional Roads Only  
\*\* Taper lengths have been rounded off.  
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
			✓	✓
				TCP (2-3b) ONLY

- GENERAL NOTES**
- Flags attached to signs where shown, are REQUIRED.
  - All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.
  - When work space will be in place less than three days existing pavement markings may remain in place. Channelizing devices shall be used to separate traffic.
  - Flagger control should NOT be used unless roadway conditions or heavy traffic volume require additional emphasis to safely control traffic. Flagger should be positioned at end of traffic queue.
  - The R4-1 "DO NOT PASS," R4-2 "PASS WITH CARE" and construction regulatory speed zone signs may be installed within CW20-1D "ROAD WORK AHEAD" signs. Proper spacing of signs shall be maintained.
  - Conflicting pavement marking shall be removed for long term projects.
  - A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted.
  - Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect a wider work space.
- TCP (2-3a)**
- Conflicting pavement markings shall be removed for long-term projects. For shorter durations where traffic is directed over a yellow centerline, channelizing devices which separate two-way traffic should be spaced on tapers at 20' or 15' if posted speeds are 35 mph or slower, and for tangent sections, at 1/2(S) where S is the speed in mph. This tighter device spacing is intended for the area of the conflicting markings, not the entire work zone.

Texas Department of Transportation  
Traffic Operations Division Standard


## TRAFFIC CONTROL PLAN TRAFFIC SHIFTS ON TWO-LANE ROADS

### TCP (2-3) - 18


FILE: tcp(2-3)-18.dgn	DN:	CK:	DW:	CK:
© TxDOT December 1985	CONT	SECT	JOB	HIGHWAY
REVISIONS				
8-95 3-03				
1-97 2-12				
4-98 2-18				
	DIST	COUNTY	SHEET NO.	
			74	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

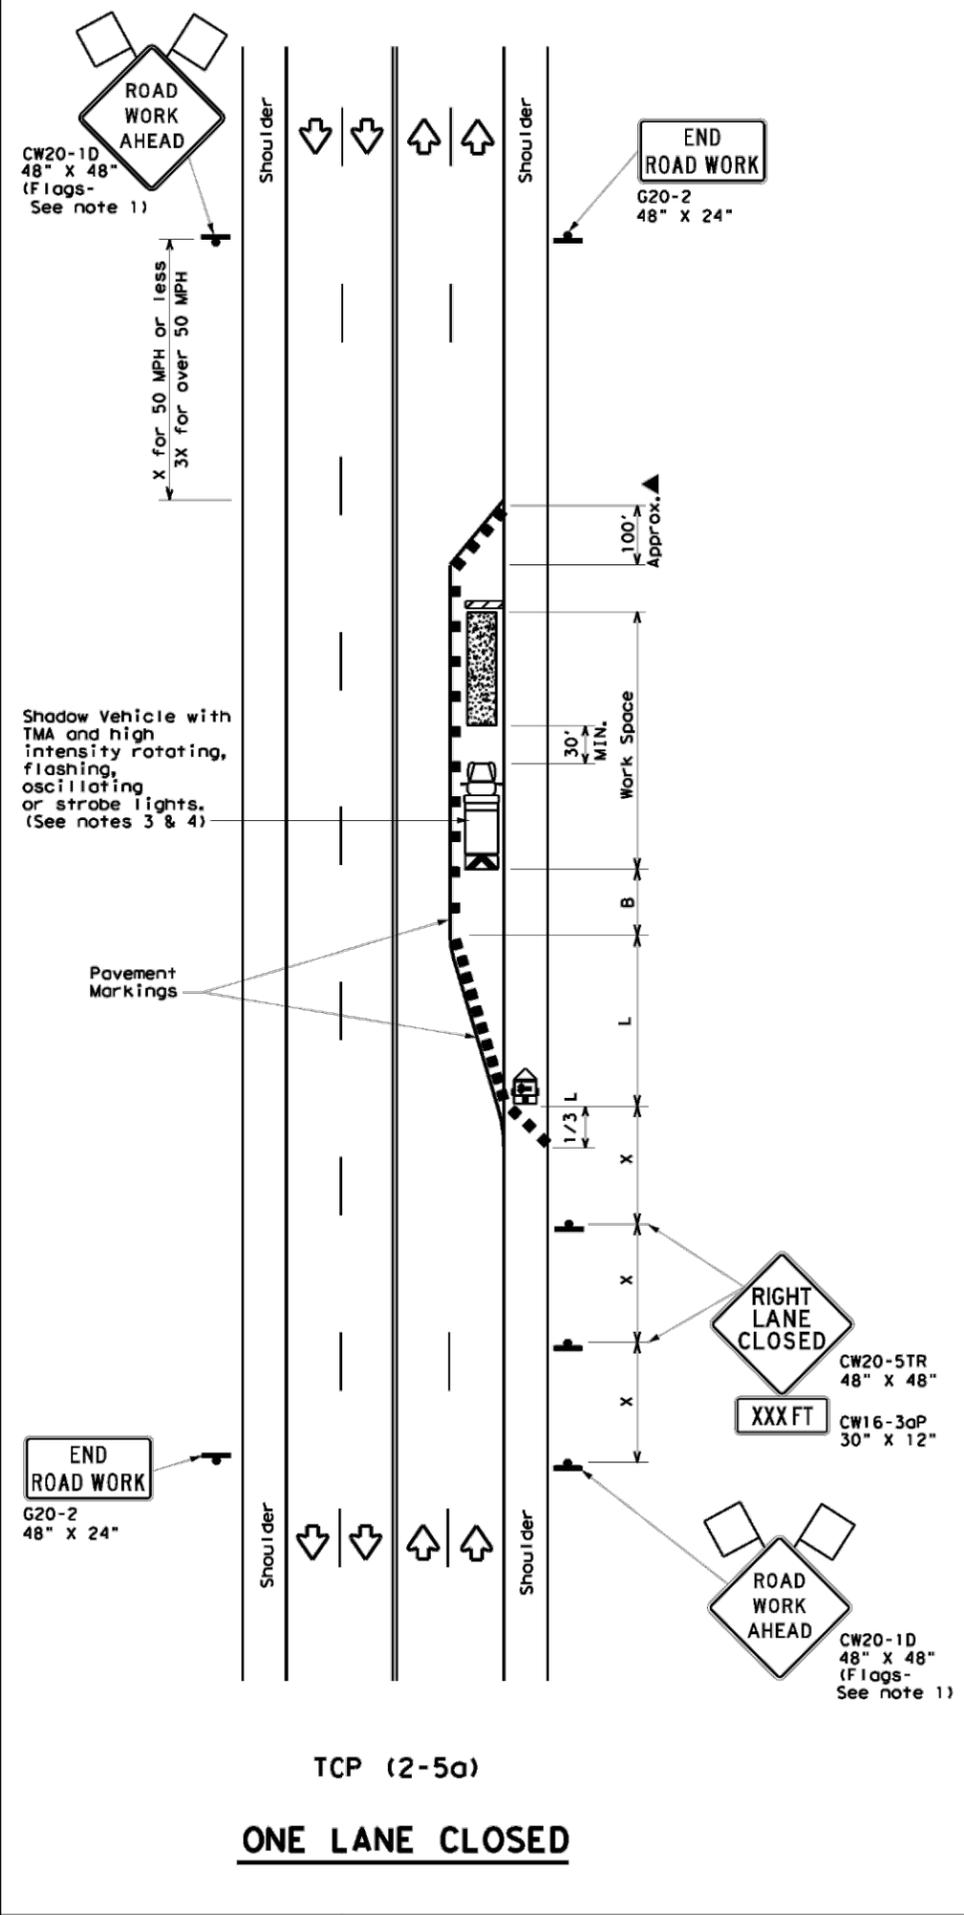

TCP (2-5a)  
**ONE LANE CLOSED**

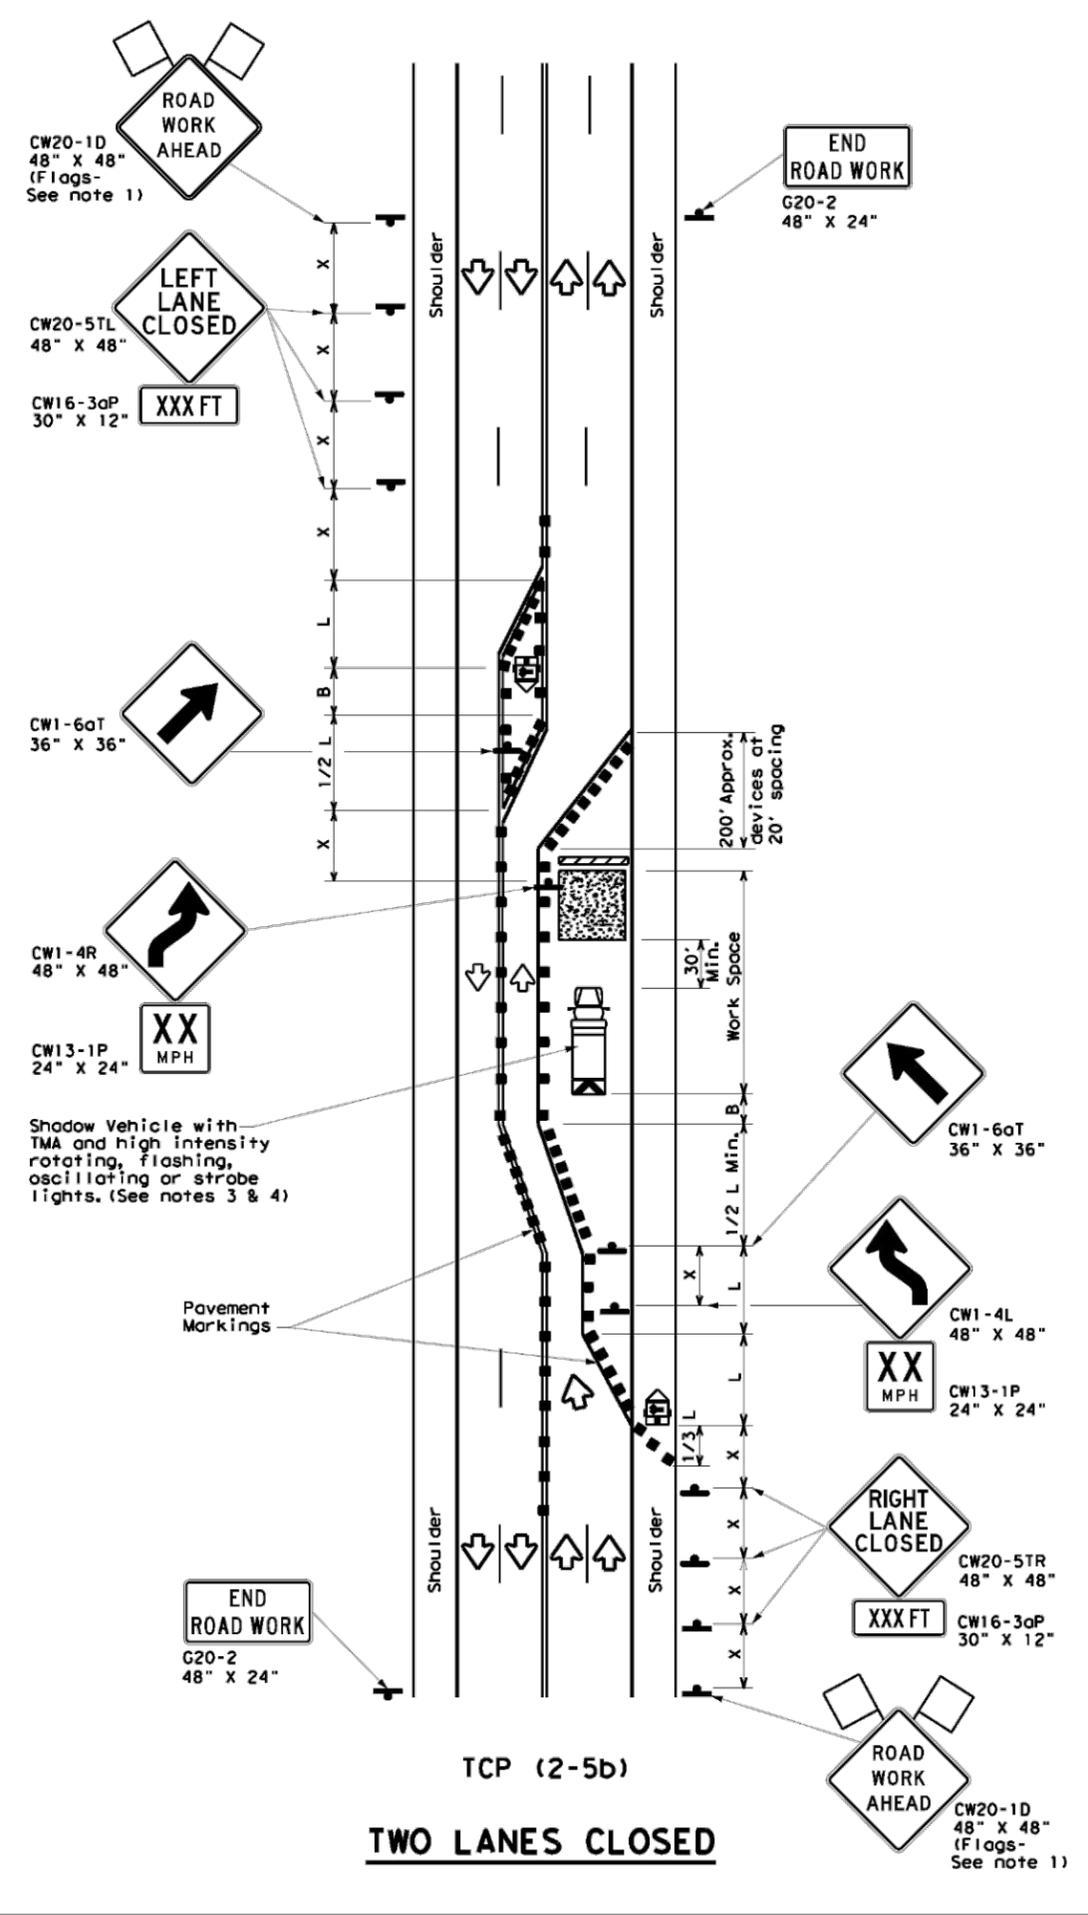

TCP (2-5b)  
**TWO LANES CLOSED**

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "x" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40	L = WS	265'	295'	320'	40'	80'	240'	155'
45		450'	495'	540'	45'	90'	320'	195'
50	L = WS	500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60	L = WS	600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70	L = WS	700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

\* Conventional Roads Only  
 \*\* Taper lengths have been rounded off.  
 L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
			✓	✓

- GENERAL NOTES**
- Flags attached to signs where shown, are REQUIRED.
  - All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.
  - A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
  - Additional Shadow Vehicles with TMAs may be positioned in each closed lane, on the shoulder or off the paved surface, next to those shown in order to protect a wider work space.
  - The downstream taper is optional. When used, it should be 100 feet approximately per lane, with channelizing devices spaced at 20 feet.

**TCP (2-5a)**

- If this TCP is used for a left lane closure, CW20-5TL "LEFT LANE CLOSED" signs shall be used and channelizing devices shall be placed on the centerline to protect the work space from opposing traffic, with the arrow board placed in the closed lane near the end of the merging taper.

**TCP (2-5b)**

- Conflicting pavement markings shall be removed for long-term projects.

Traffic Operations Division Standard

**TEXAS DEPARTMENT OF TRANSPORTATION**




**TRAFFIC CONTROL PLAN  
LONG TERM LANE CLOSURES  
MULTILANE CONVENTIONAL RDS.**

**TCP (2-5) - 18**

FILE: tcp2-5-18.dgn	DN: 1	CR: 1	DR: 1	CR: 1
© TxDOT December 1985	COM: 1	SECT: 1	JOB: 1	HIGHWAY: 1
8-95 2-12	REVISIONS			
1-97 3-03	DIST: 1	COUNTY: 1	SHEET NO. 75	
4-98 2-18				

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

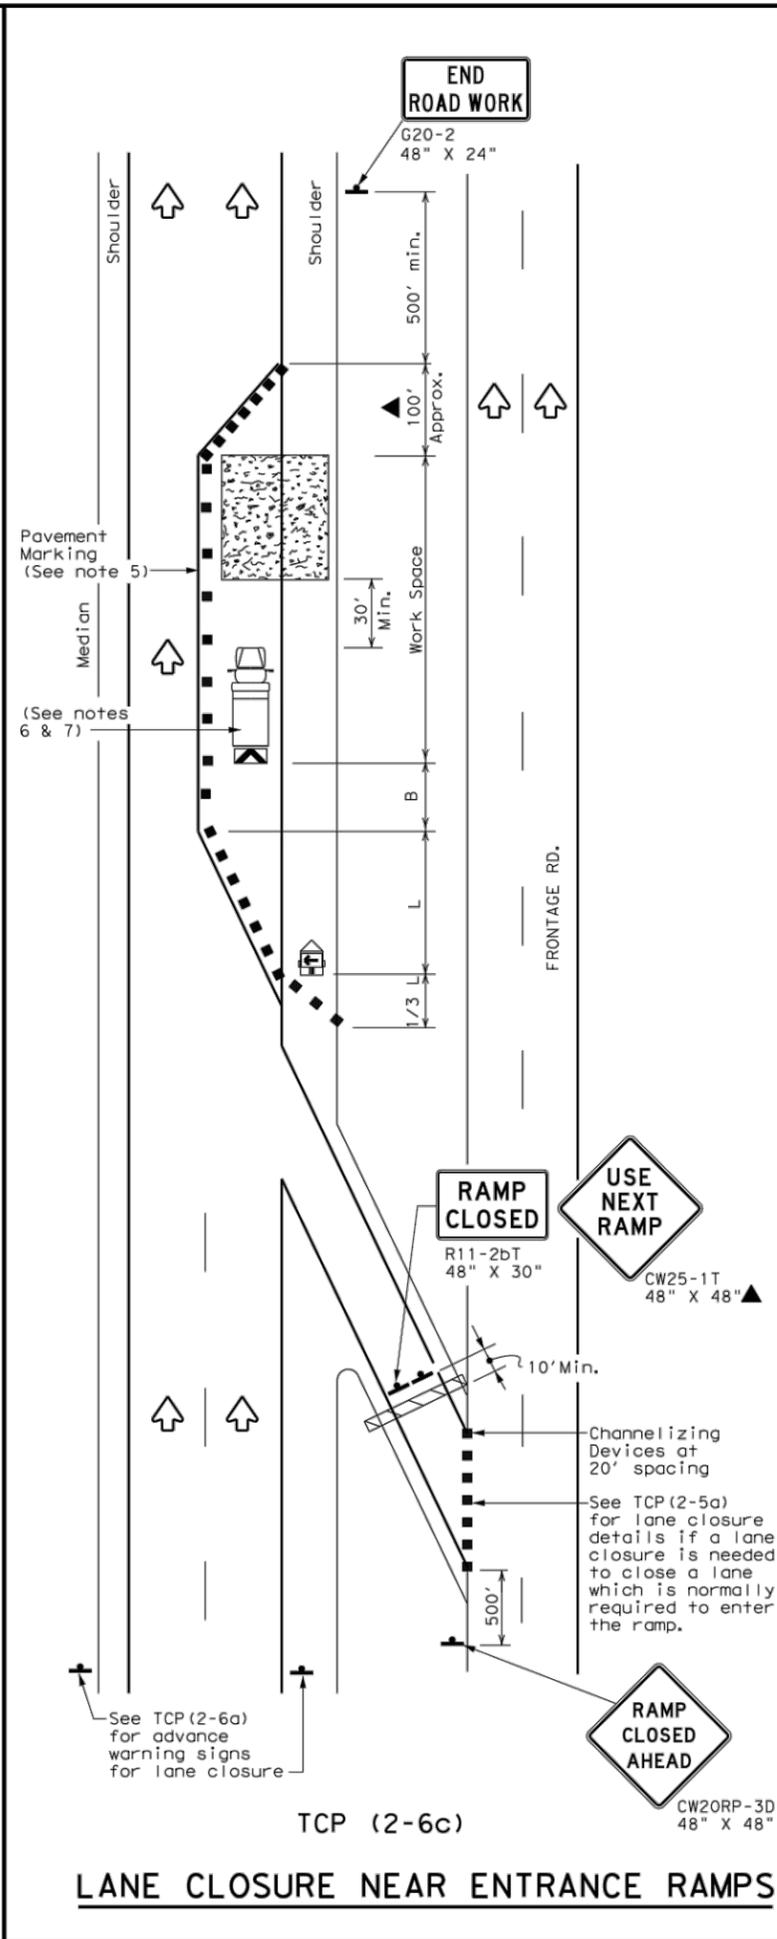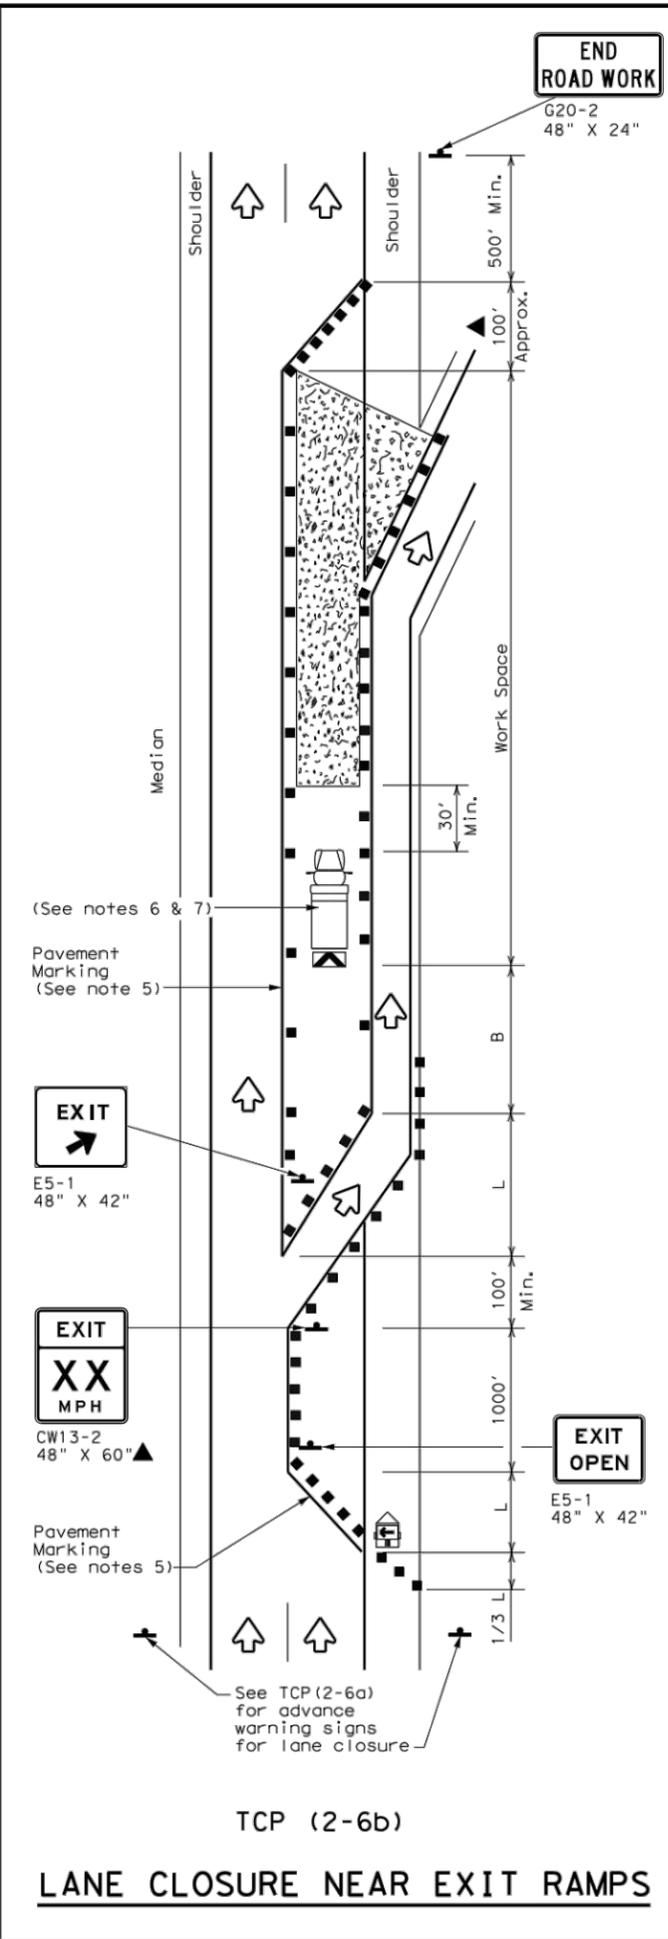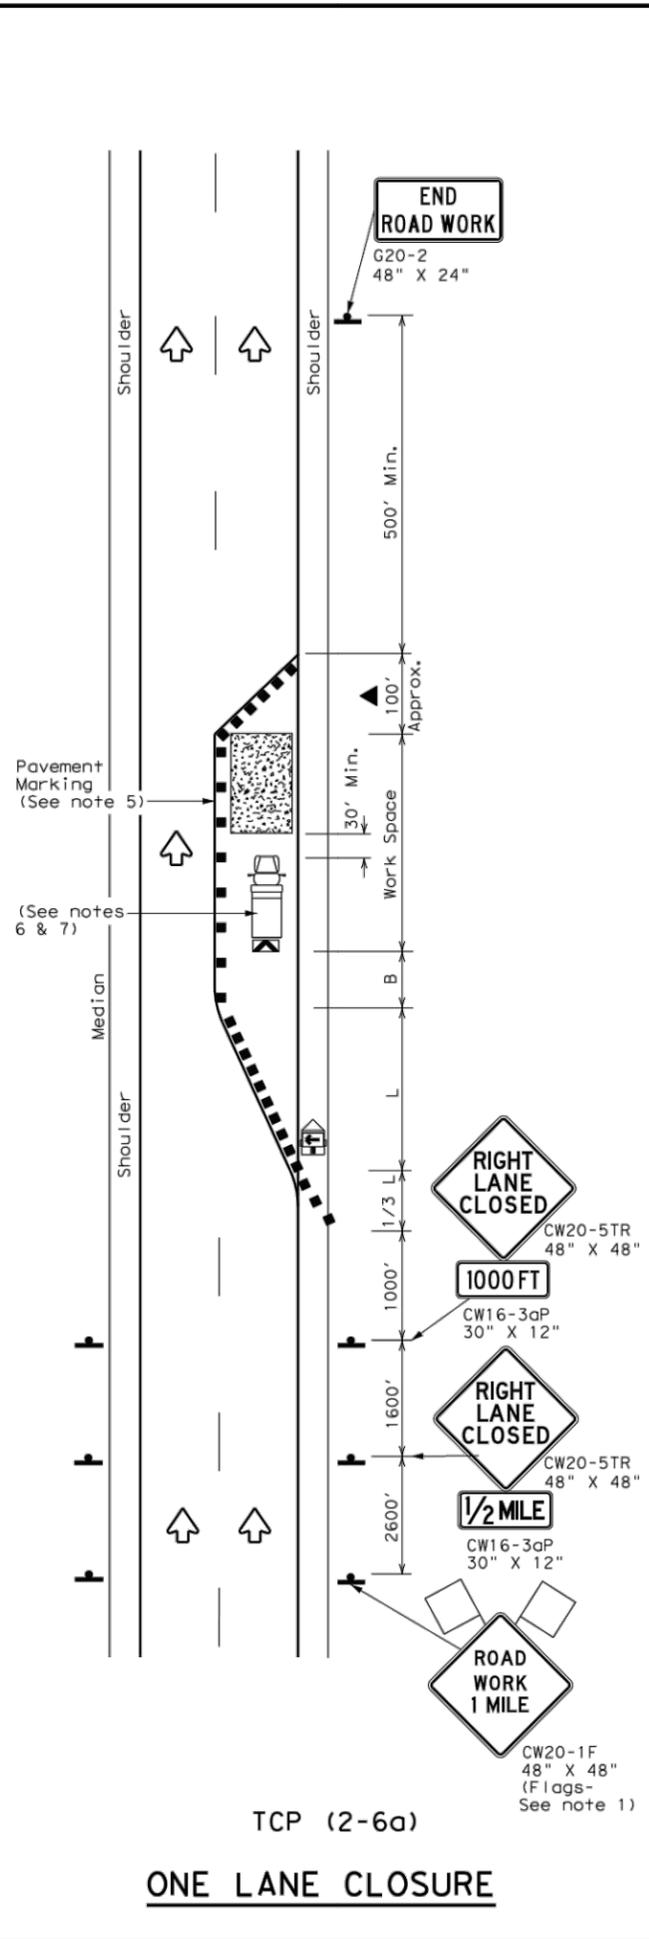

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "X" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L = WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70		700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

\* Conventional Roads Only  
 \*\* Taper lengths have been rounded off.  
 L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
			✓	✓

- GENERAL NOTES**
- Flags attached to signs where shown, are REQUIRED.
  - All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.
  - Channelizing devices used to close lanes may be supplemented with the Chevron Alignment Sign placed on every other channelizing device. Chevrons may be attached to plastic drums as per BC Standards.
  - Channelizing devices used along the work space or along tangent sections may be supplemented with vertical panels (VP) placed on every other channelizing device. If night time conditions make it difficult to see at least two VPs, the VPs may be placed on each channelizing device.
  - The placement of pavement markings may be omitted on Intermediate-term stationary work zones with the approval of the Engineer.
  - Shadow Vehicle with TMA and high intensity rotating, flashing, oscillating or strobe lights. Shadow Vehicle with TMA and high intensity rotating, flashing, oscillating or strobe lights. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
  - Additional Shadow Vehicles with TMAs may be positioned in each closed lane, on the shoulder or off the paved surface, next to those shown in order to protect a wider work space.




**TRAFFIC CONTROL PLAN  
LANE CLOSURES ON  
DIVIDED HIGHWAYS**

**TCP (2-6) - 18**

FILE: tcp2-6-18.dgn	DN:	CK:	DW:	CK:
© TxDOT December 1985	CONT	SECT	JOB	HIGHWAY
REVISIONS				
2-94 4-98				
8-95 2-12				
1-97 2-18				
	DIST	COUNTY	SHEET NO. 76	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

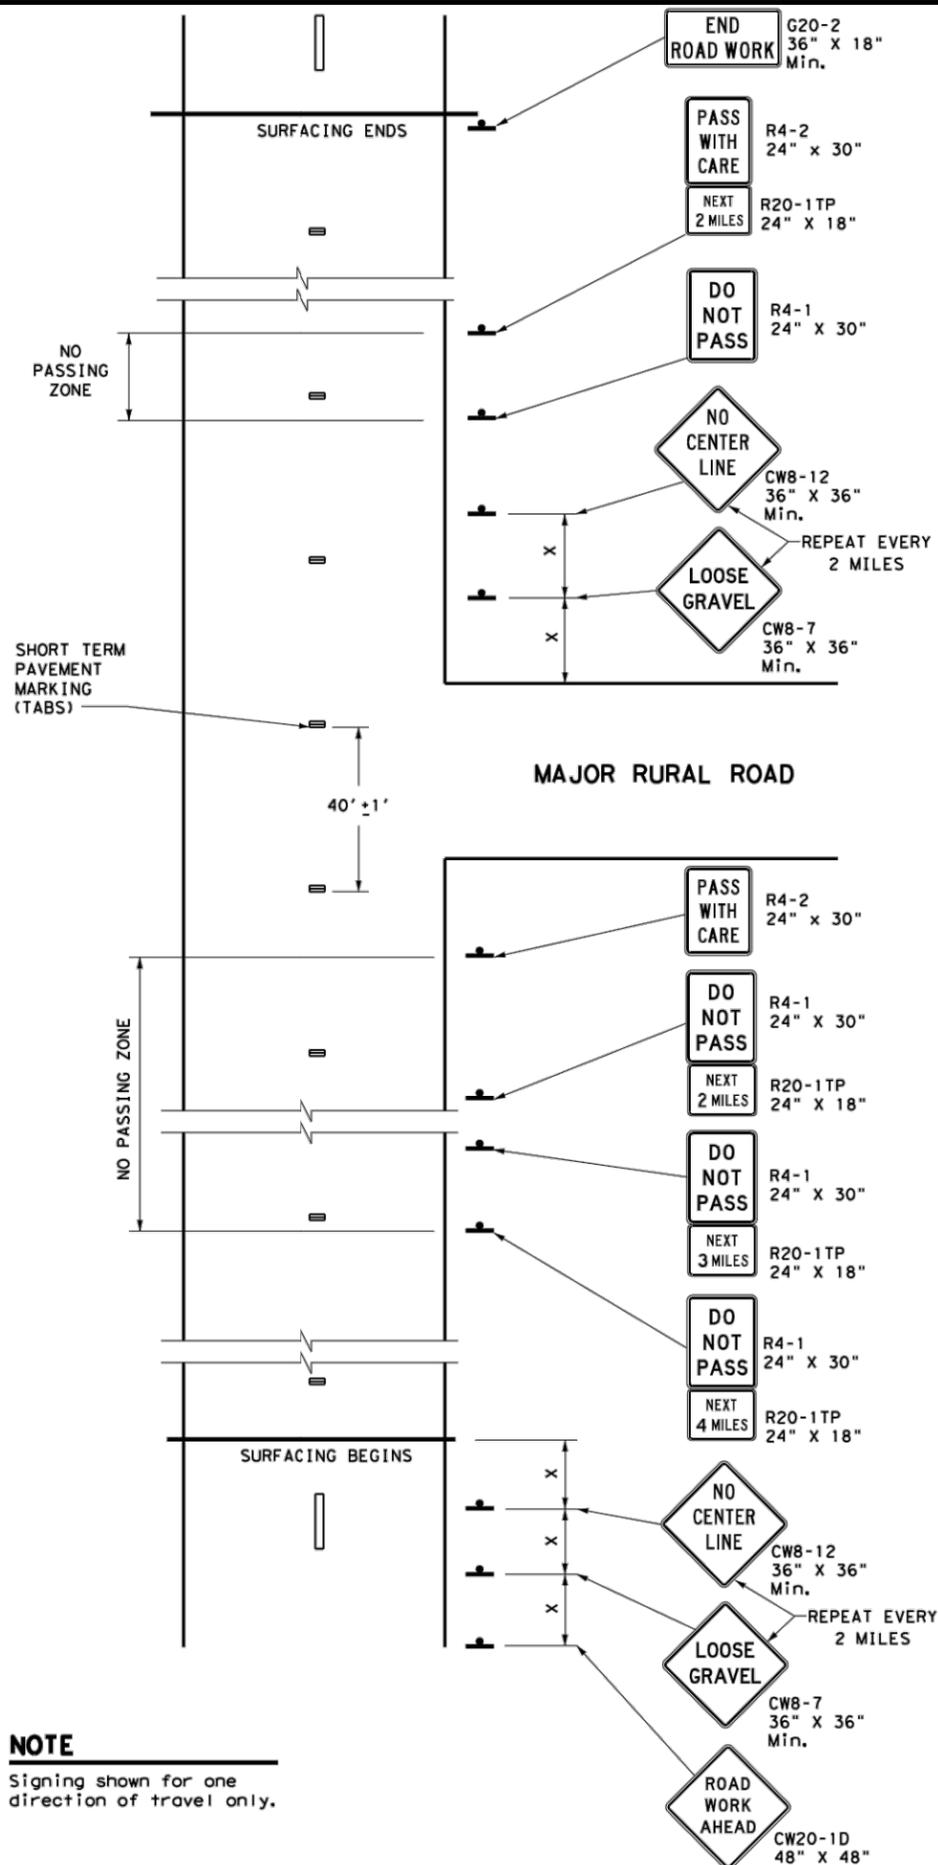

**NOTE**  
Signing shown for one direction of travel only.

**NO PASSING ZONES ON TWO-LANE TWO-WAY ROADS**

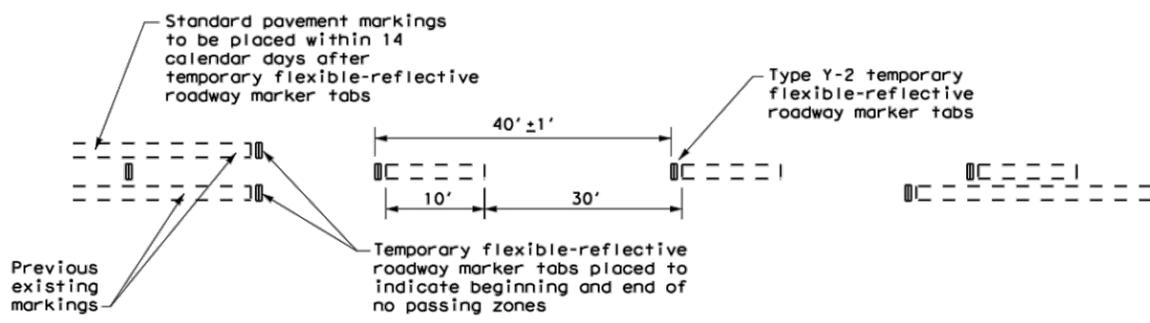

**TABS ON CENTERLINES OF TWO-LANE TWO-WAY ROADS**  
For seal coat, micro-surface or similar operations

**"DO NOT PASS" SIGN (R4-1) and NO-PASSING ZONES**

- A. Prior to the beginning of construction, all currently striped no-passing zones shall be signed with the DO NOT PASS (R4-1) signs and PASS WITH CARE (R4-2) signs placed at the beginning and end of each zone for each direction of travel except as otherwise provided herein. Signs marking these individual no-passing zones need not be covered prior to construction if the signs supplement the existing pavement markings.
- B. At the discretion of the Engineer, in areas of numerous no-passing zones, several zones may be combined as a single zone. If passing is to be prohibited over one or more lengthy sections, a DO NOT PASS sign and a NEXT XX MILES (R20-1TP) plaque may be used at the beginning of such zones. The DO NOT PASS sign and the NEXT XX MILES plaque should be repeated every mile to the end of the no-passing zone. In areas where there is considerable distance between no-passing zones, the end of the no-passing zone may be signed with a PASS WITH CARE sign and a NEXT XX MILES plaque.
- C. Depending on traffic volumes and length of sections, it may be desirable to prohibit passing throughout the project to prevent damage to windshield and lights. The DO NOT PASS sign and NEXT XX MILES plaque should be used and repeated as often as necessary for this purpose. Where several existing zones are to be combined into one individual no-passing zone, the sign at the beginning of the zone should be covered until the surfacing operation has passed this location so as not to have the DO NOT PASS sign conflict with the existing pavement markings. Also, unless one days operation completes the entire length of such combined zones, appropriate DO NOT PASS and PASS WITH CARE signs should be placed at the beginning and end of the no-passing zones where the surfacing operation has stopped for the day.
- D. R4-1 and R4-2 are to remain in place until standard pavement markings are installed.

**"NO CENTER LINE" SIGN (CW8-12)**

- A. Center line markings are yellow pavement markings that delineate the separation of travel lanes that have opposite directions of travel on a roadway. Divided highways do not typically have center line markings.
- B. At the time construction activity obliterates the existing center line markings (low volume roads may not have an existing center line), a NO CENTER LINE (CW8-12) sign should be erected at the beginning of the work area, at approximately 2 mile intervals within the work area, beyond major intersections and other locations deemed necessary by the Engineer.
- C. The NO CENTER LINE signs are to remain in place until standard pavement markings are installed.

**"LOOSE GRAVEL" SIGN (CW8-7)**

- A. When construction begins, a LOOSE GRAVEL (CW8-7) sign should be erected at each end of the work area and repeated at intervals of approximately 2 miles in rural areas and closer in urban areas.
- B. The LOOSE GRAVEL signs are to remain in place until the condition no longer exists.

**PAVEMENT MARKINGS**

- A. Temporary markings for surfacing projects shall be Temporary Flexible-reflective Roadway Marker Tabs unless otherwise approved by the Engineer. Tabs are to be installed to provide true alignment for striping crews or as directed by the Engineer. Tabs will be placed at the spacing indicated. Tabs should be applied to the pavement no more than two (2) days before the surfacing is applied. After the surfacing is rolled and swept, the cover over the reflective strip shall be removed.
- B. Tabs shall not be used to simulate edge lines.
- C. Tab placement for overlay/inlay operations shall be as shown on the WZ(STPM) standard sheet.

**COORDINATION OF SIGN LOCATIONS**

- A. The location of warning signs at the beginning and end of a work area are to be coordinated with other signing typically shown on the Barricade and Construction Standards for project limits to ensure adequate sign spacing.
- B. Where possible the ROAD WORK AHEAD (CW20-1D), LOOSE GRAVEL (CW8-7), and NO CENTER LINE (CW8-12) signs should be placed in the sequence shown following the OBEY WARNING SIGNS STATE LAW (R20-3T) and the TRAFFIC FINES DOUBLE (R20-5T) sign, and one "X" sign spacing prior to the CONTRACTOR (G20-6T) sign typically located at or near the limits of surfacing. LOOSE GRAVEL and NO CENTER LINE signs will then be repeated as described above.


Posted Speed *	Minimum Sign Spacing "X" Distance
30	120'
35	160'
40	240'
45	320'
50	400'
55	500'
60	600'
65	700'
70	800'
75	900'

\* Conventional Roads Only

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
			✓	✓

**GENERAL NOTES**

1. The traffic control devices detailed on this sheet will be furnished and erected as directed by the Engineer on sections of roadway where tabs must be placed prior to the surfacing operation which will cover or obliterate the existing pavement markings.
2. The devices shown on this sheet are to be used to supplement those required by the BC Standards or others required elsewhere in the plans.
3. Signs shall be erected as detailed on the BC Standards or the Compliant Work Zone Traffic Control Devices List (CWZTCD) on supports approved for Long-Term / Intermediate-Term Work Zone Sign Supports.
4. When surfacing operations take place on divided highways, freeways or expressways, the size of diamond shaped construction warning signs shall be 48" x 48".
5. Signs on divided highways, freeways and expressways will be placed on both right and left sides of the roadway based on roadway conditions as directed by the Engineer.



**TRAFFIC CONTROL DETAILS FOR SURFACING OPERATIONS**

**TCP (7-1) - 13**

FILE: tcp7-1.dgn	DW: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT March 1991	CONT	SECT	JOB	HIGHWAY
REVISIONS				
4-92 4-98	DIST	COUNTY	SHEET NO.	
1-97 7-13			77	